McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

Electrical Warehouse (CMO Beer & Soda)

Location ID: B121

Two-story Navy Bureau of Yards & Docks Warehouse Type 1 or 2. First floor used for MWR beer and soda storage and second floor used for electrical stock storage.



Photo 1: *Electrical Warehouse (CMO Beer & Soda)*

General Structure Information

Usage	Warehouse
Occupancy Group	B-2 Warehouse
Maximum Occupancy	15
Construction Type	Type V, 1-hour, combustible; two-story, steel-framed structure with insulated metal siding and roofing, wood timber first floor decking, corrugated metal second floor decking.
Year Constructed	1963
Dimensions	40' x 98'

Floor Area

Floor	Area
Floor 1	3,920 sq ft
Floor 2	3,920 sq ft
Total	7,840 sq ft

HVAC System

Heating	One Jackson-Church forced-air, oil-burning unit (750,000 Btu/hr)

Air Handling Units	None
Fuel Tank	None

Water and Sewer

Water Service	Not connected
Sewer Service	Not connected
Water Heater	None

Electrical Service

Service Feeder	Feeder D
Electrical Service	208/120V, 3PH, 200A main

Fire System

Fire Panel Type	King-Fisher KFRTI-20 industrial radio and control system (IRAC) panel, heat detectors, pull stations, alarm horns

Heat Detectors	Located throughout building
Suppression Type	Automatic dry-chemical fire extinguisher located over furnace.

Floorplans

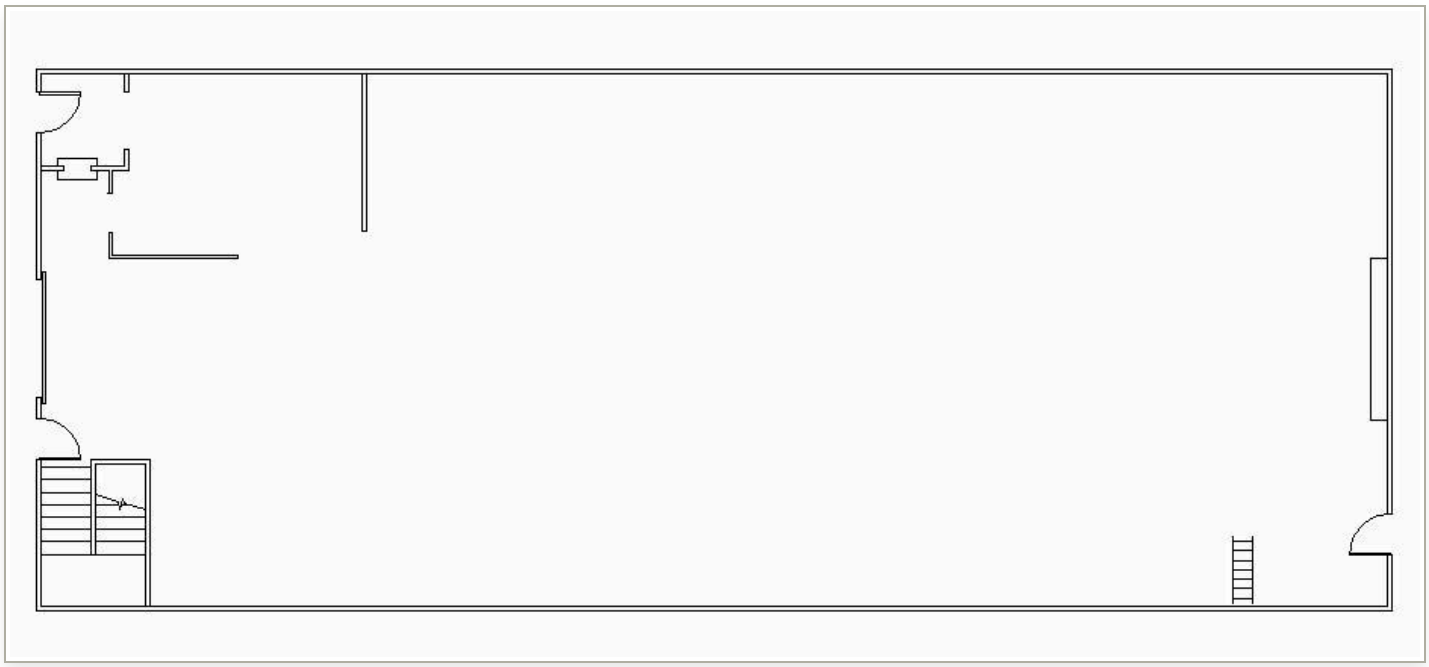


Figure 1: *Electrical Warehouse (CMO Beer & Soda)*

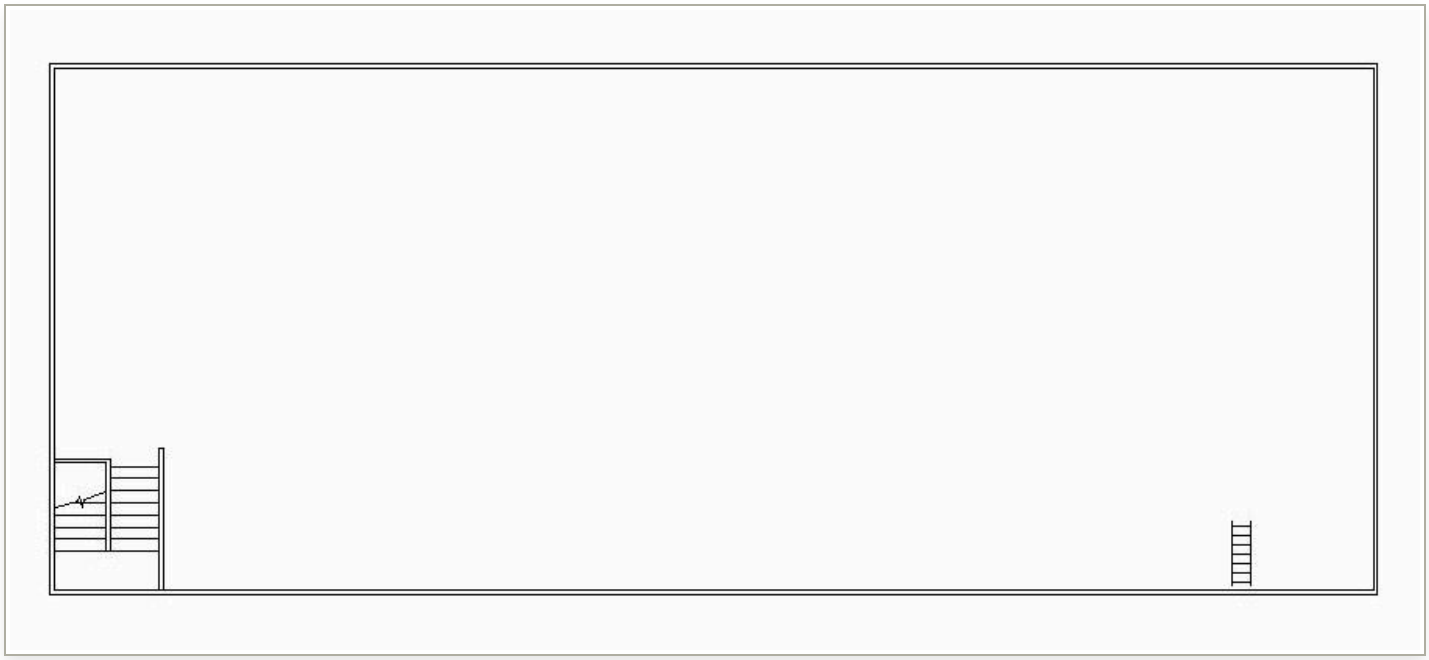


Figure 2: *Electrical Warehouse (CMO Beer & Soda)*