McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

NSF Dorm

Location ID: B125

Single-story building used as housing for NSF/OPP employees and distinguished visitors. Includes 6 one-person rooms, a lounge, a kitchenette/laundry room, two restrooms and a furnace room.



Photo 1: *NSF Dorm*

General Structure Information

Usage	NSF Berthing
Occupancy Group	R-3 Dormitory
Maximum Occupancy	6
Construction Type	Type II, 1-Hour, non-combustible; steel-framed structure with foam insulated metal siding and roofing, steel-framed precast concrete slab floor, no interior partitions.
Year Constructed	1963
Dimensions	20' x 56'4' x 8' furnace vestibule4' x 6' entry vestibule4' x 8' exit vestibule
Floor Area	

Floor	Area
Floor 1	1,208 sq ft
Total	1,208 sq ft

HVAC System

Heating	One Lennox forced-air oil-burning unit (125,000 Btu/hr)
Air Handling Units	None

Fuel Tank	300 gallon fuel tank

Water and Sewer

Water Service	2" off of 4" main
Sewer Service	4" off of a 4" main
Connections	Sinks: 3 Toilets: 2 Urinals: 0 Showers: 2 Washing Machine: 1
Water Heater	66 gallon electric water heater

Electrical Service

Service Feeder	Feeder B
Electrical Service	208/120V, 3PH

Fire System

Fire Panel Type	Pyrotronics CP-400 control panel, King-Fisher KFRTI-WP-8 radio interface/transmitter panel, heat detectors, heat/smoke detectors, manual pull stations, alarm horns.
Suppression Type	Automatic dry-chemical fire extinguisher over furnace

Floorplans

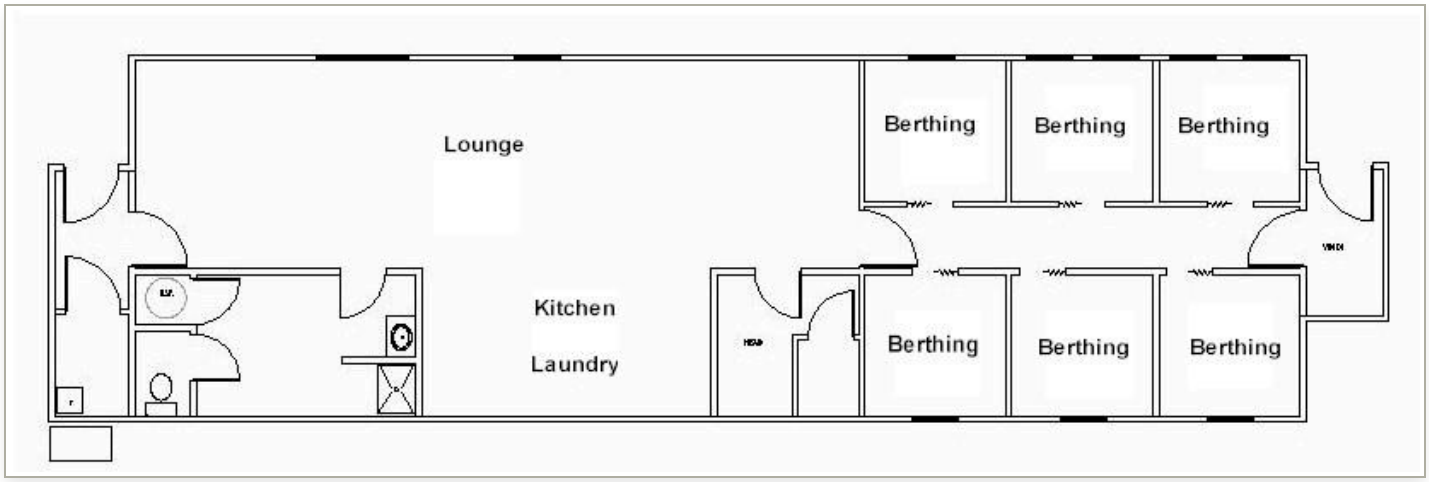


Figure 1: *NSF Dorm*