McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

Helicopter Hangar

Location ID: B129

Single-story, prefabricated, steel structure with steel framing as its main structure.



Photo 1: *Helicopter Hangar*

General Structure Information

Usage	Helicopter Hangar
Occupancy Group	B-3
Maximum Occupancy	8
Construction Type	Type V, N, combustible;
Year Constructed	1964
Dimensions	41' x 98'8' x 12' furnace room

Floor Area

Floor	Area
Floor 1	4,354 sq ft
Floor 2	420 sq ft
Total	4,774 sq ft

HVAC System

Heating	One Jackson & Church furnace (1,000,000 Btu/hr)
Air Handling Units	None

Fuel Tank	800 gallon fuel tank

Water and Sewer

Water Service	Not connected
Sewer Service	Not connected
Connections	Sinks: 0 Toilets: 0 Urinals: 0 Showers: 0 Water Cooler: 0 Other:400-gallon water tank
Water Heater	None

Electrical Service

Service Feeder	Feeder C
Electrical Service	208/120V, 3PH

Fire System

Fire Panel Type	King-Fisher KFRTI-20 industrial radio and control system (IRAC) panel, pull stations, and alarm horns.
Heat Detectors	Located throughout building
Suppression Type	Automatic dry-chemical fire extinguisher located over furnace.

Floorplans

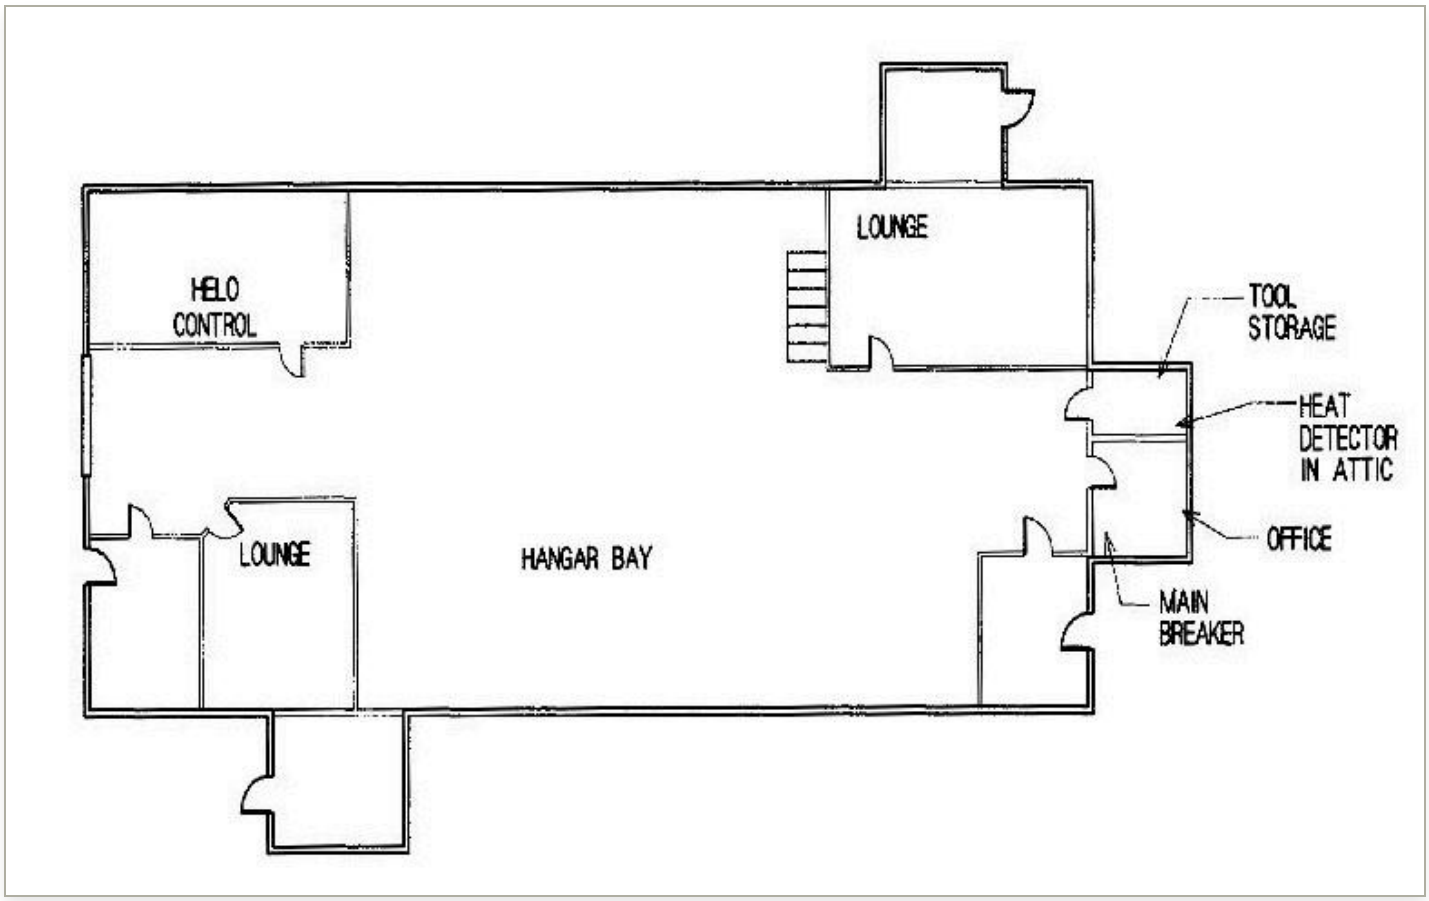


Figure 1: *Helicopter Hangar*

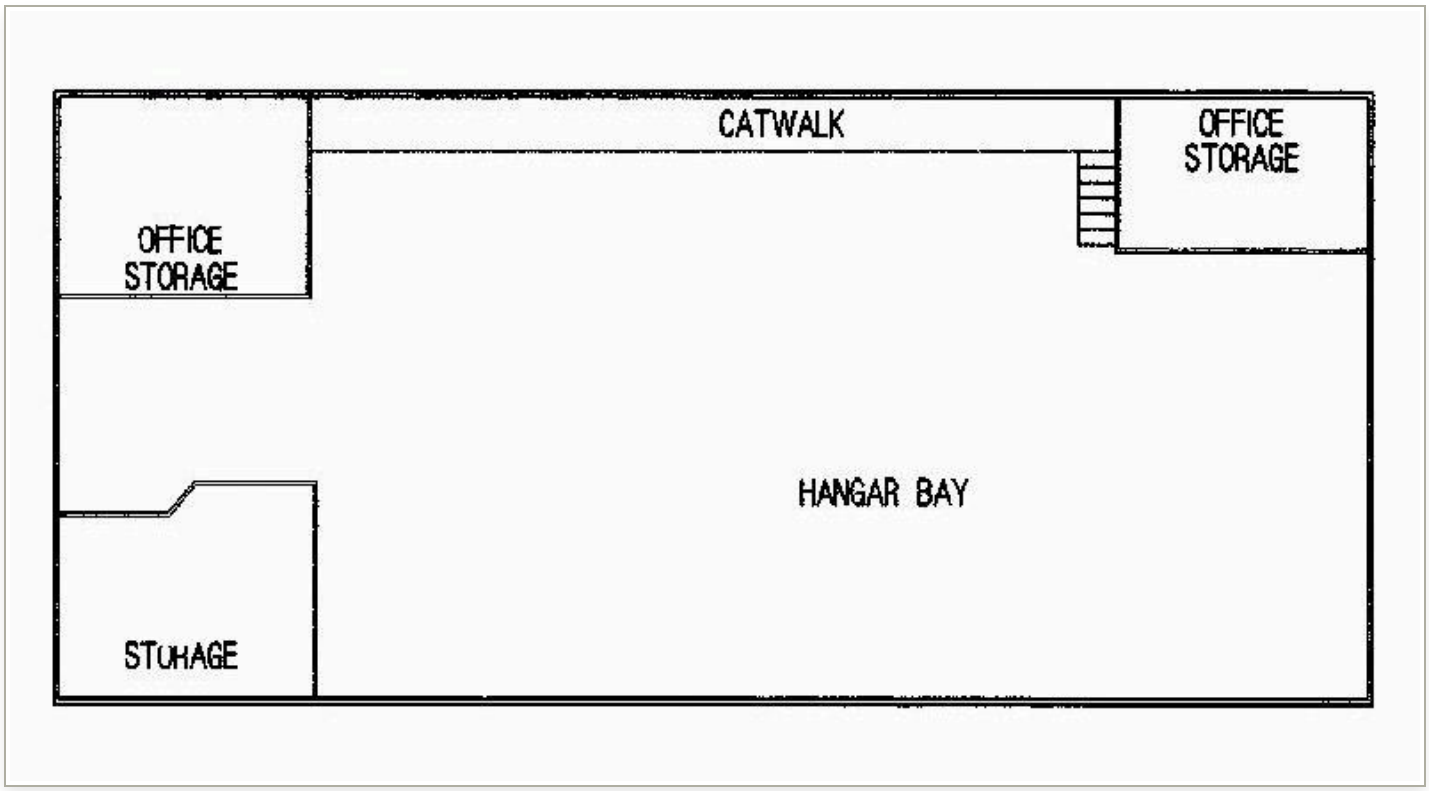


Figure 2: *Helicopter Hangar*