McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

Auto Materials Warehouse

Location ID: B132

Two-story heated warehouse used for the storage of automotive parts.



Photo 1: *Auto Materials Warehouse*

General Structure Information

Usage	Automotive Warehouse, heated
Occupancy Group	B-4
Maximum Occupancy	15
Construction Type	Type V, 1-Hour, combustible; steel-framed structure with insulated metal siding and roofing, steel-framed heavy-timber first floor, steel-framed corrugated metal and steel plate second floor, wood-framed gysum board interior partitions.
Year Constructed	1964
Dimensions	40' x 98'

Floor Area

Floor	Area
Floor 1	3,920 sq ft
Floor 2	3,920 sq ft
Total	7,840 sq ft

HVAC System

Air Handling Units	None

Fuel Tank	300 gallon fuel tank

Water and Sewer

Water Service	Not connected
Sewer Service	Not connected
Connections	Sinks: 0 Toilets: 0 Urinals: 0 Showers: 0 Water Cooler: 0
Water Heater	None

Electrical Service

Service Feeder	Feeder A
Electrical Service	208/120V, 3PH, 125A main

Fire System

Fire Panel Type	King-Fisher KFRTI-20 industrial radio and control system (IRACS) panel, heat detectors, pull stations, alarm horns.
Heat Detectors	Located throughout building
Suppression Type	Automatic dry-chemical fire extinguisher located over furnace.

Floorplans

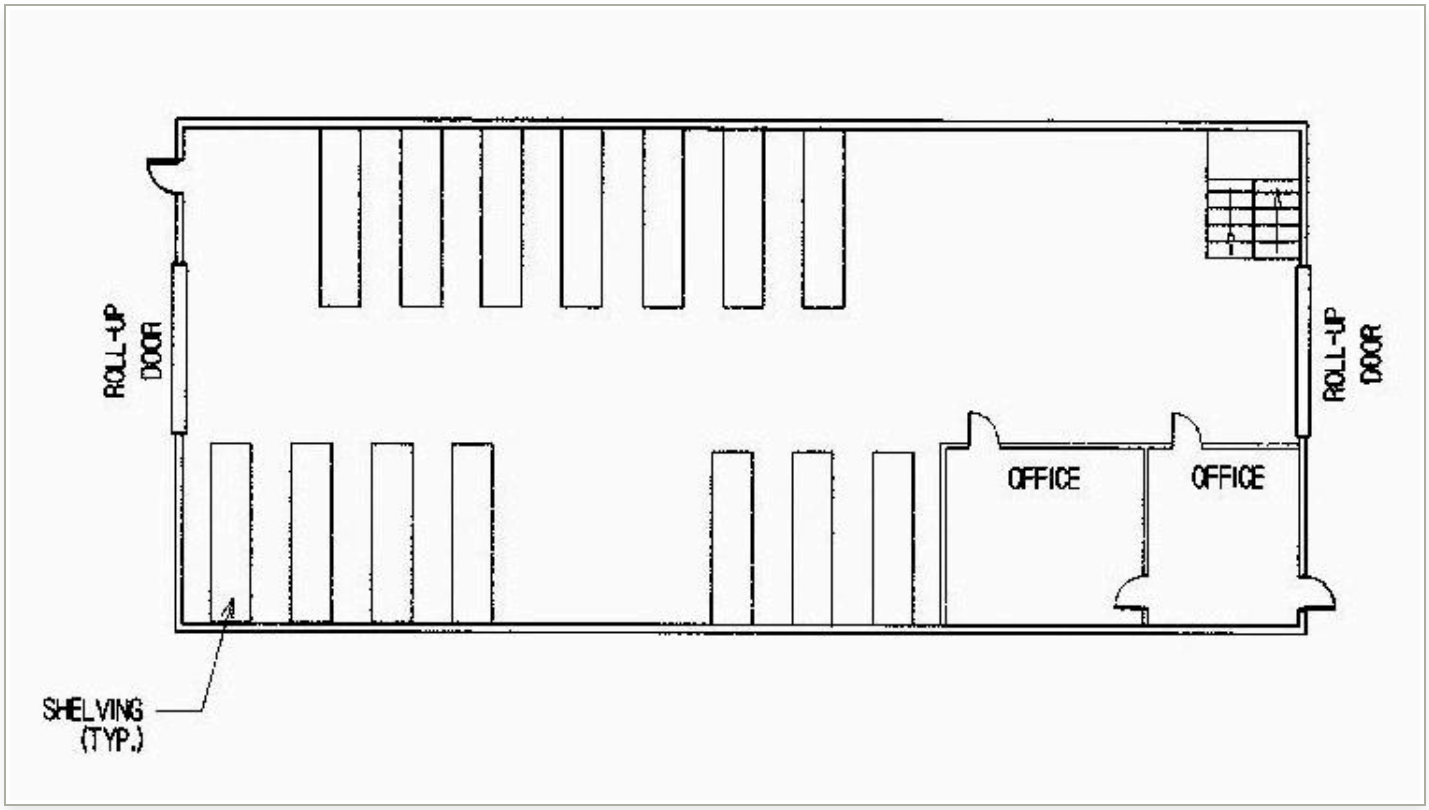


Figure 1: *Auto Materials Warehouse*