McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

NSF Dorm

Location ID: B137

Single-story building used as housing for NSF/OPP employees. Includes 5 one-person rooms, a lounge/kitchen, a laundry room, two restrooms and a furnace room.



Photo 1: *NSF Dorm*

General Structure Information

Usage	NSF Berthing
Occupancy Group	R-3 Dormitory
Maximum Occupancy	6
Construction Type	Type V, N, combustible; single-story, T-5 insulated plywood panel structure, wood-framed plywood floor and roof. Interior partitions are wood-framed with gypsum board and wood paneling.
Year Constructed	1964
Dimensions	20' x 56'4' x 12' entry/furnace vestibule4' x 8' exit vestibule

Floor Area

Floor	Area
Floor 1	1,200 sq ft
Total	1,200 sq ft

HVAC System

Heating	One Dornback forced-air, oil-burning unit (176,000 Btu/hr)
Air Handling Units	None

Fuel Tank	300 gallon fuel tank

Water and Sewer

Water Service	2" stub off the 4" main
Sewer Service	4" stub off the 4" main
Connections	Sinks: 4 Toilets: 2 Urinals: 1 Showers: 2 Washing Machine: 1
Water Heater	66 gallon electric water heater

Electrical Service

Service Feeder	Feeder B
Electrical Service	208/120V, 3PH

Fire System

Fire Panel Type	King-Fisher KFRTI-20 industrial radio and control system (IRACS) panel, heat detectors, manual pull stations, alarm horns.
Suppression Type	Automatic dry-chemical fire extinguisher over furnace

Floorplans

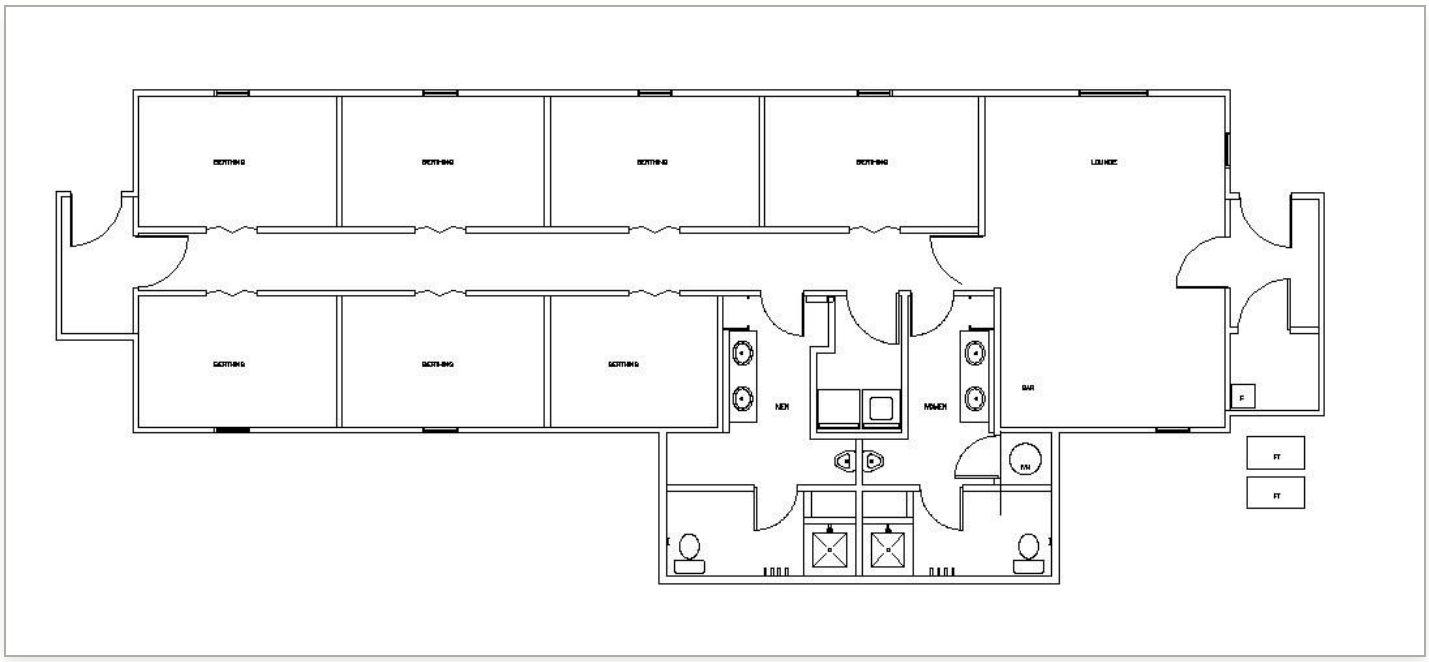


Figure 1: *NSF Dorm*