McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

Field Safety Training Ops Building

Location ID: B138

Originally constructed as an earth sciences and glaciology laboratory, for which it was used until 1992. Converted in 1995 for use a field training safety office and classroom. Partitioned into eight offices and storage rooms and a furnace room. Building 139 was constructed as an addition to the building in 1965, and houses two walk-in freezers used for the storage of ice cores and other scientific samples. There is also a small attic space used for storage.



Photo 1: *Field Safety Training Ops Building*

General Structure Information

Usage	BFC Field Safety Training
Occupancy Group	B-2 Office
Maximum Occupancy	13
Construction Type	Type V, N, combustible; T-5 insulated plywood panel structure, wood-framed plywood floor, wood-framed gysum board and plywood interior partitions.
Year Constructed	1964
Dimensions	20' x 68'20' x 26'6' x 8' entry vestibule8' x 8' entry vestibule6' x 8' storage room

Floor Area

Floor	Area
Floor 1	2,040 sq ft
Total	2,040 sq ft

HVAC System

Heating	One Lennox forced-air, oil-burning unit with ducted return (125,000 Btu/hr)
Air Handling Units	None

Refrigeration	Two Carrier Transicold units, providing freezer space for science.
Fuel Tank	300 gallon fuel tank

Water and Sewer

Water Service	2" stub off the 4" main
Sewer Service	4" stub off the 4" main
Connections	Sinks: 2 Toilets: 1 Urinals: 0 Showers: 0 Washing Machine: 0
Water Heater	19 gallon electric water heater

Electrical Service

Service Feeder	Feeder D
Electrical Service	208/120V, 3PH, 225A main in Building 138Two 50A main breakers in Building 139

Fire System

Fire Panel Type	King-Fisher industrial radio and control system (IRACS) panel, heat detectors, pull stations, alarm horns

Floorplans

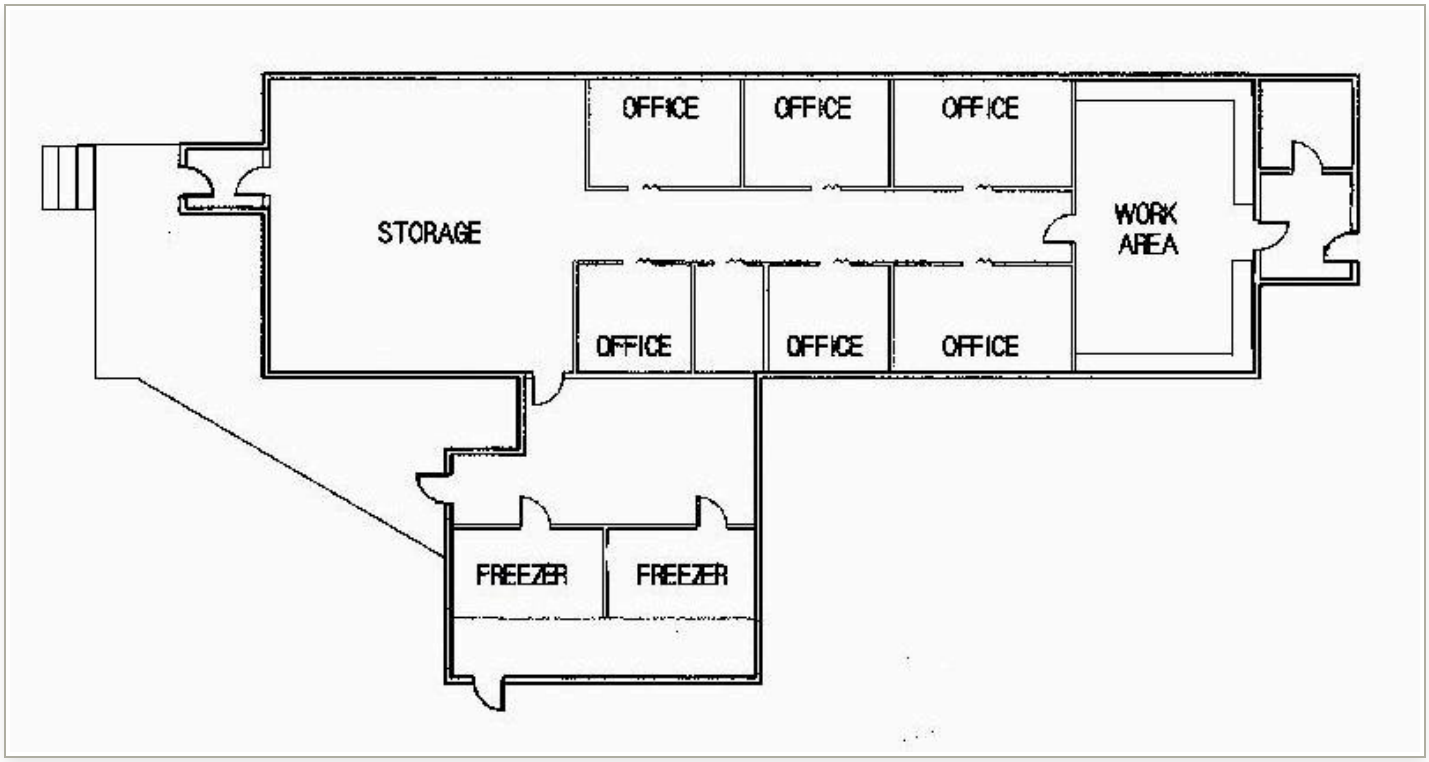


Figure 1: *Field Safety Training Ops Building*