McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

MCC - Post Office - Central Supply

Location ID: B140

Building 140 consists of an existing two-story warehouse remodeled for office, warehouse and assembly use, with high-bay warehouse addition. The building serves as a logistics office, office supply warehouse, aircraft passenger processing center, and special cargo handling facility. The cargo handlding facility is has a precast concrete slab floor.



Photo 1: *MCC - Post Office - Central Supply*

General Structure Information



Automatic External Defibrillator (AED) Locations

This building contains one or more AED devices that may be used in the event of life-threatening cardiac arrhythmia.

- **In the Lobby**

Usage	Movement Control Center (MCC), logistics offices and warehousing for Central Supply
Occupancy Group	B-1 Industrial and B-2 Office
Maximum Occupancy	94
Construction Type	Type V, 1-Hour, rigid steel frame with metal panels, either batt or rigid foam insulation, steel-framed heavy-timber first floor, steel-framed corrugated metal second floor, metal stud gypsum board interior partitions.
Year Constructed	1965 and remodeled for current use in 1994
Dimensions	40' x 98' existing 2-story building30' x 80' warehouse addition

Floor Area

Floor	Area
Floor 1	6,320 sq ft
Floor 2	3,920
Total	10,240 sq ft

HVAC System

Heating	Office/assembly/warehouse areas: Jackson-Church forced-air oil-fired furnace (500,000 Btu/hr) High-bay warehouse: Four oil-fired, radiant tube heaters (65,000 Btu/hr each)
Air Handling Units	None
Fuel Tank	1,000 gallon fuel tank

Water and Sewer

Water Service	2" stub off the 4" main
Sewer Service	4" stub off the 6" main
Connections	Sinks: 3 Toilets: 3 Urinals: 1 Showers: 0 Water Cooler: 1
Water Heater	19 gallon electric water heater located in men's bathroom closet.

Electrical Service

Service Feeder	Feeder A
Electrical Service	208/120V, 3PH, 225A main

Fire System

Fire Panel Type	King-Fisher KFRTI-20 industrial radio and control system (IRACS) panel, heat and smoke detectors, pull stations, alarm horns
Heat Detectors	Located throughout building
Suppression Type	Automatic dry-chemical extinguisher located over furnace.

Floorplans

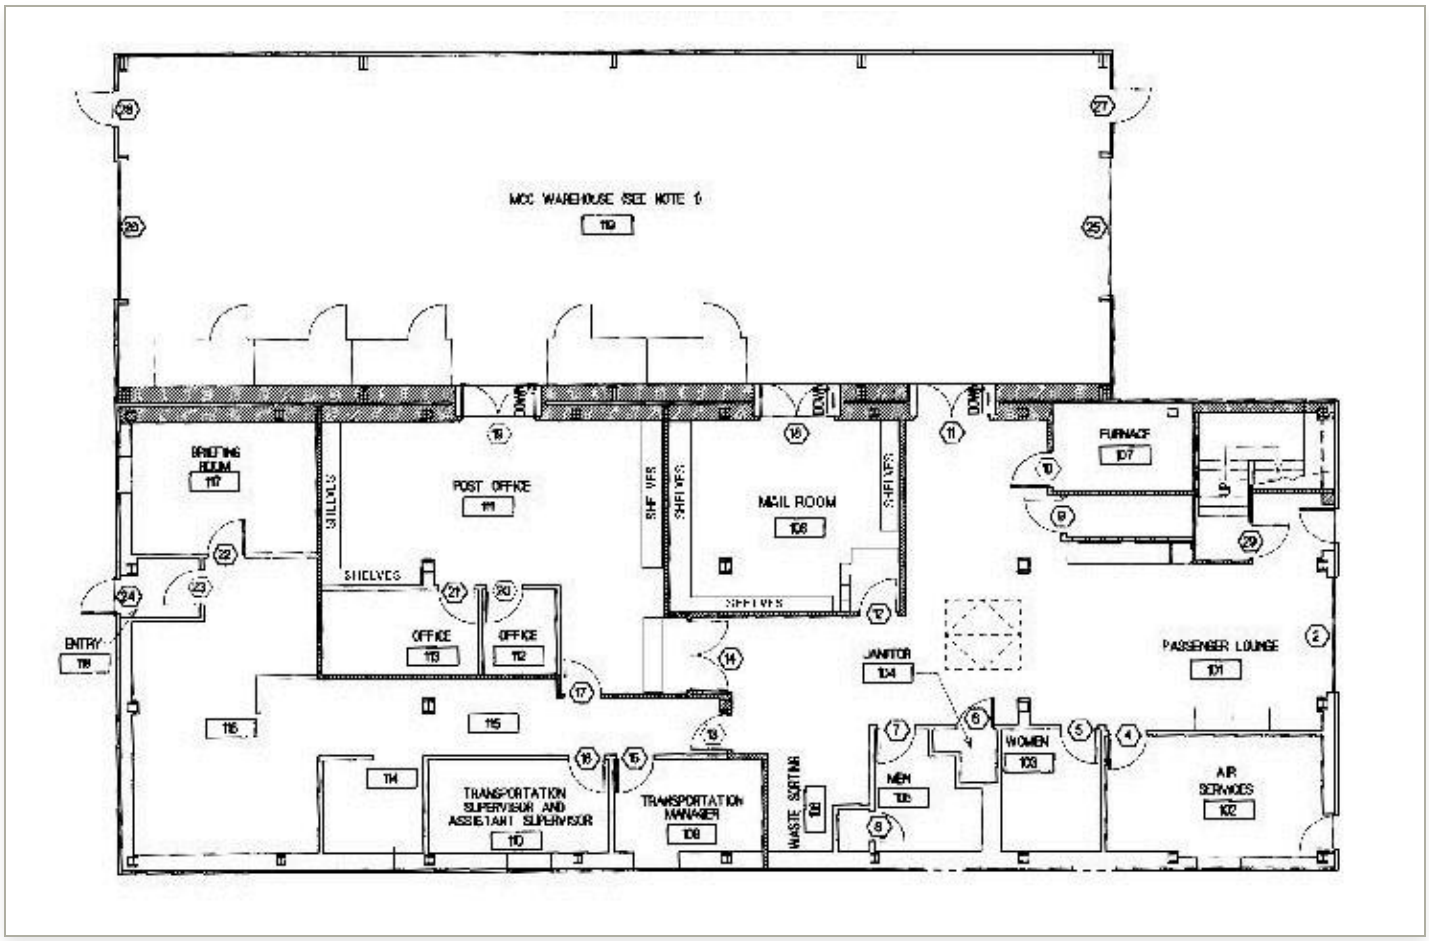


Figure 1: *MCC - Post Office - Central Supply*

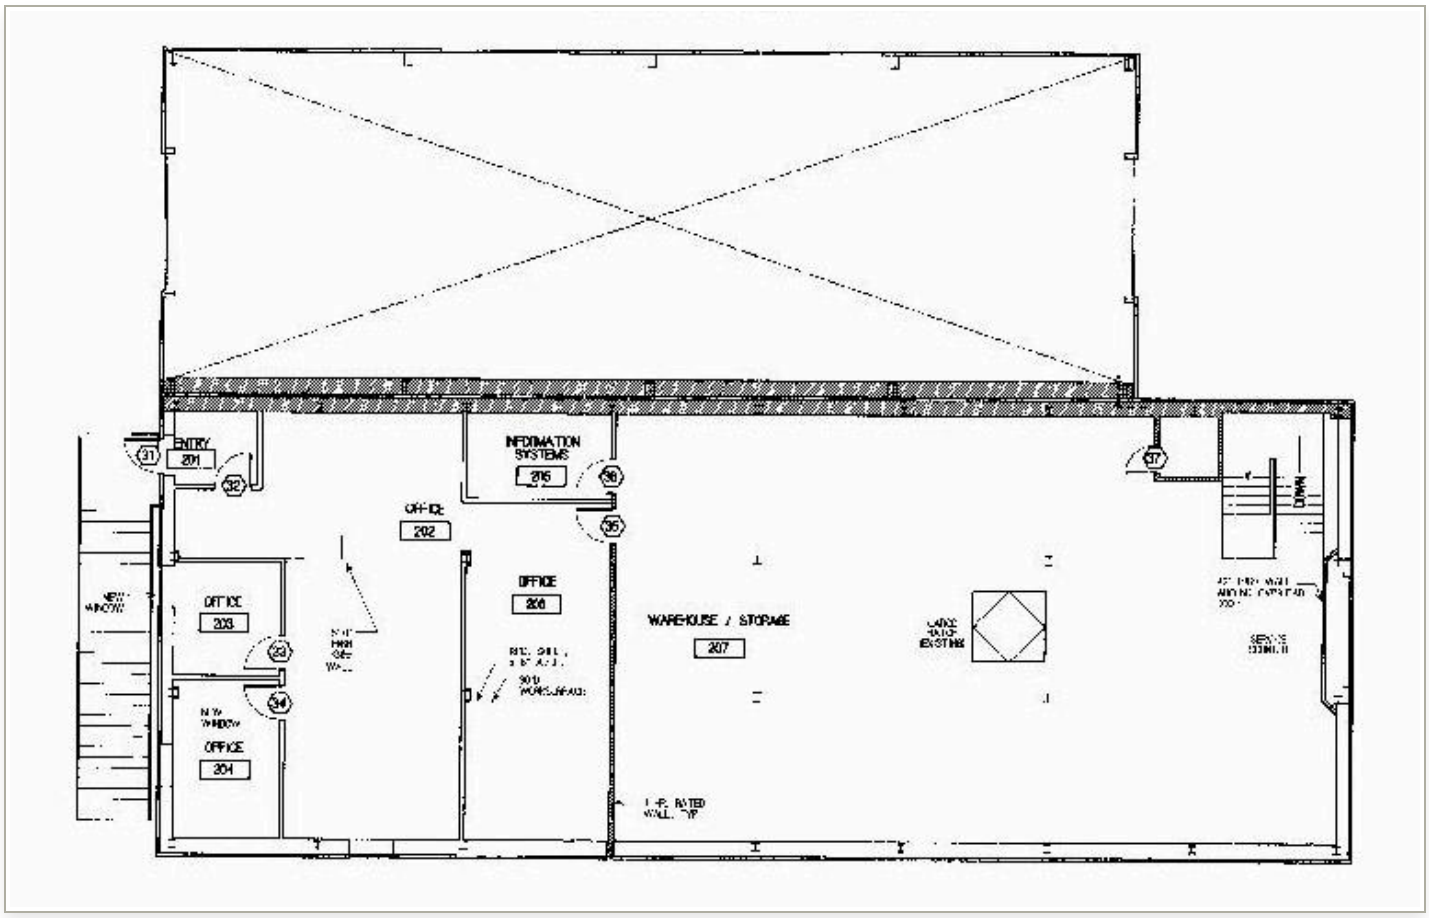


Figure 2: *MCC - Post Office - Central Supply*