McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

Fuel Department

Location ID: B141

Two-story warehouse-type building used primarily as office, shop and storage space for the fuels work center. The first floor includes offices, a shop, and a large open storage area. The open second floor is used for the storage of electrical inventory.

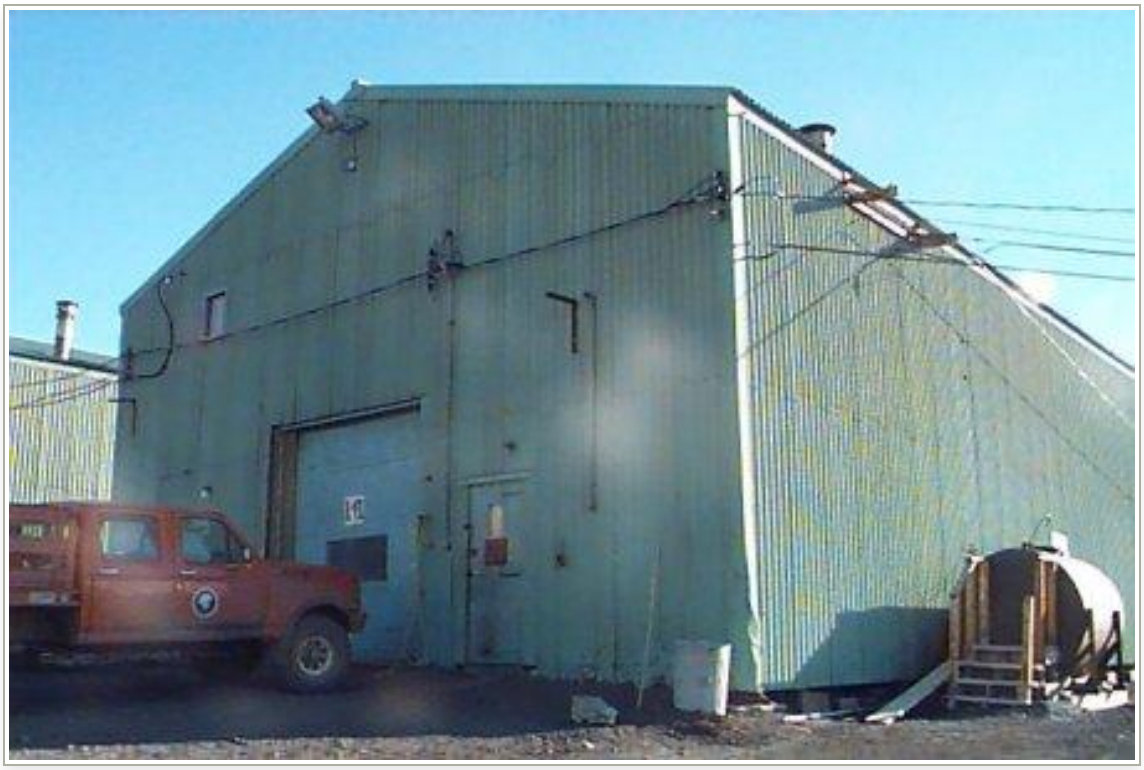


Photo 1: *Fuel Department*

General Structure Information

Usage	Fuels Operations Work Center
Occupancy Group	B-2 Office and storage; B-4 Storage; H-4 Repair shop
Maximum Occupancy	19
Construction Type	Type V, 1-Hour, combustible; two-story, steel-framed structure with insulated metal siding and roofing, wood timber first floor decking, corrugated metal second floor decking. Wood-framed gypsum board interior partitions.
Year Constructed	1965
Dimensions	40' x 98'

Floor Area

Floor	Area
Floor 1	3,920 sq ft
Floor 2	3,920 sq ft
Total	7,840 sq ft

HVAC System

Heating	One Hastings forced-air, oil-burning unit (500,000 Btu/hr)

Air Handling Units	None
Fuel Tank	1,000 gallon fuel tank

Water and Sewer

Water Service	Not connected
Sewer Service	Not connected
Connections	Sinks: 0 Toilets: 0 Urinals: 0 Showers: 0 Water Cooler: 0
Water Heater	None

Electrical Service

Service Feeder	Feeder A
Electrical Service	208/120V, 3PH

Fire System

Fire Panel Type	Kingfisher KFRTI-20 industrial radio and control system (IRACS) panel, heat detectors, pull stations, alarm horns
Heat Detectors	Located throughout building
Suppression Type	Ansul SPA-50 total flood dry-chemical extinguishing system located in fuels workshop. Automatic dry-chemical extinquisher located over furnace.

Floorplans

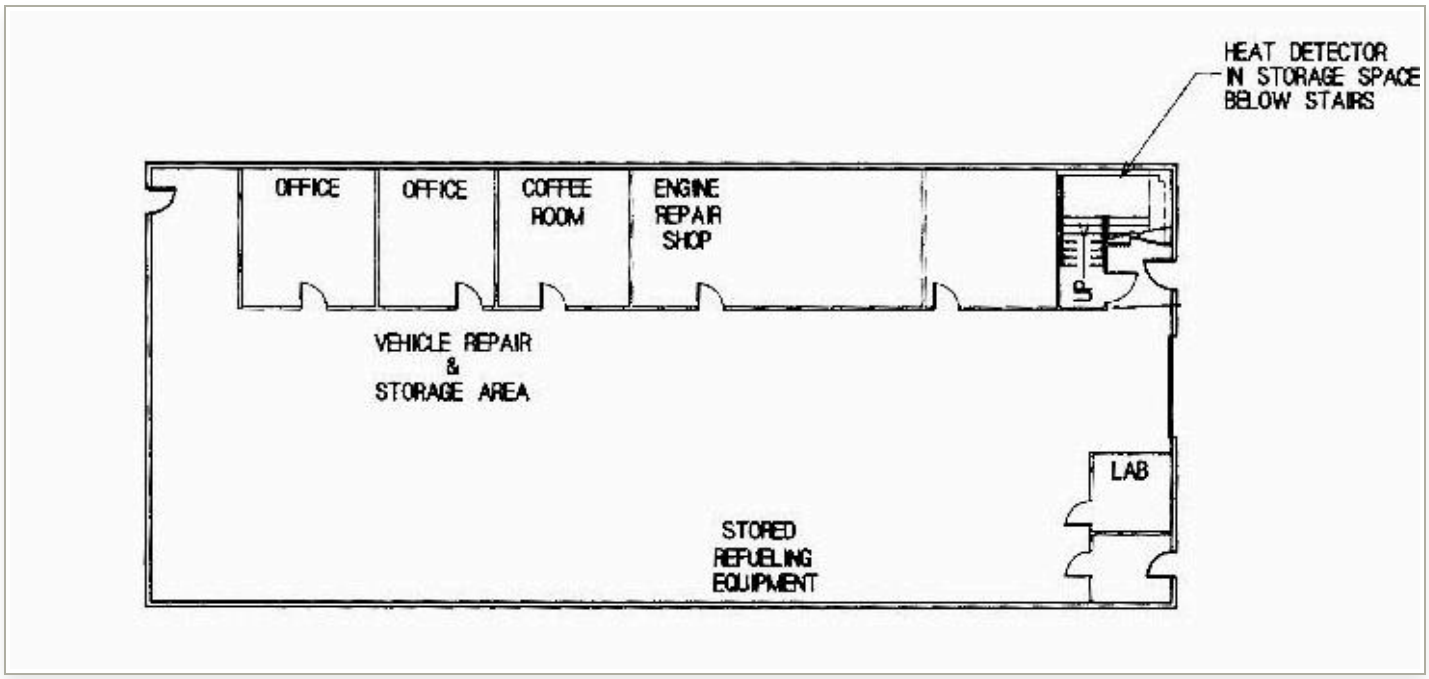


Figure 1: *Fuel Department*

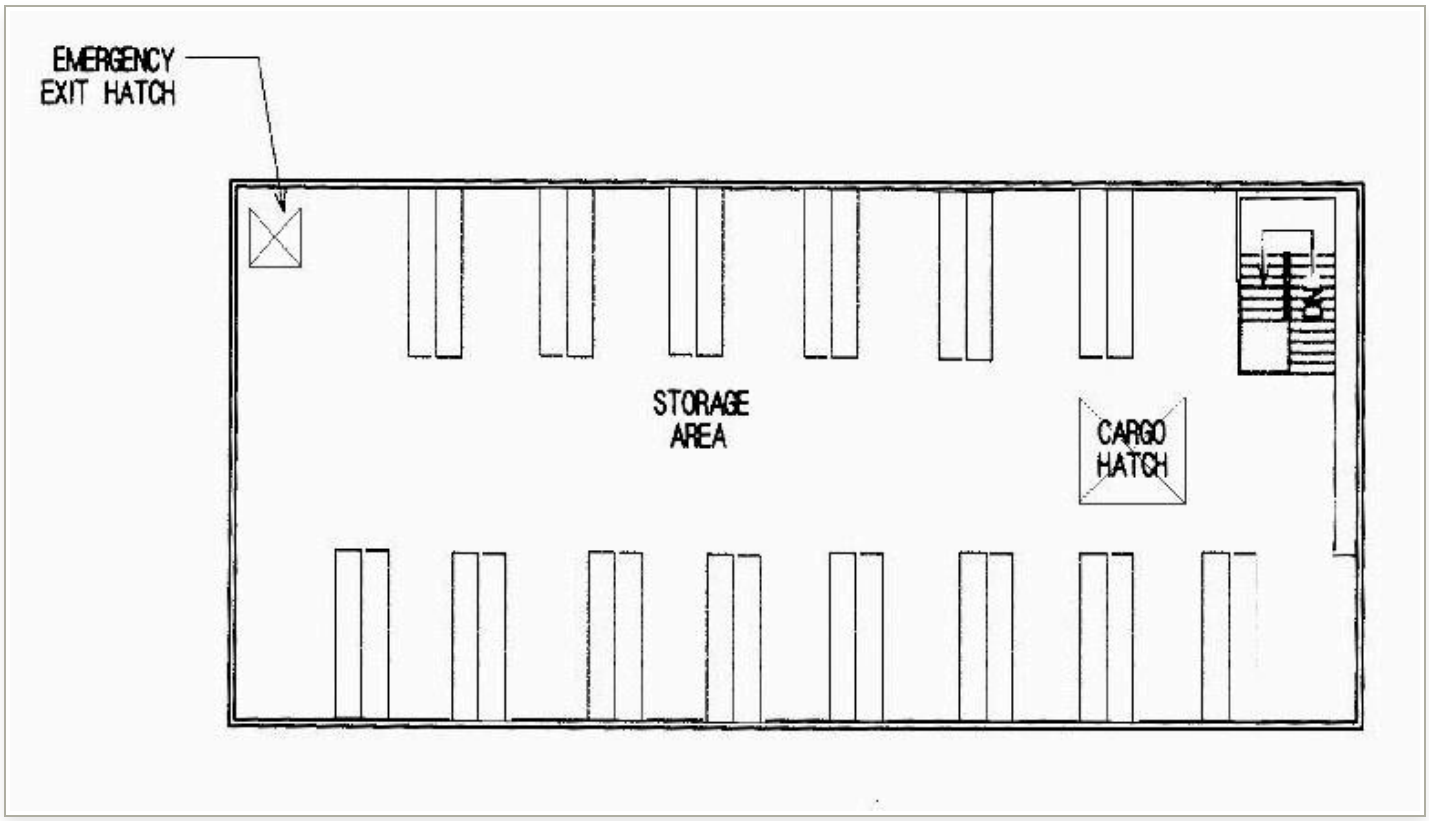


Figure 2: *Fuel Department*