McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

Medical; 085 - Recompression Chamber

Location ID: B142

Single story building used as a level 3 trauma medical facility. The building is equipped with a dedicated emergency generator.



Photo 1: *Medical; 085 - Recompression Chamber*

General Structure Information

Usage	Medical Clinic
Occupancy Group	I-1 Dispensary
Maximum Occupancy	59
Construction Type	Type V, 1-Hour, combustible; Single-story, prefabricated, steel frame structure with insulated metal siding. The interior is a steel frame with a combination of wood and vinyl-clad paneling.
Year Constructed	1961
Dimensions	51' x 98'

Floor Area

Floor	Area
Floor 1	4,743 sq ft
Total	4,743 sq ft

HVAC System

Heating	One Jackson-Church forced-air, oil-burning unit (250,000 Btu/hr)Forty chromolux electric heaters

Air Handling Units	None
Fuel Tank	1,000 gallon fuel tank

Water and Sewer

Water Service	2" stub off the 6" main
Sewer Service	4" stub off the 6" main
Connections	Sinks: 5 Toilets: 5 Urinals: 0 Showers: 2 Water Cooler: 1
Water Heater	Two electric water heaters, 66 and 100 gallons

Electrical Service

Service Feeder	Feeder B
Electrical Service	208/120V, 3PH, 400A main

Fire System

Fire Panel Type	King-Fisher KFRTI-20 industrial radio and control system (IRAC) panel, heat detectors, pull stations, alarm horns
Heat Detectors	Located in bathrooms and furnace room
Suppression Type	Automatic dry-chemical fire extinguisher located over furnace. CO2 hose reel station with three main and three reserve cylinders (50 lbs each) and Kidde actuaction heads with manual pull release.

Floorplans

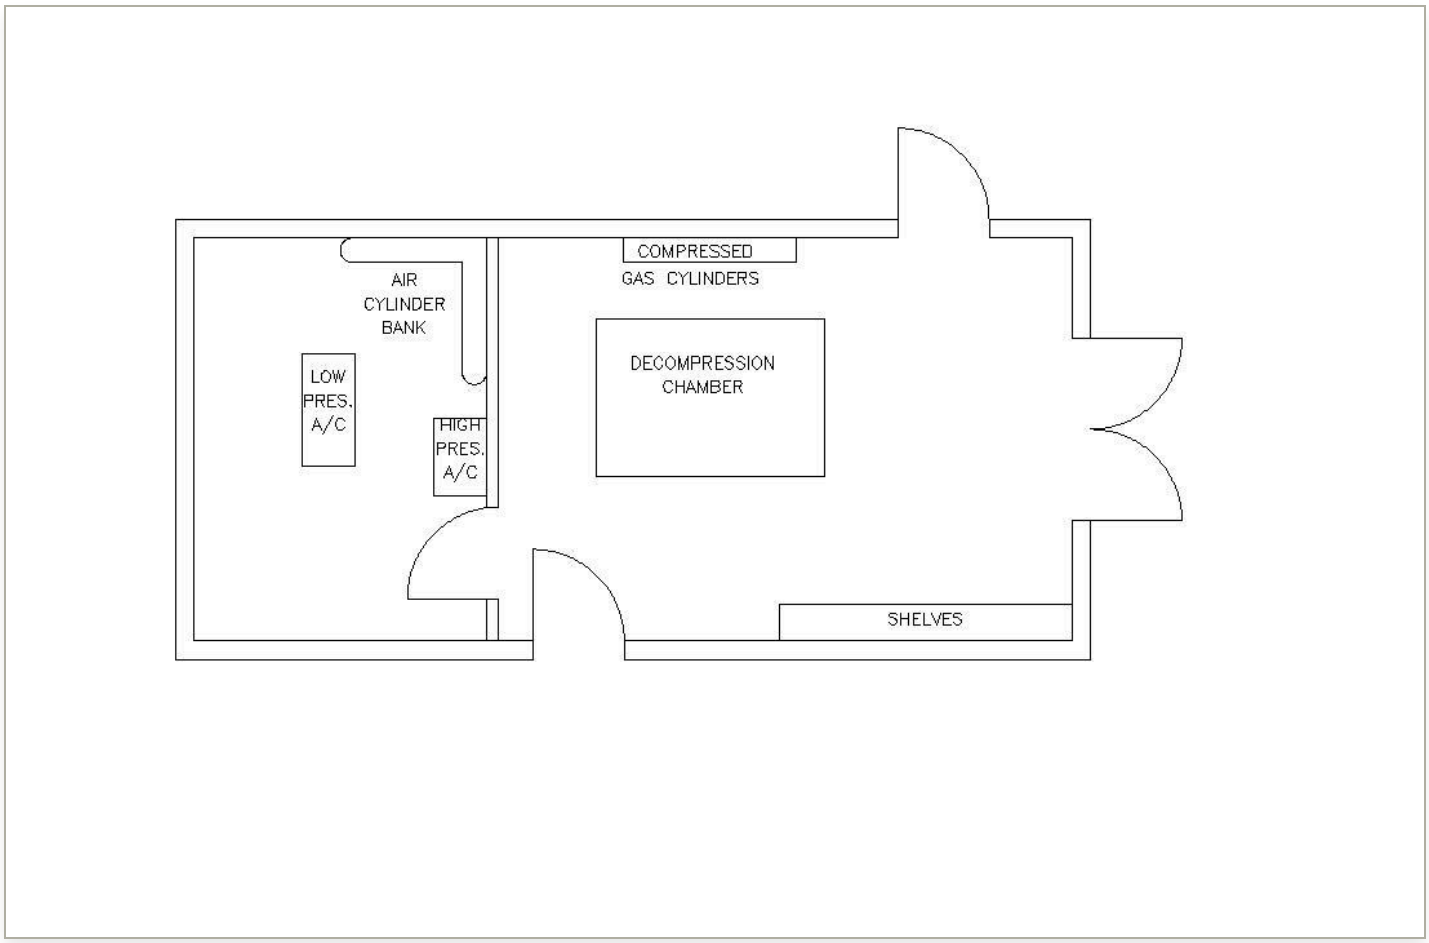


Figure 1: *Medical; 085 - Recompression Chamber*