McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

Dive Shack

Location ID: B144

Single-story building used as a dive locker. Includes areas for equipment storage, cleaning and maintenance, toilet facilities, and a breathing air compressor.



Photo 1: *Dive Shack*

General Structure Information

Usage	Dive Locker
Occupancy Group	B-2
Maximum Occupancy	7
Construction Type	Type V, N, combustible; T-5 insulated plywood panel system, wood-framed plywood floor, wood-framed gypsum board and plywood interior partitions.
Year Constructed	1989
Dimensions	24' x 26'5' x 12' furnace/compressor extension5' x 17' entry/toilet vestibule

Floor Area

Floor	Area
Floor 1	769 sq ft
Total	769 sq ft

HVAC System

Heating	One Lennox forced-air, oil-burning unit (84,000 Btu/hr output)
Air Handling Units	None

Fuel Tank	300 gallon fuel tank

Water and Sewer

Water Service	2" stub off the 2" main
Sewer Service	4" stub off the 4" main
Connections	Mop Sink: 1 Toilets: 1 Urinals: 1 Showers: 1 One line with one instrument
Water Heater	Electric water heater with 50 gallon capacity

Electrical Service

Service Feeder	Feeder C
Electrical Service	208/120V, 3 phase
Phone and LAN	One line with one instrument

Fire System

Fire Panel Type	King-Fisher KFRTI-20 industrial radio and control system (IRACS) panel, manual pull stations, and alarm horns.
Heat Detectors	Located throughout building
Suppression Type	Automatic dry-chemical fire extinguisher located over furnace.

Floorplans

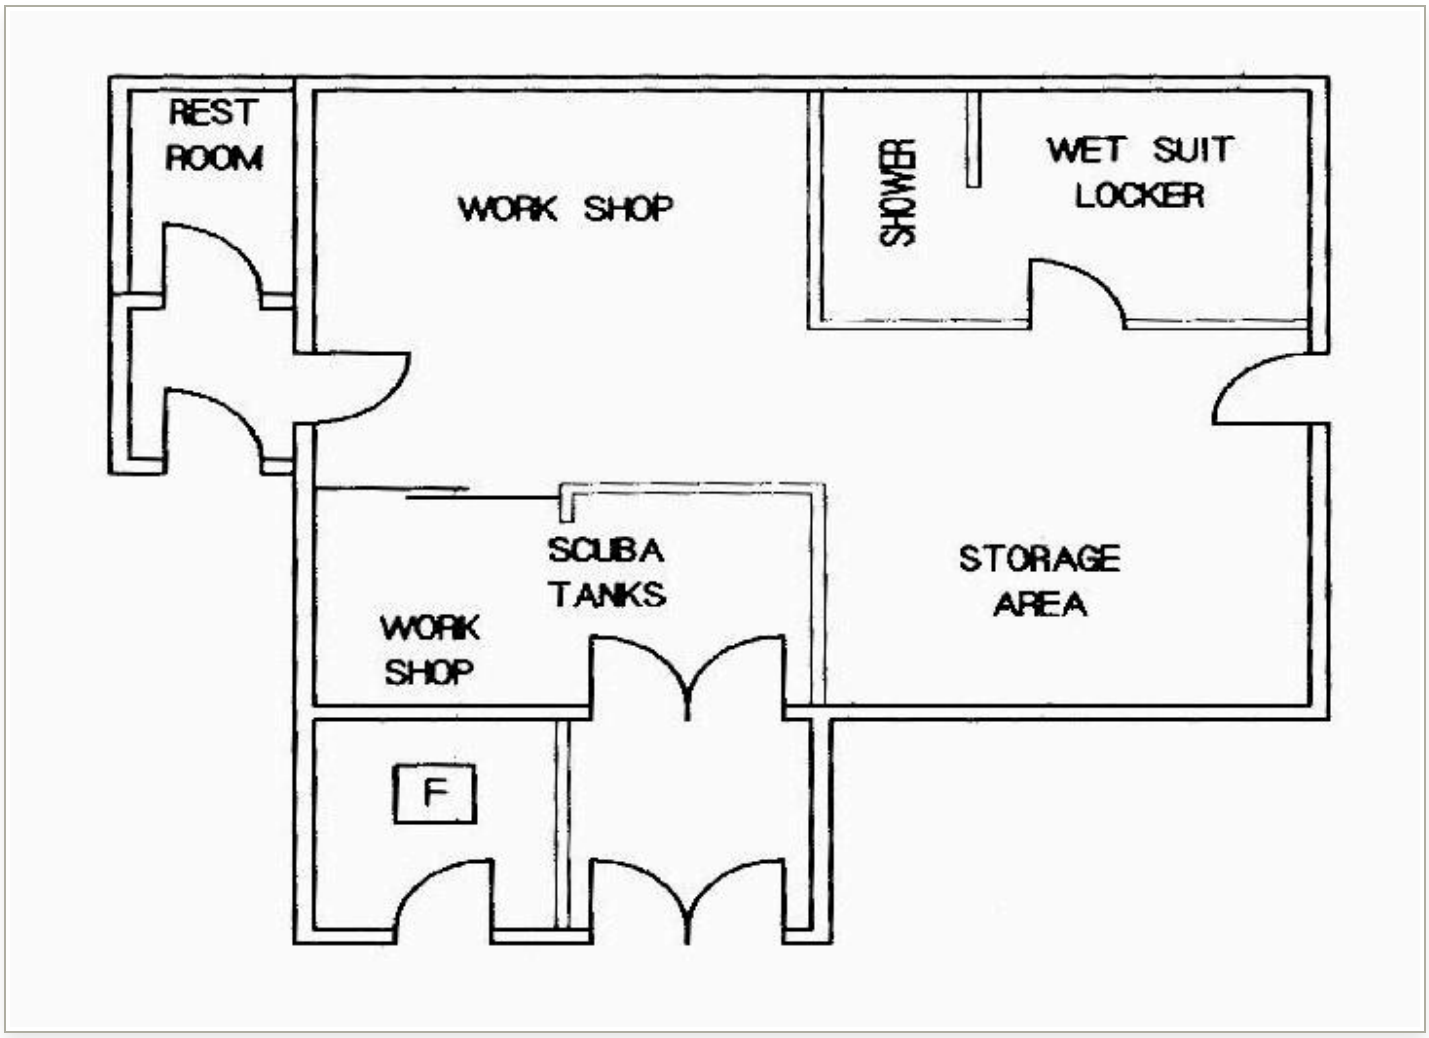


Figure 1: *Dive Shack*