McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

Thiele Gravity Survey Hut

Location ID: B146

Previously housed a 20 hp pump used to transfer water from the new water plant (Building 198) to tanks in Building 126, the old water plant. The equipment was removed during the 98-99 summer season.



Photo 1: *Thiele Gravity Survey Hut*

General Structure Information

Usage	Thiele Gravity Survey Hut
Occupancy Group	B-4 Pumping Plant
Maximum Occupancy	1
Construction Type	Type II, 1-Hour, non-combustible; steel-framed structure with foam-insulated metal sandwich panel siding, steel-framed metal floor. No interior partitions.
Year Constructed	1986
Dimensions	12' x 13'

Floor Area

Floor	Area
Floor 1	156 sq ft
Total	156 sq ft

HVAC System

Air Handling Units	None
Fuel Tank	None

Water and Sewer

Water Service	Not connected
Sewer Service	Not connected
Connections	Sinks: 0 Toilets: 0 Urinals: 0 Showers: 0 Water Cooler: 0 Not connected
Water Heater	None

Electrical Service

Service Feeder	Feeder D
Electrical Service	208/120V, 3PH, 225A main
Phone and LAN	Not connected

Fire System

Fire Panel Type	King-Fisher KFRTI-20 industrial radio and control system (IRACS) panel, heat detector, pull station.

Floorplans

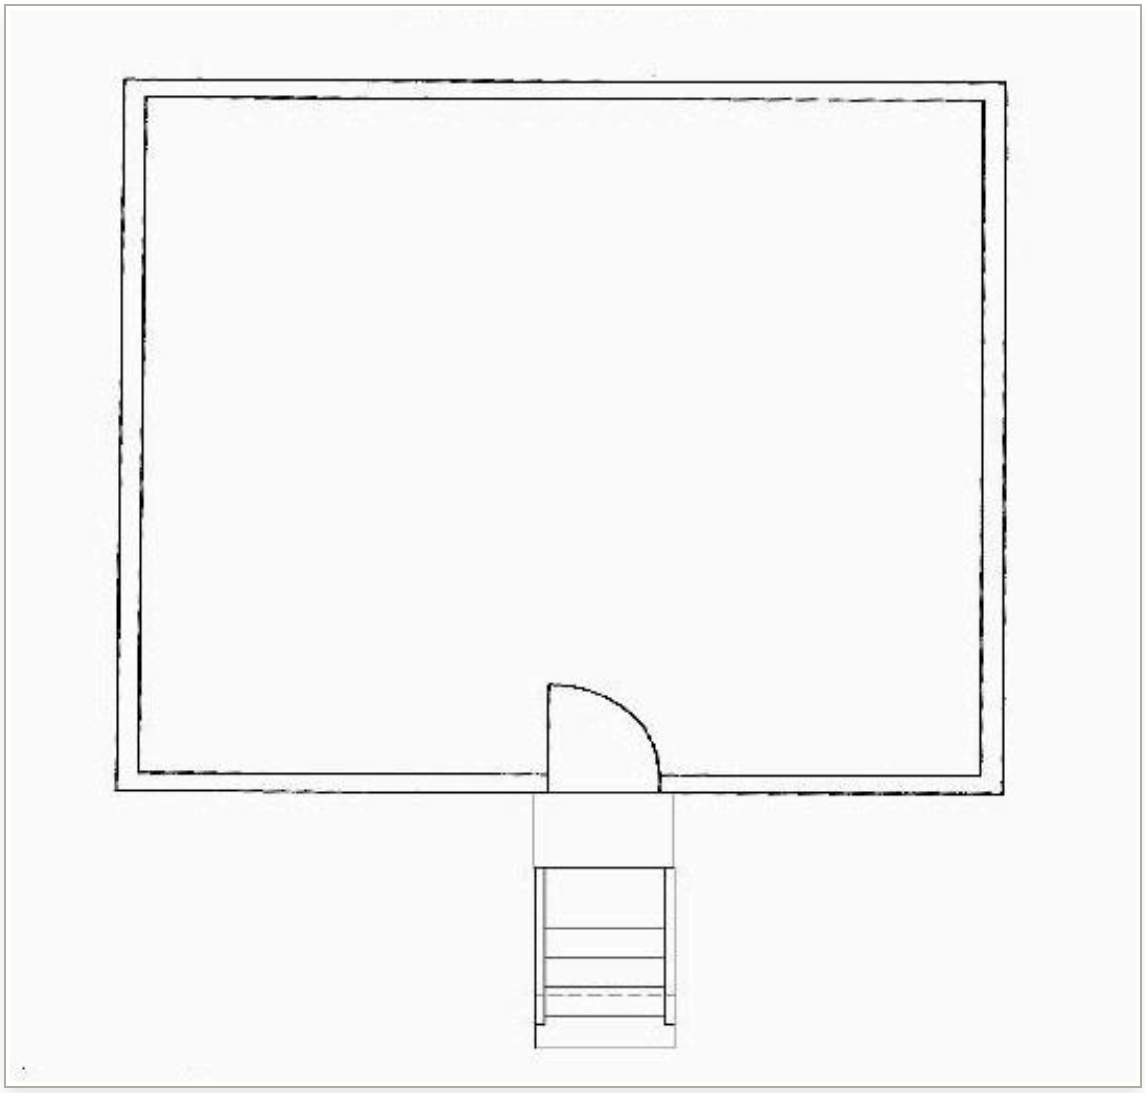


Figure 1: *Thiele Gravity Survey Hut*