McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

Pass Pump House

Location ID: B150

Single-story building used to house two 50-hp pumps used to transfer fuel to Williams Field. The building is divided into a pump room and a control room.



Photo 1: *Pass Pump House*

General Structure Information

Usage	Pass Pump House
Occupancy Group	H-2 Fuel Pump House
Maximum Occupancy	1
Construction Type	Type II, N, non-combustible; steel-framed structure with insulated metal siding and roofing, steel plate floor, wood-framed gypsum board interior partition.
Year Constructed	1989
Dimensions	16' x 24'

Floor Area

Floor	Area
Floor 1	384 sq ft
Total	384 sq ft

HVAC System

Air Handling Units	None
Fuel Tank	None

Water and Sewer

Water Service	Not connected
Sewer Service	Not connected
Connections	Sinks: 0 Toilets: 0 Urinals: 0 Showers: 0 Water Cooler: 0 One line with one instrument
Water Heater	None

Electrical Service

Service Feeder	Feeder D
Electrical Service	208/120V, 3PH, 225A main, Class I, Division 1 interior electric
Phone and LAN	One line with one instrument

Fire System

Fire Panel Type	King-Fisher KFRTI-20 industrial radio and control system (IRACS) panel, heat detectors, pull station, alarm horn
Suppression Type	Ansul SPA-50 total flood CO2 system in pump room

Floorplans

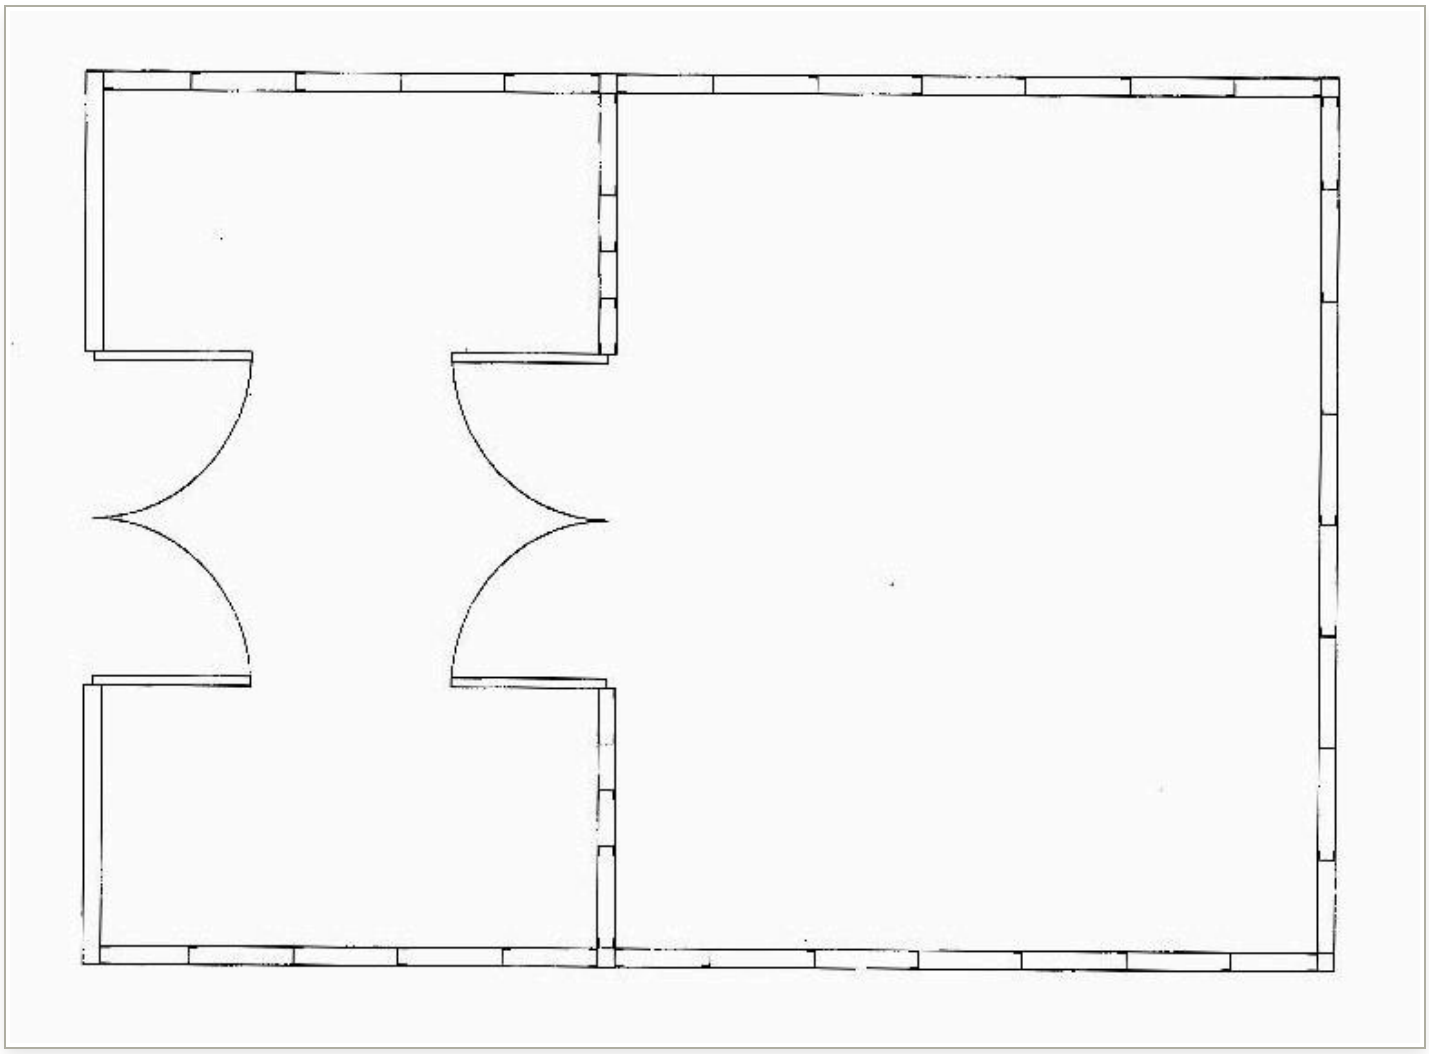


Figure 1: *Pass Pump House*