McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

Administration & GSE Shop

Location ID: B159

Two-story, metal prefabricated structure. Interior is wood framed with gypsum board and plywood paneling. The upper floor is office as well as part of the lower floor. There is a repair shop on the first floor.



Photo 1: *Administration & GSE Shop*

General Structure Information

Usage	Air support administration and ground support equipment shop
Occupancy Group	B-2 Office and B-1 Repair Shop
Maximum Occupancy	92
Construction Type	Type V, N, combustible
Year Constructed	1970
Dimensions	51' x 102'11' x 48' mechanical, paraloft, stair addition9' x 18' stair

Floor Area

Floor	Area
Floor 1	5,892 sq ft
Floor 2	5,202 sq ft
Total	11,094 sq ft

HVAC System

Heating	Kewanee oil-fired glycol boiler (1,350,000 Btu/hr)
Air Handling Units	None

Fuel Tank	1,000 gallon fuel tank

Water and Sewer

Water Service	400 gallon holding tank
Sewer Service	Connected by a 4" stub to Building 181
Connections	Sinks: 3 Toilets: 2 Urinals: 1 Showers: 0 Water cooler: 1 Mop sink: 1 12 lines with 16 instruments

Electrical Service

Service Feeder	Feeder C
Electrical Service	208/120V, 3PH
Phone and LAN	12 lines with 16 instruments

Fire System

Fire Panel Type	King-Fisher KFRTI-20 industrial radio and control system (IRAC) panel, heat detectors, pull stations, alarm horns
Heat Detectors	Located throughout building
Suppression Type	Automatic dry-chemical fire extinguisher located over furnace.

Floorplans

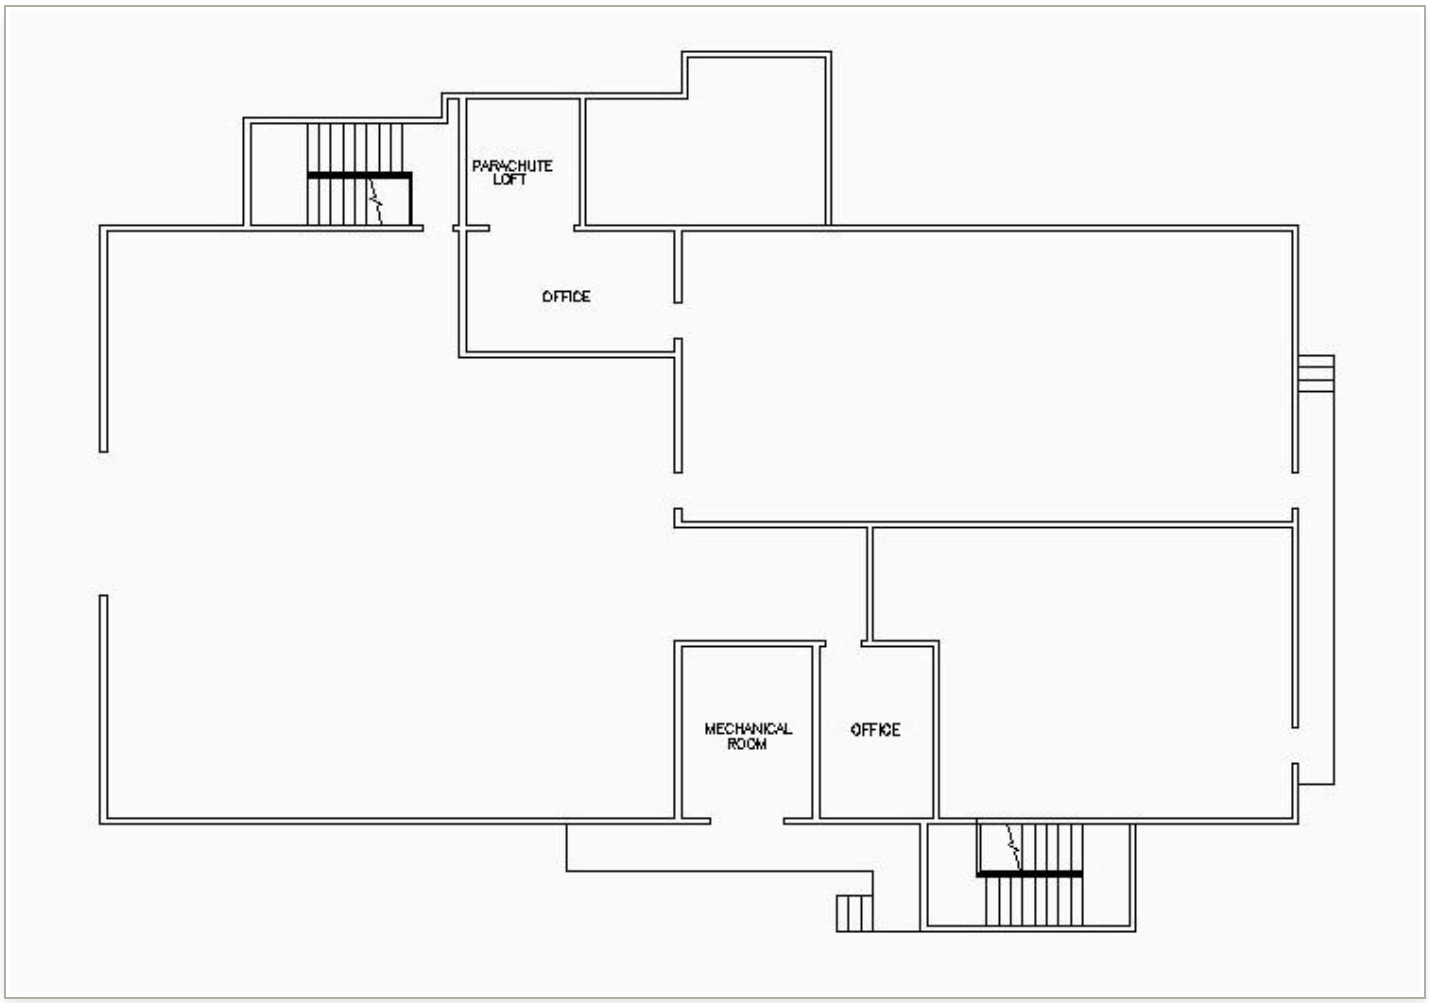


Figure 1: *Administration & GSE Shop*

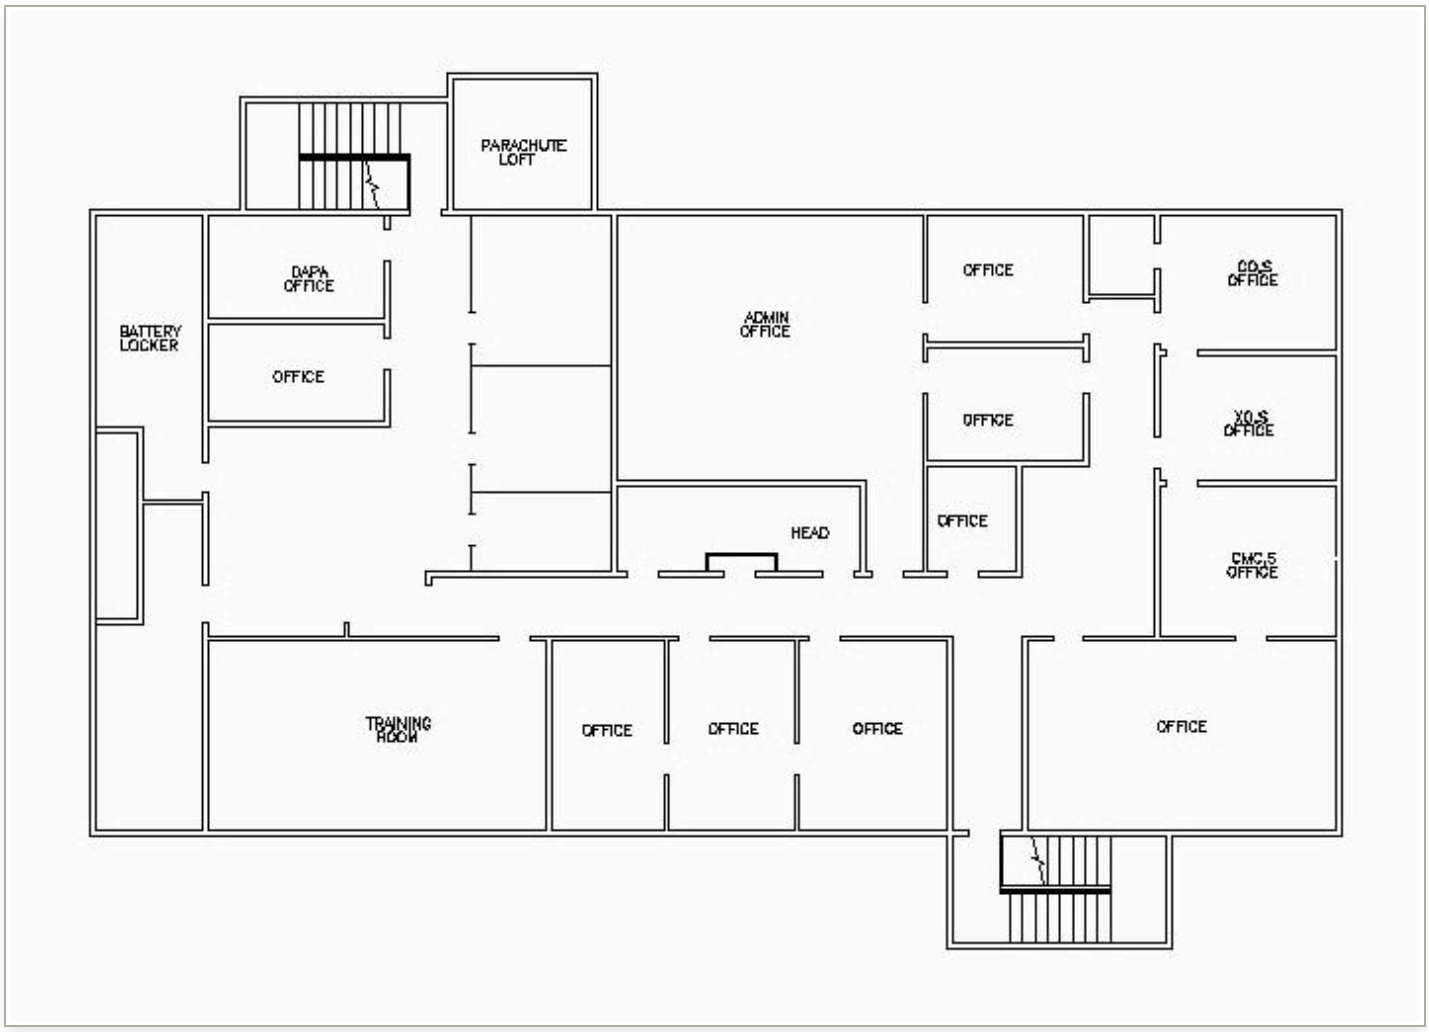


Figure 2: *Administration & GSE Shop*