McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

Carpentry Shop

Location ID: B161

Single-room building used in conjunction with Building 191/191A as a carpentry shop.



Photo 1: *Carpentry Shop*

General Structure Information

Usage	FMC Carpentry Shop (tow-away)
Occupancy Group	H-2 Hazardous (wood shop)
Maximum Occupancy	1
Construction Type	Type V, N, combustible; insulated, wood-framed structure with plywood interior and exterior siding. Wood-framed plywood floor on steel skids. No interior partitions.
Year Constructed	1977
Dimensions	12' x 30', 3' x 4' furnace room
Floor Area	

Floor	Area
Floor 1	372 sq ft
Total	372 sq ft

HVAC System

Heating	One Lennox forced-air, oil-burning furnace (105,000 Btu/hr)
Air Handling Units	None

Fuel Tank	100 gallon fuel tank

Water and Sewer

Water Service	Not connected
Sewer Service	Not connected
Connections	Sinks: 0 Toilets: 0 Urinals: 0 Showers: 0 Water Cooler: 0 Water Heater: 1 One line with one instrument

Electrical Service

Service Feeder	Feeder D
Electrical Service	208/120V, 3PH, 100A panel
Phone and LAN	One line with one instrument

Fire System

Fire Panel Type	King-Fisher KFRTI-20 industrial radio and control system (IRACS) panel, heat detectors, pull stations, and alarm horns.

Floorplans

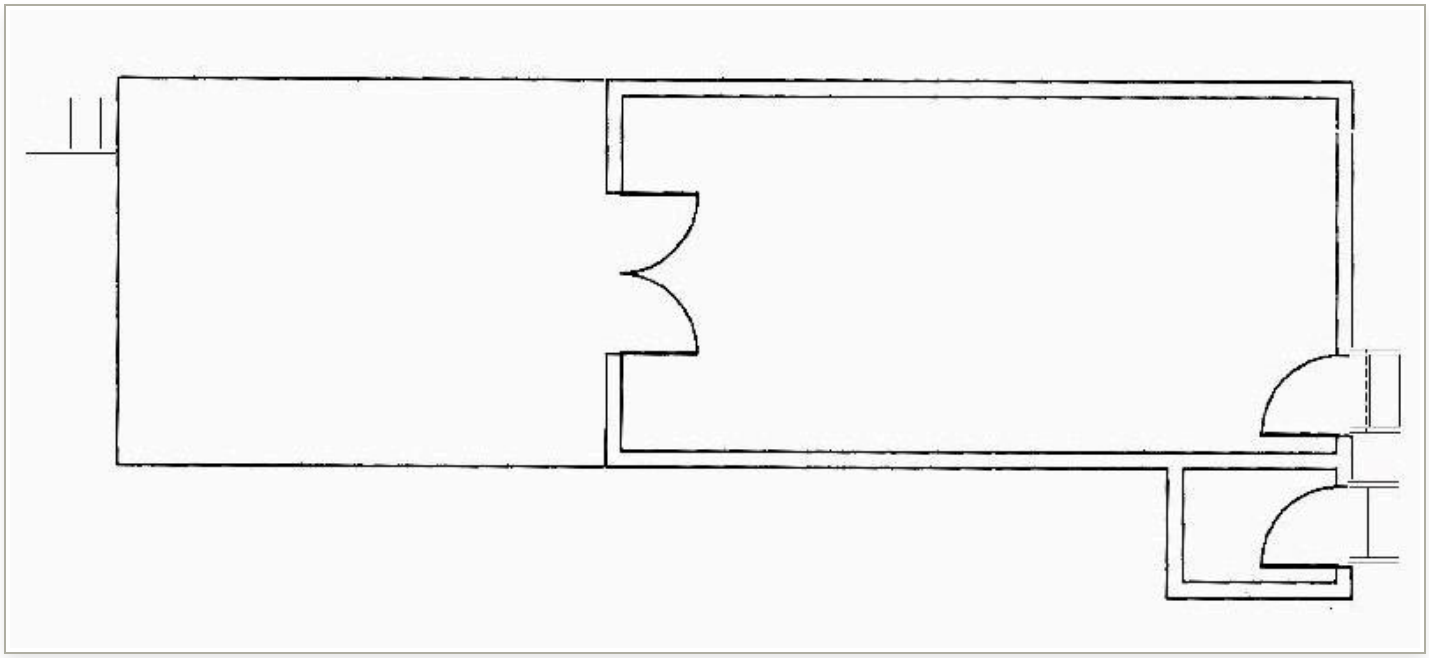


Figure 1: *Carpentry Shop*