## McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

# Frozen Food Storage

## Location ID: B164

Single-story, prefabricated, metal structure. The building has no interior partitions. The building functions as a frozen food storage warehouse with six air conditioning units. One heated office is located on the dock. It also provides warm storage for the electric forklift.



***Photo 1:*** *Frozen Food Storage*

# General Structure Information

| | |
|---|---|
| **Usage** | Frozen Food Storage Facility |
| **Occupancy Group** | B-2 Cold Storage |
| **Maximum Occupancy** | 10 |
| **Construction Type** | Type V, N, combustible; wood floor |
| **Year Constructed** | 1968 |
| **Dimensions** | 50' x 102 and a 12' x 12' vestibule |

**Floor Area**

| Floor | Area |
|---|---|
| Floor 1 | 5,100 sq ft |
| **Total** | 5,244 sq ft |

---

# HVAC System

| | |
|---|---|
| **Heating** | Only the vestibule is heated. It is equipped with two Chromolax electric heaters. |
| **Air Handling Units** | None |

| | |
|---|---|
| **Refrigeration** | Carrier Transicold Refrigeration units |
| **Fuel Tank** | None |

## Water and Sewer

| | |
|---|---|
| **Water Service** | Not connected |
| **Sewer Service** | Not connected |
| **Connections** | Sinks: 0<br>Toilets: 0<br>Urinals: 0<br>Showers: 0<br>Water Cooler: 0<br>None |
| **Water Heater** | None |

## Electrical Service

| | |
|---|---|
| **Service Feeder** | Feeder D |
| **Electrical Service** | 208/120V, 3PH |
| **Phone and LAN** | None |

# Fire System

| | |
|---|---|
| **Fire Panel Type** | King-Fisher KFRTI-20 industrial radio and control system (IRACS) panel, heat/smoke detectors, pull station, alarm horn. |
| **Heat Detectors** | Located throughout building |
| **Suppression Type** | None |

# Floorplans

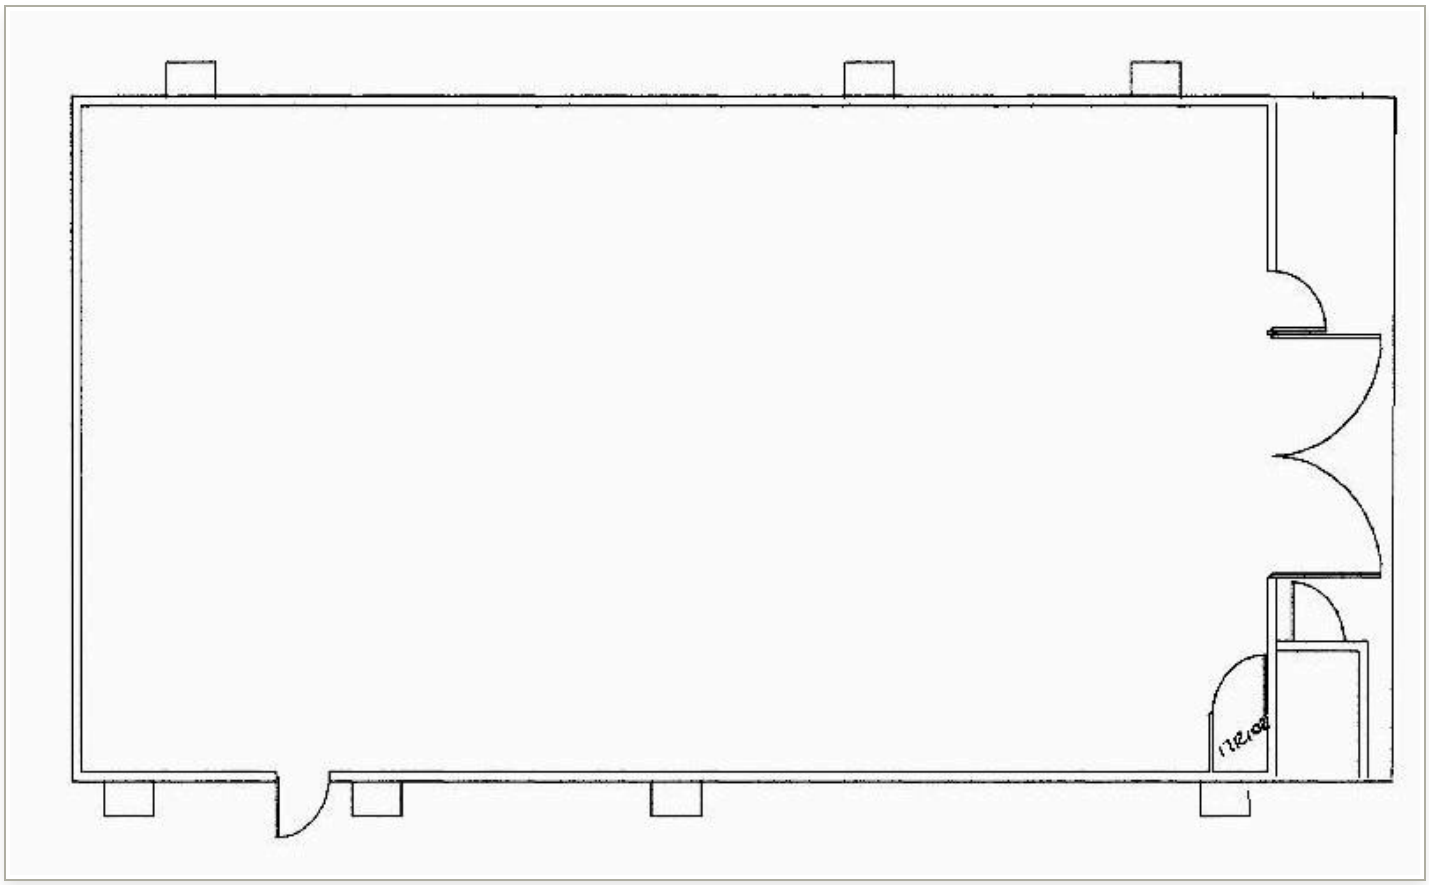


***Figure 1:*** *Frozen Food Storage*