McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

NSF Dorm (Hotel California)

Location ID: B166

Two-story dormitory used primarily to house NSF grantees and personnel travelling through McMurdo Station to other locations. The first floor includes 13 two-person rooms, a laundry room, a women's bathroom, a sauna, and a mechanical room. The second floor includes 8 two-person rooms, a bunkroom, a lounge, and men's bathroom. Originally constructed in 1968, the building interior was completely rehabilitated in 1986.

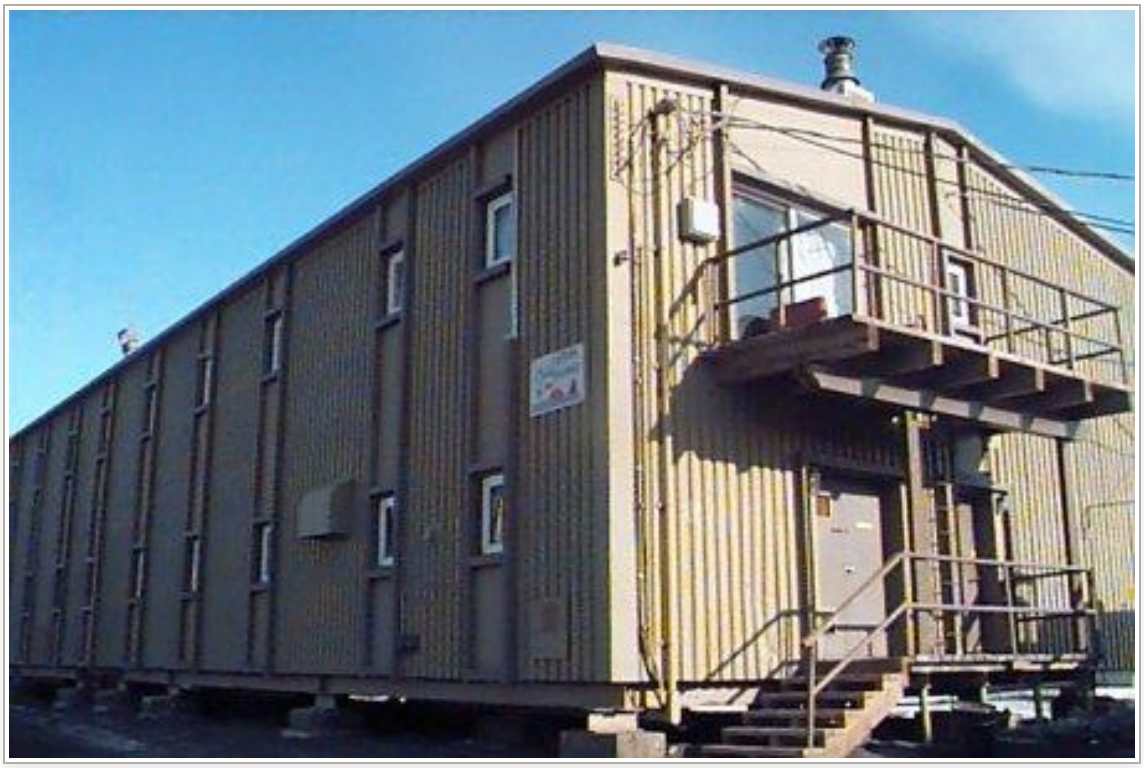


Photo 1: *NSF Dorm (Hotel California)*

General Structure Information

Usage

Berthing, Hotel California

Occupancy Group

R-1 Dormitory

Maximum Occupancy

91

Construction Type

Type V, 1-Hour, combustible; steel-framed structure with insulated metal siding and roofing, steel-framed heavy-timber floors, wood-framed gypsum
board interior partitions.

Year Constructed

1968

Dimensions

40' x 102'

Floor Area

Floor	Area
Floor 1	4,080 sq ft
Floor 2	4,080 sq ft
Total	8,160 sq ft

HVAC System

Heating

One Kewanee glycol boiler (1,688,000 Btu/hr), glycol heating loop with fin-tube baseboard radiators.

Air Handling Units	Central station air handler with glycol heating coil. Fresh air is tempered at 60 degrees F. There is also one glycol unit heater located in the mechanical room.
Fuel Tank	1,000 gallon fuel tank shared with Building 188

Water and Sewer

Water Service	2" stub off of the 6" main
Sewer Service	4" stub off of the 6" main
Connections	Sinks: 8 Toilets: 4 Urinals: 4 Showers: 4 Water Cooler: 2 Washing Machine: 2 Dryers: 2 Ice Machine: 1 Sauna: 1 One line with two instruments
Water Heater	119 gallon electric water heater

Electrical Service

Service Feeder	Feeder C

Electrical Service	208/120V, 3PH, 400A main
Phone and LAN	One line with two instruments

Fire System

Fire Panel Type	Pyrotronics System 3 control panel, King-Fisher KFRTI-WP-8 radio interface/transmitter panel, pull stations, and alarm bells
Heat Detectors	Located throughout building
Suppression Type	The building is equipped with a sprinkler system with standpipe connection only. Sprinkler heads open on high temperature. Piping is dry and must be charged with water by fire truck via outside standpipe connection. Automatic dry-chemical fire extinguisher located over boiler.

Floorplans

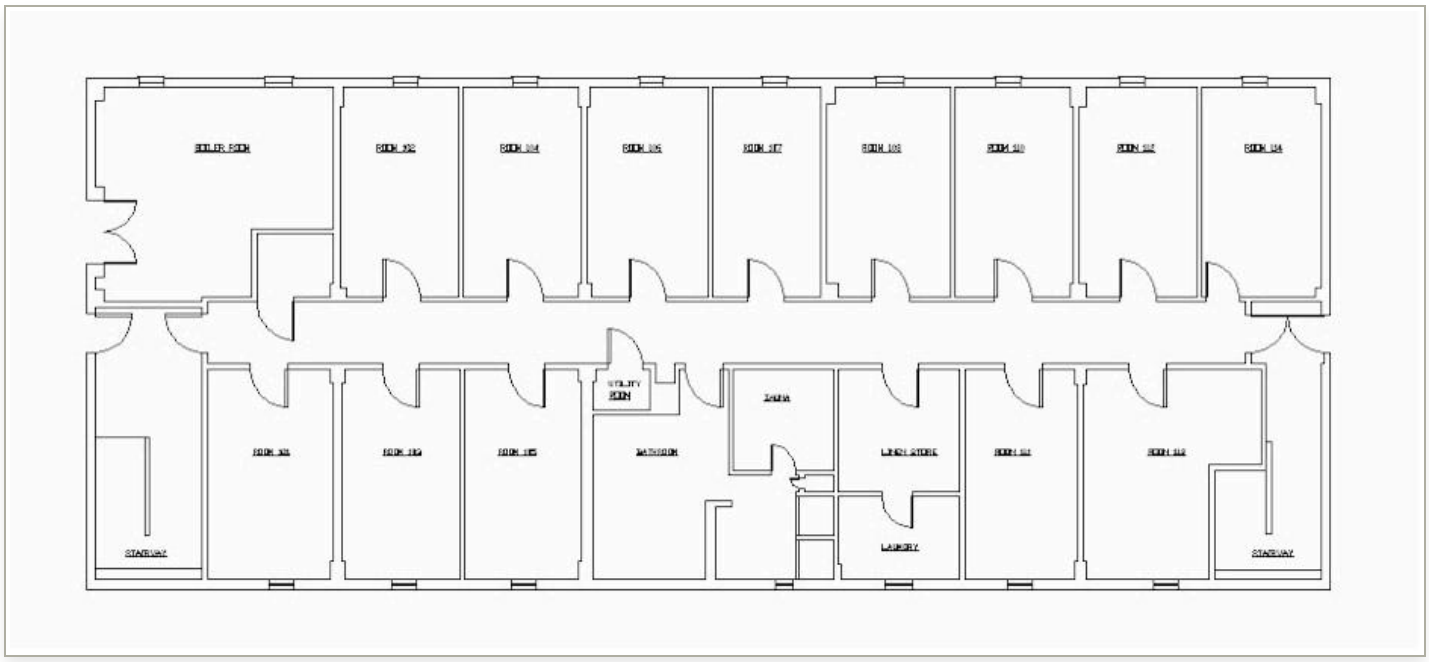


Figure 1: *NSF Dorm (Hotel California)*

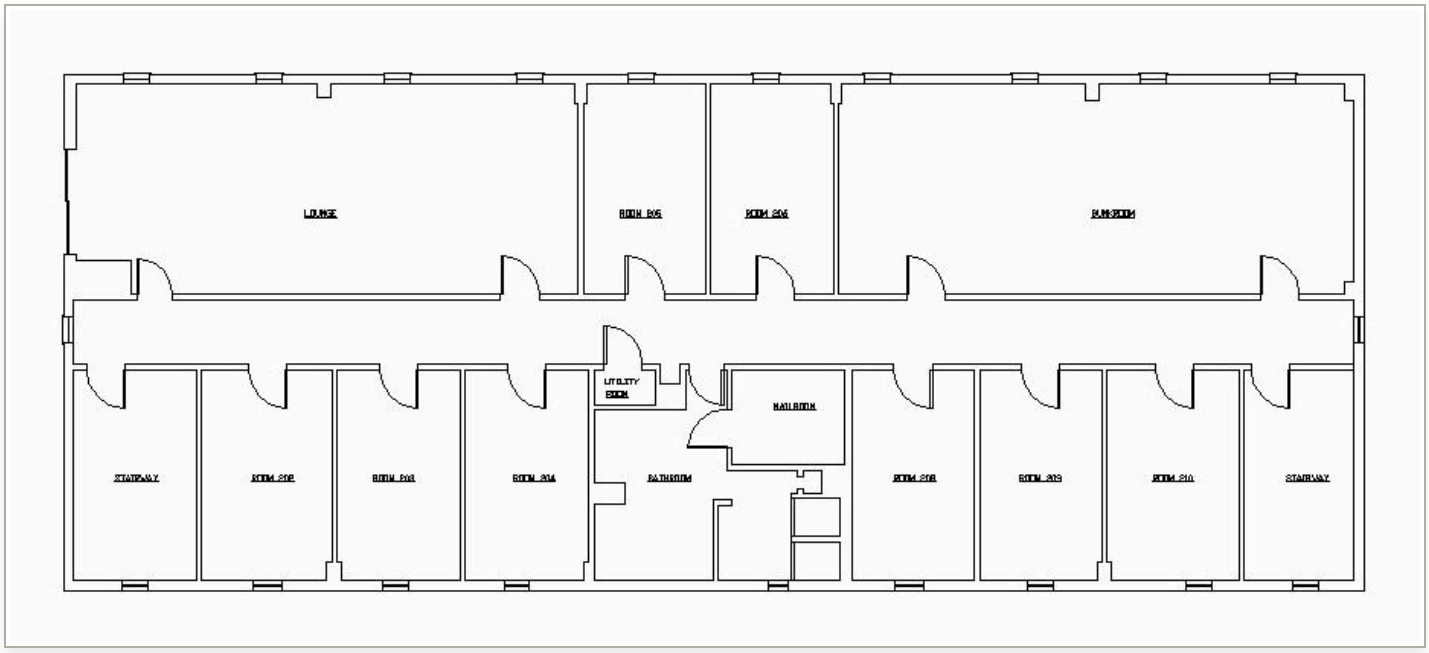


Figure 2: *NSF Dorm (Hotel California)*