McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

Chalet (NSF Offices)

Location ID: B167

A-frame style building containing offices for senior NSF and contractor personnel. The building containsfive offices, a storage room, a restroom, a mechanical room, and a central assembly room with a conference mezzanine area above.



Photo 1: *Chalet (NSF Offices)*

General Structure Information

Usage	Chalet, ASA and NSF Administration
Occupancy Group	B-2 Office
Maximum Occupancy	61
Construction Type	Type V, N, combustible; wood structure with wood siding and wood shake roof, wood-framed timber floor, wood-framed, wood-paneled interior partitions.
Year Constructed	1969
Dimensions	45' x 50' with a 10' x 20' office extension

Floor Area

Floor	Area
Floor 1	2,450 sq ft
Floor 2	400 sq ft
Total	2,850 sq ft

HVAC System

Heating	One Peerless oil-burning glycol boiler, two Chromalox electric wall heaters in mechanical room. The boiler is equipped with an outdoor reset,

	which is scheduled to reset at a ratio of 1.25:1. Heat is supplied to the building via baseboard heat.
Air Handling Units	Central station air handler supplying tempered fresh air at 60 degrees F.
Fuel Tank	2,000 gallon fuel tank

Water and Sewer

Water Service	2" stub off of the 6" main
Sewer Service	4" stub off of the 4" main
Connections	Sinks: 2 Toilets: 1 Urinals: 1 Water Cooler: 1 Three lines with six instruments
Water Heater	19 gallon electric water heater

Electrical Service

Service Feeder	Feeder B
Electrical Service	208/120V, 3PH, 125A main

Phone and LAN	Three lines with six instruments

Fire System

Fire Panel Type	Kingfisher KFRTI-20 industrial radio and control system (IRACS) panel, pull stations, and alarm horns
Heat Detectors	Located throughout building
Suppression Type	Automatic dry-chemical fire extinguisher located over boiler.

Floorplans

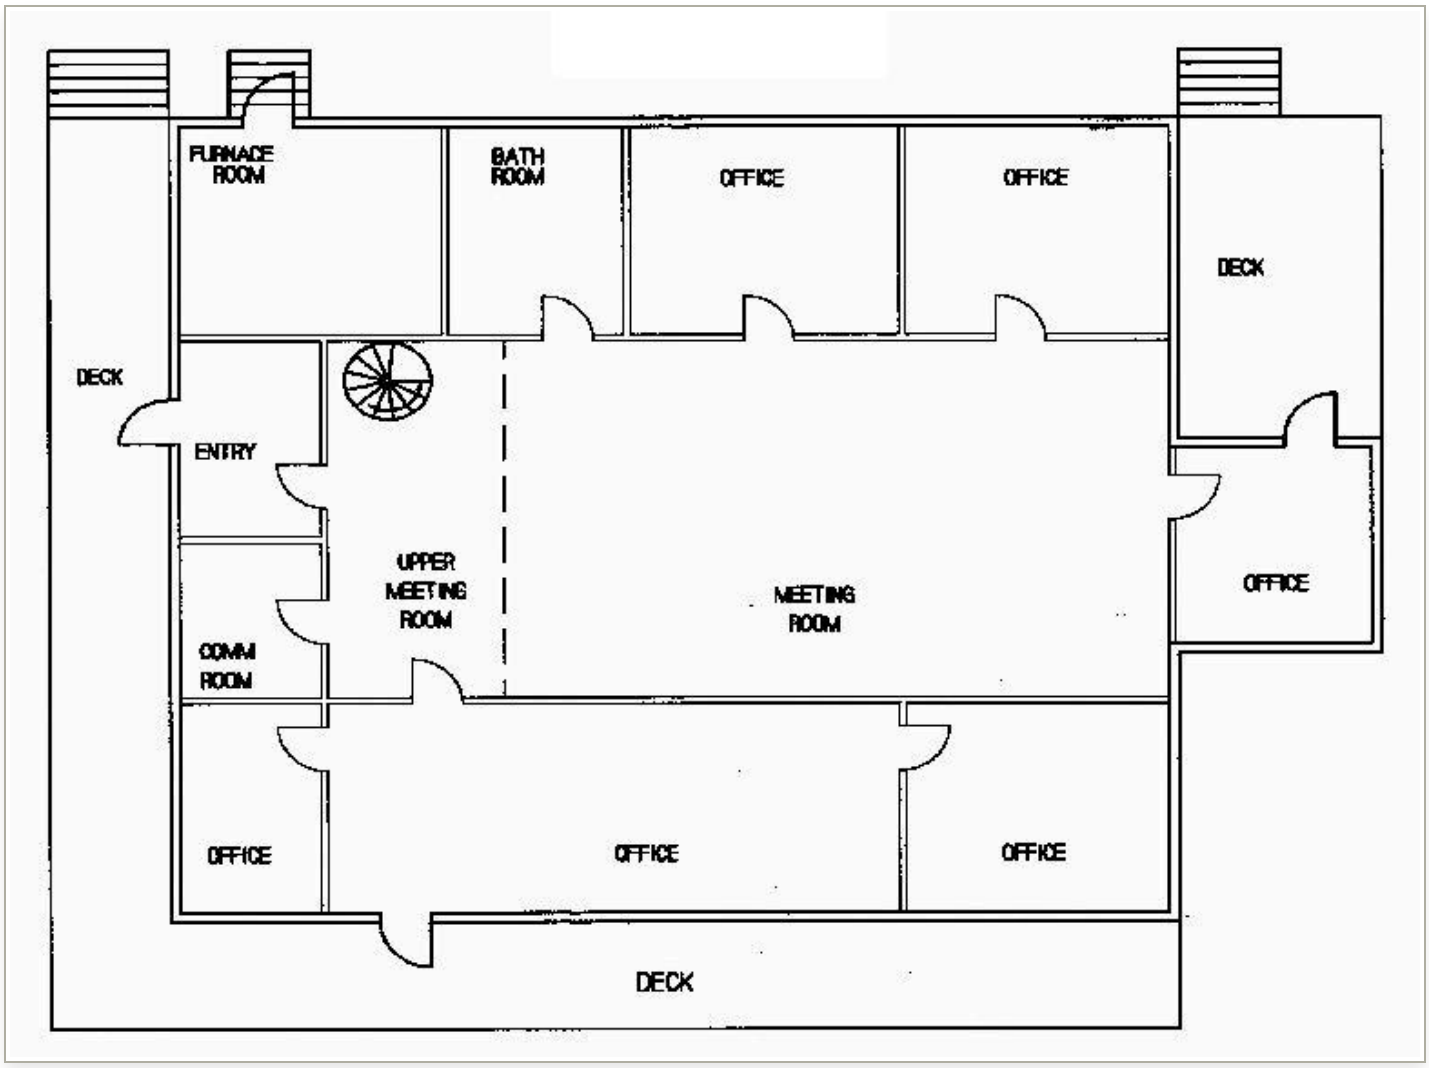


Figure 1: *Chalet (NSF Offices)*