McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

Auto Storage

Location ID: B168

Two-story warehouse used for the unheated storage of automotive parts.

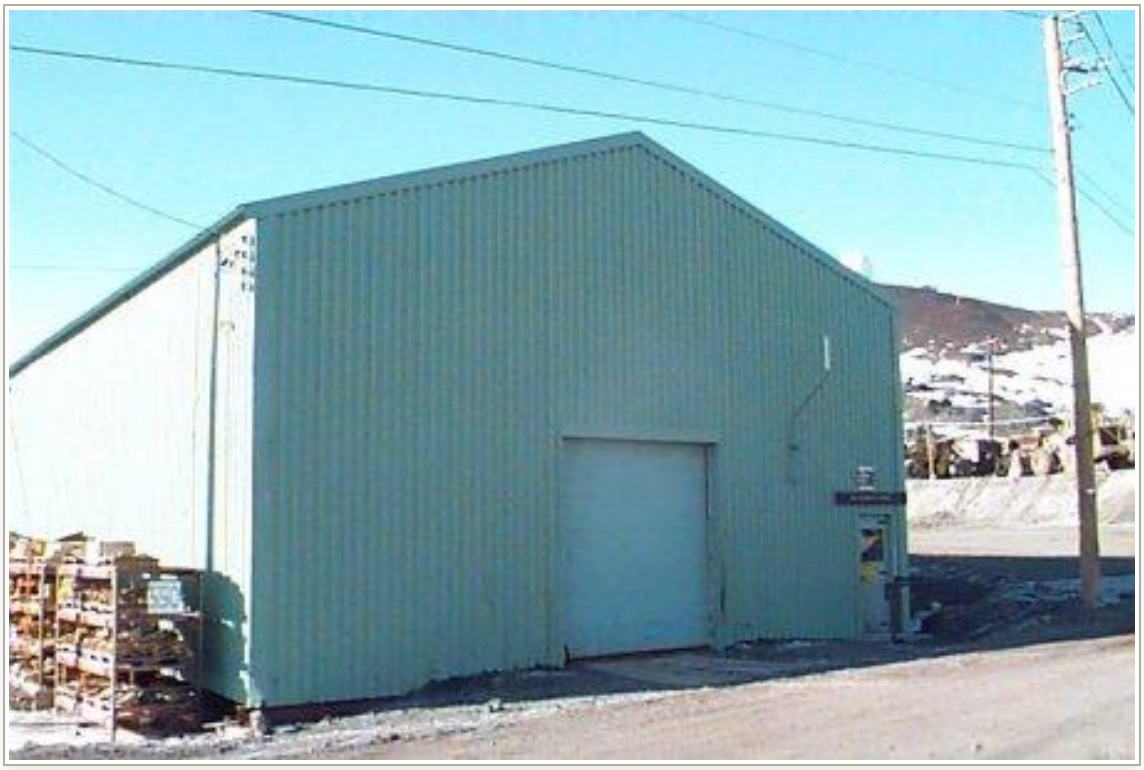


Photo 1: *Auto Storage*

General Structure Information

Usage	Automotive Warehouse, Unheated
Occupancy Group	B-4 Warehouse
Maximum Occupancy	15
Construction Type	Type V, N, combustible; steel-framed structure with uninsulated metal siding and roofing, steel-framed heavy timber first floor, steel-framed corrugated metal and plate steel second floor. Interior partitions are wood- and metal-framed plywood and sheet metal.
Year Constructed	1969
Dimensions	40' x 98'

Floor Area

Floor	Area
Floor 1	3,920 sq ft
Floor 2	3,920 sq ft
Total	7,840 sq ft

HVAC System

Heating	None

Air Handling Units	None
Fuel Tank	None

Water and Sewer

Water Service	Not connected
Sewer Service	Not connected
Connections	Sinks: 0 Toilets: 0 Urinals: 0 Showers: 0 Water Cooler: 0 Not connected
Water Heater	None

Electrical Service

Service Feeder	Feeder A
Electrical Service	208/120V, 3PH, 100A main
Phone and LAN	Not connected

Fire System

Fire Panel Type	King-Fisher KFRTI-20 industrial radio and control system (IRACS) panel in heated enclosure, heat detectors, pull stations, alarm horns.
Suppression Type	None

Floorplans

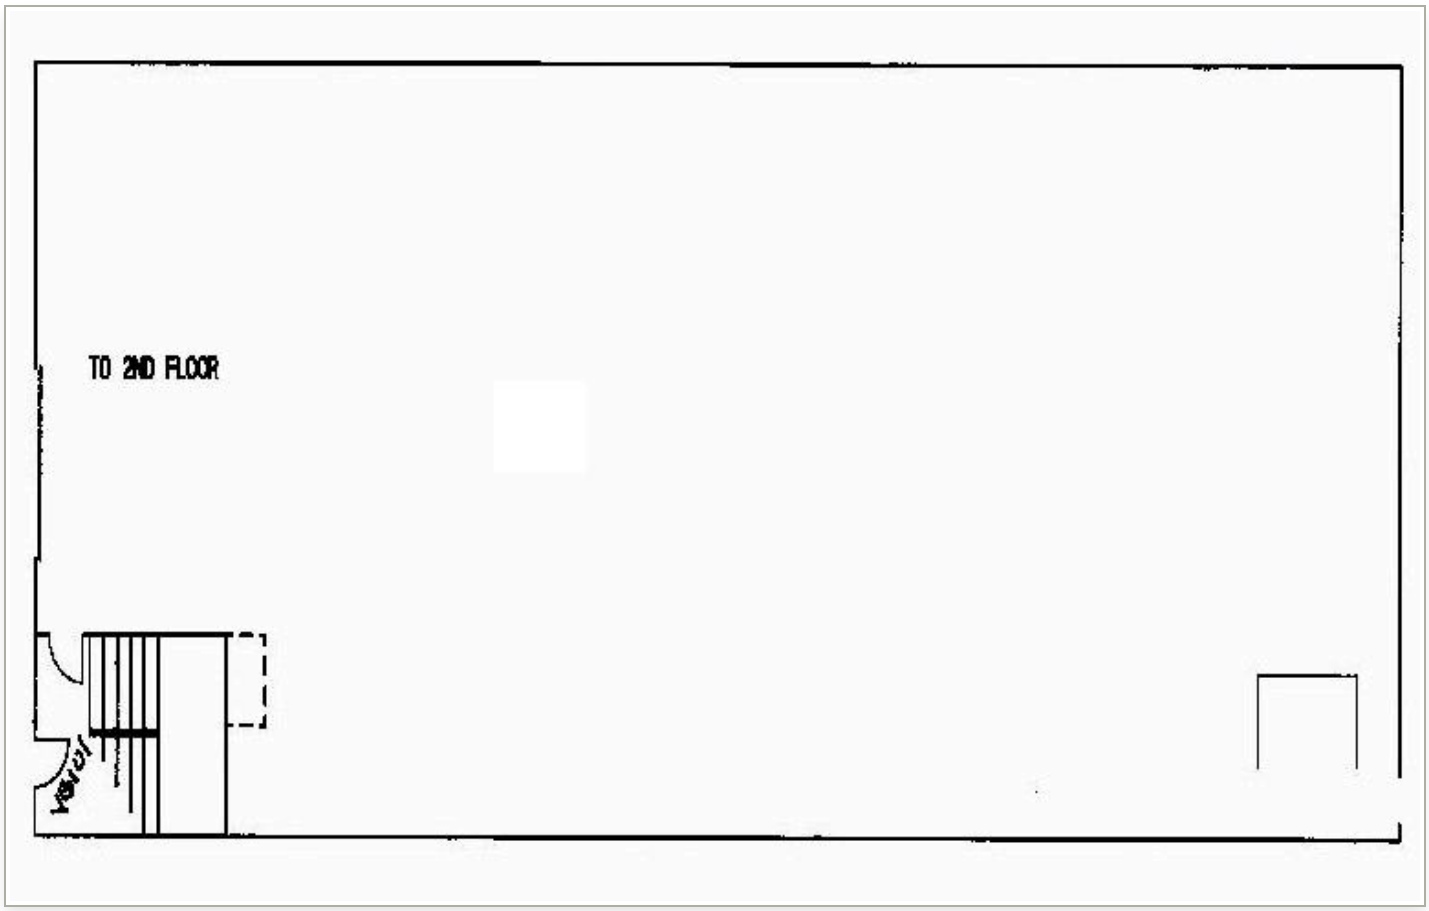


Figure 1: *Auto Storage*

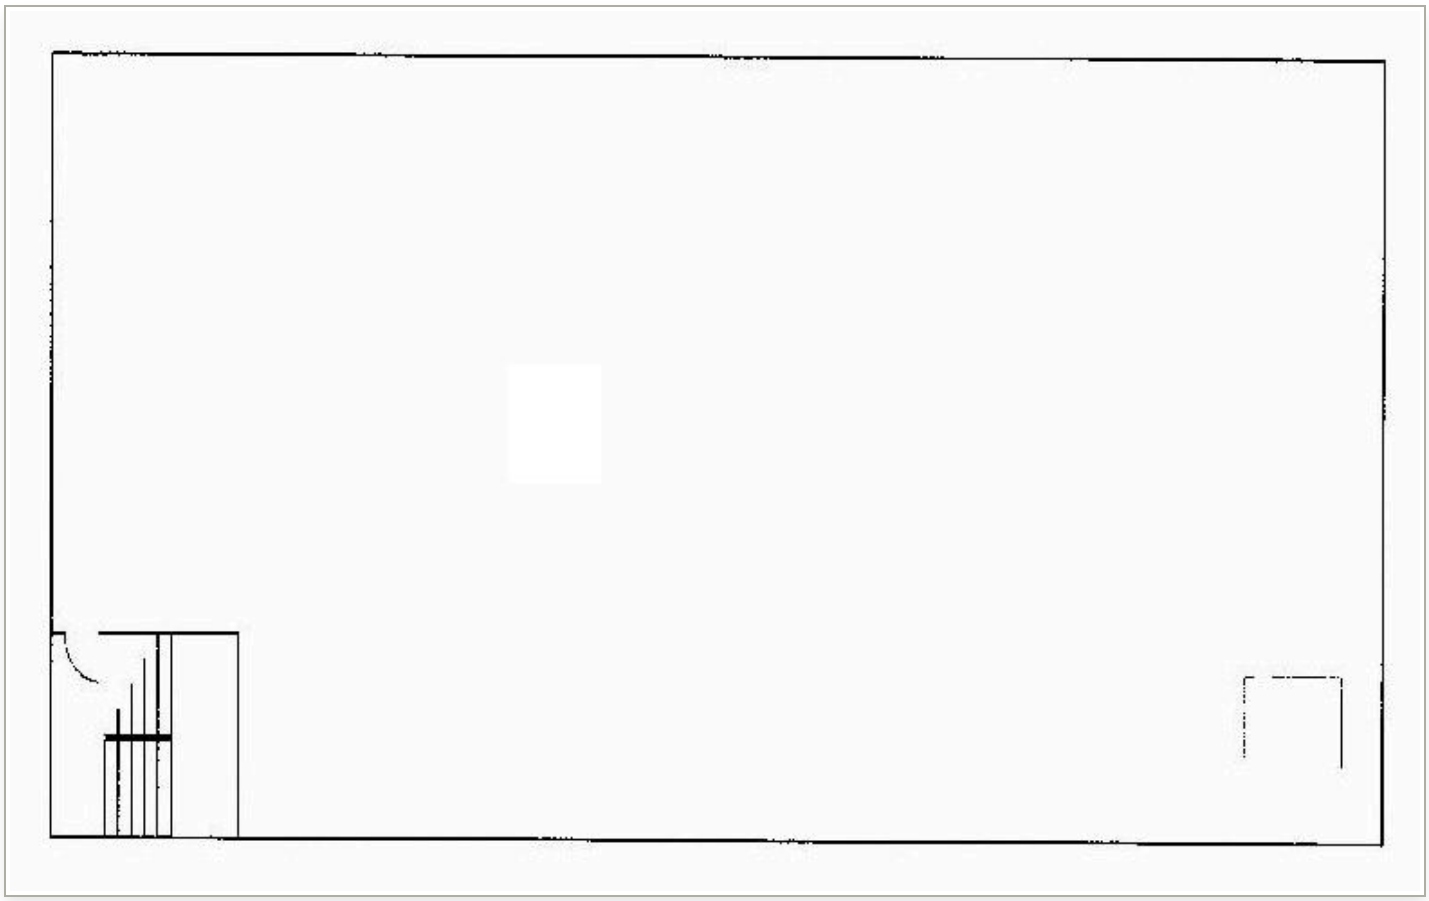


Figure 2: *Auto Storage*