McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

Hazardous Waste Facility

Location ID: B170

This facility was constructed in the 97-98 summer season. It is used for waste sorting, office space for hazardous waste personnel, and radioactive material handling. The main portion of the building was built using the steel from the old pumphouse that was located at Hut Point. The building is located in the hazardous waste yard.



Photo 1: *Hazardous Waste Facility*

General Structure Information

Usage

Hazardous Waste Building/Offices

Construction Type

The main facility uses structural steel from the pumphouse that was located at Hut Point. Prefabricated metal skin siding (3-inch thickness) was added. Two
trailers were attached to the west end of the main building. One serves as office space and the other, which is equipped with a fume hood, is used for
material sorting and handling. On the east end of the building, the radioactive material handling (Radshack) was attached.

Year Constructed

1997-98

Dimensions

Trailers: 10'2" x 20'2" eachMain Building: 20' 8" x 40'Radshack: 16' x 20'

Floor Area

Floor	Area
Floor 1	1,353 sq. ft.
Total	1,353 sq. ft.

HVAC System

Heating

Clean Burn waste oil furnace with forced draft

Fuel Tank

500 gallon fuel tank with double-walled containment

Water and Sewer

Water Service	Not connected
Sewer Service	Not connected

Electrical Service

Service Feeder	Feeder D
Transformer	XF300 B-7
Electrical Service	208/120V, 3PH

Fire System

Fire Panel Type	King Fisher IRAC panel
Heat Detectors	Located in all rooms.
Suppression Type	An ADX cylinder is located over the furnace.

Floorplans

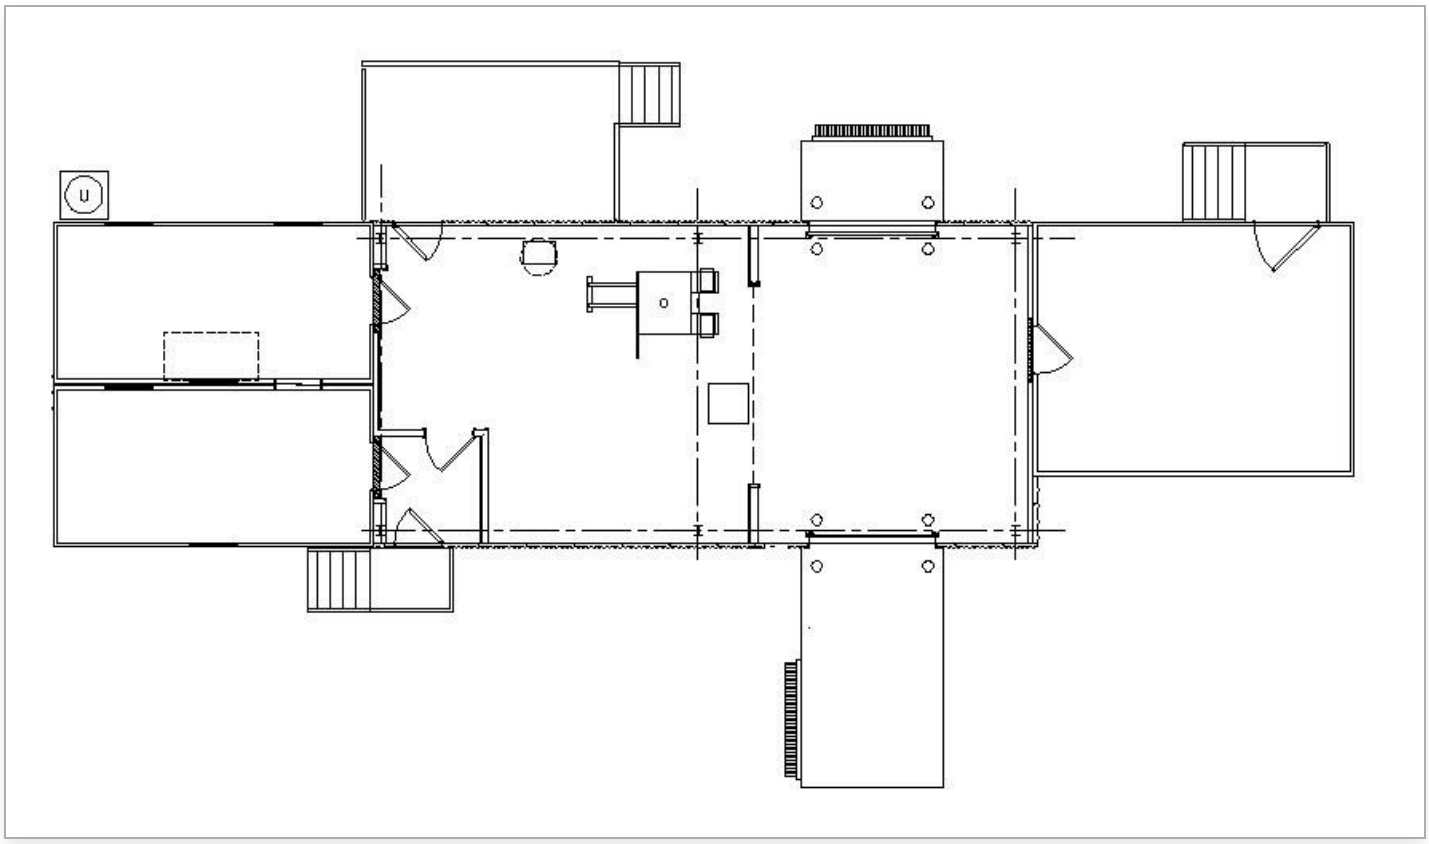


Figure 1: *Hazardous Waste Facility*