McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

Flammable Storage

Location ID: B174

Building is used as a warehouse for the storage of safety equipment and various flammable materials, including flammable and combustible liquids.



Photo 1: *Flammable Storage*

General Structure Information

Usage	Flammable Storage
Occupancy Group	H-3 Hazardous
Maximum Occupancy	15
Construction Type	Type V, 1-Hour, combustible; two-story, steel-framed structure with fiberglass-insulated metal siding, steel-framed timber first floor, steel-framed metal decking second floor. Interior partitions are steel- and wood-framed gypsum board.
Year Constructed	1970
Dimensions	40' x 98'

Floor Area

Floor	Area
Floor 1	3,920 sq ft
Floor 2	3,920 sq ft
Total	7,840 sq ft

HVAC System

Heating	One Jackson-Church forced-air, oil-burning unit (750,000 Btu/hr)

Air Handling Units	None
Fuel Tank	1,000 gallon fuel tank

Water and Sewer

Water Service	Not connected
Sewer Service	Not connected
Connections	Sinks: 0 Toilets: 0 Urinals: 0 Showers: 0 Water Cooler: 0 One line with two instruments
Water Heater	None

Electrical Service

Service Feeder	Feeder A
Electrical Service	208/120V, 3PH, 200A, Class I, Division 1 interior electrical (except furnace room)
Phone and LAN	One line with two instruments

Fire System

Fire Panel Type	King-Fisher KFRTI-52 industrial radio and control system (IRACS) panel, heat detectors, pull stations, alarm horns
Heat Detectors	Located throughout building
Suppression Type	Ansul SPA-50 total-flood dry chemical suppression system provided throughout first and second floors. Automatic dry-chemical fire extinguisher located over furnace.

Floorplans

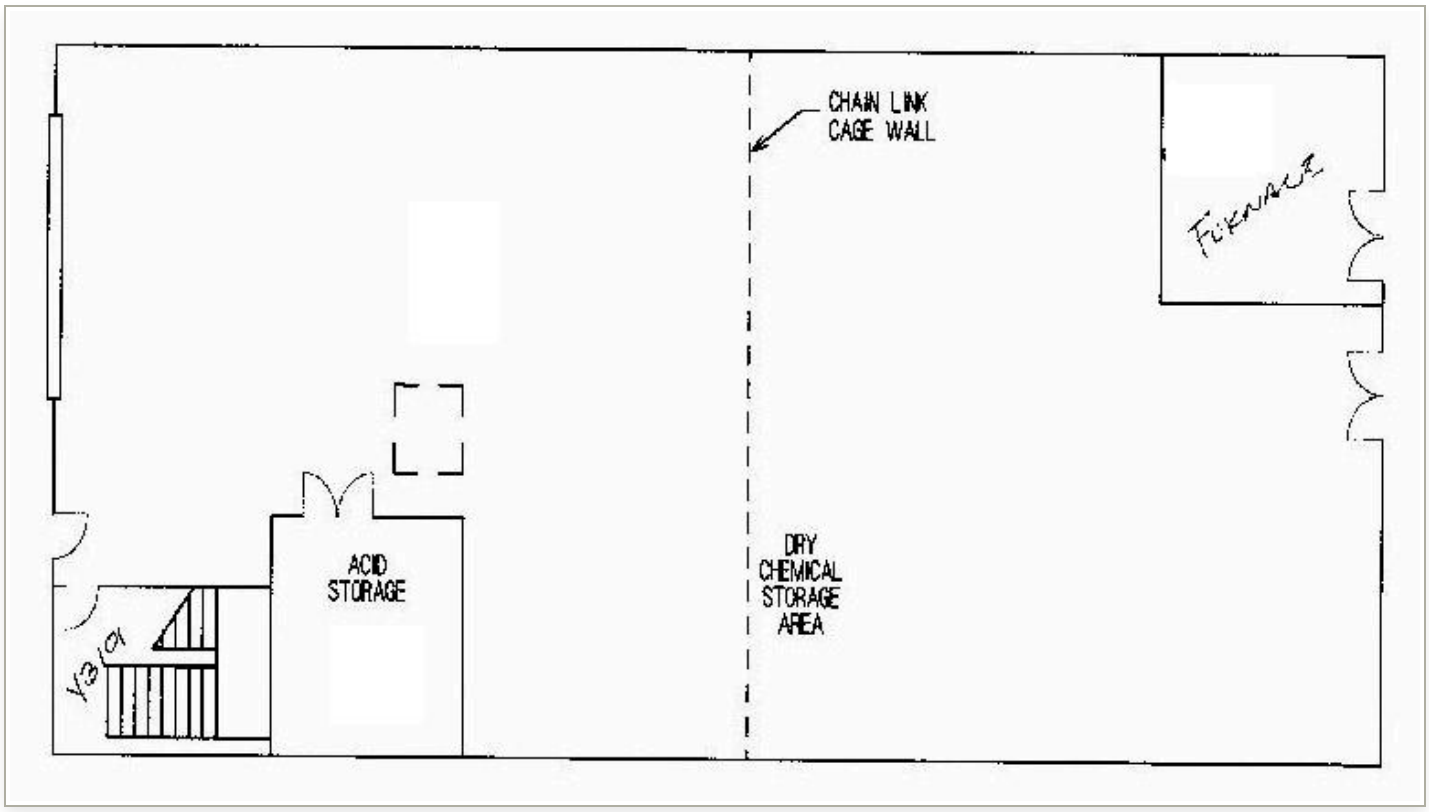


Figure 1: *Flammable Storage*

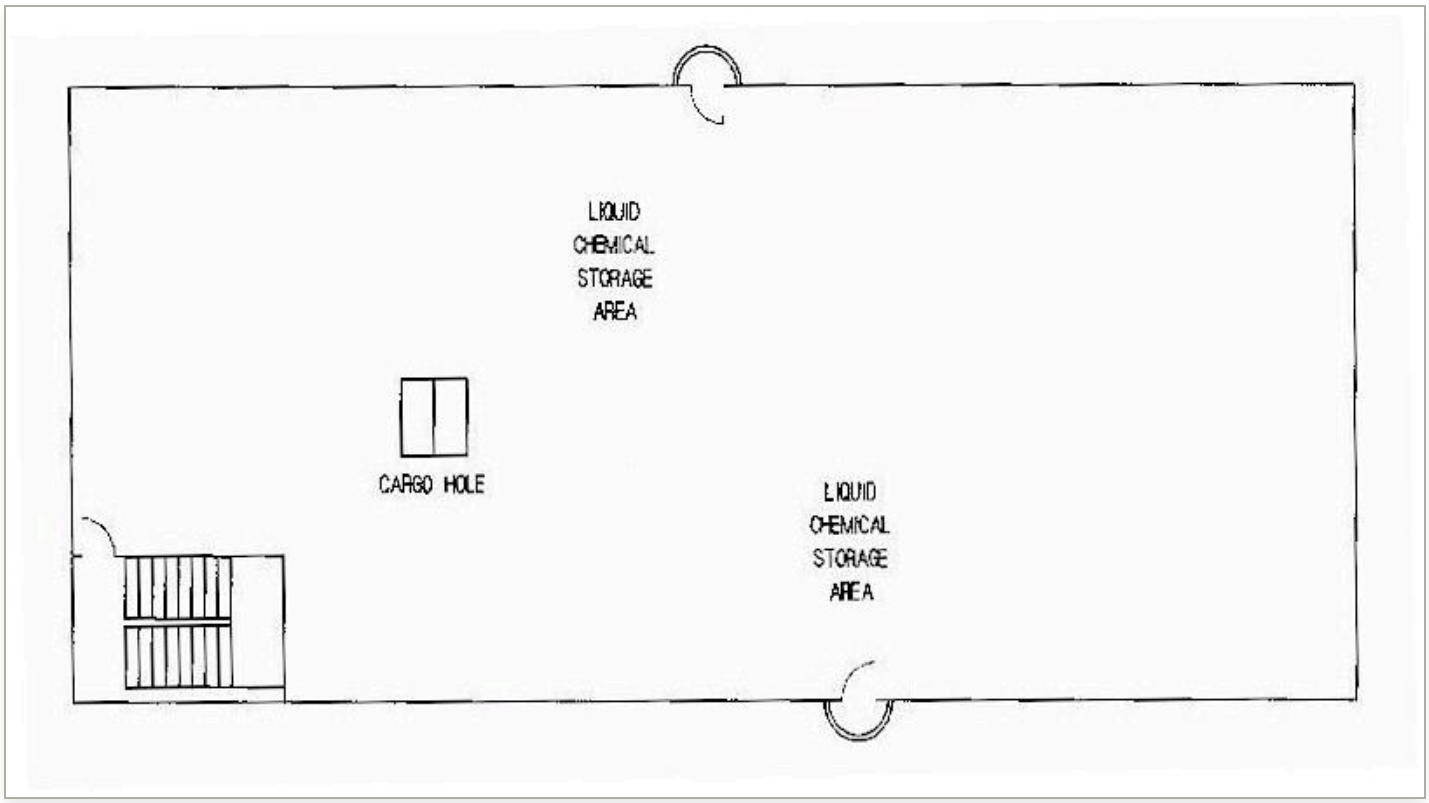


Figure 2: *Flammable Storage*