McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

Dry Foods Storage

Location ID: B176

This building is used for the storage of dry food items not requiring heat.



Photo 1: *Dry Foods Storage*

General Structure Information

Usage	Dry Foods Storage, Unheated Warehouse
Occupancy Group	B-2 Cold Storage
Maximum Occupancy	15
Construction Type	Type V, 1-Hour, combustible; two-story prefabricated, steel-framed structure with insulated metal siding and roofing, enclosed stairway, no other interior partitions.
Year Constructed	1970
Dimensions	40' x 98'

Floor Area

Floor	Area
Floor 1	3,920 sq ft
Floor 2	3,920 sq ft
Total	7,840 sq ft

HVAC System

Heating	None

Air Handling Units	None
Fuel Tank	None

Water and Sewer

Water Service	Not connected
Sewer Service	Not connected
Connections	Sinks: 0 Toilets: 0 Urinals: 0 Showers: 0 Water Cooler: 0 None
Water Heater	None

Electrical Service

Service Feeder	Feeder A
Electrical Service	208/120V, 3PH
Phone and LAN	None

Fire System

Fire Panel Type	King-Fisher KFRTI-52 industrial radio and control system (IRACS) panel, heat detectors, pull stations, alarm horns
Heat Detectors	1st and 2nd floors

Floorplans

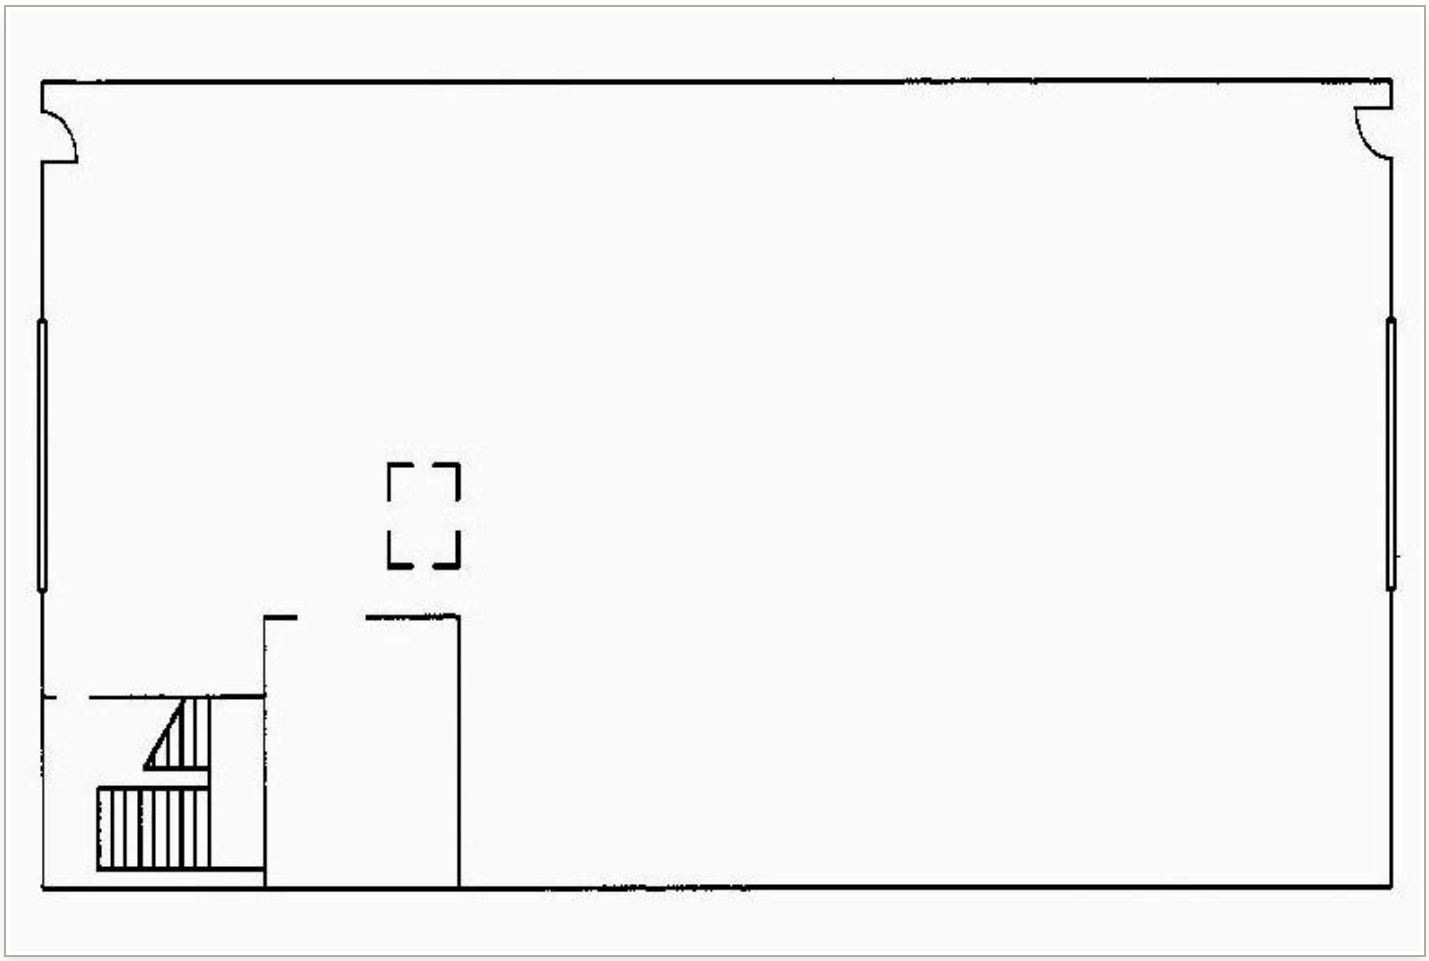


Figure 1: *Dry Foods Storage*

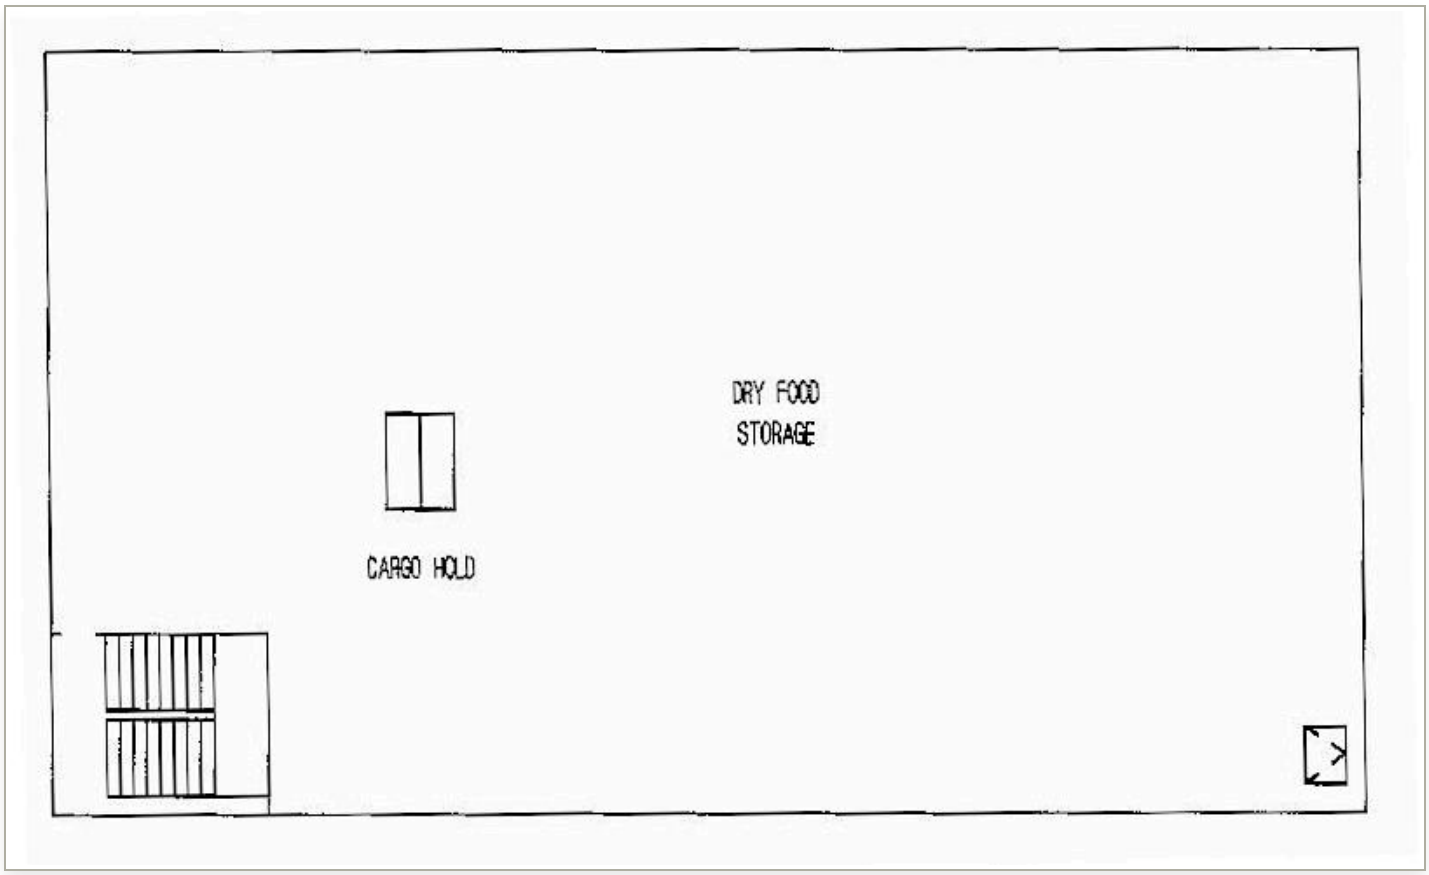


Figure 2: *Dry Foods Storage*