McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

Paint Barn - Storage

Location ID: B177

Used for small-quantity paint storage and painting work. Serves as Facilities Maintenance and Construction painting work center. Building is a single-room T-5 with a smaller shed-roof T-5 attached.

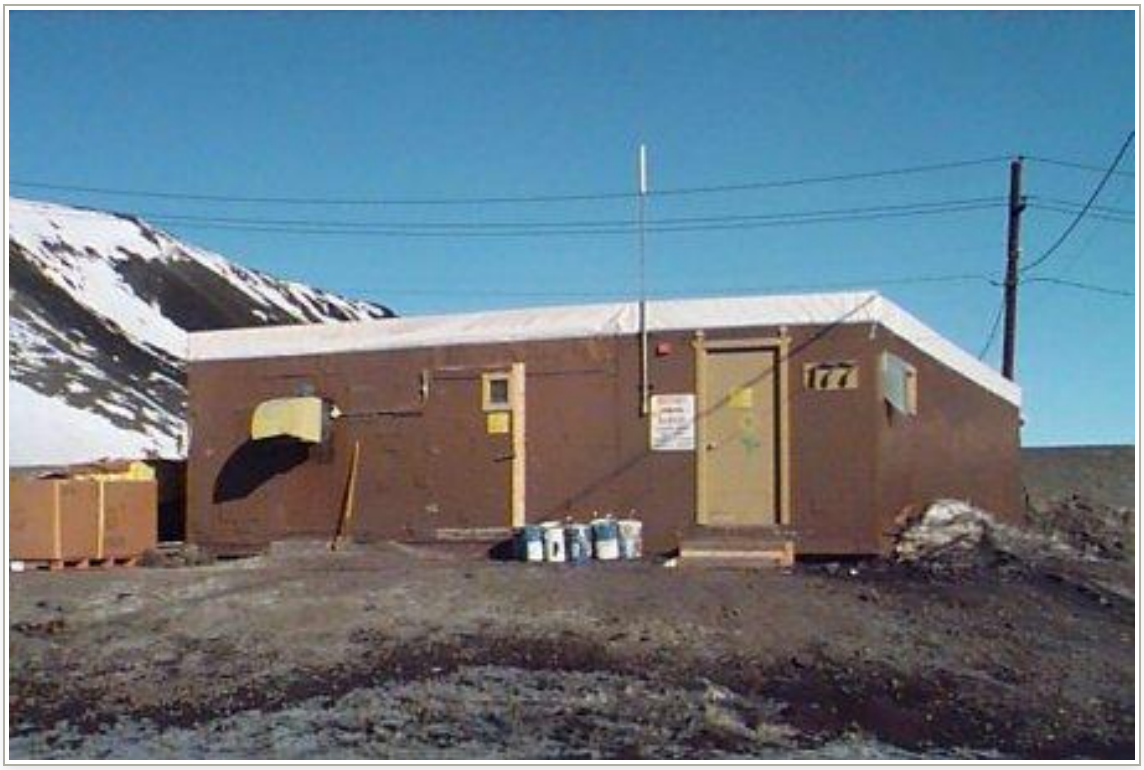


Photo 1: *Paint Barn - Storage*

General Structure Information

Usage	Painting Work Center (the Paint Barn)
Occupancy Group	H-2 Hazardous and B-2 Storage of Exempt Amount of Flammable and Combustible Liquids
Maximum Occupancy	7
Construction Type	Type V, N, combustible; single-story, T-5 insulated plywood panel structure.
Year Constructed	1970
Dimensions	40' x 98'

Floor Area

Floor	Area
Floor 1	3,920 sq ft
Floor 2	3,920 sq ft
Total	7,840 sq ft

HVAC System

Heating	One forced-air Lennox (168,000 Btu/hr), seven 3 kW Chromolax explosion-proof heaters
Air Handling Units	None

Fuel Tank	100 gallon fuel tank

Water and Sewer

Water Service	Not connected
Sewer Service	Not connected
Connections	Sinks: 0 Toilets: 0 Urinals: 0 Showers: 0 Water Cooler: 0 None
Water Heater	None

Electrical Service

Service Feeder	Feeder A
Electrical Service	208/120V, 3PH, 225A
Phone and LAN	None

Fire System

Fire Panel Type	King-Fisher KFRTI-52 industrial radio and control system (IRACS) panel, heat detectors, pull stations, alarm horns
Suppression Type	Automatic dry-chemical fire extinguisher over furnace Ansul SPA-50 total-flood dry chemical suppression system throughout first and second floors

Floorplans

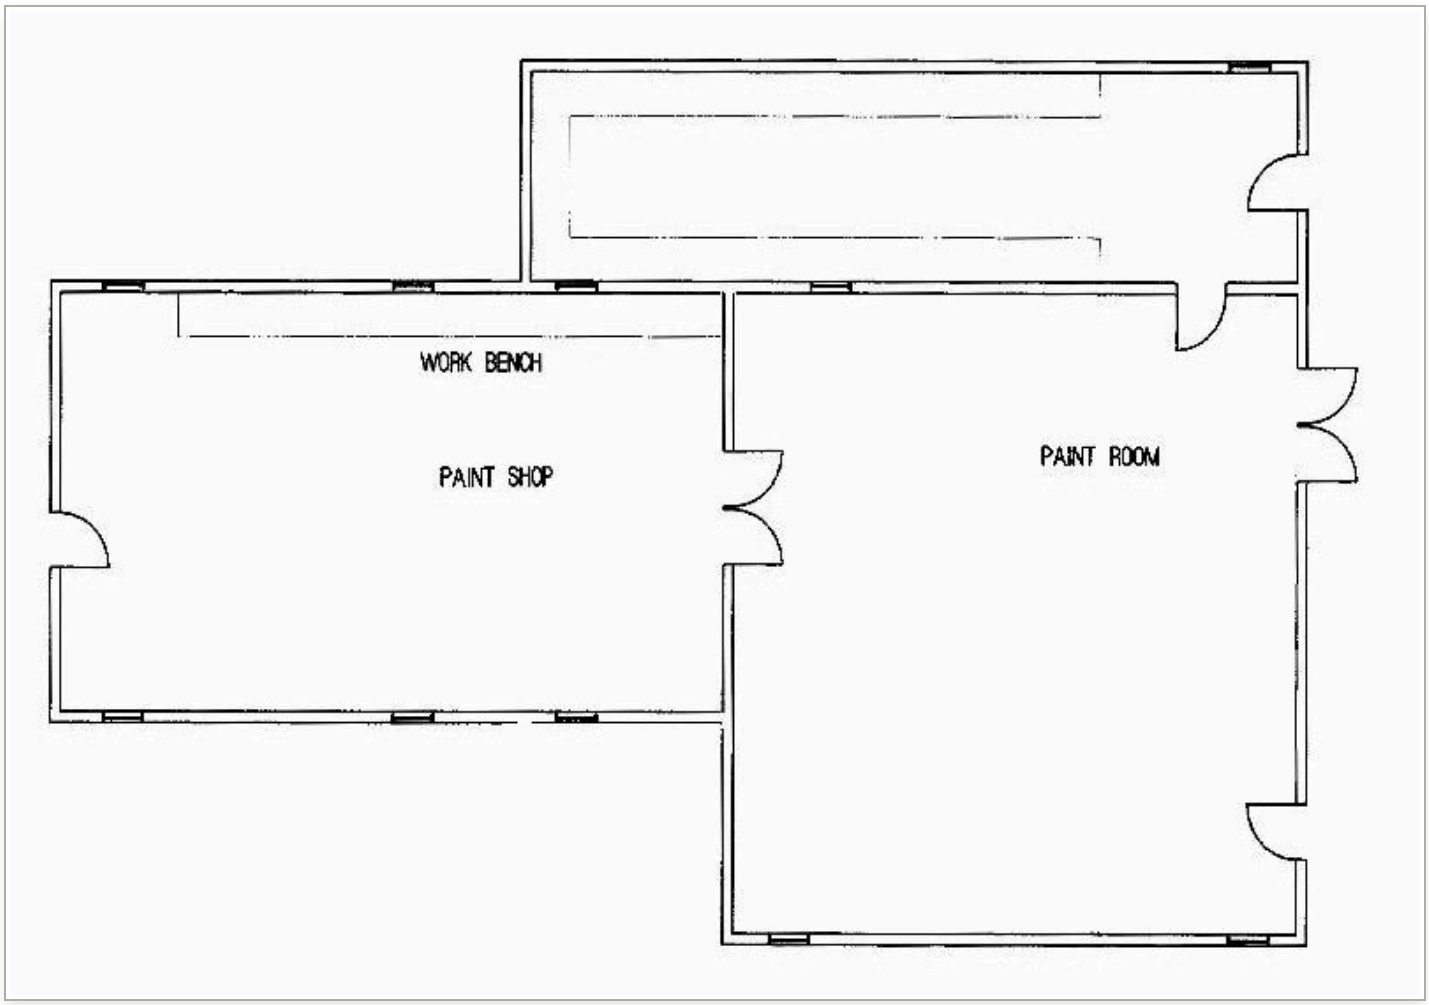


Figure 1: *Paint Barn - Storage*