McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

Seawater Intake

Location ID: B179

Single-story, single-room building used as a shelter over a seawater intake well. The building is located at the end of a man-made earthen jetty extending approximately 150 feet into McMurdo Sound from the shoreline. The building also houses two submersible seawater pumps for the Building 001, Phase III, aquarium and two pumps for the Building 187, the old aquarium.



Photo 1: *Seawater Intake*

General Structure Information

Usage	Seawater Intake Building
Occupancy Group	B-4 Pumping Plant
Maximum Occupancy	1
Construction Type	Type II, 1-hour, non-combustible; steel-framed structure with foam insulated metal sandwich panel siding and roofing. Precast concrete slab floor, no interior partitions.
Year Constructed	1993
Dimensions	8' x 10'

Floor Area

Floor	Area
Floor 1	80 sq ft
Total	80 sq ft

HVAC System

Heating	One Lennox forced-air, oil-burning unit (55,000 Btu/hr)
Air Handling Units	None

Fuel Tank	300 gallon fuel tank with containment

Water and Sewer

Water Service	Not connected
Sewer Service	Not connected
Connections	Sinks: 0 Toilets: 0 Urinals: 0 Showers: 0 Water Cooler: 0 Not connected
Water Heater	None

Electrical Service

Service Feeder	Feeder C
Electrical Service	208/120V, 3PH, 60A main
Phone and LAN	Not connected

Fire System

Fire Panel Type	Heat detector, pull station, alarm horn, connected to King-Fisher KFRTI-20 industrial radio and control system (IRACS) panel in Building 124.

Floorplans

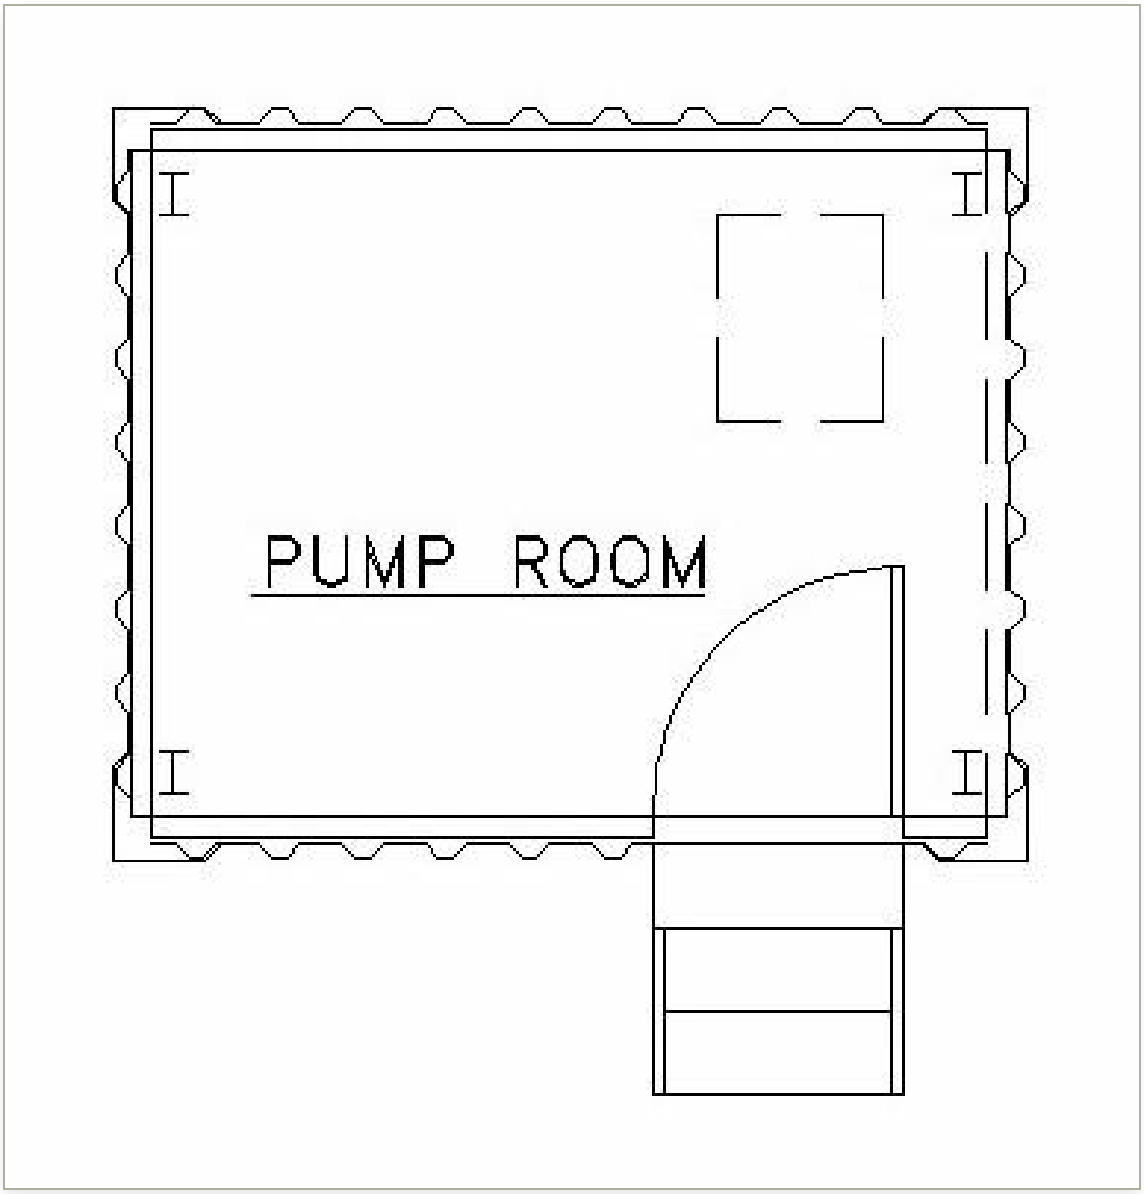


Figure 1: *Seawater Intake*