## McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

# Sewage Masticator

## Location ID: B181

Single-story building used to house two 12-inch sewage masticators. Occasionally serves as a temporary dive locker.



***Photo 1:*** *Sewage Masticator*

# General Structure Information

| | |
|---|---|
| **Usage** | Sewage Masticator |
| **Occupancy Group** | B-4 Pump House |
| **Maximum Occupancy** | 2 |
| **Construction Type** | Type V, N, combustible; steel-framed structure with foam insulated metal sandwich panel siding and roofing. Steel-framed<br>plywood floor. No interior partitions. |
| **Year Constructed** | 1989 |
| **Dimensions** | 30' x 24' |
| **Floor Area** | |

| Floor | Area |
|---|---|
| Floor 1 | 720 sq ft |
| **Total** | 720 sq ft |

# HVAC System

| | |
|---|---|
| **Heating** | One Lennox forced-air, oil-burning unit (85,000 Btu/hr) |
| **Air Handling Units** | None |

| | |
|---|---|
| **Fuel Tank** | 300 gallon fuel tank |

## Water and Sewer

| | |
|---|---|
| **Water Service** | Not connected |
| **Sewer Service** | Not connected |
| **Connections** | Sinks: 0<br>Toilets: 0<br>Urinals: 0<br>Showers: 0<br>Water Cooler: 0<br>One line with one instrument |
| **Water Heater** | None |

## Electrical Service

| | |
|---|---|
| **Service Feeder** | Feeder F |
| **Electrical Service** | 208/120V, 3PH, 125A main |
| **Phone and LAN** | One line with one instrument |

# Fire System

| | |
|---|---|
| **Fire Panel Type** | King-Fisher KFRTI-20 industrial radio and control system (IRACS) panel, heat/smoke detectors, pull station, alarm horn |
| **Suppression Type** | None |

# Floorplans

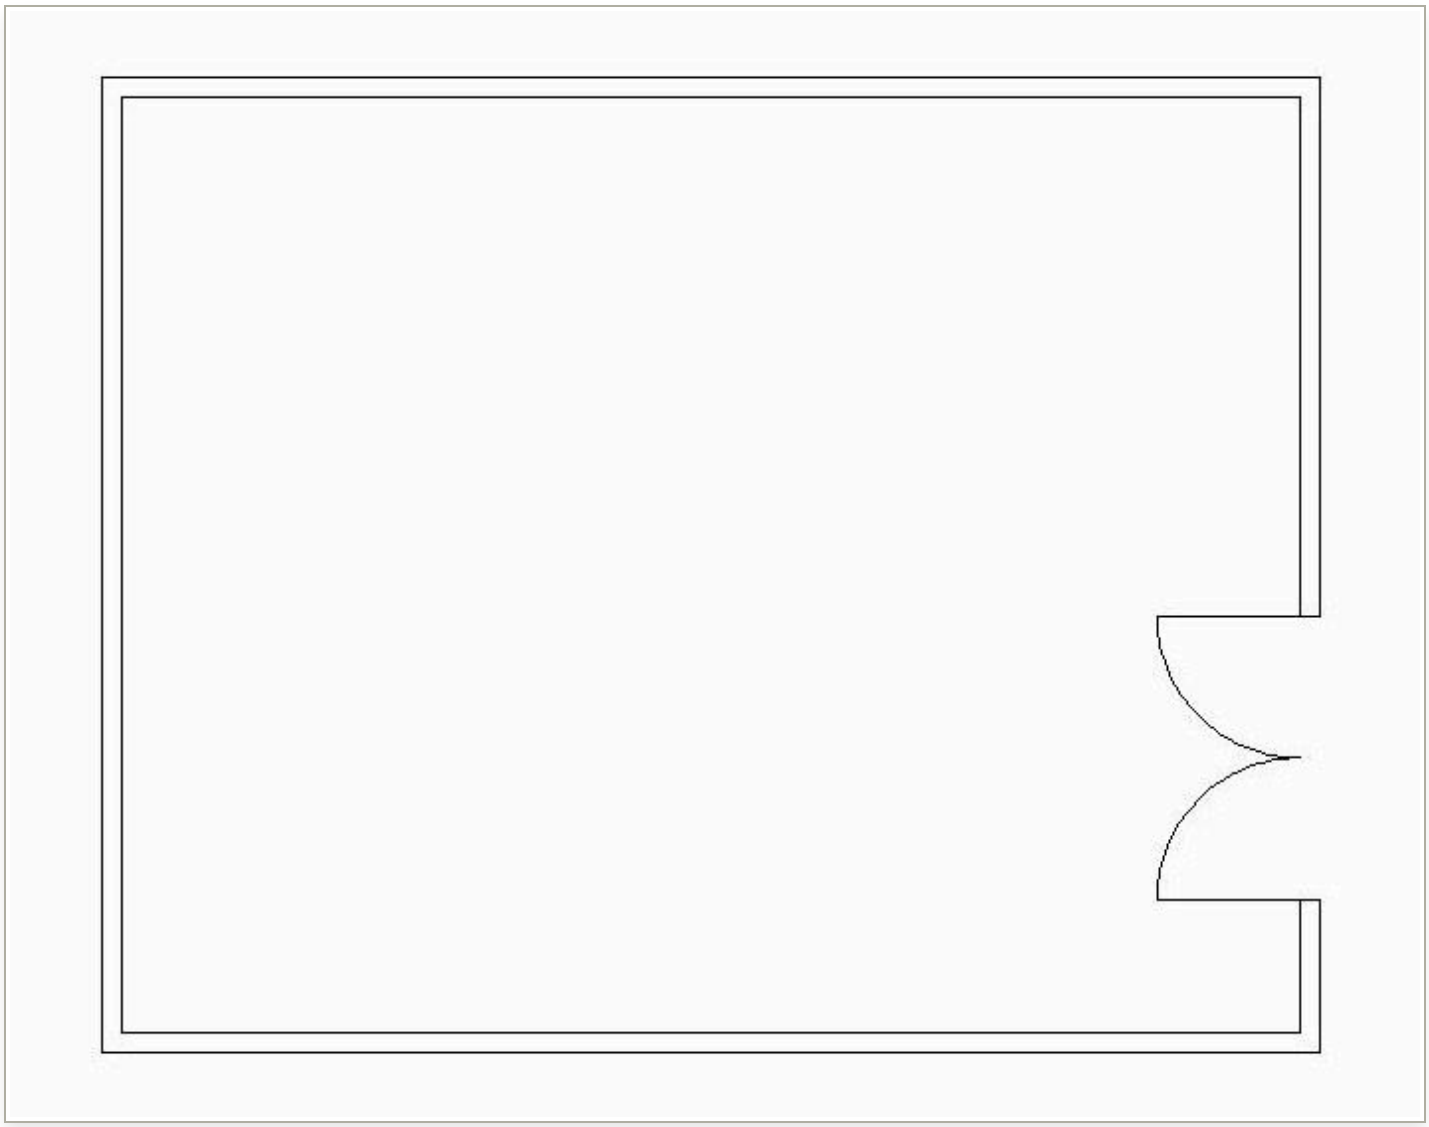


***Figure 1:*** *Sewage Masticator*