McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

Waste Management

Location ID: B185

Single-story arch building used as a waste management sorting and processing facility.



Photo 1: *Waste Management*

General Structure Information

Usage	Waste Management Work Center
Occupancy Group	B-2 Work shop
Maximum Occupancy	15
Construction Type	Type V, N, combustible; prefabricated metal arch with fiberglass batt insulation with diamond plate, wood-framed plywood end walls, wood-framed plywood floor, and no interior partitions.
Year Constructed	1973
Dimensions	42' x 73'

Floor Area

Floor	Area
Floor 1	3,066 sq ft
Total	3,066 sq ft

HVAC System

Heating	One Jackson-Church forced-air, oil-fired unit (250,000 Btu/hr)
Air Handling Units	None

Fuel Tank	Fuel tank #1: 300 gallon, Fuel tank #2: 500 gallon with containment

Water and Sewer

Water Service	Not connected
Sewer Service	Not connected
Connections	Sinks: 0 Toilets: 0 Urinals: 0 Showers: 0 Water Coolers: 0 One line with one instrument
Water Heater	None

Electrical Service

Service Feeder	Feeder A
Electrical Service	208/120V, 3PH, 225A
Phone and LAN	One line with one instrument

Fire System

Fire Panel Type	King-Fisher KFRTI-20 industrial radio and control system (IRACS) panel, heat detectors, pull station, alarm horns.
Heat Detectors	Located throughout building
Suppression Type	Automatic dry-chemical fire extinguisher located over furnace.

Floorplans

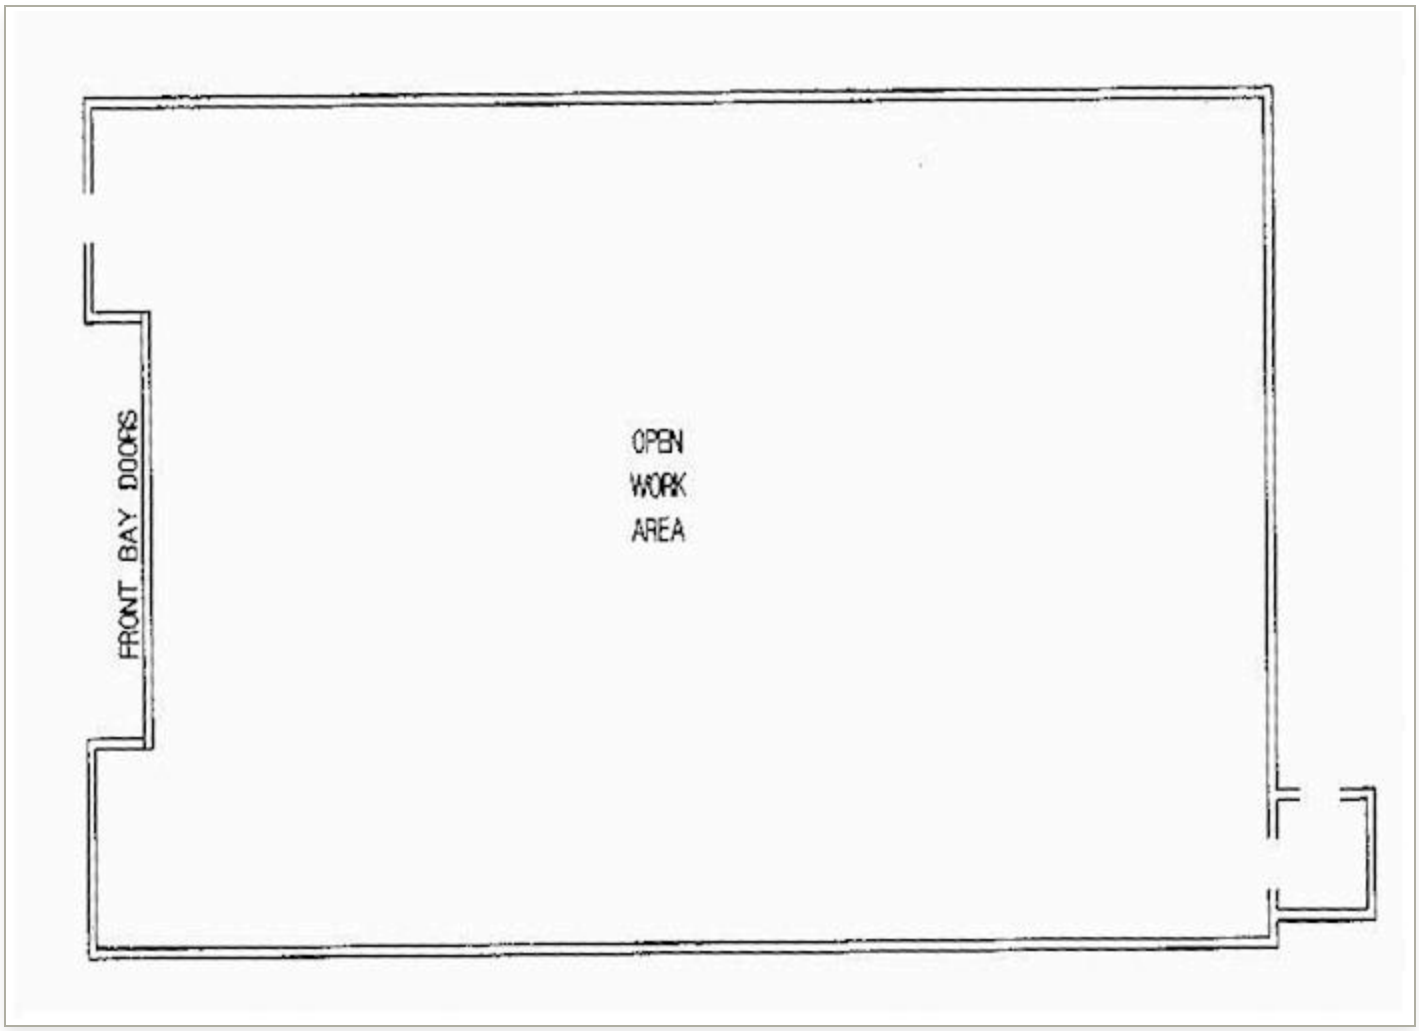


Figure 1: *Waste Management*