McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

Environmental Health and Saftey

Location ID: B192

Single-story building used as office space for the contractor's environmental, safety, QA, and waste handling personnel. Includes four office spaces, a furnace room and a storage room used for the off-season storage of runway lighting.



Photo 1: *Environmental Health and Saftey*

General Structure Information

Usage	Safety, Environment, and Health Administration Offices
Occupancy Group	B-2 Office
Maximum Occupancy	14
Construction Type	Type V, N, combustible; T-5 insulated plywood panel system walls and roof, wood-framed plywood floor. Wood-framed gypsum board interior partitions.
Year Constructed	1977
Dimensions	20' x 60'10' x 40'6' x 8' furnace room and 5' x 8' entry vestibule

Floor Area

Floor	Area
Floor 1	1,888 sq ft
Total	1,888 sq ft

HVAC System

Heating	One Lennox forced-air, oil-burning unit (125,000 Btu/hr)
Air Handling Units	None

Fuel Tank	300 gallon fuel tank

Water and Sewer

Water Service	Not connected
Sewer Service	Not connected
Connections	Sinks: 0 Toilets: 0 Urinals: 0 Showers: 0 Water Cooler: 0 One line with two instruments
Water Heater	None

Electrical Service

Service Feeder	Feeder A
Electrical Service	208/120V, 3PH, 100A main
Phone and LAN	One line with two instruments

Fire System

Fire Panel Type	King-Fisher KFRTI-20 industrial radio and control system (IRACS) panel, heat detectors, pull stations, alarm horns
Suppression Type	Automatic dry chemical fire extinguisher located over furnace.

Floorplans

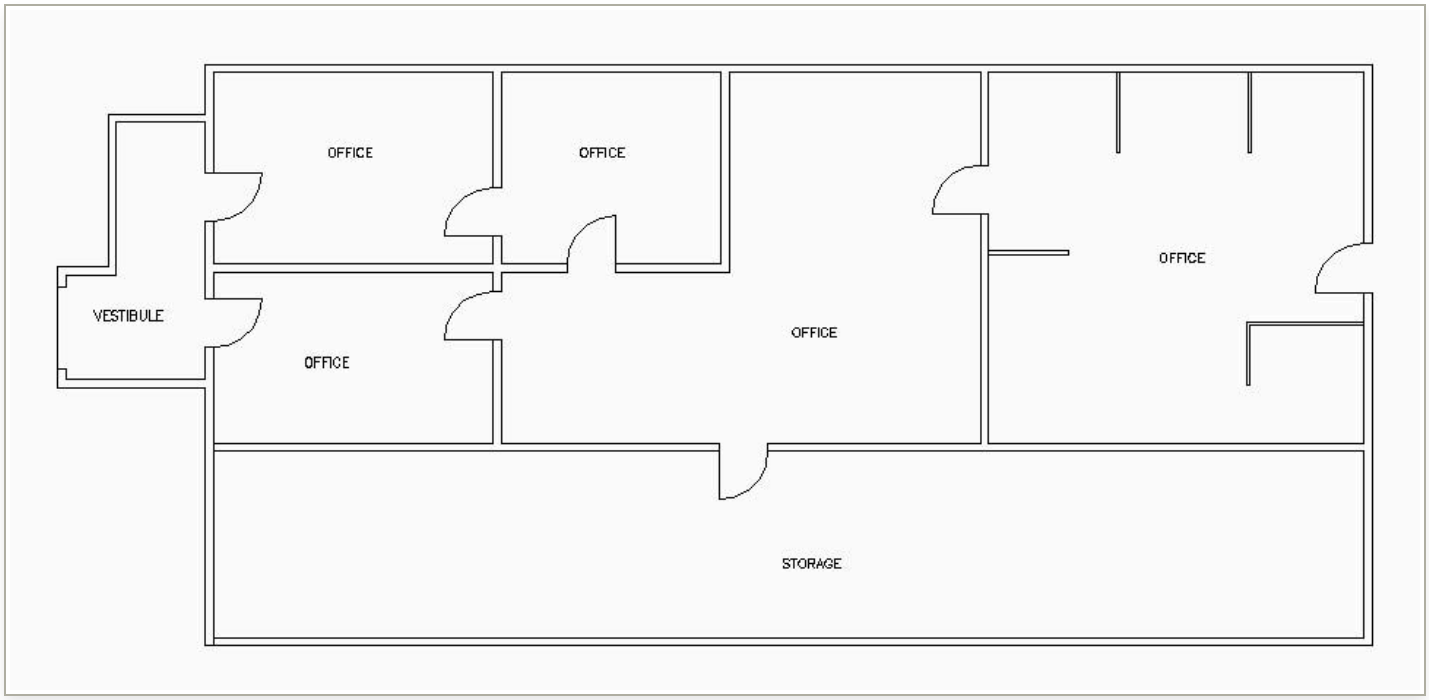


Figure 1: *Environmental Health and Saftey*