McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

Dorm

Location ID: B202

Two-story personnel dormitory housing up to 54 persons. The first floor inlcudes 11 two-person rooms, an entry foyer, a mechanical room, two storage rooms, two communal bathrooms, and a lounge. The second floor includes 16 two-person rooms, two bathrooms, and a laundry room.



Photo 1: *Dorm*

General Structure Information

Usage	Dormitory
Occupancy Group	R-1 Dormitory
Maximum Occupancy	98
Construction Type	Type V, N, combustible; two-story, wood-framed exterior walls and roof with 5-1/2" fiberglass insulation, foam-backed aluminum siding and cedar shake roofing. Wood-framed gypsum board interior partitions.
Year Constructed	1980
Dimensions	39' x 109'

Floor Area

Floor	Area
Floor 1	4,251 sq ft
Floor 2	4,251 sq ft
Total	8,502 sq ft

HVAC System

Heating	One Kewanee oil-fired glycol boiler (1,350,000 Btu/hr) with glycol baseboard heaters

Air Handling Units	Two central station air handlers supplying tempered fresh air at 60 degrees F with ducted return air.
Fuel Tank	Dorm 202 is tied into the 900 gallon fuel tank for Dorm 201.

Water and Sewer

Water Service	2" stub off the 4" main
Sewer Service	4" stub off the 6" main
Connections	Sinks: 17 Toilets: 8 Urinals: 2 Showers: Water Cooler: Washing Machines: Two lines with two instruments
Water Heater	120 gallon electric water heater located in 1st floor closet.

Electrical Service

Service Feeder	Feeder A
Electrical Service	208/120V, 3PH, 225A main breaker

Phone and LAN	Two lines with two instruments

Fire System

Fire Panel Type	Pyrotronics System 3 control panel, King-Fisher KFRTI-WP-8 radio interface/transmitter panel, pull stations, alarm horns. Panels located in front entryway.
Heat Detectors	Halls, bathrooms, boiler room
Suppression Type	Pre-action sprinkler system connected to Firetrol pump and resevoir in Building 151 and equipped with Star, 3-inch, model D, electromagnetic deluge valve with air pressure supervision. Deluge valve releases upon low air pressure and heat detector actuation. Firetrol pump starts on water pressure loss in main trunk line to dorms.

Floorplans

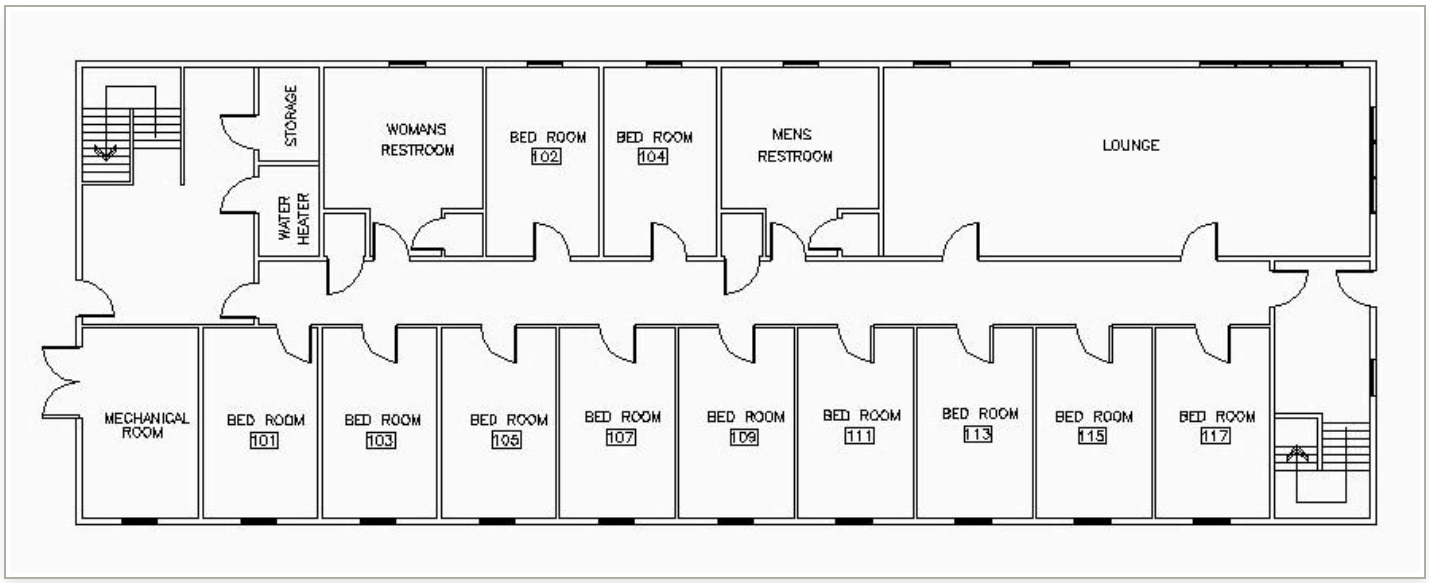


Figure 1: *Dorm*

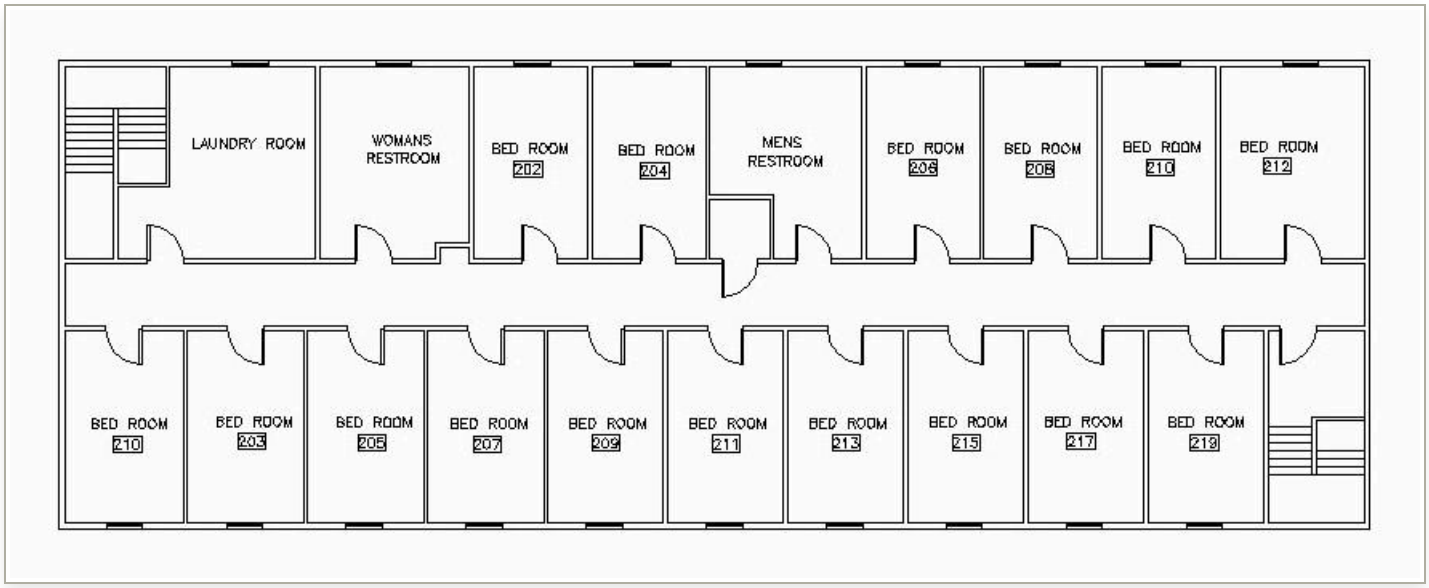


Figure 2: *Dorm*