McMurdo Station, Ross Island

BUILDING INFORMATION SHEET

Unheated Storage; 341A - Cold Storage Annex

Location ID: B341

Single-story unheated warehouse currently used for the storage of piping and pipe insulation. It has a large cargo door at one end and personnel doors at both ends.



Photo 1: *Unheated Storage; 341A - Cold Storage Annex*

General Structure Information

Usage	Unheated Warehouse
Occupancy Group	B-2 Storage
Maximum Occupancy	8
Construction Type	Type II, N, non-combustible; steel-framed structure with uninsulated metal siding and roofing. No interior partitions.
Year Constructed	1982-83
Dimensions	40' x 100'

Floor Area

Floor	Area
Floor 1	4,000 sq ft
Total	4,000 sq ft

HVAC System

Heating	None
Air Handling Units	None

Fuel Tank	None

Water and Sewer

Water Service	Not connected
Sewer Service	Not connected
Connections	Sinks: 0 Toilets: 0 Urinals: 0 Showers: 0 Water Cooler: 0 Not connected

Electrical Service

Service Feeder	Feeder D
Electrical Service	120V, 1PH, 100A main breaker, fed from Building 340
Phone and LAN	Not connected

Fire System

Fire Panel Type	No fire system
Suppression Type	None

Floorplans

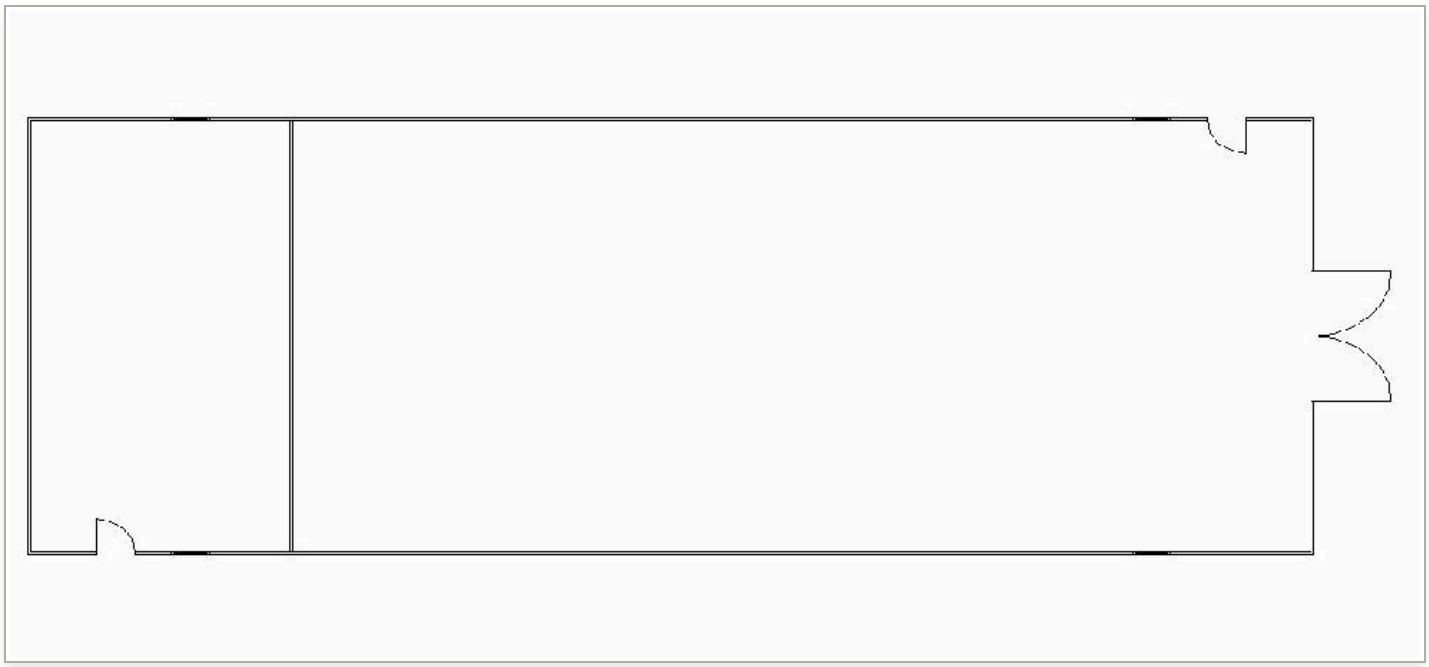


Figure 1: *Unheated Storage; 341A - Cold Storage Annex*



Figure 2: *Unheated Storage; 341A - Cold Storage Annex*