
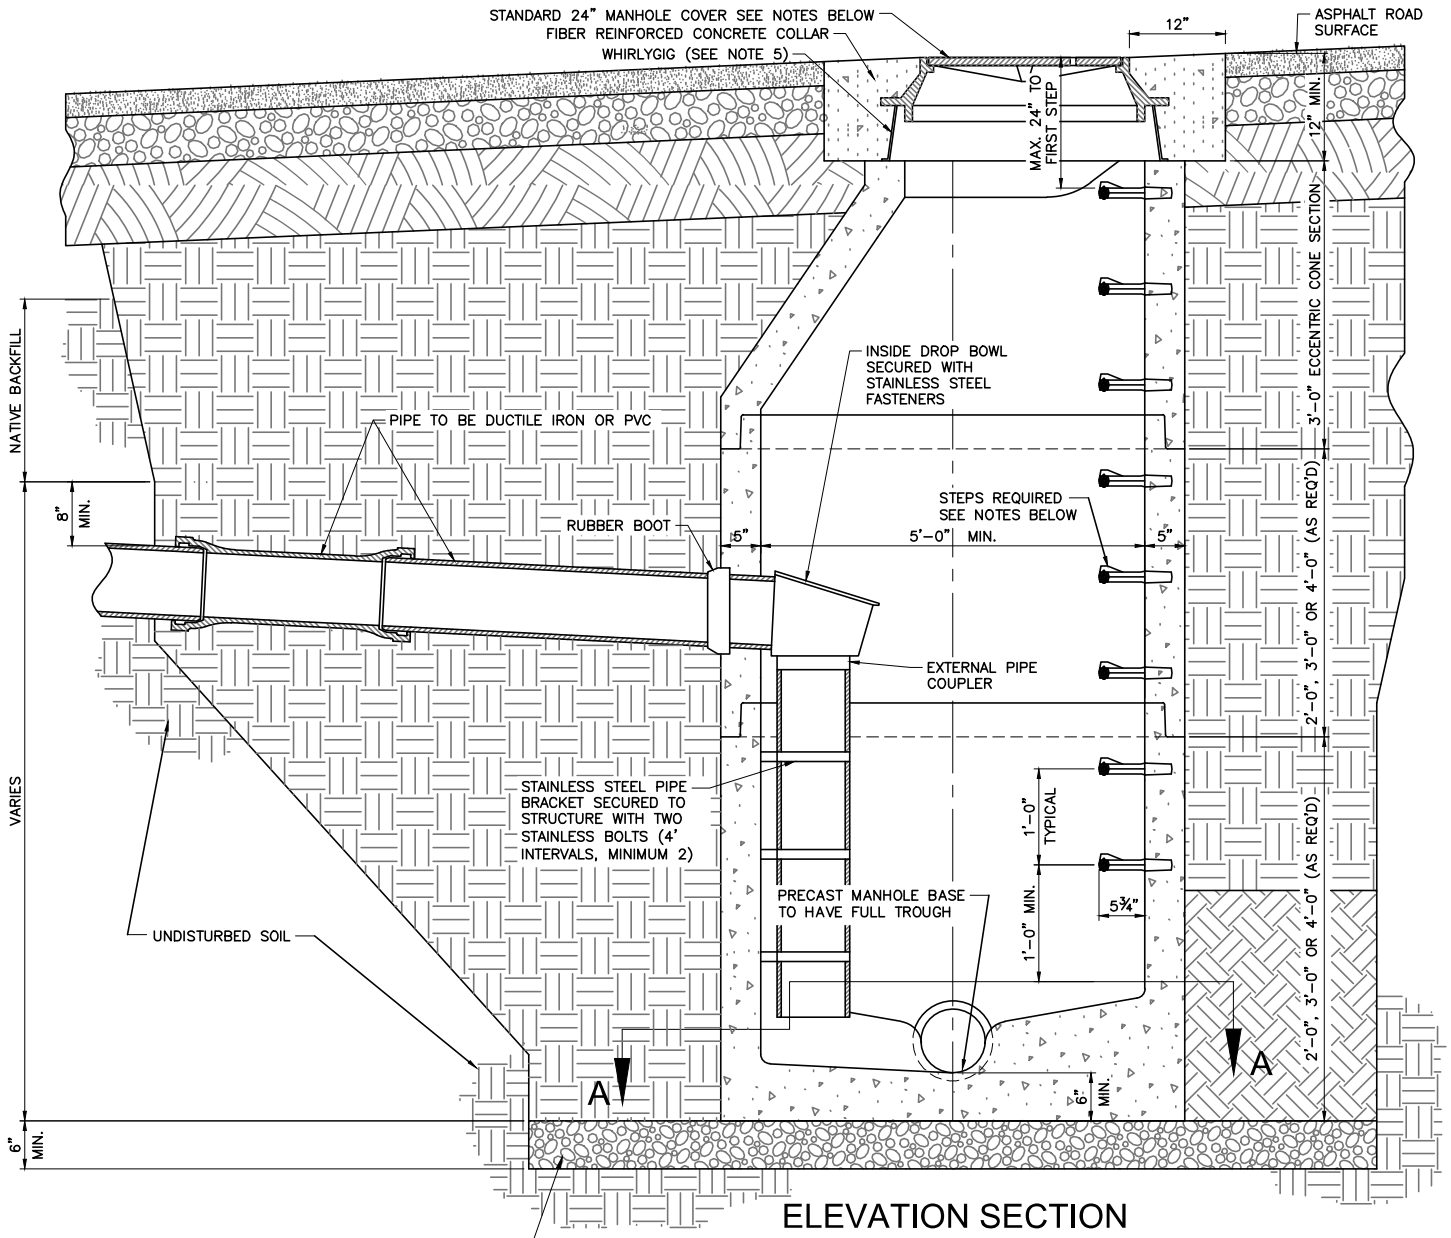


ELEVATION SECTION

1½" MINUS MIN. GRAVEL FOUNDATION OUTSIDE SHAPE MAY BE IRREGULAR. MAXIMUM THICKNESS WILL DEPEND ON SPECIFIC SITE CONDITIONS.

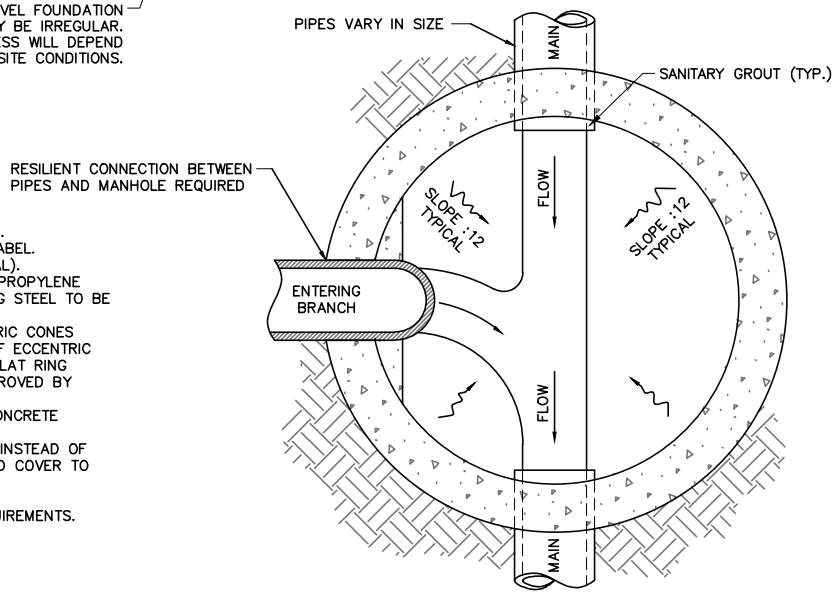

SECTION A-A

NOTES:
1. MANHOLE COVER TO CONTAIN ONE PICK HOLE. SEE SPECIFICATION DIVISION 5 FOR COVER LABEL. D&L SUPPLY P/N A-1180 VENTED (OR EQUAL).
2. STEPS SHALL BE MADE OF COPOLYMER POLYPROPYLENE CONFORMING TO ASTM D-4101. REINFORCING STEEL TO BE DEFORMED ½" DIAMETER GRADE 60 ROD.
3. FLAT LIDS MAY BE USED IN LIEU OF ECCENTRIC CONES WHERE NECESSARY. FLAT LIDS SHALL BE OF ECCENTRIC DESIGN AND MEET H20 LIVE LOADING. NO FLAT RING AND COVERS WILL BE ALLOWED UNLESS APPROVED BY PUBLIC WORKS.
4. USE FERNCO COUPLING TO TRANSITION TO CONCRETE OR PVC PIPE AS APPROPRIATE.
5. WHIRLYGIG RISER OR EQUAL SHALL BE USED INSTEAD OF GRADE RINGS TO ADJUST MANHOLE RING AND COVER TO GRADE.
6. 18" MAXIMUM RISER HEIGHT.
7. REFER TO DESIGN CRITERIA FOR INVERT REQUIREMENTS.

STATEMENT OF USE

THIS DOCUMENT AND ANY ILLUSTRATIONS HEREON ARE PROVIDED AS STANDARD CONSTRUCTION DETAILS WITHIN THE TOWN OF VINEYARD. DEVEATION FROM THIS DOCUMENT REQUIRES APPROVAL FROM THE TOWN OF VINEYARD. THE TOWN OF VINEYARD CORPORATION CAN NOT BE HELD LIABLE FOR MISUSE OR CHANGES REGARDING THIS DOCUMENT.

REVISION

NO.	DESCRIPTION	BY	APR.	DATE
1	STANDARDS UPDATE	JMM	DEO	8/08/16
2	HANSEN, ALLEN & LUCE	DCL	CMT	9/12/25
3				
4				

VINEYARD
STAY CONNECTED

TYPICAL SEWER DROP MANHOLE

VINEYARD

STANDARD DRAWING NUMBER:	21
CAD DWG:	STANDARD DRAWINGS
PLOT SCALE:	1.000
DRAWN BY:	JMM
DESIGN BY:	CRW
CHECKED BY:	DEO
ADOPTED DATE:	SEPTEMBER 1, 2016