

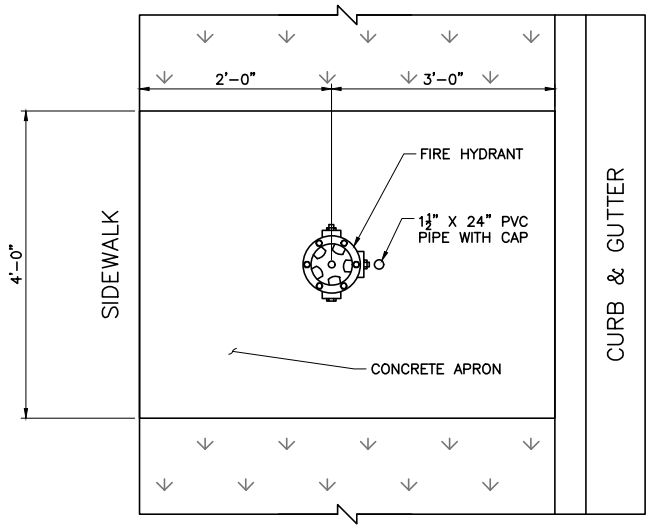


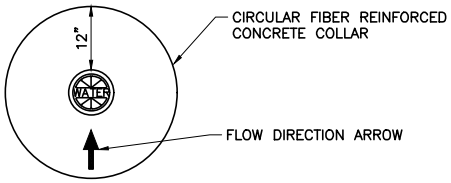

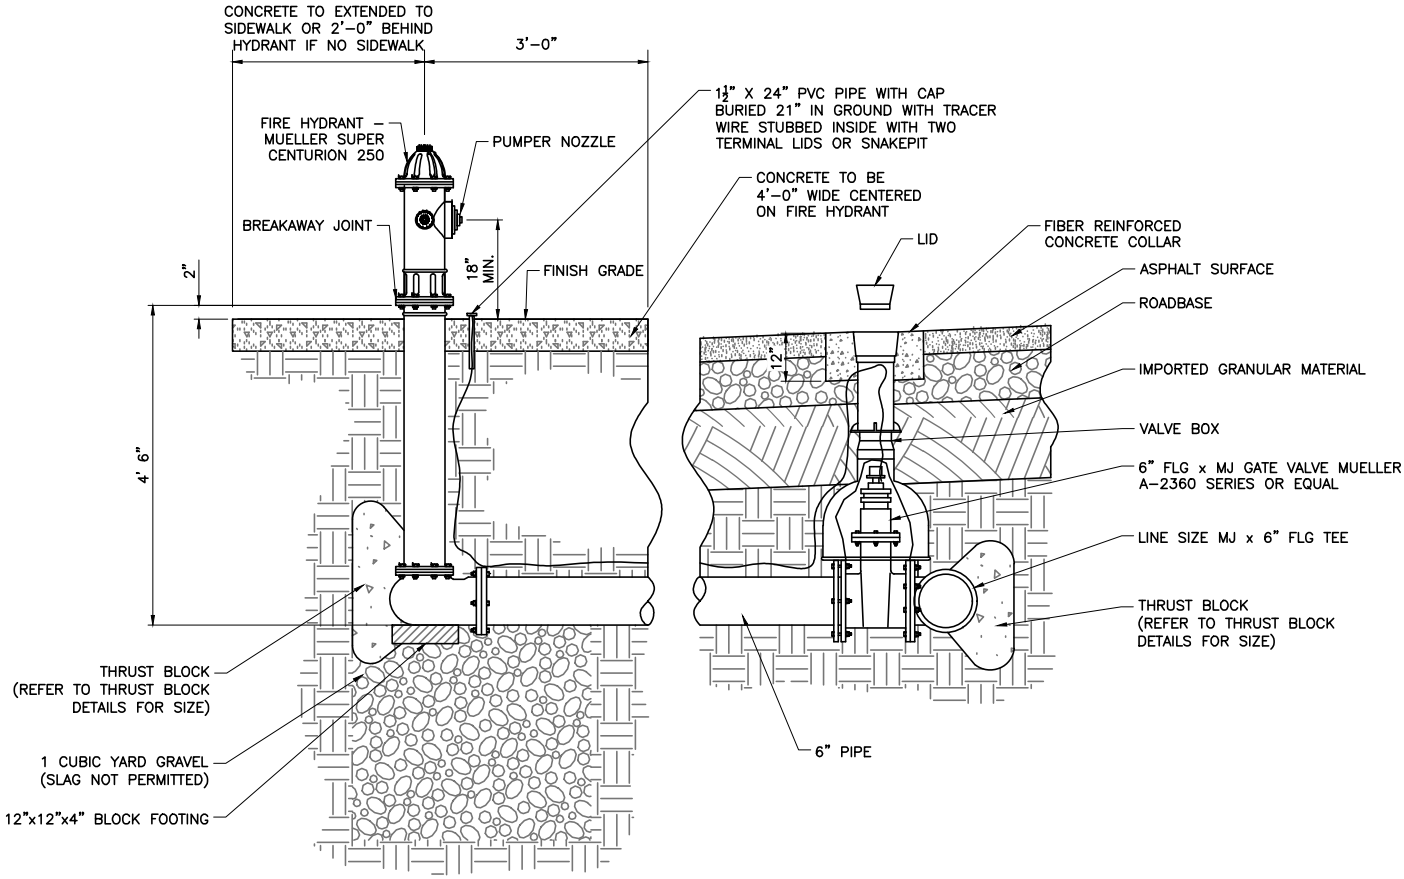

FIRE HYDRANT & WATER VALVE

NOTES:

1. BOLTS: APPLY ONE (1) COAT OF FM2 GREASE (FOOD GRADE) TO ALL EXPOSED SURFACES OF BOLTS AND TO ALL BOLT THREADS AFTER INSTALLATION OF PIPING, FITTINGS, VALVES, AND COUPLINGS.

2. VALVES, FITTINGS, CONNECTIONS, ETC.: ENCASE ALL BURIED DUCTILE IRON VALVES, FITTINGS, CONNECTIONS AND SPECIALTIES IN MINIMUM 8 MIL. BLACK POLYETHYLENE SHEETS IN ACCORDANCE WITH AWWA C-105. SECURE POLYETHYLENE SHEETS TO THE PIPE AS SPECIFIED ABOVE.

3. DUCTILE IRON PIPE: ENCASE BURIED DUCTILE IRON PIPE IN MINIMUM 8 MIL. POLYETHYLENE SHEETS IN ACCORDANCE WITH AWWA C105 IN ALL AREAS AND SOIL TYPES AS SHOWN ON THE PROJECT PLANS OR AS SPECIFIED BY THE ENGINEER.

4. NO RISER KITS SHALL BE INSTALLED ABOVE FINISHED GRADE.

STATEMENT OF USE

THIS DOCUMENT AND ANY ILLUSTRATIONS HEREON ARE PROVIDED AS STANDARD CONSTRUCTION DETAILS WITHIN THE TOWN OF VINEYARD. DEVEATION FROM THIS DOCUMENT REQUIRES APPROVAL FROM THE TOWN OF VINEYARD. THE TOWN OF VINEYARD CORPORATION CAN NOT BE HELD LIABLE FOR MISUSE OR CHANGES REGARDING THIS DOCUMENT.

REVISION

NO.	DESCRIPTION	BY	APR.	DATE
1	STANDARDS UPDATE	JMM	DEO	8/08/16
2	HANSEN, ALLEN & LUCE	DCL	CMT	9/12/25
3				
4				

VINEYARD
STAY CONNECTED

FIRE HYDRANT AND WATER VALVE DETAIL

VINEYARD

STANDARD DRAWING NUMBER: 22

CAD DWG:	STANDARD DRAWINGS
PLOT SCALE:	1.000
DRAWN BY:	JMM
DESIGN BY:	CRW
CHECKED BY:	DEO
ADOPTED DATE:	SEPTEMBER 1, 2016