
LIST OF MATERIALS


ITEM	QTY	SIZE	DESCRIPTION
1	1	A x B	MJ x FE DUCTILE IRON REDUCER
2	1	B x AS REQ'D	FLG x FLG DUCTILE IRON SPOOL
3	2	B x B	FLG x FLG DUCTILE IRON TEE
4	3	B	FLG x FLG GATE VALVE
5	1	B	BADGERMETER FSAA-01 FIRE SERIES METER W/SIZE ON SIZE BYPASS
6	1	B	DRESSER FLANGED ADAPTER STYLE 128
7	2	C x AS REQ'D	FLG x PE DUCTILE IRON PIPE
8	1	B	FEBCO MODEL LF880V (UP TO 8") OR FEBCO MODEL LF860V (FOR 10") OR EQUAL
9	1	C	FEBCO SERIES 611 VALVE SETTERS MJ x FLG OR EQUAL
10	2	B x 12"	FLG x FLG DUCTILE IRON SPOOL
11	2	B	FLG x FLG DUCTILE IRON 90° ELBOW
12	1	B x AS REQ'D	FLG x PE DUCTILE IRON PIPE W/ ALL THREAD
13	1	A x C	MJ x FLG DUCTILE IRON REDUCER
14	1	B x C	MJ x FLG DUCTILE IRON REDUCER
15	2	A	FLG x MJ C900 FLANGE ADAPTOR
16	1	ENCLOSURE	SAFE-T-COVER MODEL # 1000LU880-AL (UP TO 8") (OR EQUAL) SAFE-T-COVER MODEL # 1000-AL (10") (OR EQUAL)
17	1	VAULT	PRECAST VAULT SIZE SHALL MEET MINIMUM CLEARANCE REQ'D
18	1	30"	MANHOLE RING & COVER D&L SUPPLY # A-1181 W/ 6" GRADE RING
19	1	HEATER	SAFE-T-COVER MODEL NO. HCH2000-120 (OR EQUAL)

NOTE: ALL DUCTILE IRON PIPE AND FITTINGS TO BE POLYWRAPPED.


"A" = MAIN LINE SIZE.
"B" = REQ'D METER SIZE.
"C" = SIZE BACKFLOW ASSEMBLY TO MATCH METER FLOW (CFS).

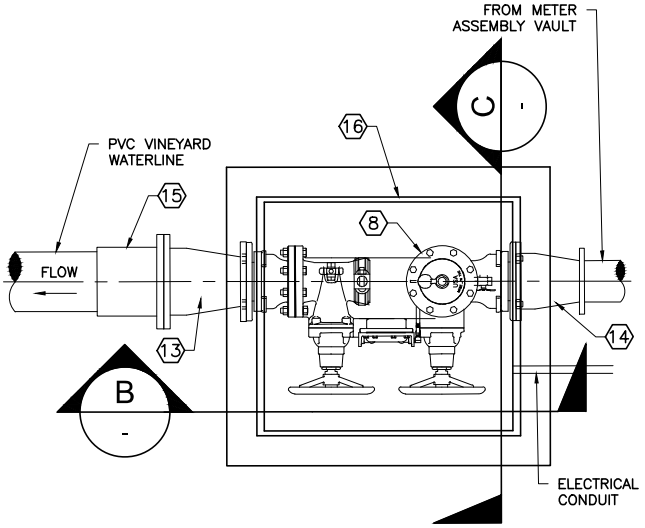

BACKFLOW PREVENTION ASSEMBLY ENCLOSURES

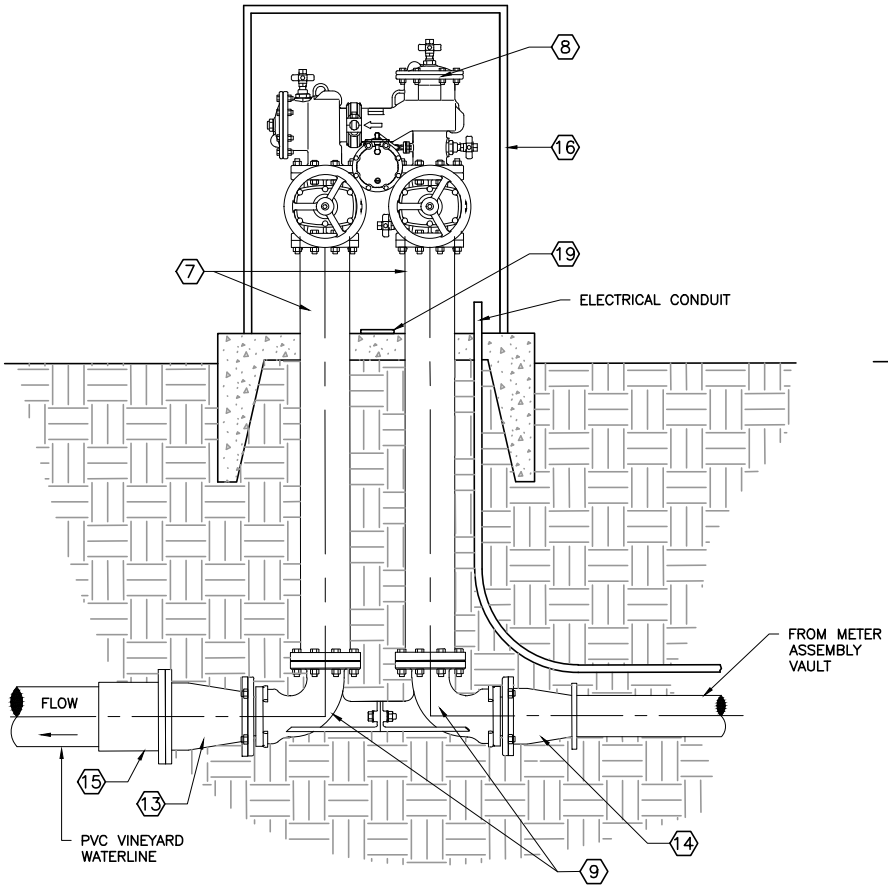

SECTION B-B

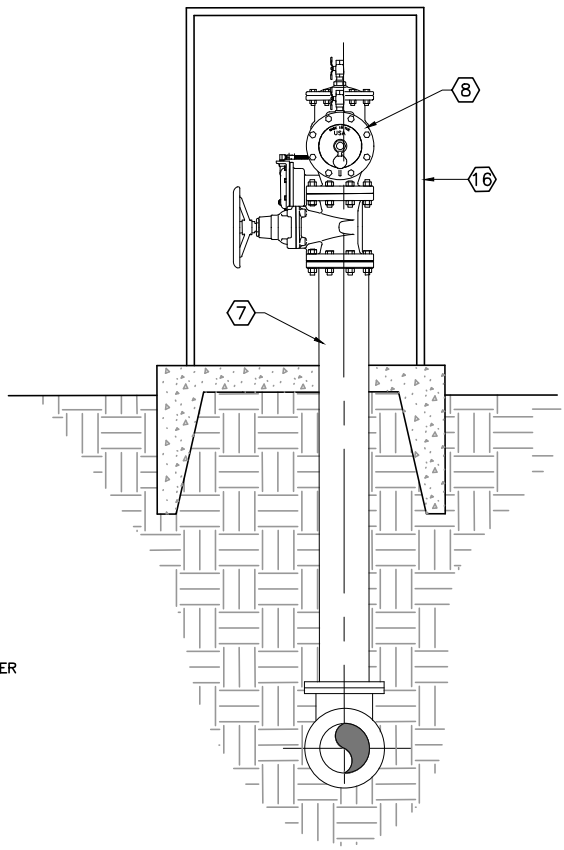

SECTION C-C

STATEMENT OF USE

THIS DOCUMENT AND ANY ILLUSTRATIONS HEREON ARE PROVIDED AS STANDARD CONSTRUCTION DETAILS WITHIN THE TOWN OF VINEYARD. DEVEATION FROM THIS DOCUMENT REQUIRES APPROVAL FROM THE TOWN OF VINEYARD. THE TOWN OF VINEYARD CORPORATION CAN NOT BE HELD LIABLE FOR MISUSE OR CHANGES REGARDING THIS DOCUMENT.

REVISION

NO.	DESCRIPTION	BY	APR.	DATE
1	STANDARDS UPDATE	JMM	DEO	6/08/16
2	HANSEN, ALLEN & LUCE	DCL	CMT	9/12/25
3				
4				

VINEYARD
STAY CONNECTED

BACKFLOW PREVENTION ASSEMBLY

VINEYARD

STANDARD DRAWING NUMBER: 26

CAD DWG:	STANDARD DRAWINGS
PLOT SCALE:	1.000
DRAWN BY:	JMM
DESIGN BY:	CRW
CHECKED BY:	DEO
ADOPTED DATE:	SEPTEMBER 1, 2016