

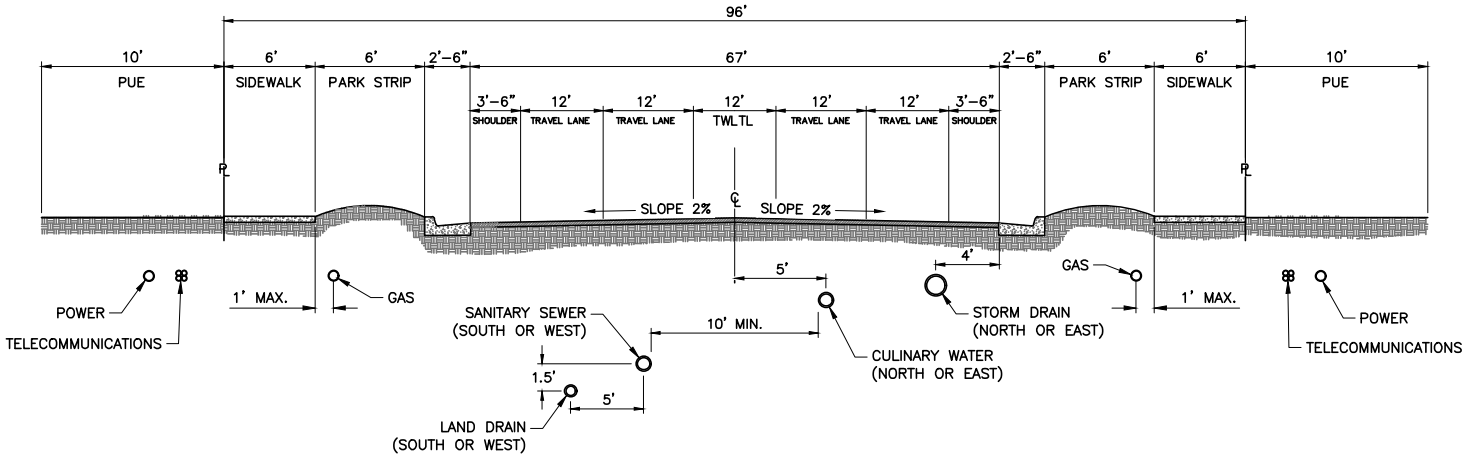


MAJOR ARTERIAL (5 LANES)
96+' ROW

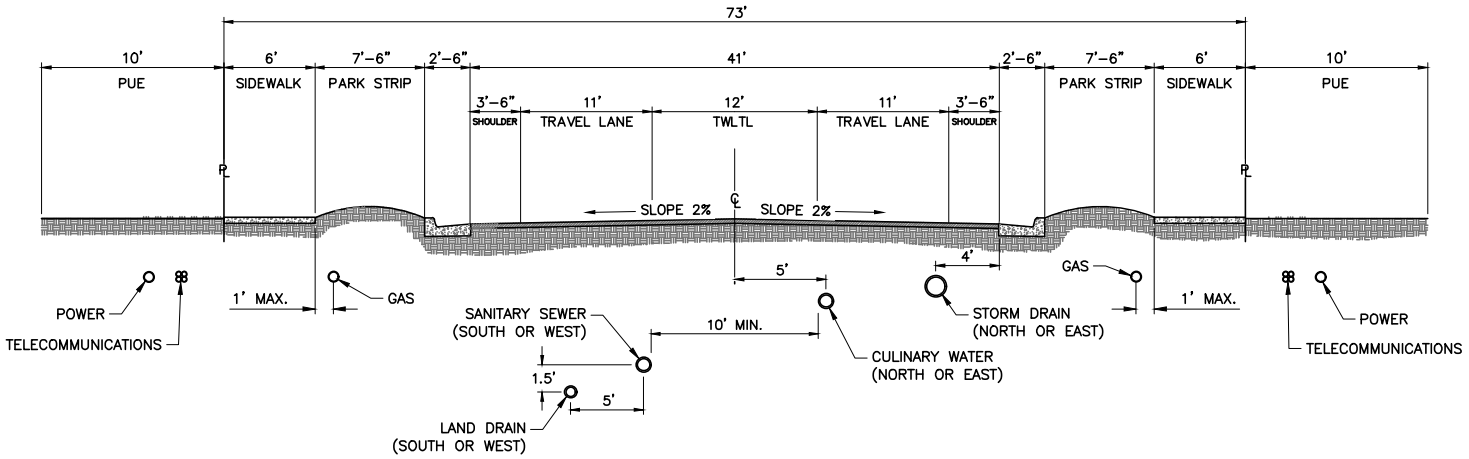

MINOR ARTERIAL (3 LANES)
73' ROW

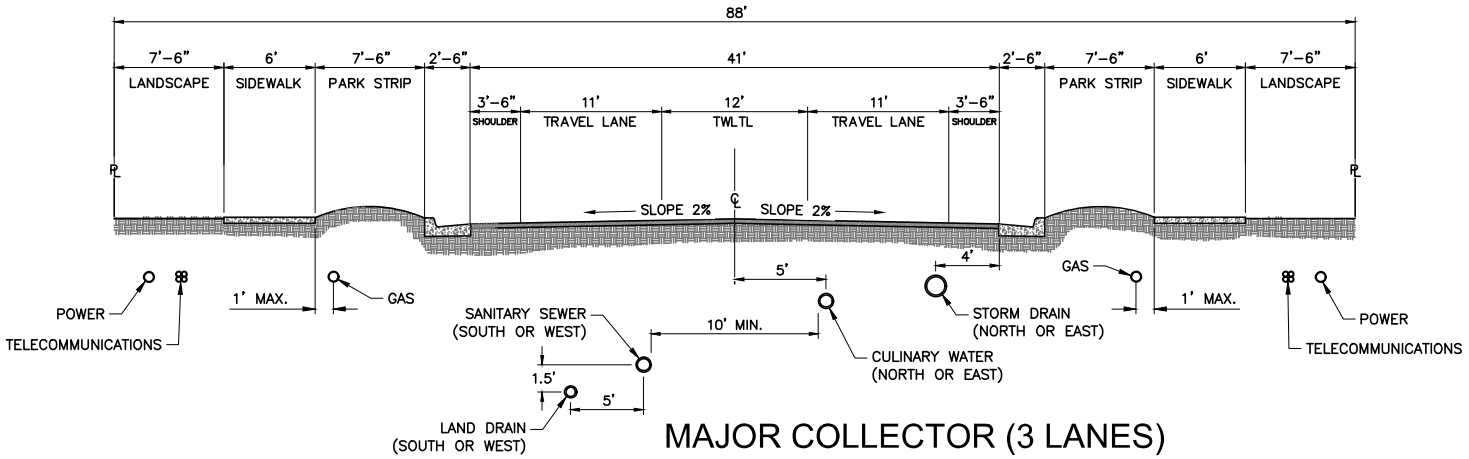

MAJOR COLLECTOR (3 LANES)
88' ROW

NOTES:
1. WHEREVER POSSIBLE, CULINARY WATER LINES SHALL BE INSTALLED ON THE NORTH AND EAST SIDE OF THE CENTERLINE.
2. FIRE HYDRANT PLACEMENT: REFER TO DESIGN CRITERIA FOR PUBLIC IMPROVEMENTS SECTION 4.02 SUB-SECTION B.
3. NO CULINARY WATER LINE SMALLER THAN 8" DIA. SHALL BE INSTALLED WITHOUT APPROVAL OF TOWN ENGINEER.
4. IMPORTED GRANULAR MATERIAL, ROADBASE AND WHERE NECESSARY ASPHALT THICKNESS WILL BE DETERMINED BY PAVEMENT DESIGN.
5. REQUIRED COVER OVER UTILITY LINES ARE AS FOLLOWS:
   CULINARY WATER = 48" MINIMUM
   SANITARY SEWER = PER DESIGN
   STORM DRAIN = PER DESIGN
   TELECOMMUNICATIONS = 24" MINIMUM
   ALL OTHERS = PER UTILITY REQUIREMENTS

STATEMENT OF USE

THIS DOCUMENT AND ANY ILLUSTRATIONS HEREON ARE PROVIDED AS STANDARD CONSTRUCTION DETAILS WITHIN THE TOWN OF VINEYARD. DEVEATION FROM THIS DOCUMENT REQUIRES APPROVAL FROM THE TOWN OF VINEYARD. THE TOWN OF VINEYARD CORPORATION CAN NOT BE HELD LIABLE FOR MISUSE OR CHANGES REGARDING THIS DOCUMENT.

REVISION

NO.	DESCRIPTION	BY	APR.	DATE
1	STANDARDS UPDATE	JMM	DEO	8/08/16
2	HANSEN, ALLEN & LUCE	DCL	CMT	9/12/25
3				
4				

VINEYARD
STAY CONNECTED

STANDARD STREET CROSS SECTIONS AND UTILITY LOCATIONS

VINEYARD

STANDARD DRAWING NUMBER:	3
CAD DWG: STANDARD DRAWINGS	
PLOT SCALE:	1.000
DRAWN BY:	JMM
DESIGN BY:	CRW
CHECKED BY:	DEO
ADOPTED DATE:	SEPTEMBER 1, 2016