
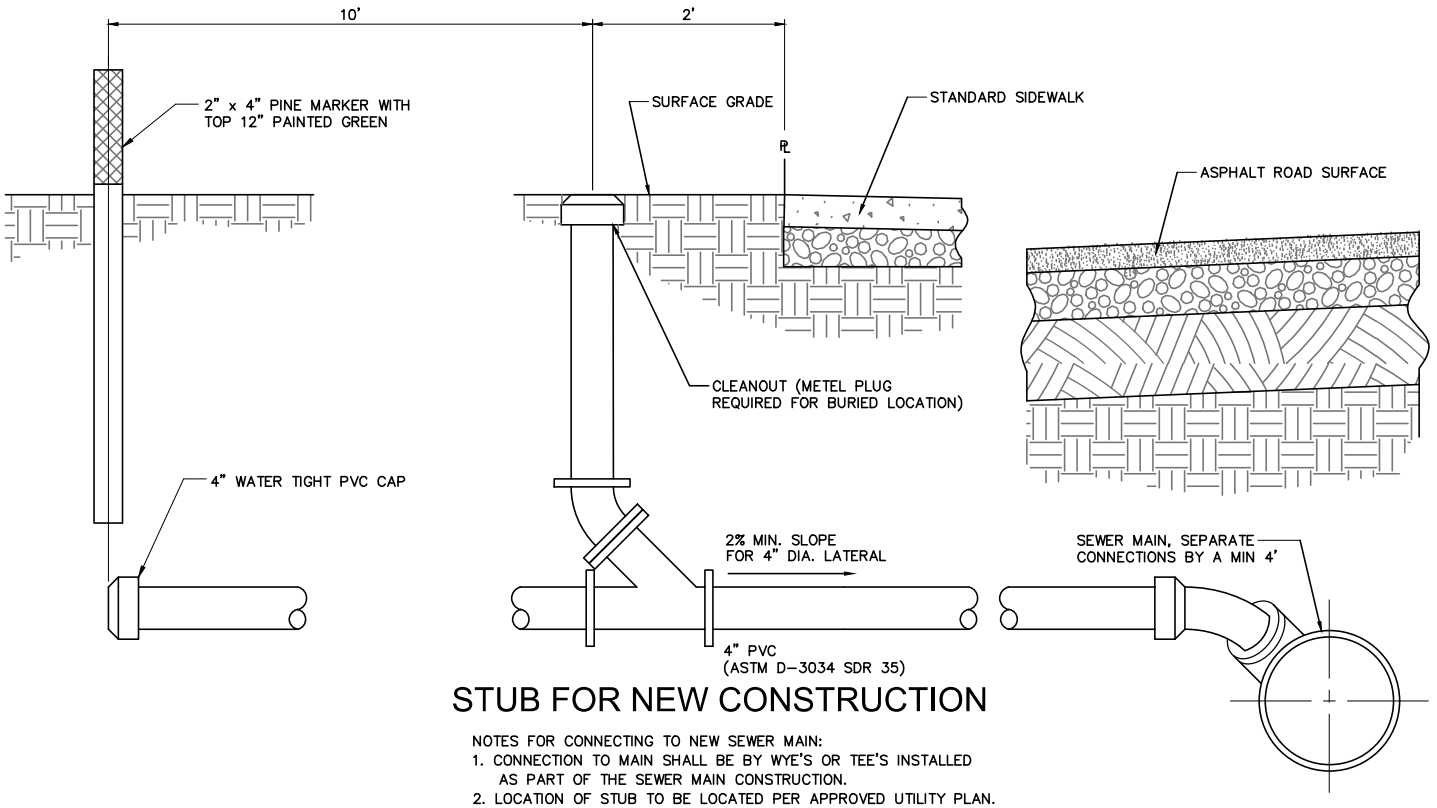


STUB FOR NEW CONSTRUCTION

NOTES FOR CONNECTING TO NEW SEWER MAIN:

1. CONNECTION TO MAIN SHALL BE BY WYE'S OR TEE'S INSTALLED AS PART OF THE SEWER MAIN CONSTRUCTION.
2. LOCATION OF STUB TO BE LOCATED PER APPROVED UTILITY PLAN.
3. SHOW CENTERLINE STATION OF THE LATERAL FROM THE NEAREST DOWNSTREAM MANHOLE. USE SAME STATIONING USED FOR SEWER MAIN.
4. TRAFFIC RATED CLEANOUT LID REQ'D IF LOCATED IN TRAFFIC AREAS.

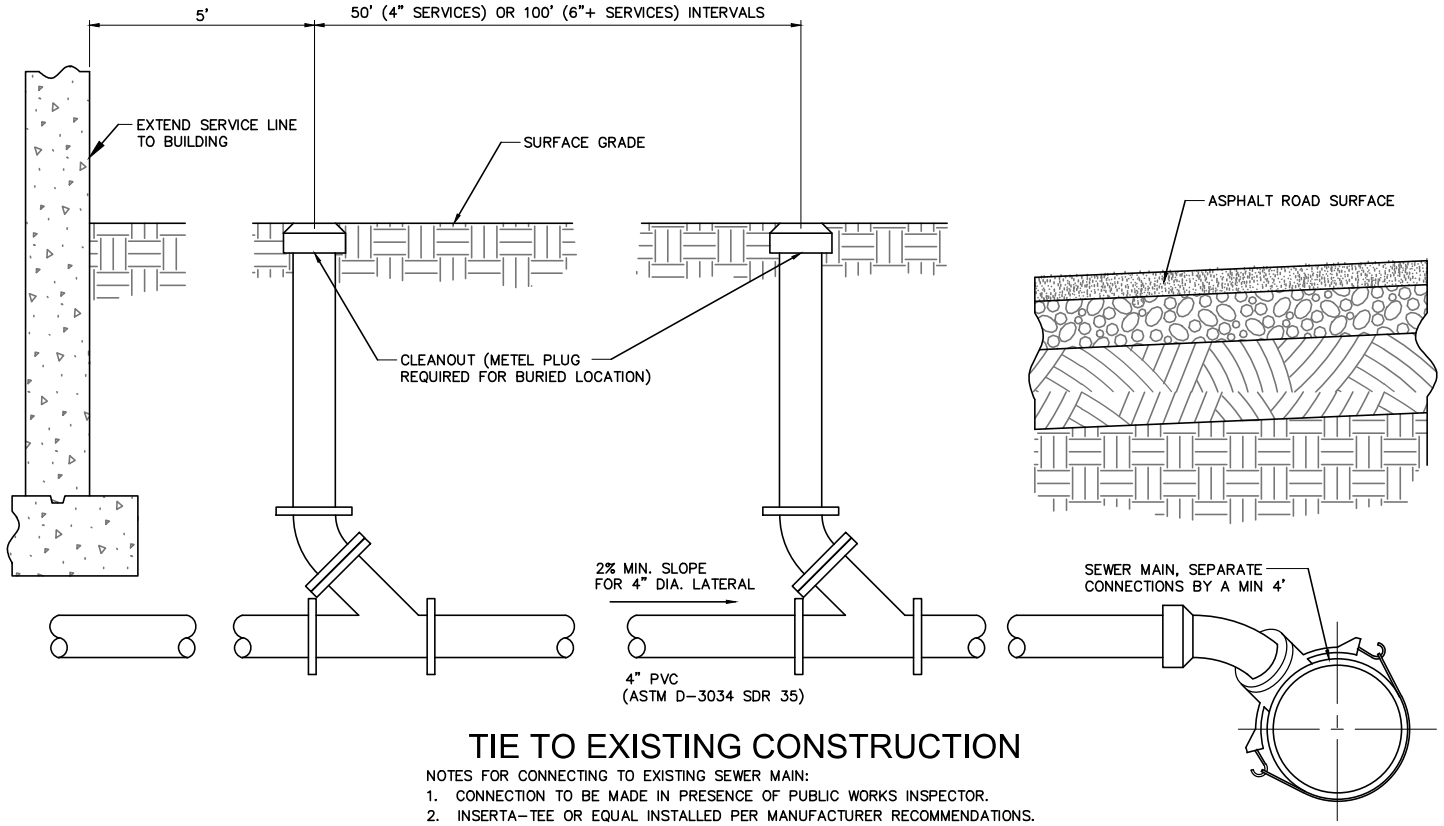

TIE TO EXISTING CONSTRUCTION

NOTES FOR CONNECTING TO EXISTING SEWER MAIN:

1. CONNECTION TO BE MADE IN PRESENCE OF PUBLIC WORKS INSPECTOR.
2. INSERTA-TEE OR EQUAL INSTALLED PER MANUFACTURER RECOMMENDATIONS.
3. TRAFFIC RATED CLEANOUT LID REQ'D IF LOCATED IN TRAFFIC AREAS.
4. CLEAN-OUTS REQUIRED AT PROPERTY LINE, EVERY 100' FOR 6" SERVICES AND 50' FOR 4" SERVICES AND AT EVERY COMBINATION OF BEND TOTALING 90°.

STATEMENT OF USE

THIS DOCUMENT AND ANY ILLUSTRATIONS HEREON ARE PROVIDED AS STANDARD CONSTRUCTION DETAILS WITHIN THE TOWN OF VINEYARD. DEVEATION FROM THIS DOCUMENT REQUIRES APPROVAL FROM THE TOWN OF VINEYARD. THE TOWN OF VINEYARD CORPORATION CAN NOT BE HELD LIABLE FOR MISUSE OR CHANGES REGARDING THIS DOCUMENT.

REVISION

NO.	DESCRIPTION	BY	APR.	DATE
1	STANDARDS UPDATE	JMM	DEO	8/08/16
2	HANSEN, ALLEN & LUCE	LRH	CMT	9/12/25
3				
4				

VINEYARD
STAY CONNECTED

TYPICAL
SEWER LATERAL

VINEYARD

STANDARD DRAWING NUMBER:	27
CAD DWG:	STANDARD DRAWINGS
PLOT SCALE:	1.000
DRAWN BY:	JMM
DESIGN BY:	CRW
CHECKED BY:	DEO
ADOPTED DATE:	SEPTEMBER 1, 2016