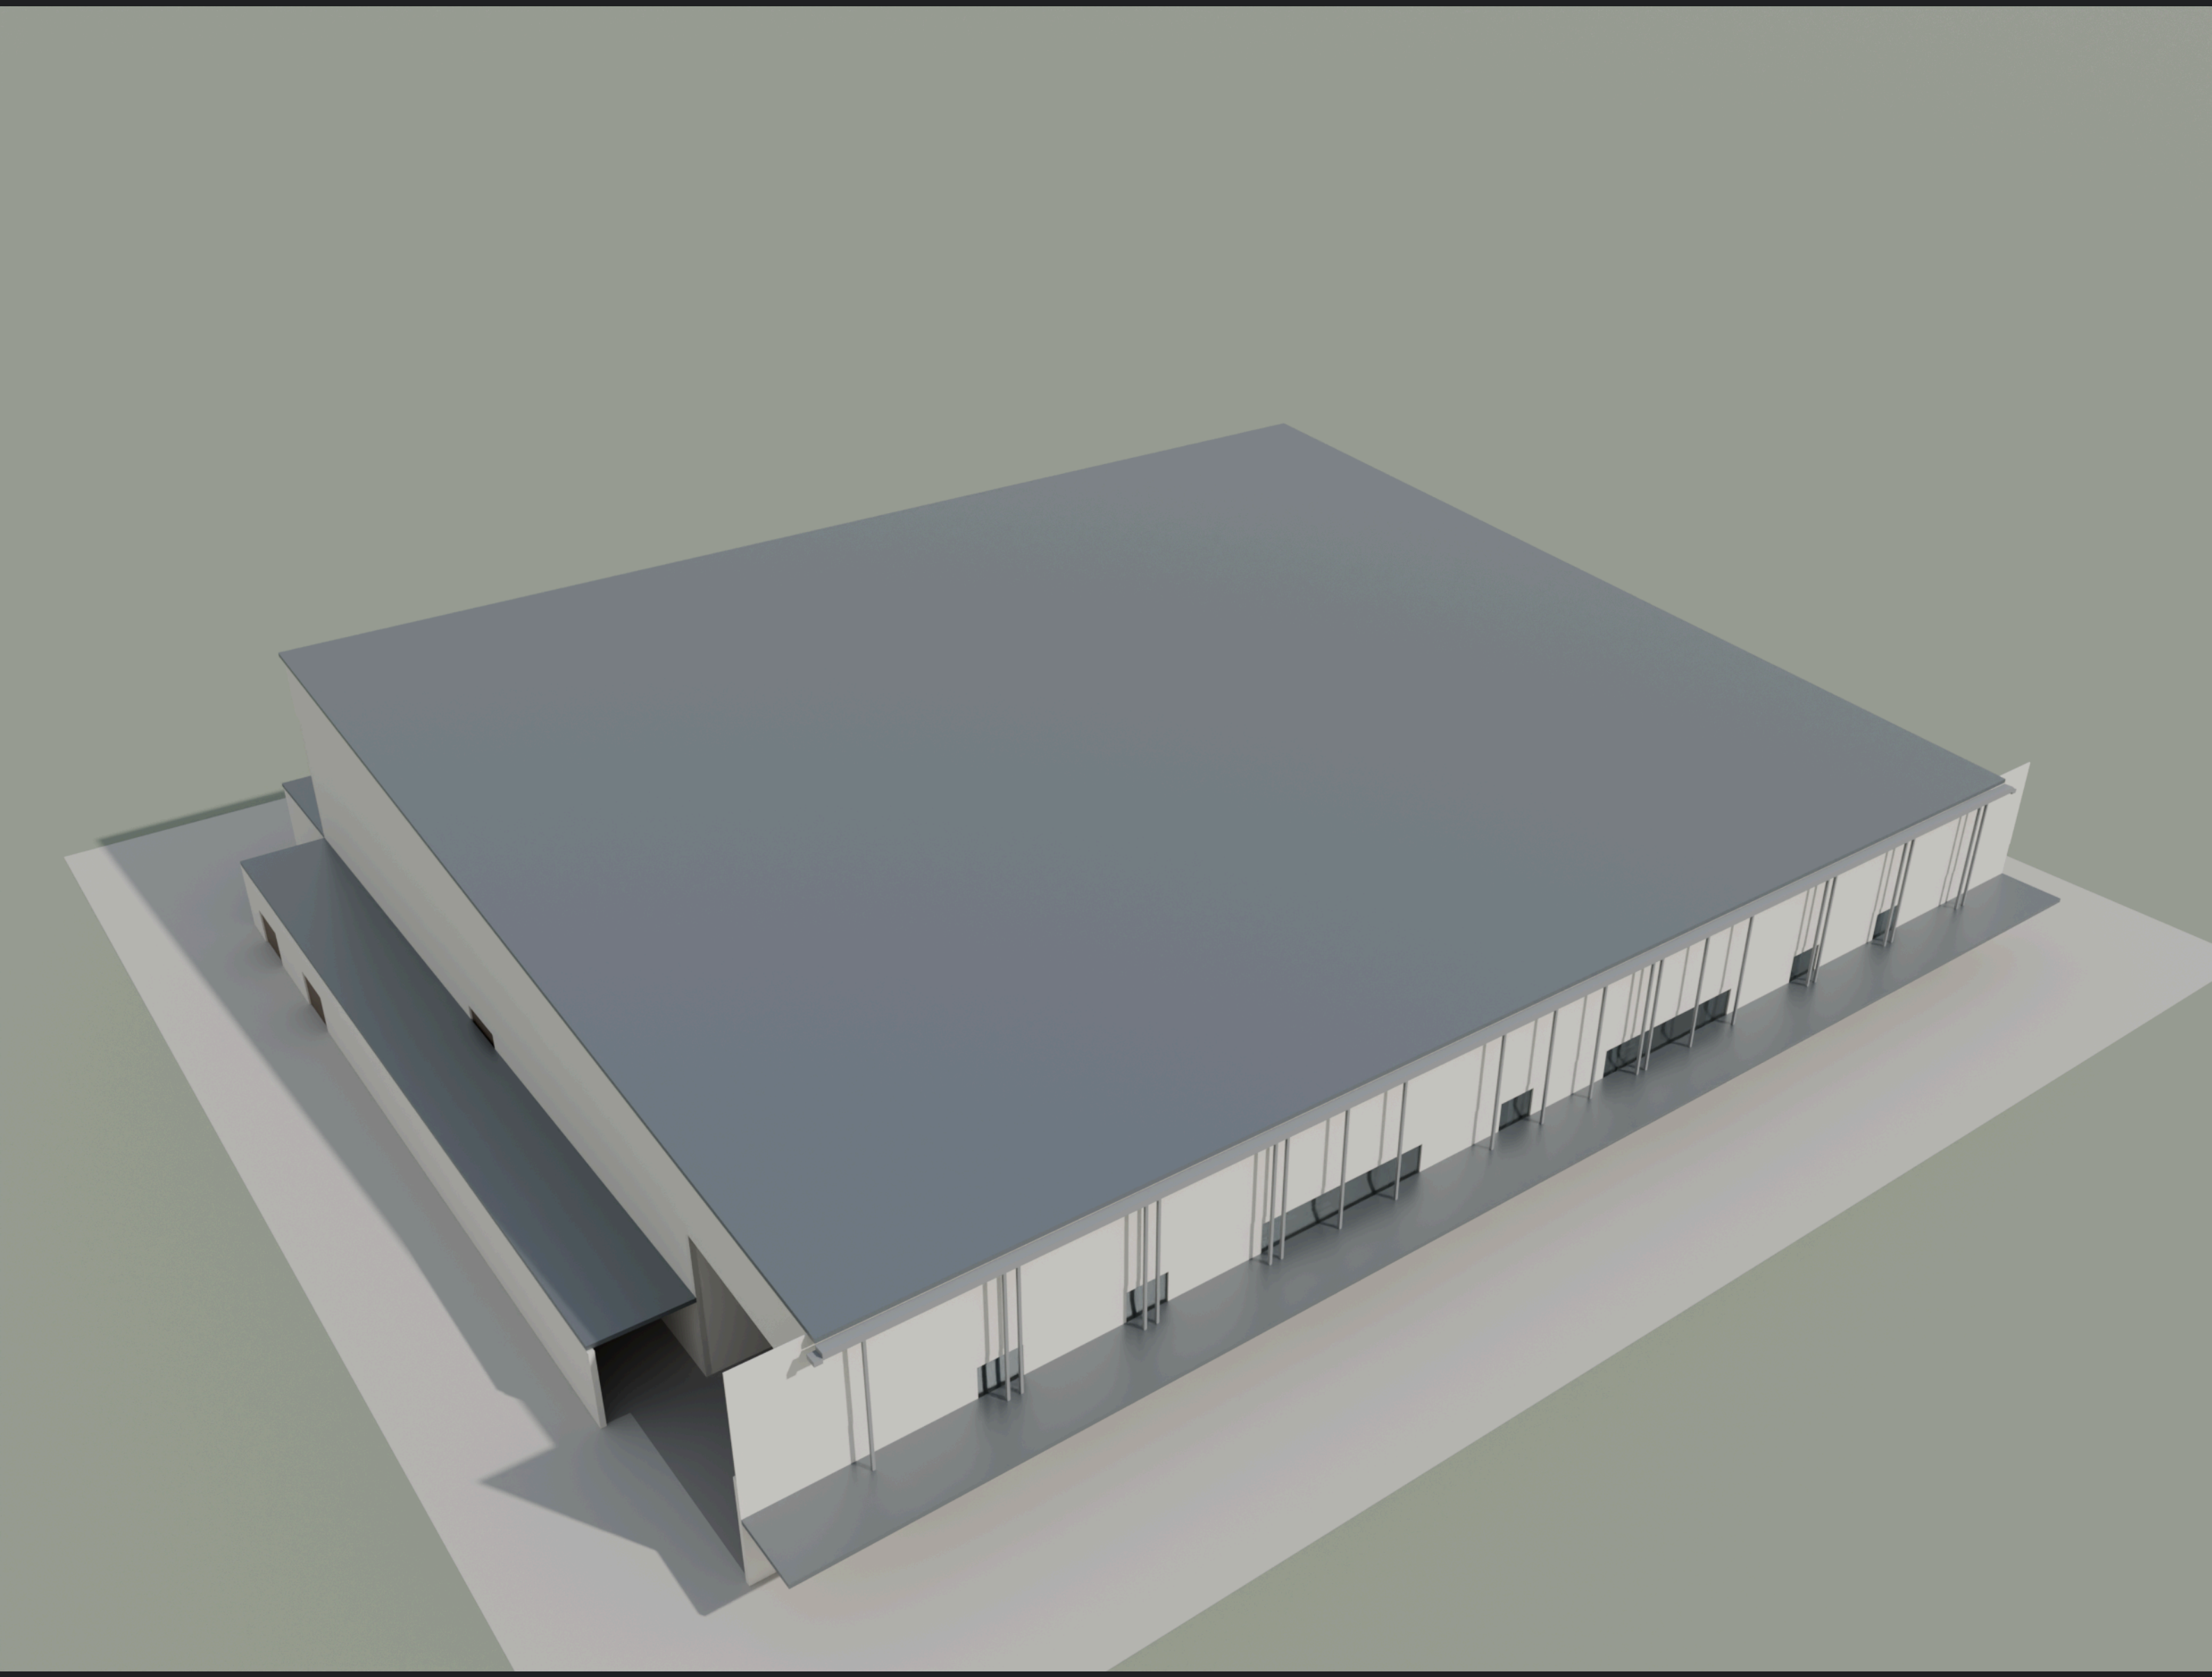

Exterior aerial perspective · Option B model B03-44bc3ae457

PROPOSED 3,000-SEAT CHURCH AUDITORIUM

Preliminary Architectural & Structural Concept Feasibility Proposal
Option B — long-side stage

LOCATION	REVISION	ISSUE DATE	STATUS
Zimbabwe — site not identified	B03-44bc3ae457	2026-11-02	Concept — unverified · Not for construction

CONTENTS

01 Project overview 03
02 Architectural vision 04
03 Project at a glance 05
B-P100 Architectural floor plan 06
04 Seating and congregation layout 07
05 Interior architecture 08
06 Structural engineering concept 10
B-S100 Roof structure 11
07 Structural member schedules 12
08 Building sections 13
09 Functional and building services review 14
10 Model inventory and preliminary cost drivers 15
11 Design review and engineering risks 16
12 Recommendations and next steps 17
A-F Technical appendices 18
G Dimensioned drawings 25

DOCUMENT CONTROL

DESIGN ID	MODEL REVISION	ISSUE DATE
B-long-side-stage	B03-44bc3ae457	2026-11-02
STATUS	BLENDER	UNITS
CONCEPT - UNVERIFIED - NOT FOR CONSTRUCTION	5.2.3 LTS	metres

MANIFEST SHA-256

356464e19ccc094f284d8ae1a5c64159700c0fbf518a867ca8b60c1ce1169c83

HOW TO READ VALUES

Headline metrics carry a source mark. Every other figure, table and drawing is measured from the model or read from its verified reports, as stated beside it.

M	Measured from model geometry
E	Derived preliminary estimate
X	Excluded from this document
P	Authored model property
C	Requires confirmation

All values are concept-model measurements or documented allowances. Professional design and code checks remain outstanding.

01

Project overview

CONCEPT

Option B, saved model B03-44bc3ae457

The platform stands at the centre of the long north wall. Concentric seating rows form a wide, shallow fan facing the platform focus. The entrance foyer and hall share one mono-pitch roof.

SCOPE

The model has 3,000 fixed congregation chairs plus 30 wheelchair places, 30 companion chairs and 412 choir chairs. With assumed platform and staff loads, provisional building occupancy is 3,562. Escape travel and side-seat viewing need decisions before the layout is adopted.

N

The hall subtotal excludes the separately modelled 43.30 m2 ministry floor. The XY box is not floor area; roof area includes all modelled roof planes. All values are concept measurements.

CONGREGATION M

3,000 seats

32 rows

FOOTPRINT M

91.8 × 79.55 m

Envelope/floor XY box

HALL M

2927.9 m²

Hall zone subtotal; ministry floor excluded

ROOF M

6844.1 m²

All modelled roof slopes

TRUSSES M

11

53.05 m span

PULPIT DISTANCE M

30.51 m

Median eye-to-pulpit distance

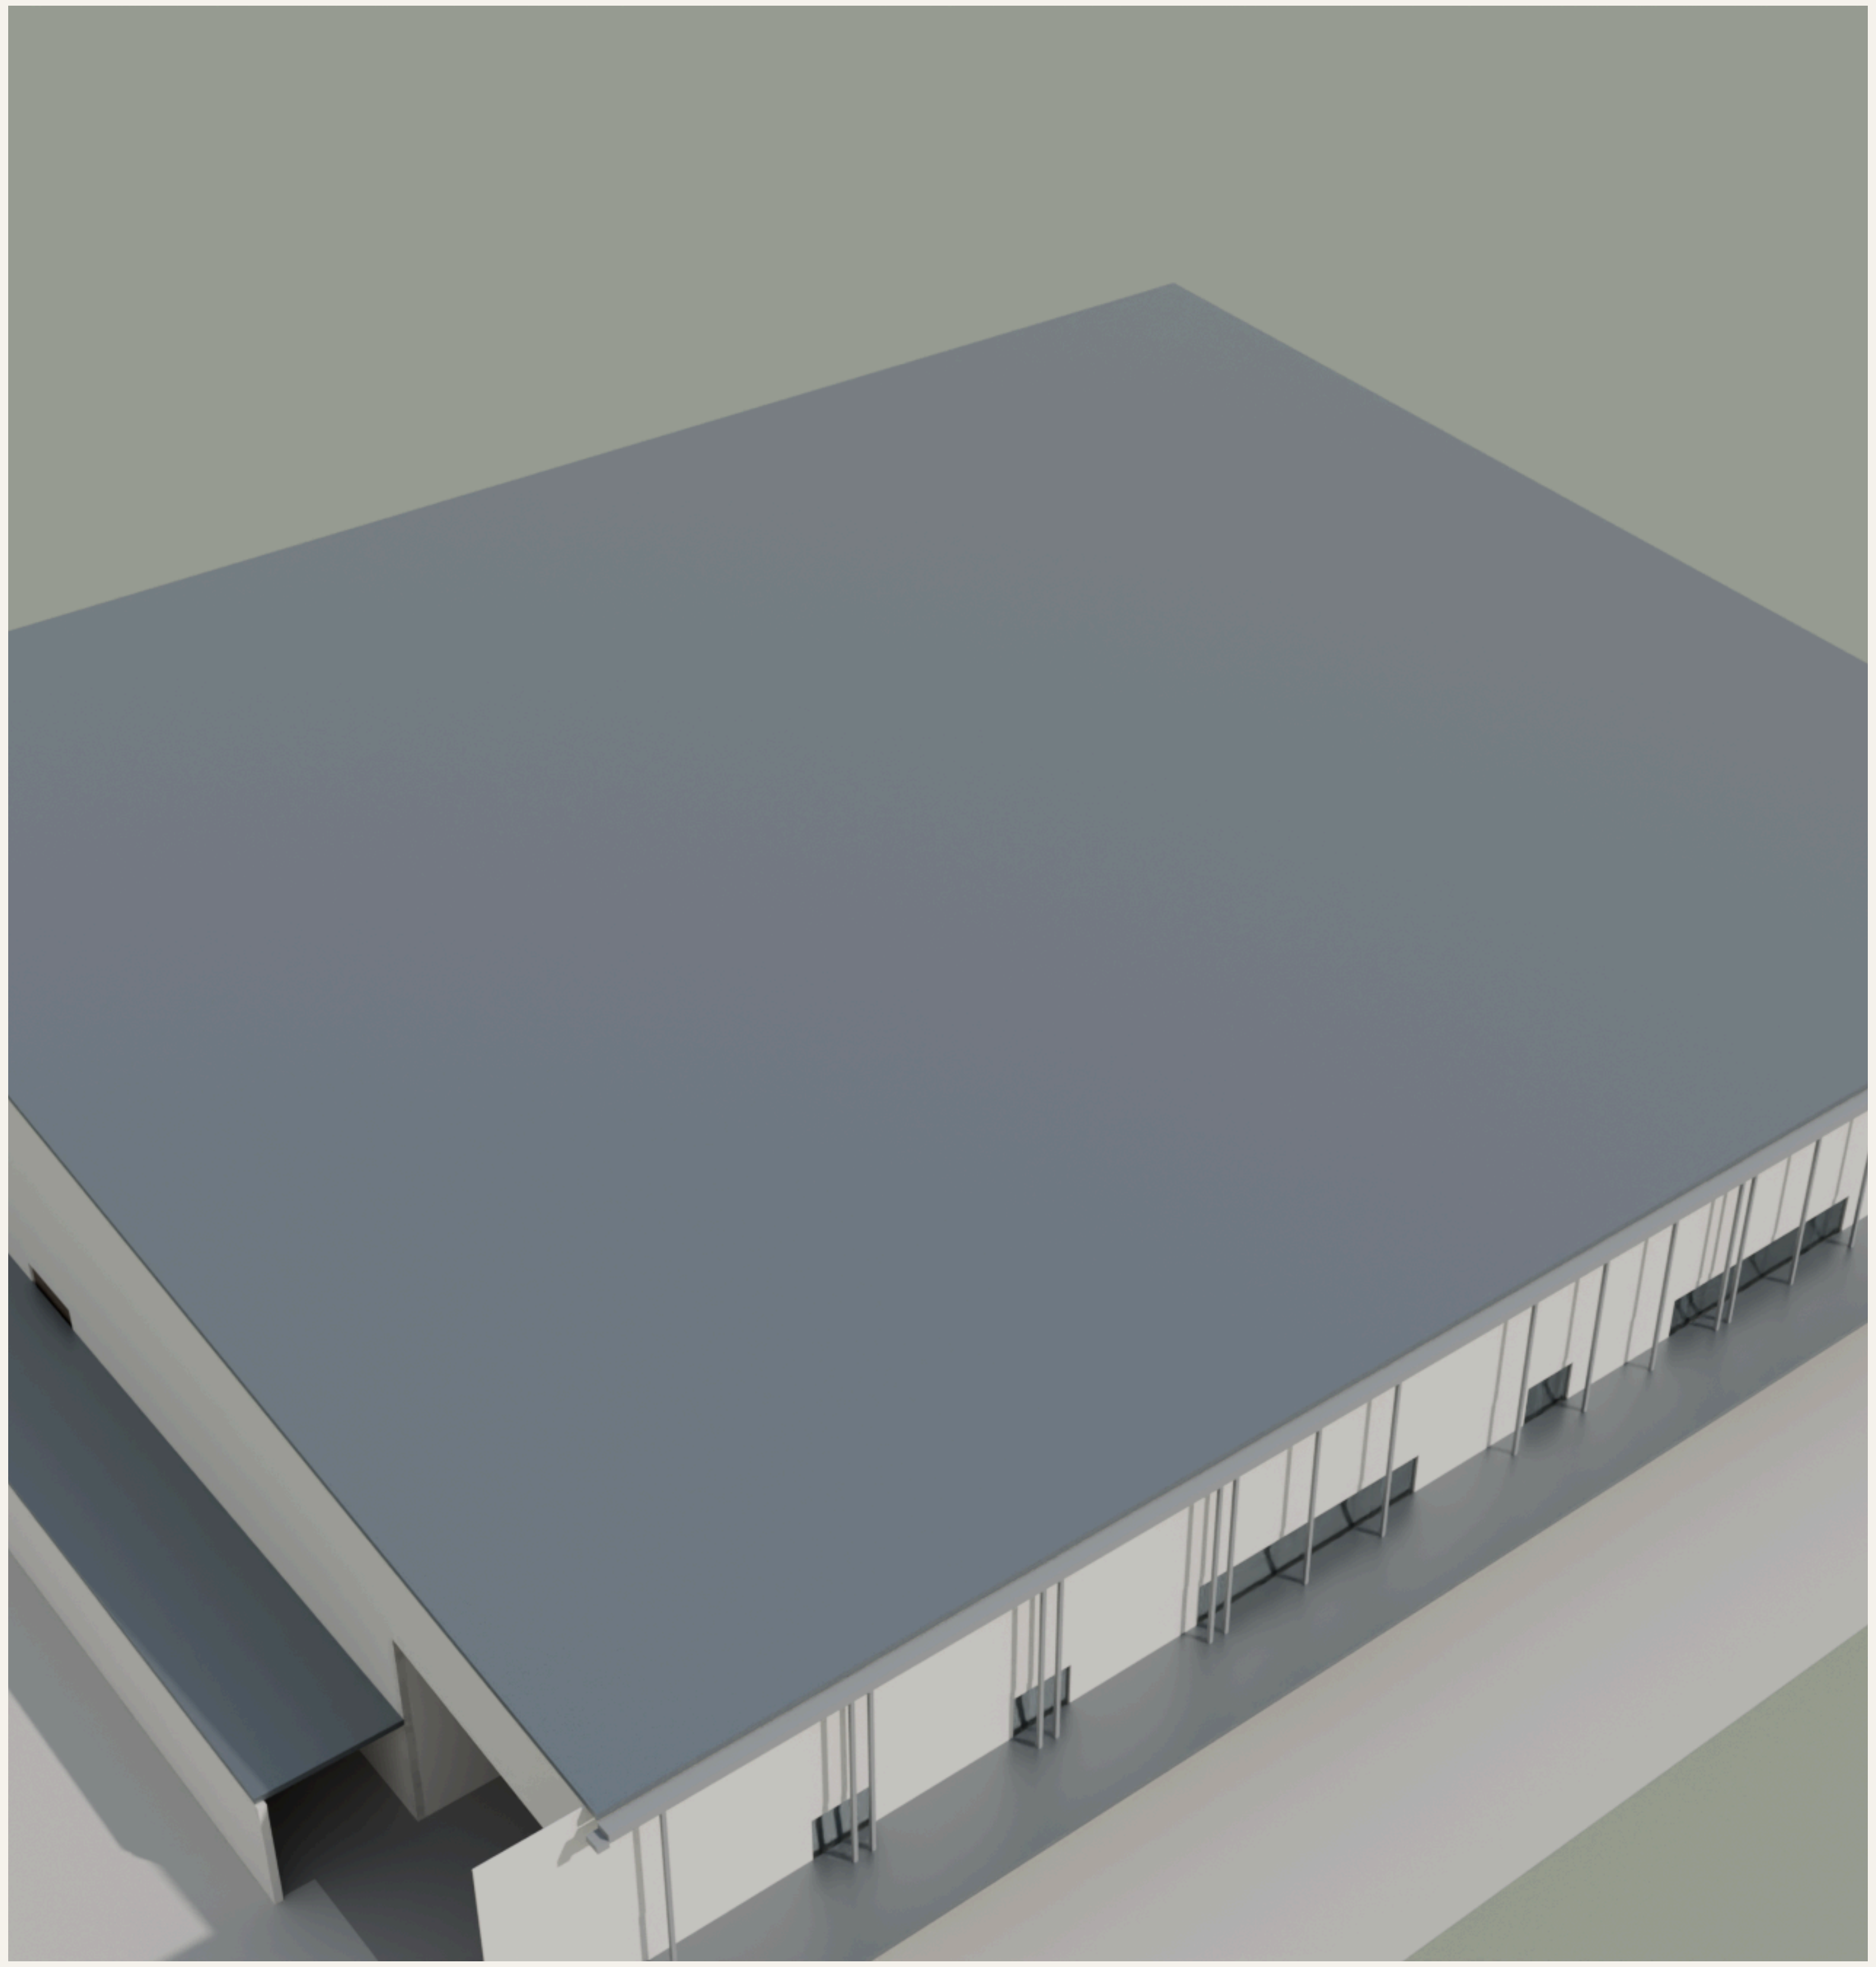

FIG. 2.1 Exterior aerial perspective · B03-44bc3ae457

02 · DESIGN INTENT

Architectural vision

The long-side stage, fan geometry and foyer create an auditorium with short sightlines for many seats and direct access to the rear passage. All finishes and services shown are indicative.

01

Shared focus

Concentric rows aim at the platform focus; the 160° seating fan needs audiovisual support at its sides.

02

Legible circulation

A full-width entrance foyer links the two central stairs, side foyers, covered ambulatories and hall exits.

03

Inclusive positions

Wheelchair places occur at the front and cross-aisle band, with step-free concept routes.

04

One roof silhouette

A mono-pitch hall roof and separate 12 m foyer rafters give the proposal a continuous external form.

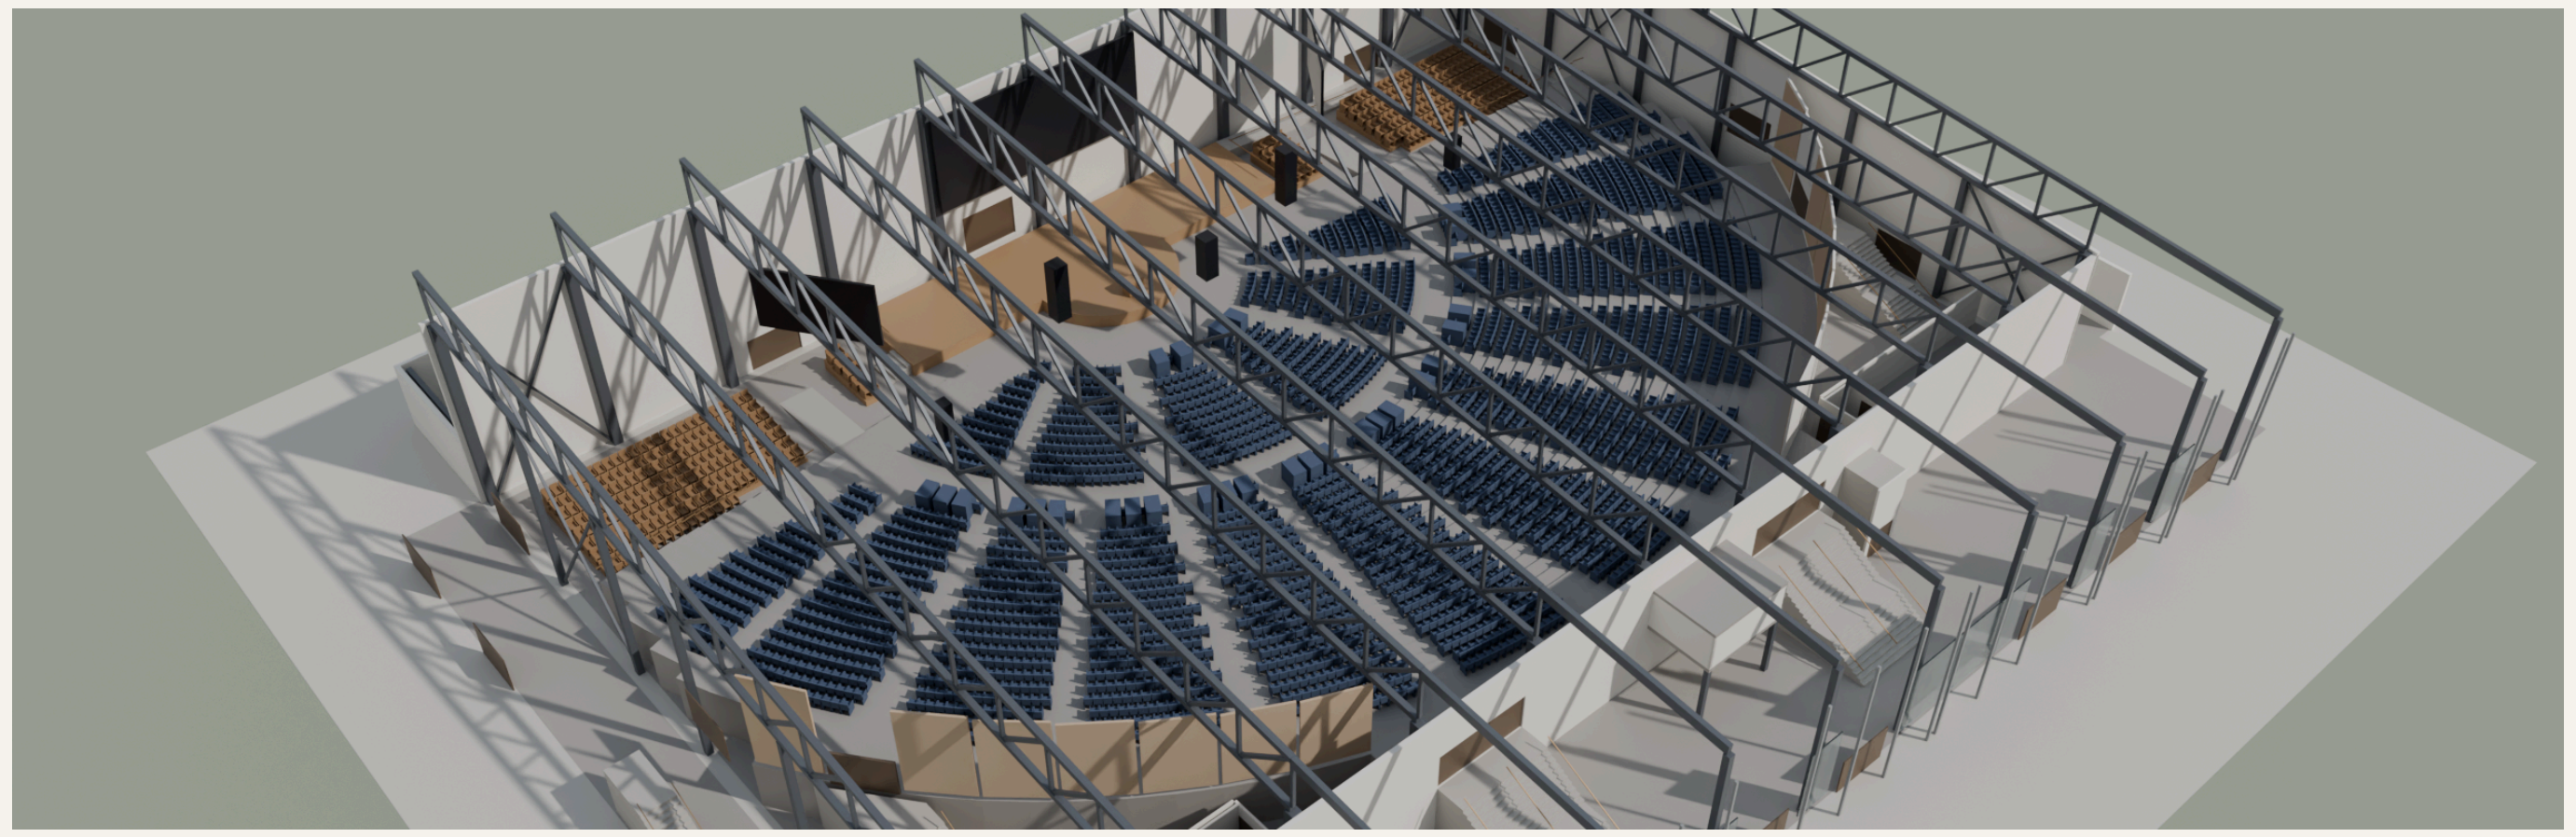

Cutaway model view · concept geometry

03

Project at a glance

ARCHITECTURE	VALUE	STRUCTURE	VALUE
Congregation seats	3,000	Columns	56
Choir chairs	412	Roof trusses	11
Wheelchair places	30	Truss span	53.05 m
Hall width	80.0 m	Purlins	350
Hall depth	53.05 m	Roof top	17.47 m
Aisle minimum	1.523 m	Braces	100

Verification status

TOPIC	CURRENT STATUS
Geometry and seat count	Checked against saved model; concept only
Egress and travel	Placeholder criteria; local requirements to confirm
Structural members and foundations	Space reservations; sizes and connections not designed
Acoustics, AV, MEP, fire strategy	Specialist design outstanding
Site and geotechnical	Survey and investigation outstanding

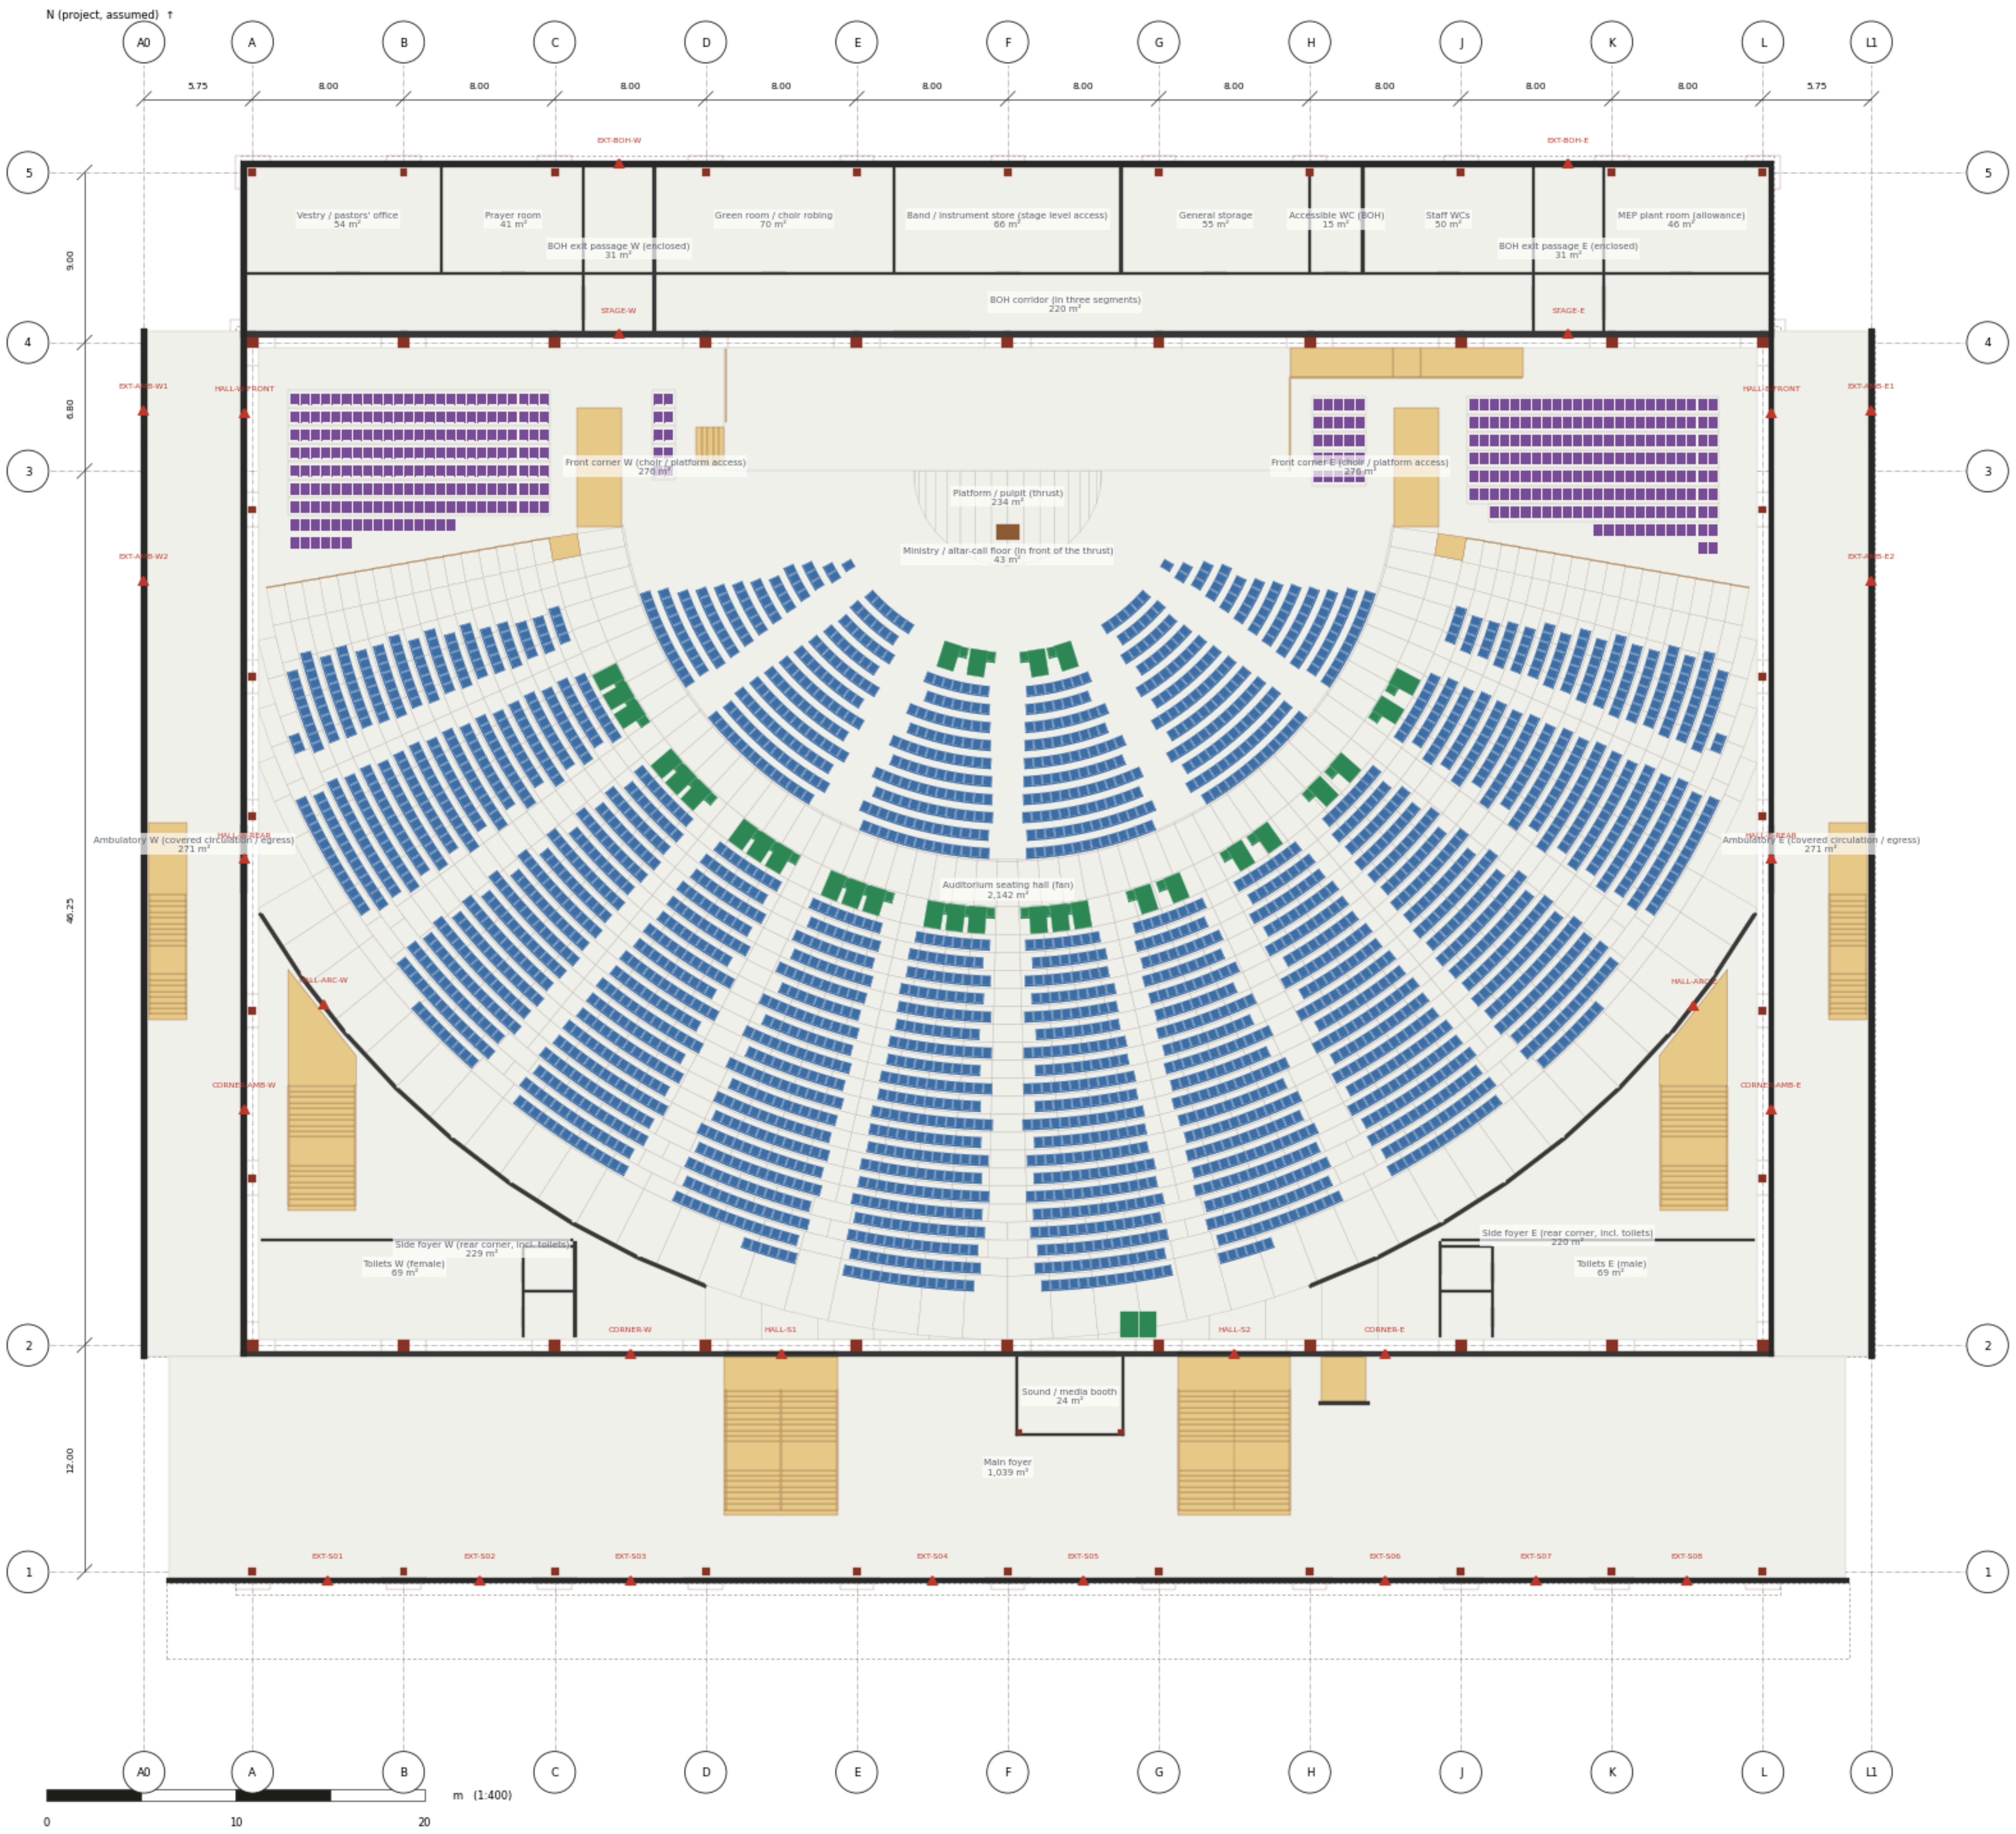
N (project, assumed) ↑
A0
A
B
C
D
E
F
G
H
J
K
L
L1
5.75
8.00
5.75
5
4
3
2
1
9.00
6.80
46.25
12.00
EXT-BOH-W
EXT-BOH-E
Vestry / pastors' office
54 m²
Prayer room
41 m²
BOH exit passage W (enclosed)
31 m²
Green room / choir robing
70 m²
Band / instrument store (stage level access)
66 m²
General storage
55 m²
Accessible WC (BOH)
15 m²
Staff WCs
50 m²
MEP plant room (allowance)
46 m²
BOH exit passage E (enclosed)
31 m²
BOH corridor (in three segments)
220 m²
STAGE-W
STAGE-E
EXT-AMB-W1
HALL-W-FRONT
HALL-E-FRONT
EXT-AMB-E1
Front corner W (choir / platform access)
276 m²
Platform / pulpit (thrust)
234 m²
Front corner E (choir / platform access)
276 m²
EXT-AMB-W2
EXT-AMB-E2
Ministry / altar-call floor (in front of the thrust)
43 m²
HALL-W-REAR
Ambulatory W (covered circulation / egress)
271 m²
Auditorium seating hall (fan)
2,142 m²
HALL-E-REAR
Ambulatory E (covered circulation / egress)
271 m²
HALL-ARC-W
HALL-ARC-E
CORNER-AMB-W
CORNER-AMB-E
Side foyer W (rear corner, incl. toilets)
229 m²
Toilets W (female)
69 m²
Side foyer E (rear corner, incl. toilets)
220 m²
Toilets E (male)
69 m²
CORNER-W
HALL-S1
HALL-S2
CORNER-E
Sound / media booth
24 m²
Main foyer
1,039 m²
EXT-S01
EXT-S02
EXT-S03
EXT-S04
EXT-S05
EXT-S06
EXT-S07
EXT-S08
0
10
20
m (1:400)

PROJECT

3,000-Seat Church Auditorium -
Option B (long-side stage)
Coordination Concept

DESIGN

B-long-side-stage

MODEL REVISION

`B03-44bc3ae457`

DRAWING

Ground floor plan

Plan at L00, cut below the roof
structure

SCALE

1:400 at A3

SHEET

B-P100

SOURCE

`blender_manifest.json sha256`
`356464e19ccc094f`

UNITS

metres; levels in m above L00

STATUS

CONCEPT - UNVERIFIED - NOT FOR
CONSTRUCTION

Concept coordination drawing generated from the
Blender model. Not for construction. Dimensions
unverified pending professional review.

04

Seating and congregation layout

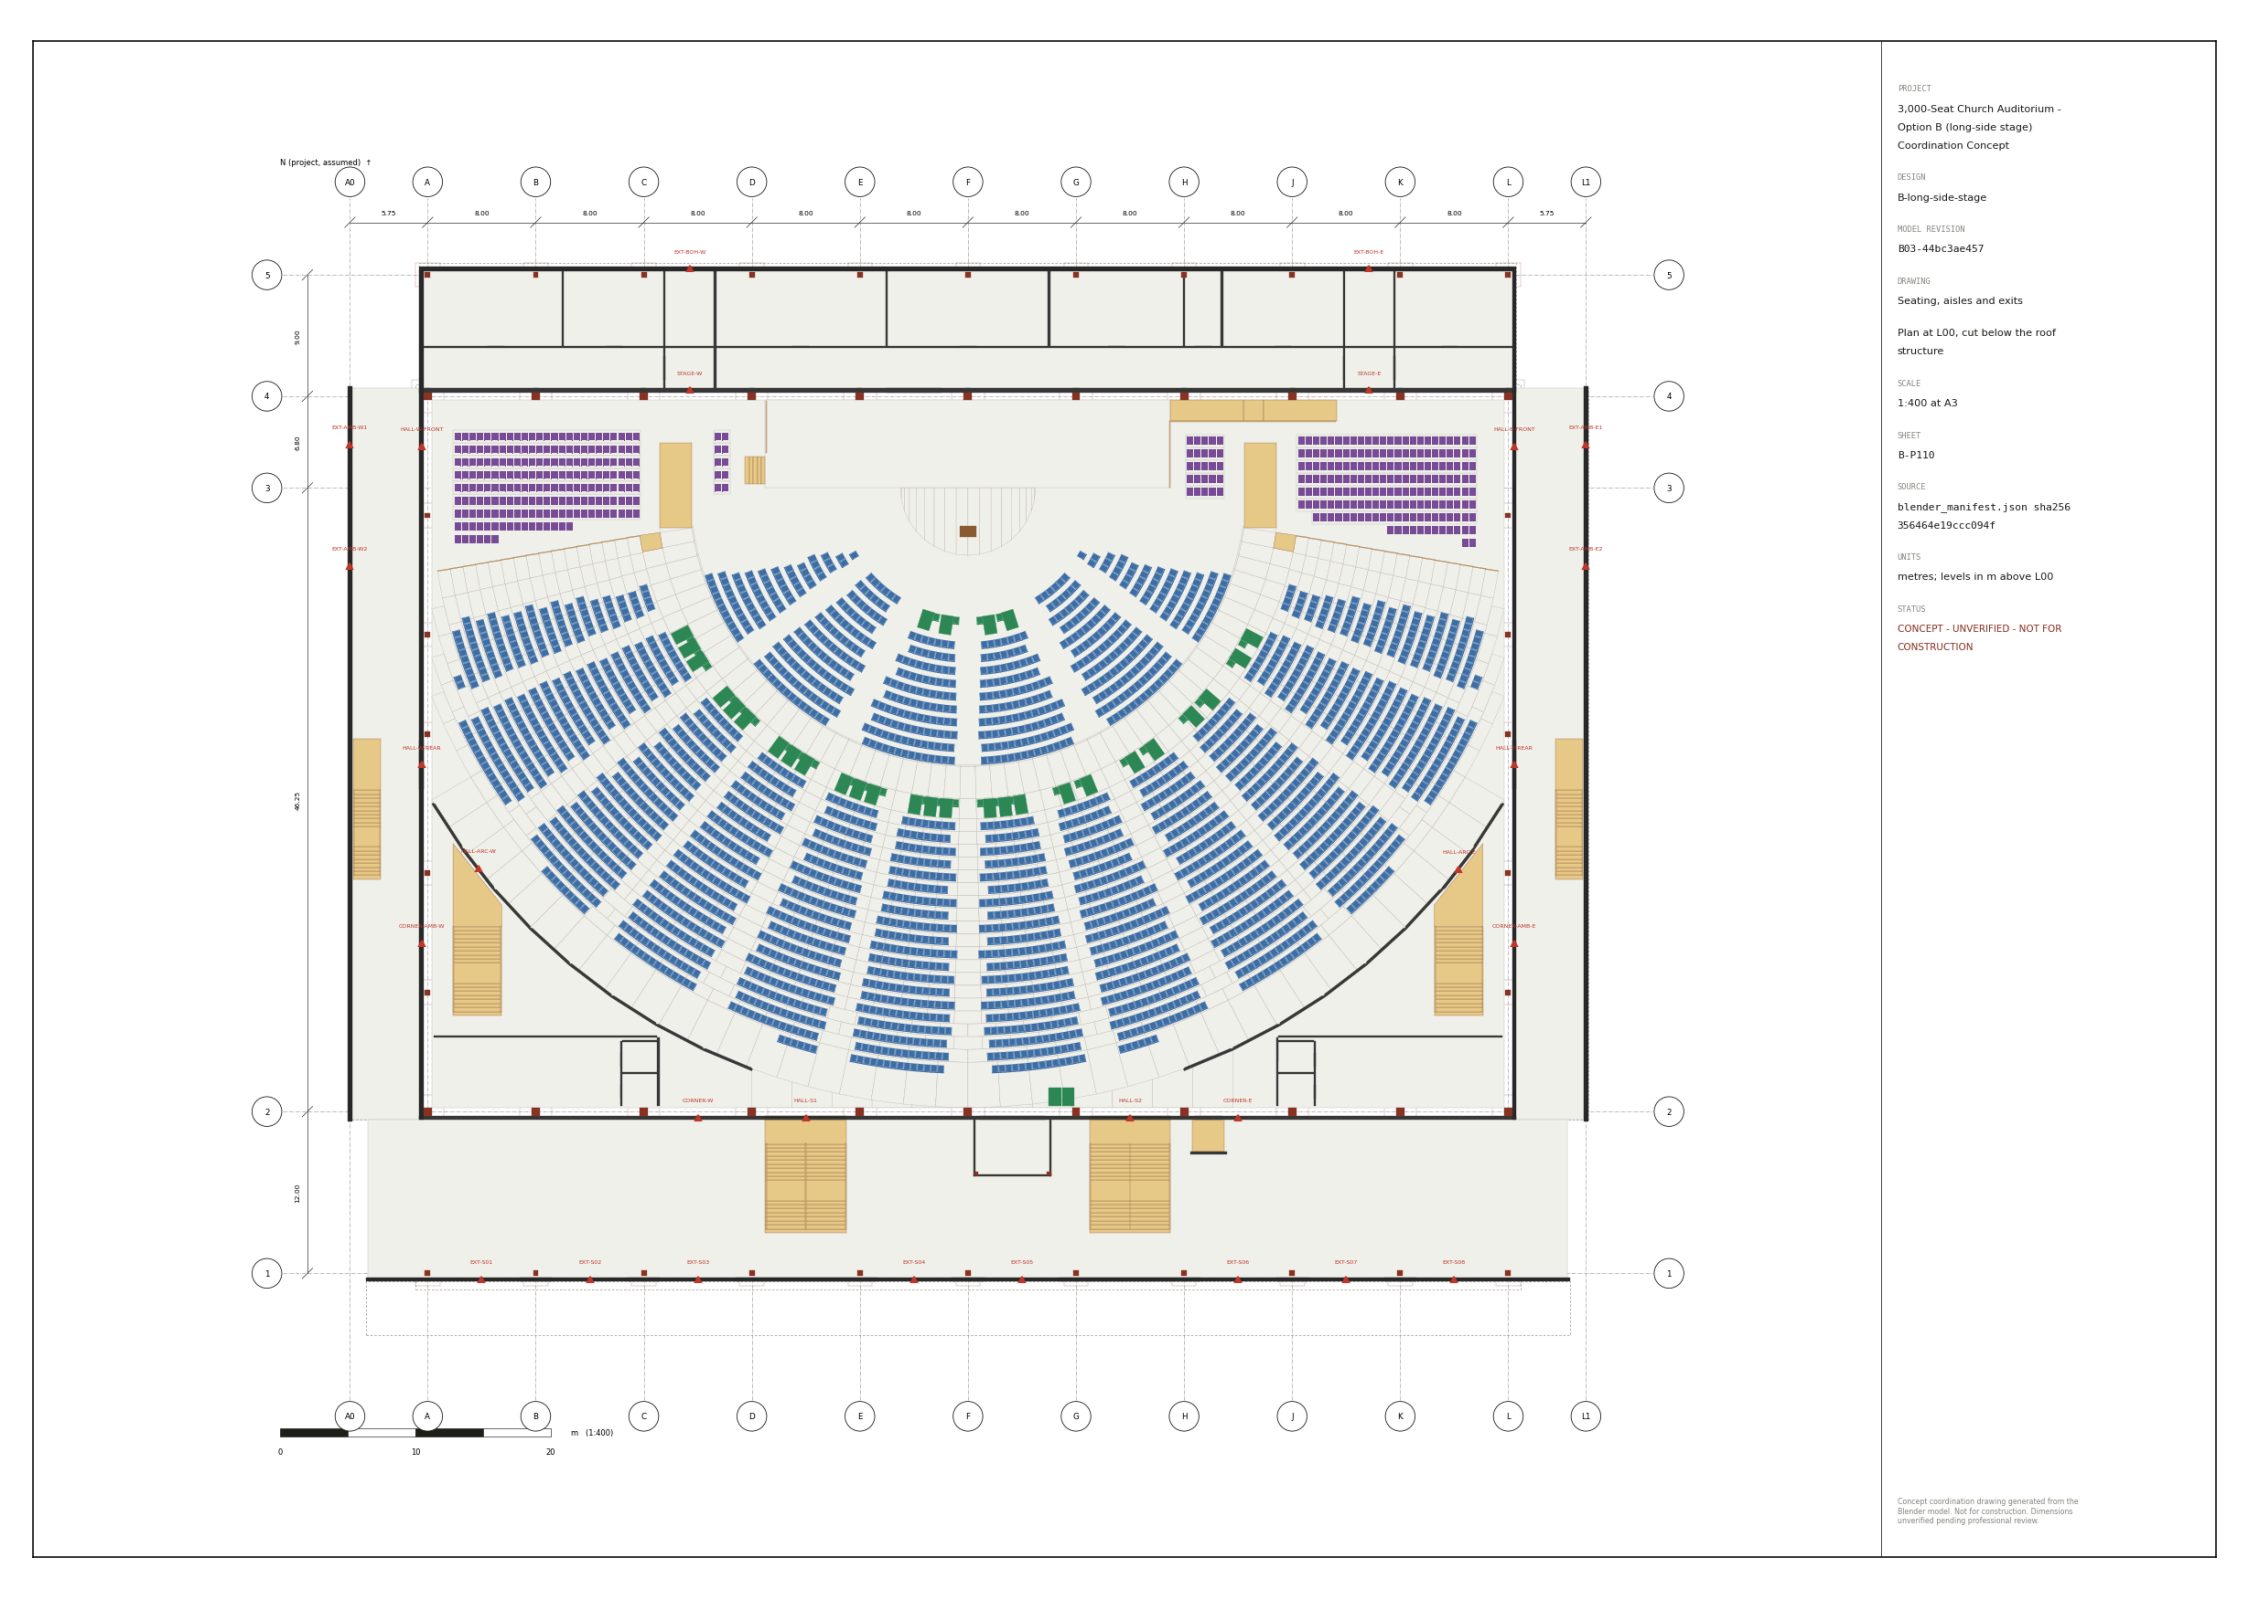
N (project, assumed) ↑
A0
A
B
C
D
E
F
G
H
J
K
L
L1
5.75
8.00
5.75
5
4
3
2
1
EXT-BOH-W
EXT-BOH-E
STAGE-W
STAGE-E
HALL-W-FRONT
HALL-E-FRONT
m (1:400)
0
10
20
PROJECT
3,000-Seat Church Auditorium - Option B (long-side stage) Coordination Concept
DESIGN
B-long-side-stage
MODEL REVISION
B03-44bc3ae457
DRAWING
Seating, aisles and exits
Plan at L00, cut below the roof structure
SCALE
1:400 at A3
SHEET
B-P110
SOURCE
blender_manifest.json sha256 356464e19ccc094f
UNITS
metres; levels in m above L00
STATUS
CONCEPT - UNVERIFIED - NOT FOR CONSTRUCTION
Concept coordination drawing generated from the Blender model. Not for construction. Dimensions unverified pending professional review.

Seating, aisles and exits · B-P110 · scaled down to fit this report page

Congregation and sightlines

MEASURE	MODEL VALUE
Congregation seating	3,000 chairs · 32 rows
Choir / wheelchair	412 choir / 30 wheelchair / 30 companion; additive
Maximum seats to an aisle	7
Eye-to-pulpit distance	median 30.51 m · max 40.13 m
Radial C-values (m)	n1 0.0602 · n2 0.1203
Pulpit bearing	772 chairs above 60 degrees; maximum 79.98 degrees
Screen reliance (model rule)	1,564 chairs; AV study pending

05

Interior architecture

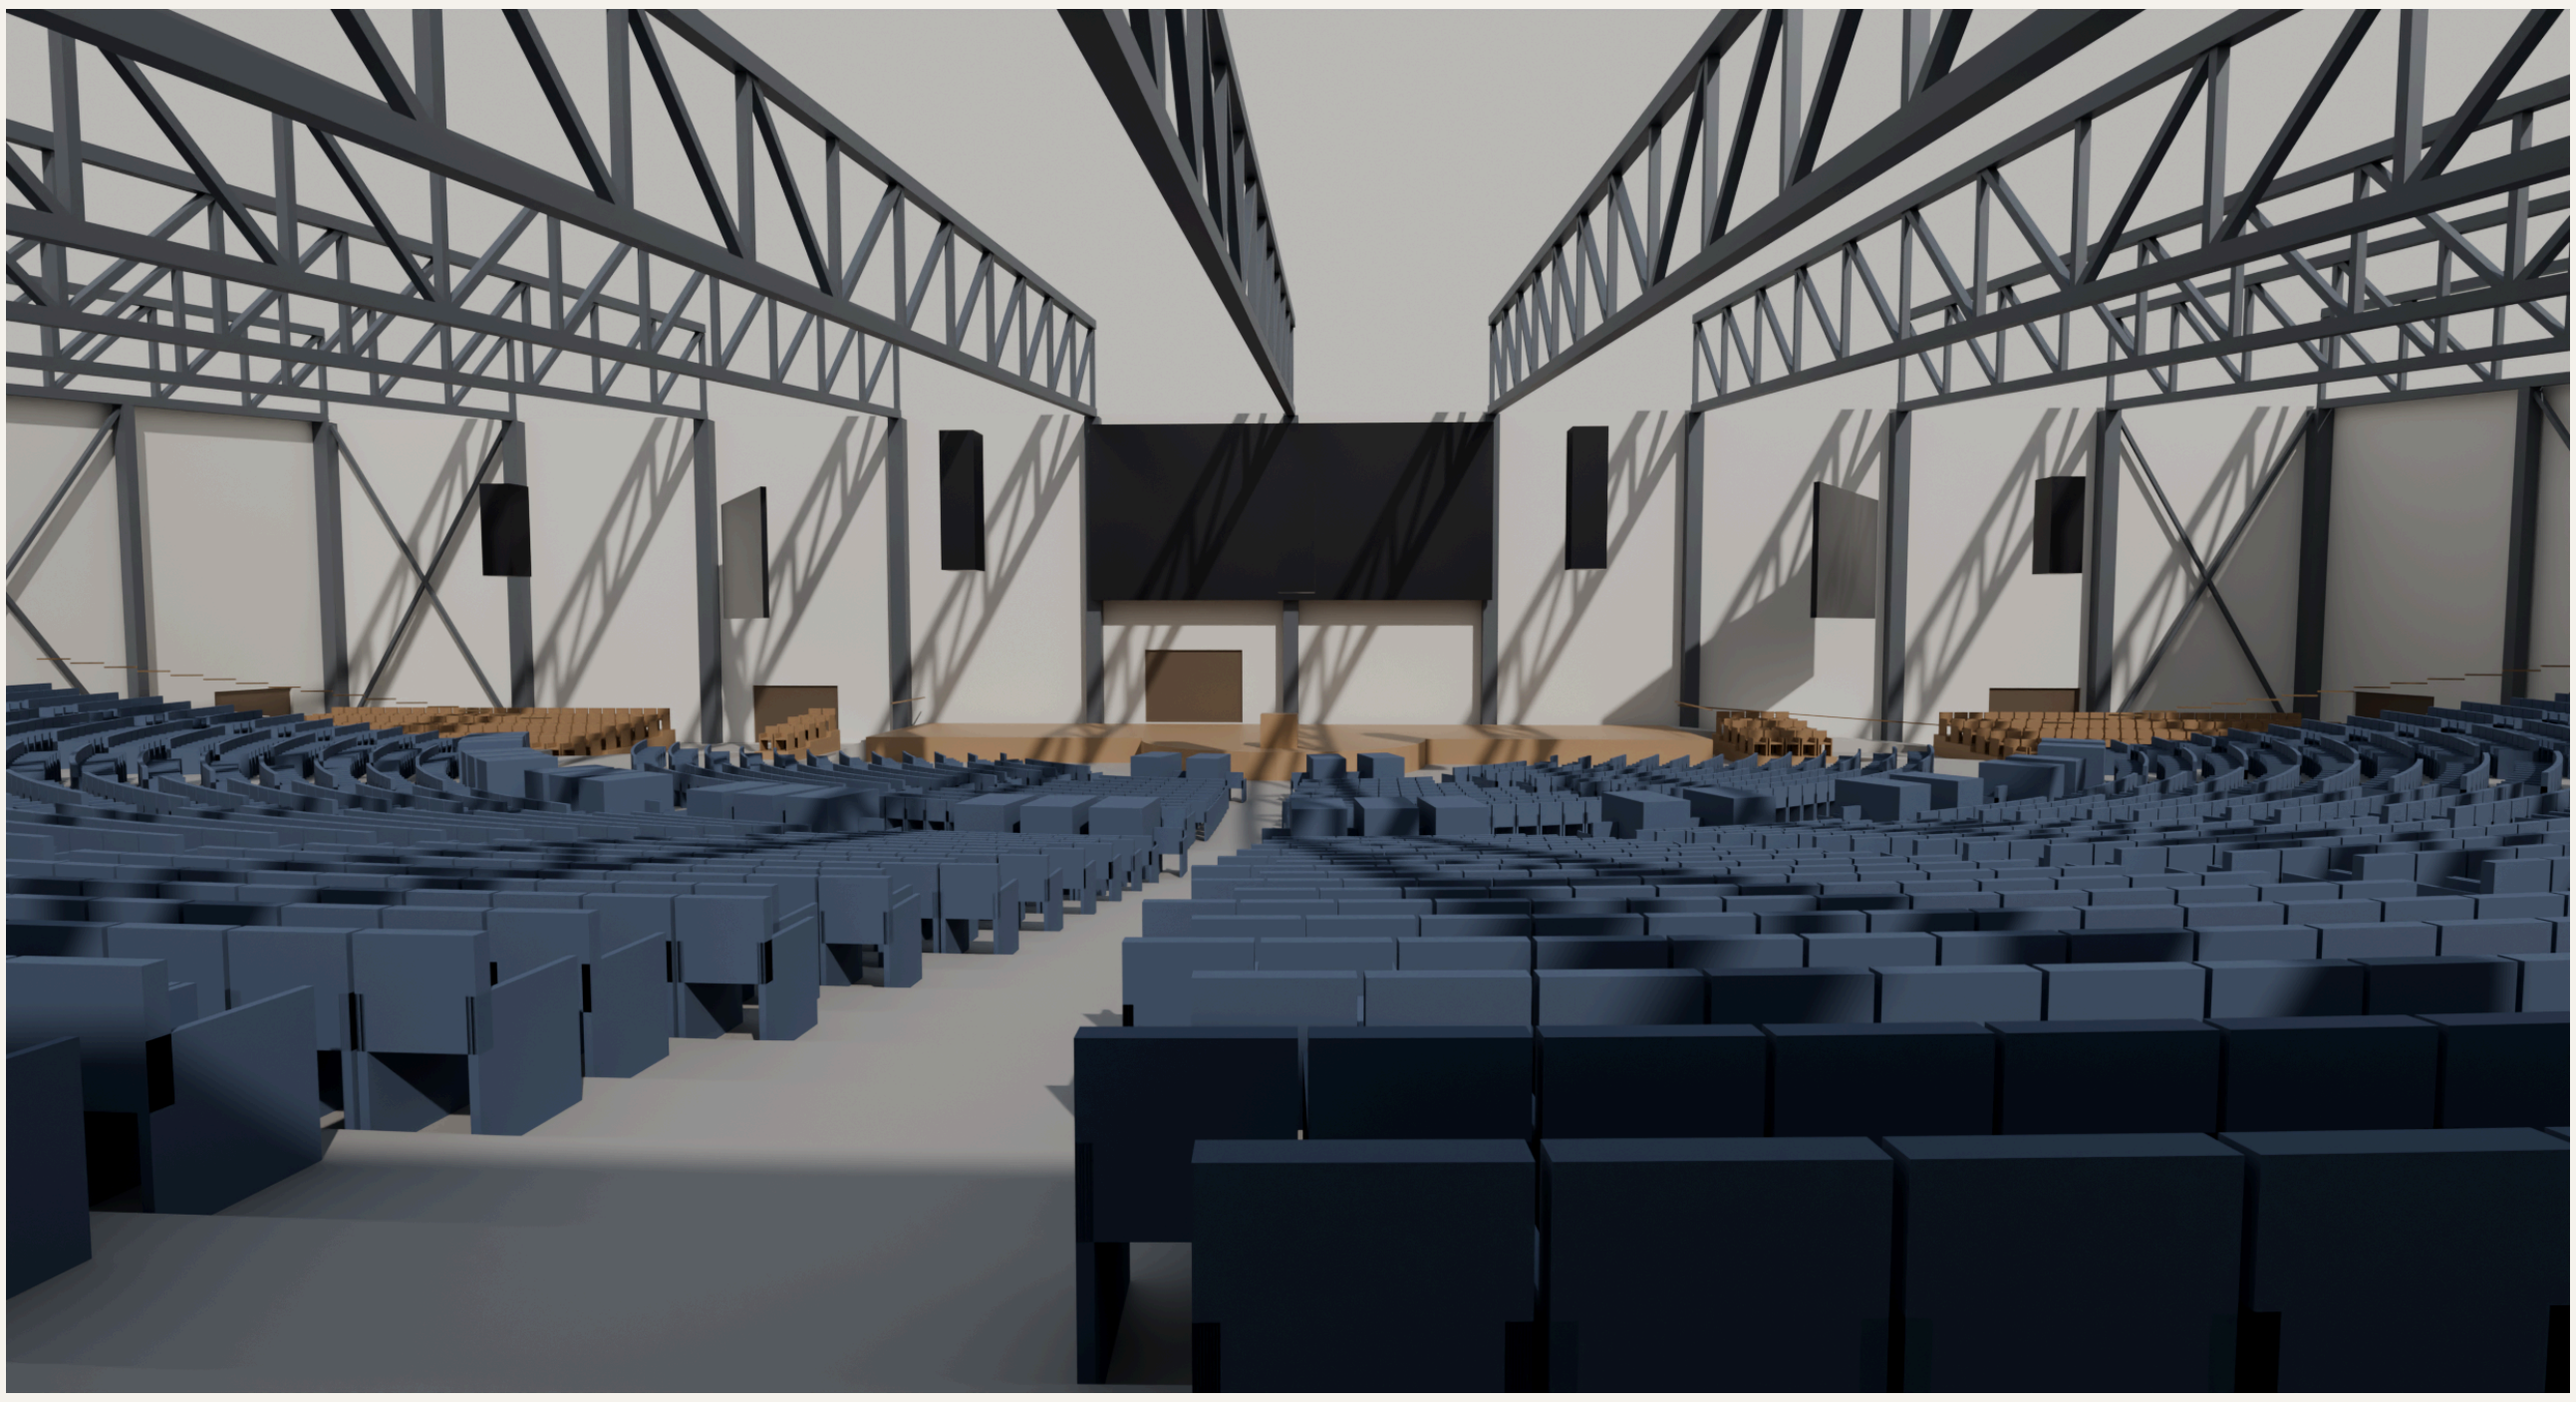

View from the rear · indicative model materials

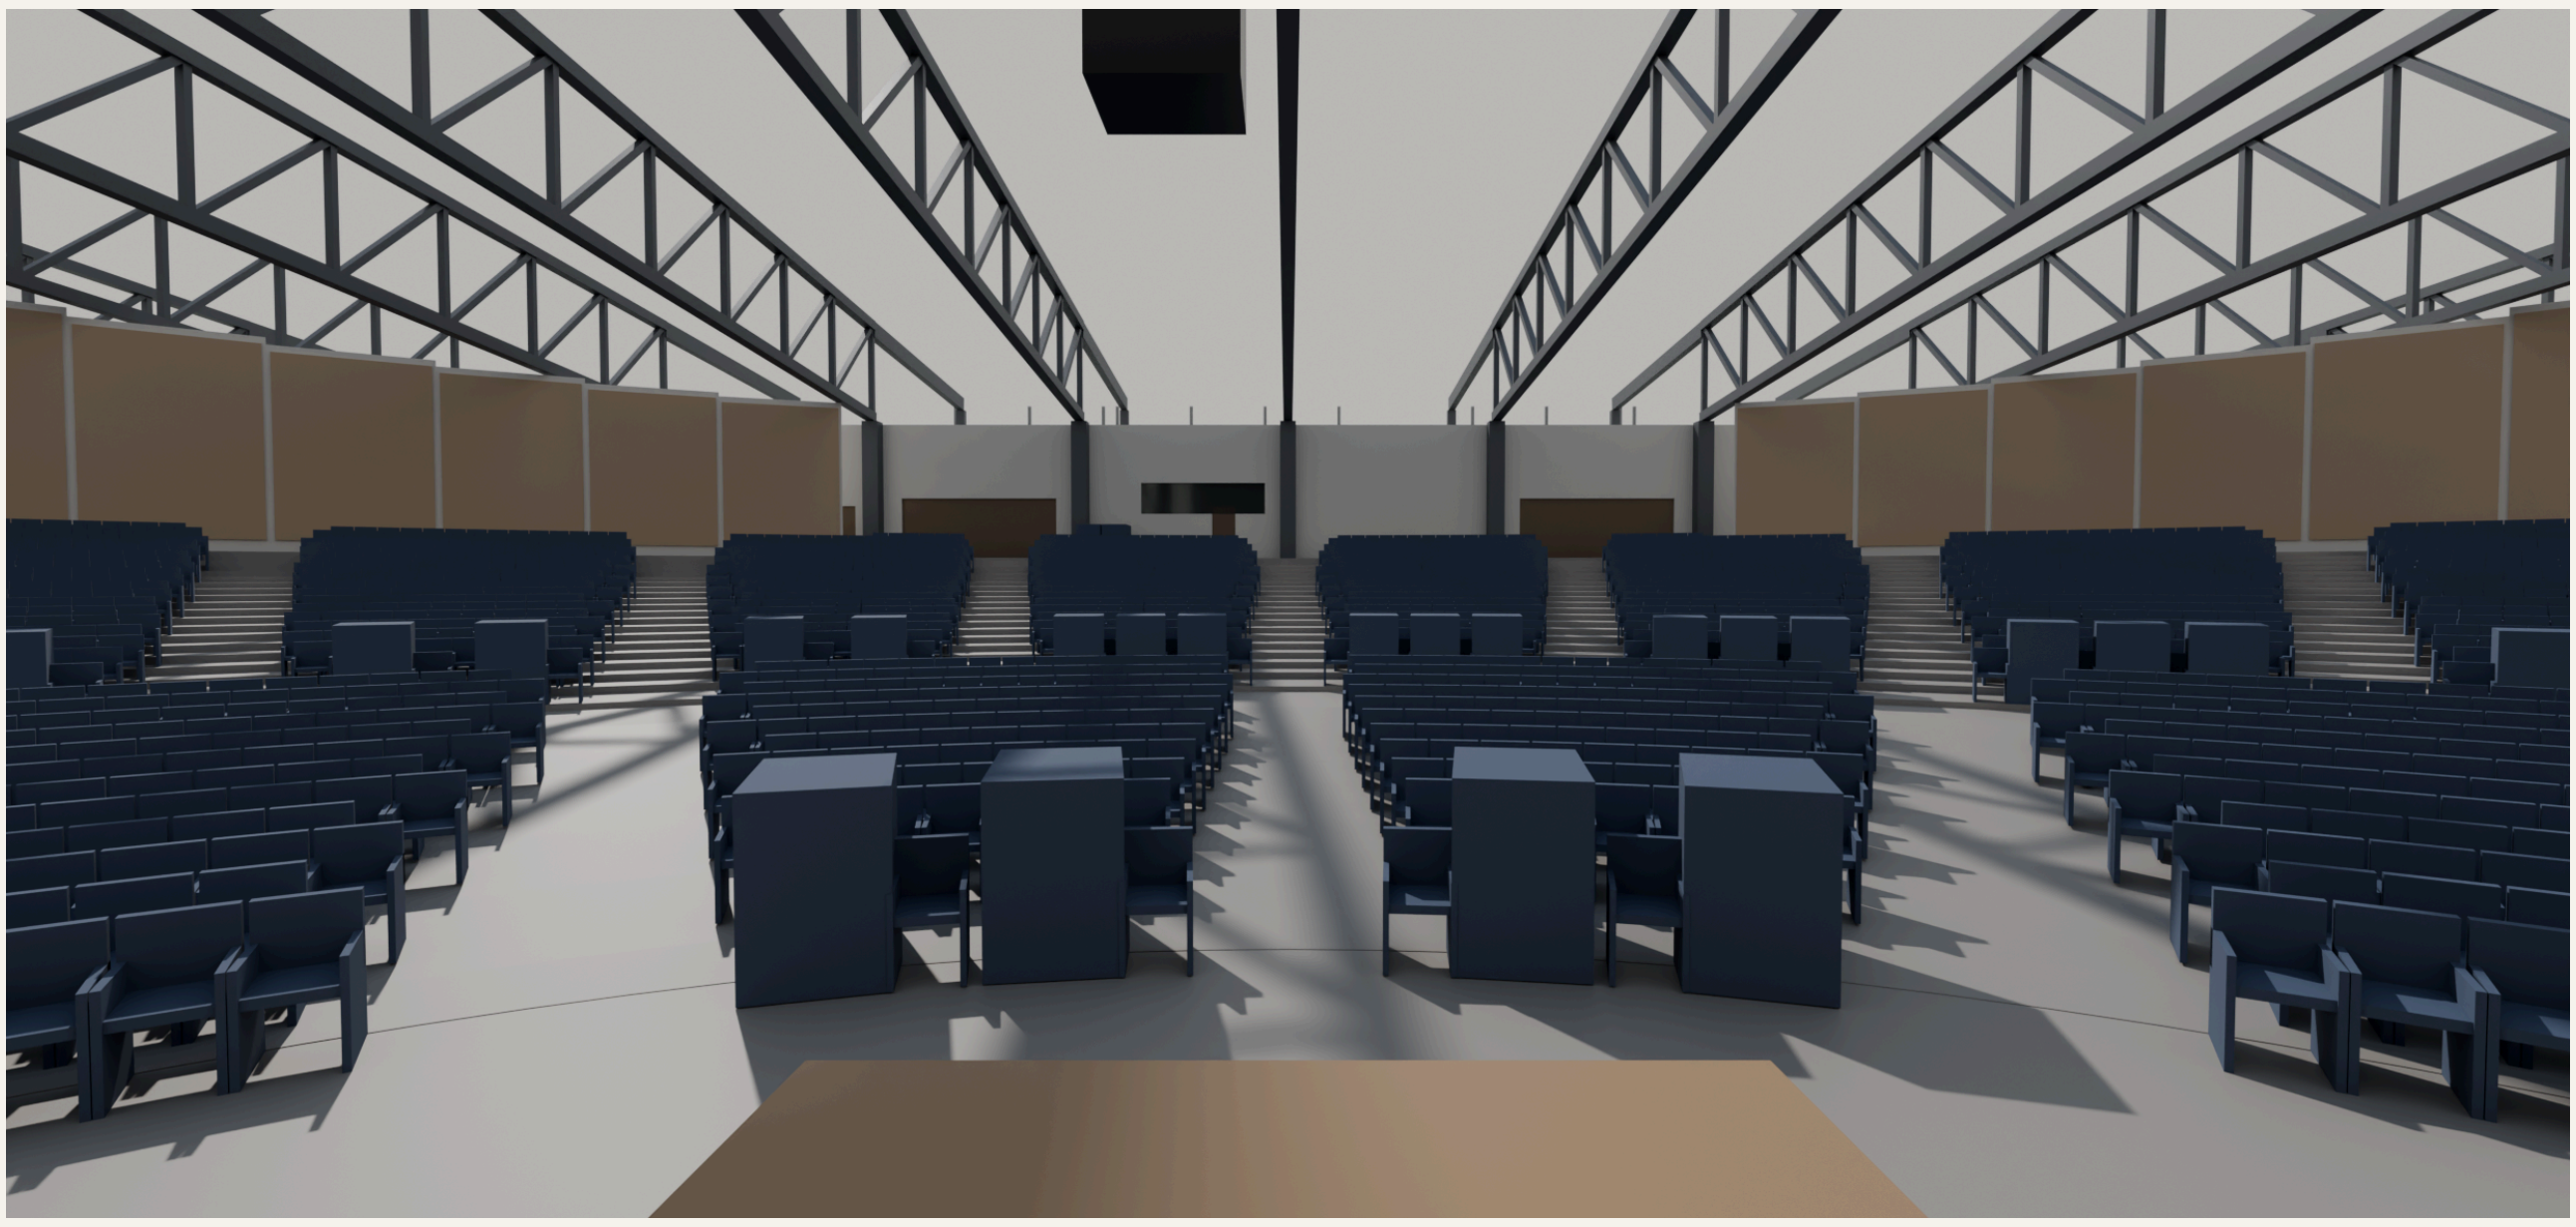

View from the platform · indicative model materials

The views show concept geometry. Acoustic finishes, lighting, screens and service systems require specialist design.

06

Structure

Long-span roof, supporting grid and foundations · concept allowances only

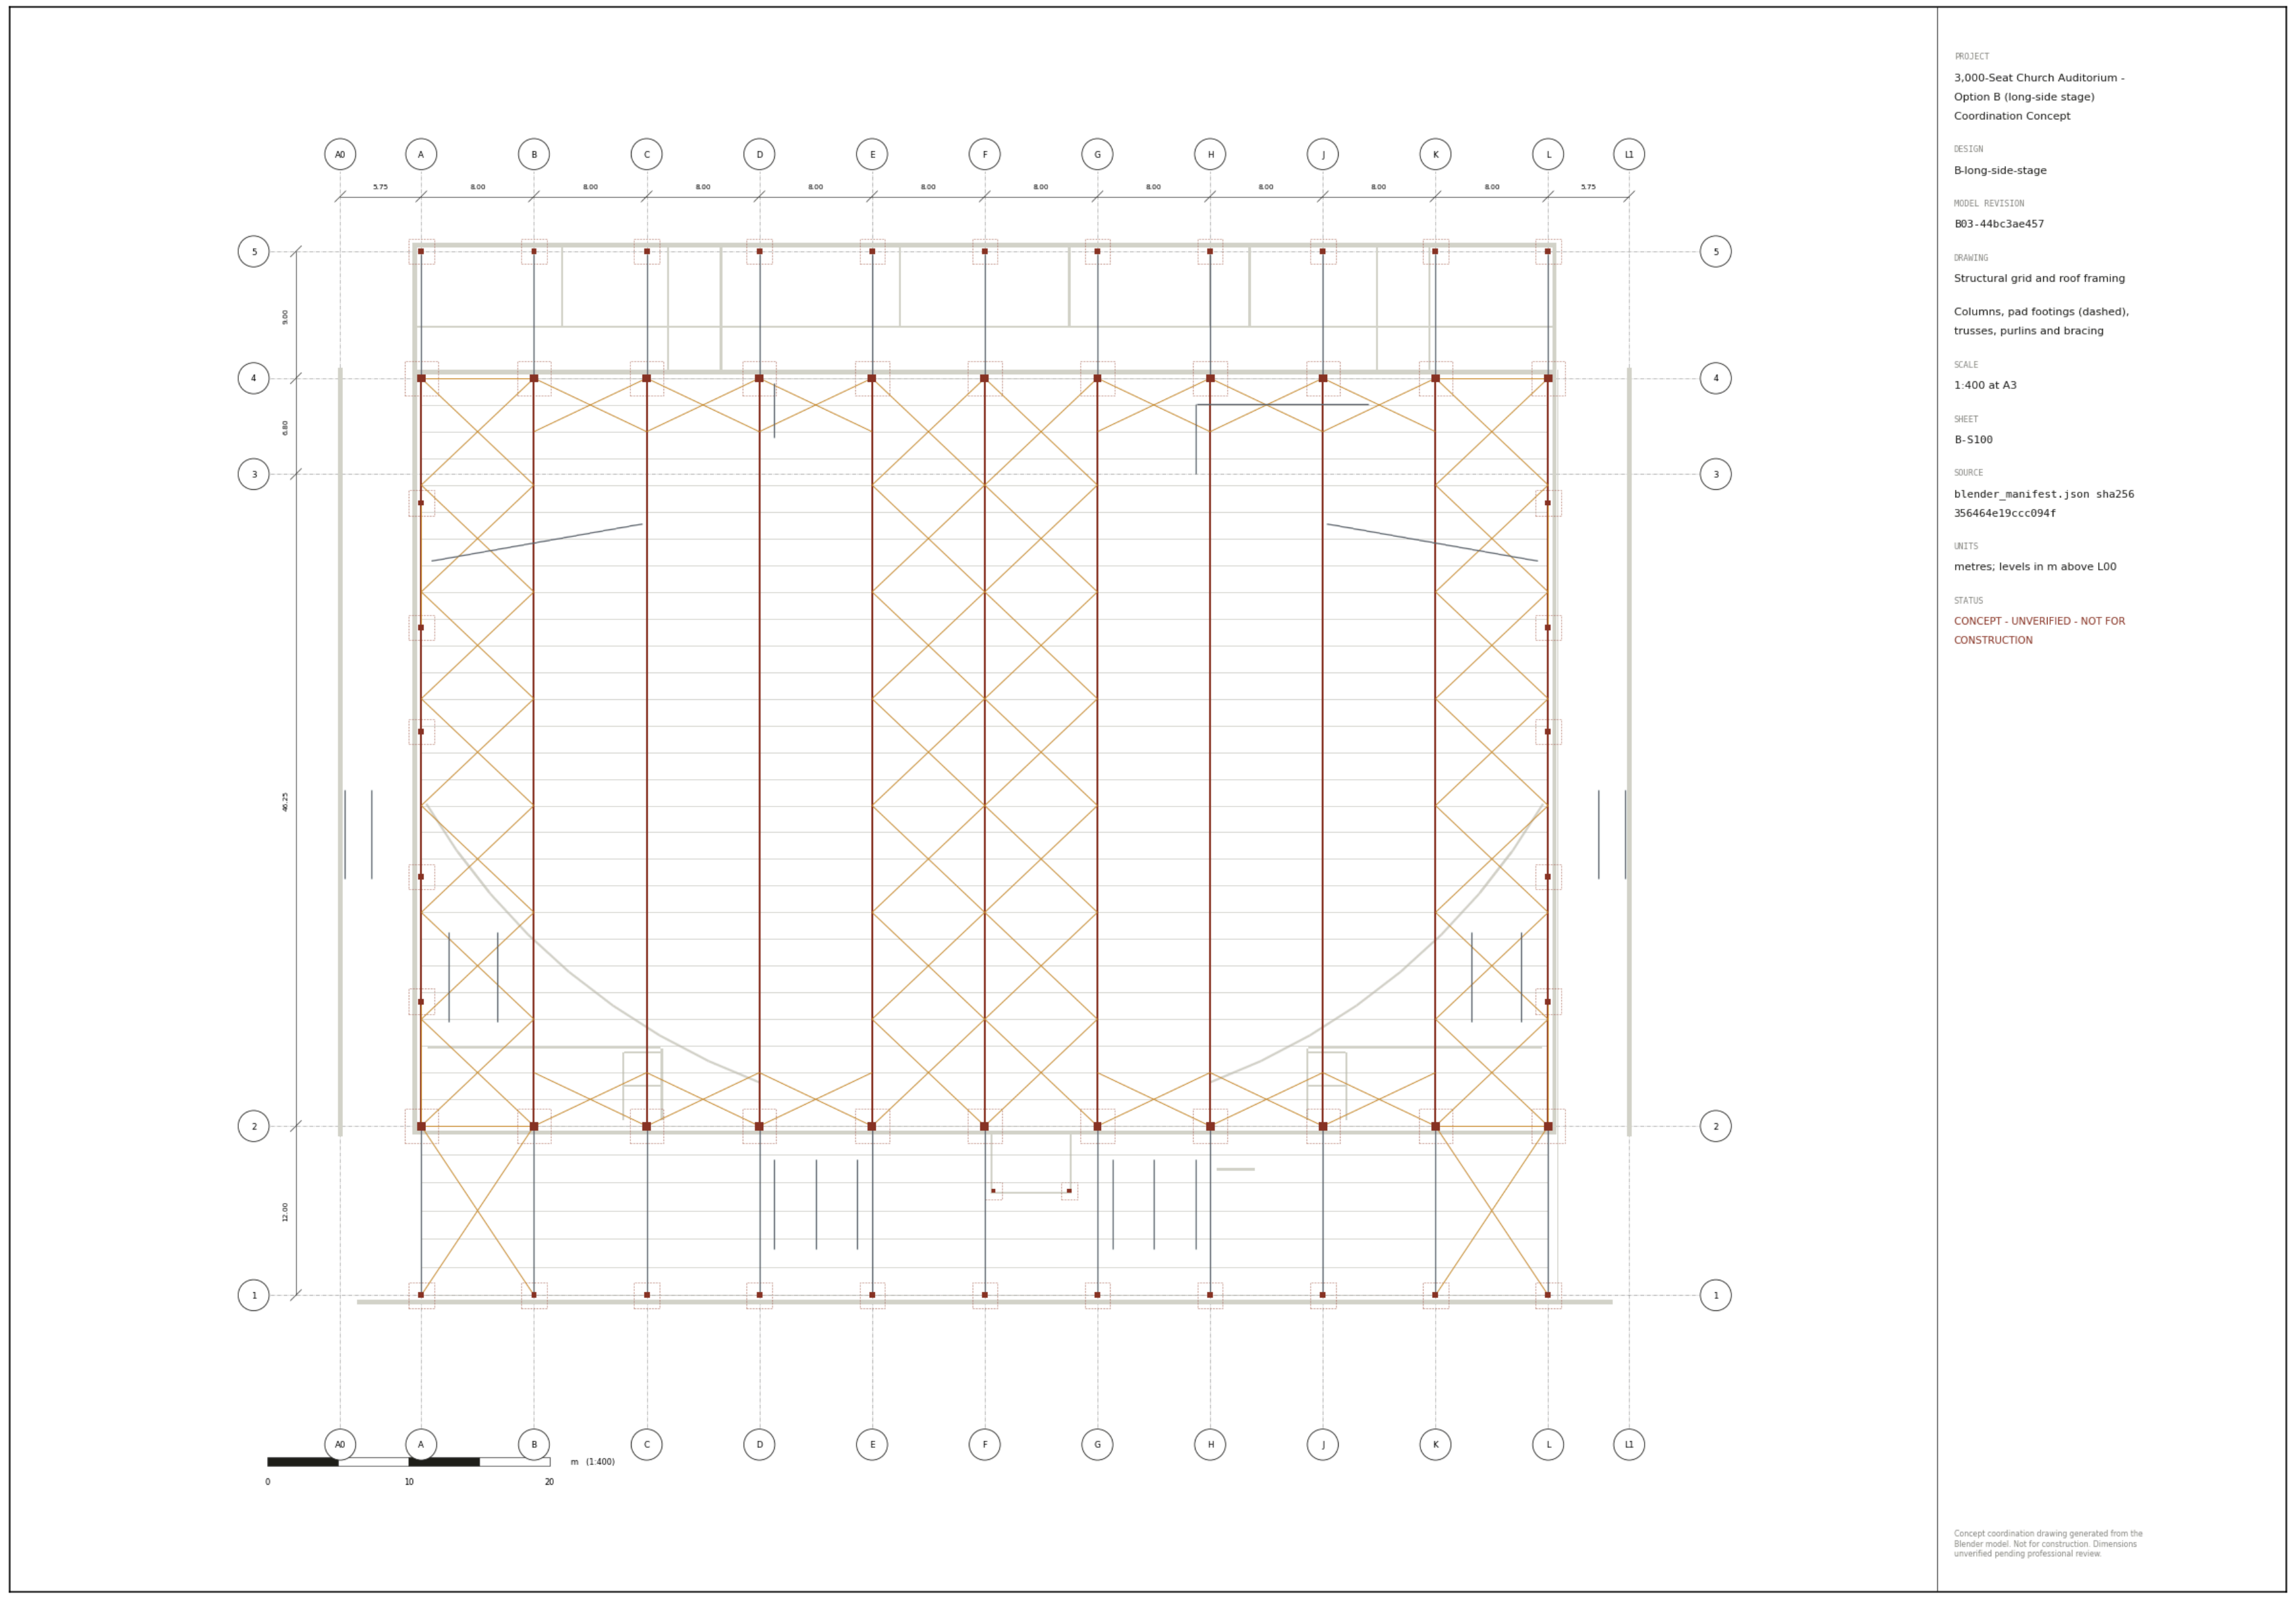

PROJECT
3,000-Seat Church Auditorium -
Option B (long-side stage)
Coordination Concept

DESIGN
B-long-side-stage

MODEL REVISION
B03-44bc3ae457

DRAWING
Structural grid and roof framing

Columns, pad footings (dashed),
trusses, purlins and bracing

SCALE
1:400 at A3

SHEET
B-S100

SOURCE
blender_manifest.json sha256
356464e19ccc094f

UNITS
metres; levels in m above L00

STATUS
CONCEPT - UNVERIFIED - NOT FOR
CONSTRUCTION

Concept coordination drawing generated from the Blender model. Not for construction. Dimensions unverified pending professional review.

06 · STRUCTURE

Structural engineering concept

Eleven steel Pratt trusses span 53.05 m over the hall depth. The foyer roof uses separate 12.0 m rafters. The saved model includes columns, purlins, bracing and pad-footing reservations.

Member sections, connections, wind uplift, deflection, erection sequence and foundations remain to be designed by the structural engineer.

MODEL ELEMENT	COUNT
Columns	56
Trusses	11
Purlins	350
Braces	100

Drawing B-S100 is a model schematic; it is not a steel fabrication design.

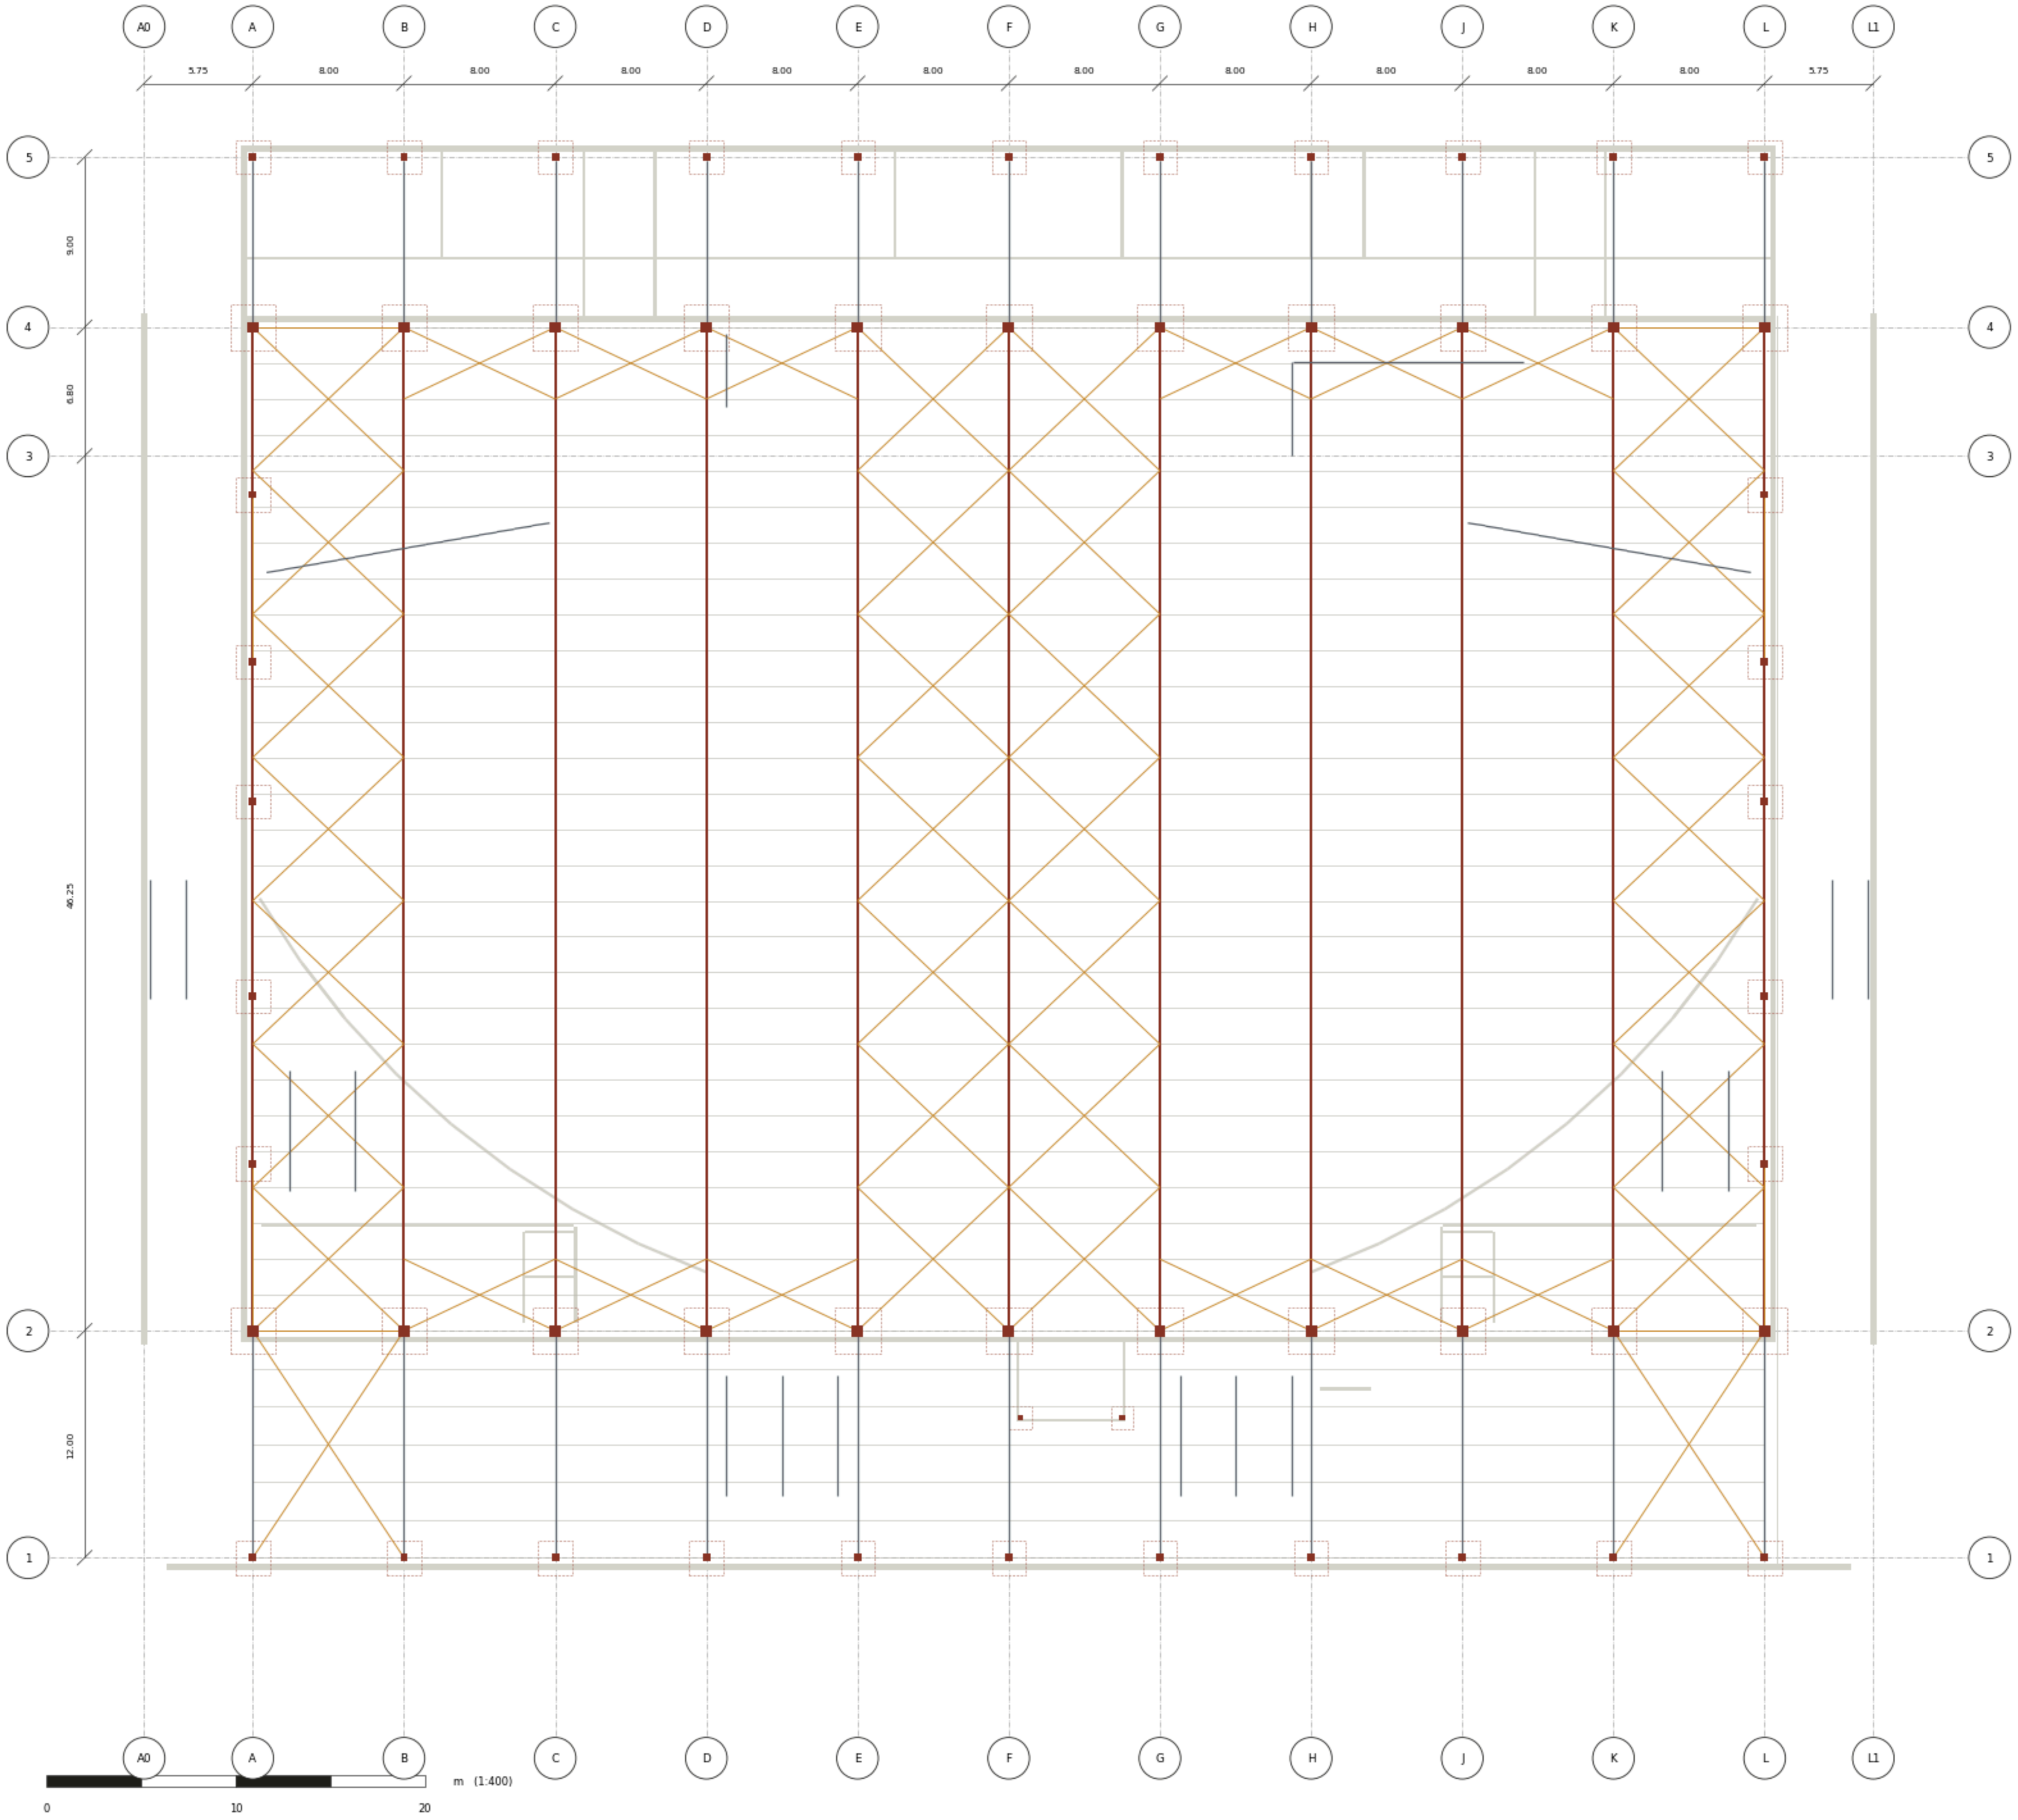
A0
A
B
C
D
E
F
G
H
J
K
L
L1
5.75
8.00
8.00
8.00
8.00
8.00
8.00
8.00
8.00
8.00
8.00
5.75
5
4
3
2
1
9.00
6.80
46.25
12.00
0
10
20
m (1:400)

PROJECT

3,000-Seat Church Auditorium -
Option B (long-side stage)
Coordination Concept

DESIGN

B-long-side-stage

MODEL REVISION

`B03-44bc3ae457`

DRAWING

Structural grid and roof framing

Columns, pad footings (dashed),
trusses, purlins and bracing

SCALE

1:400 at A3

SHEET

B-S100

SOURCE

`blender_manifest.json sha256`
`356464e19ccc094f`

UNITS

metres; levels in m above L00

STATUS

CONCEPT - UNVERIFIED - NOT FOR
CONSTRUCTION

Concept coordination drawing generated from the Blender model. Not for construction. Dimensions unverified pending professional review.

07 · STRUCTURE

Structural member schedules

Counts are from the Option B IFC element schedule. Sections, grades, connections and footing design remain unverified.

CLASS	TYPE	COLLECTION	COUNT	DESIGN STATUS
Beam	BEAM	Beams	22	Not designed
Column	COLUMN	Columns	56	Not designed
Footing	PAD_FOOTING	Foundations	56	Not designed
Member	BRACE	Bracing	100	Not designed
Member	CHORD	Roof_Trusses	308	Not designed
Member	MEMBER	Roof_Trusses	319	Not designed
Member	PURLIN	Roof_Trusses	350	Not designed

08 · DRAWINGS

Building sections

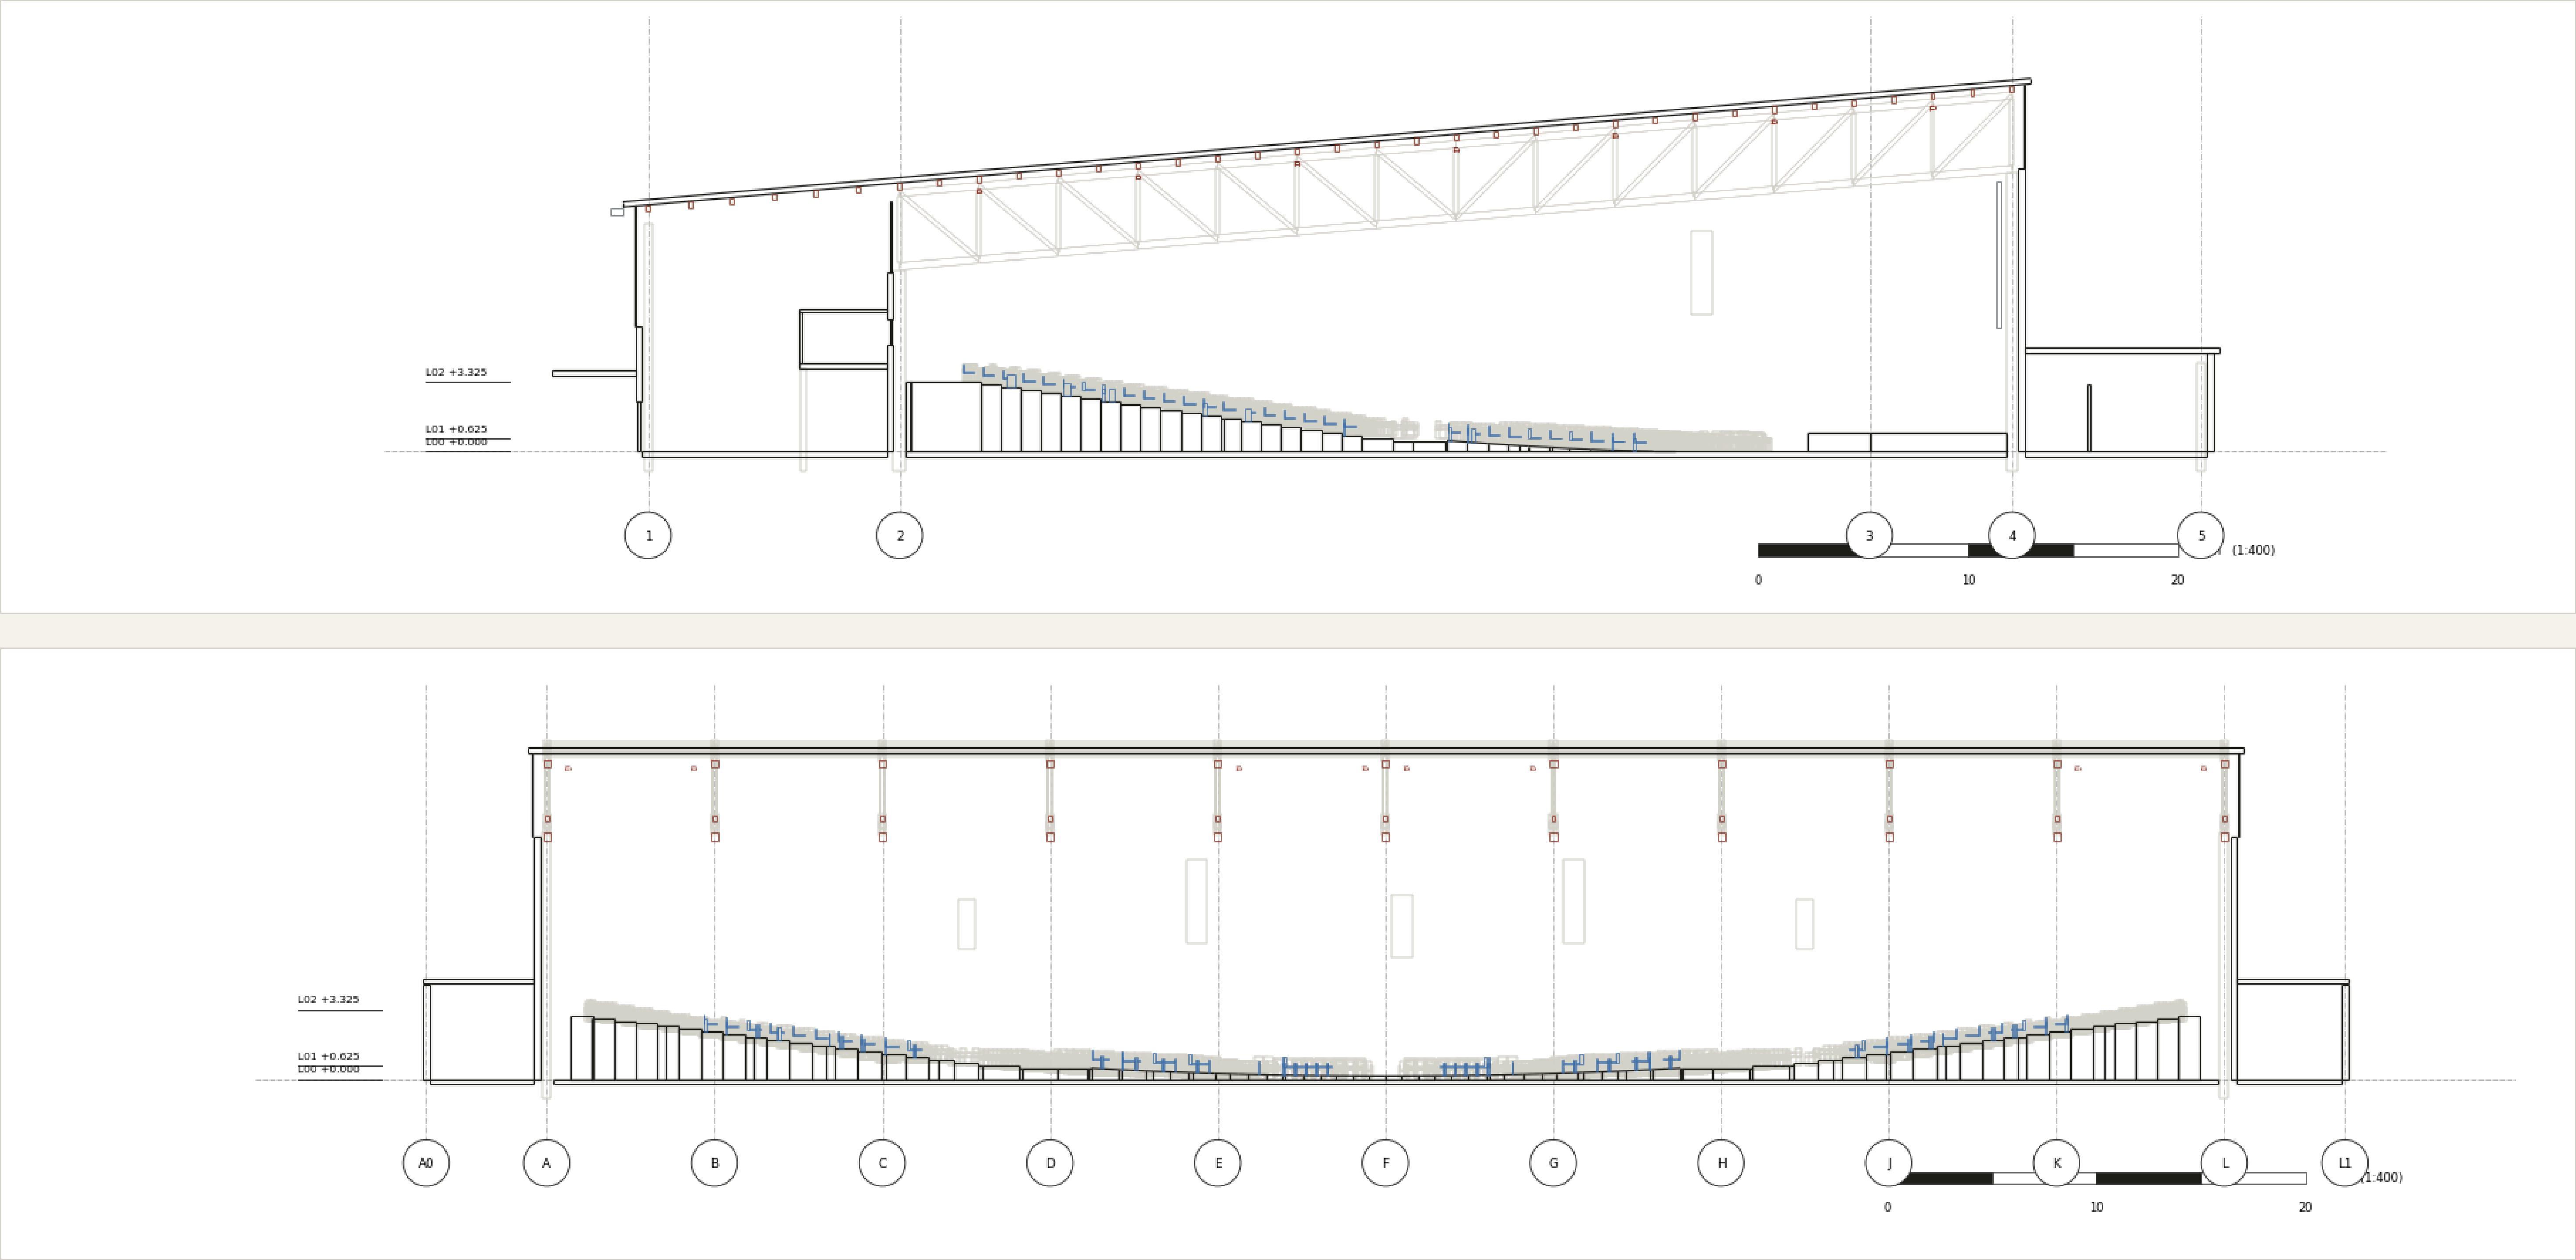
L02 +3.325
L01 +0.625
L00 +0.000
1
2
3
4
5
0
10
20
(1:400)
L02 +3.325
L01 +0.625
L00 +0.000
A0
A
B
C
D
E
F
G
H
J
K
L
L1
0
10
20
(1:400)

Sections A-A and B-B from the saved Option B model · schematic, concept status

09

Functional and building services review

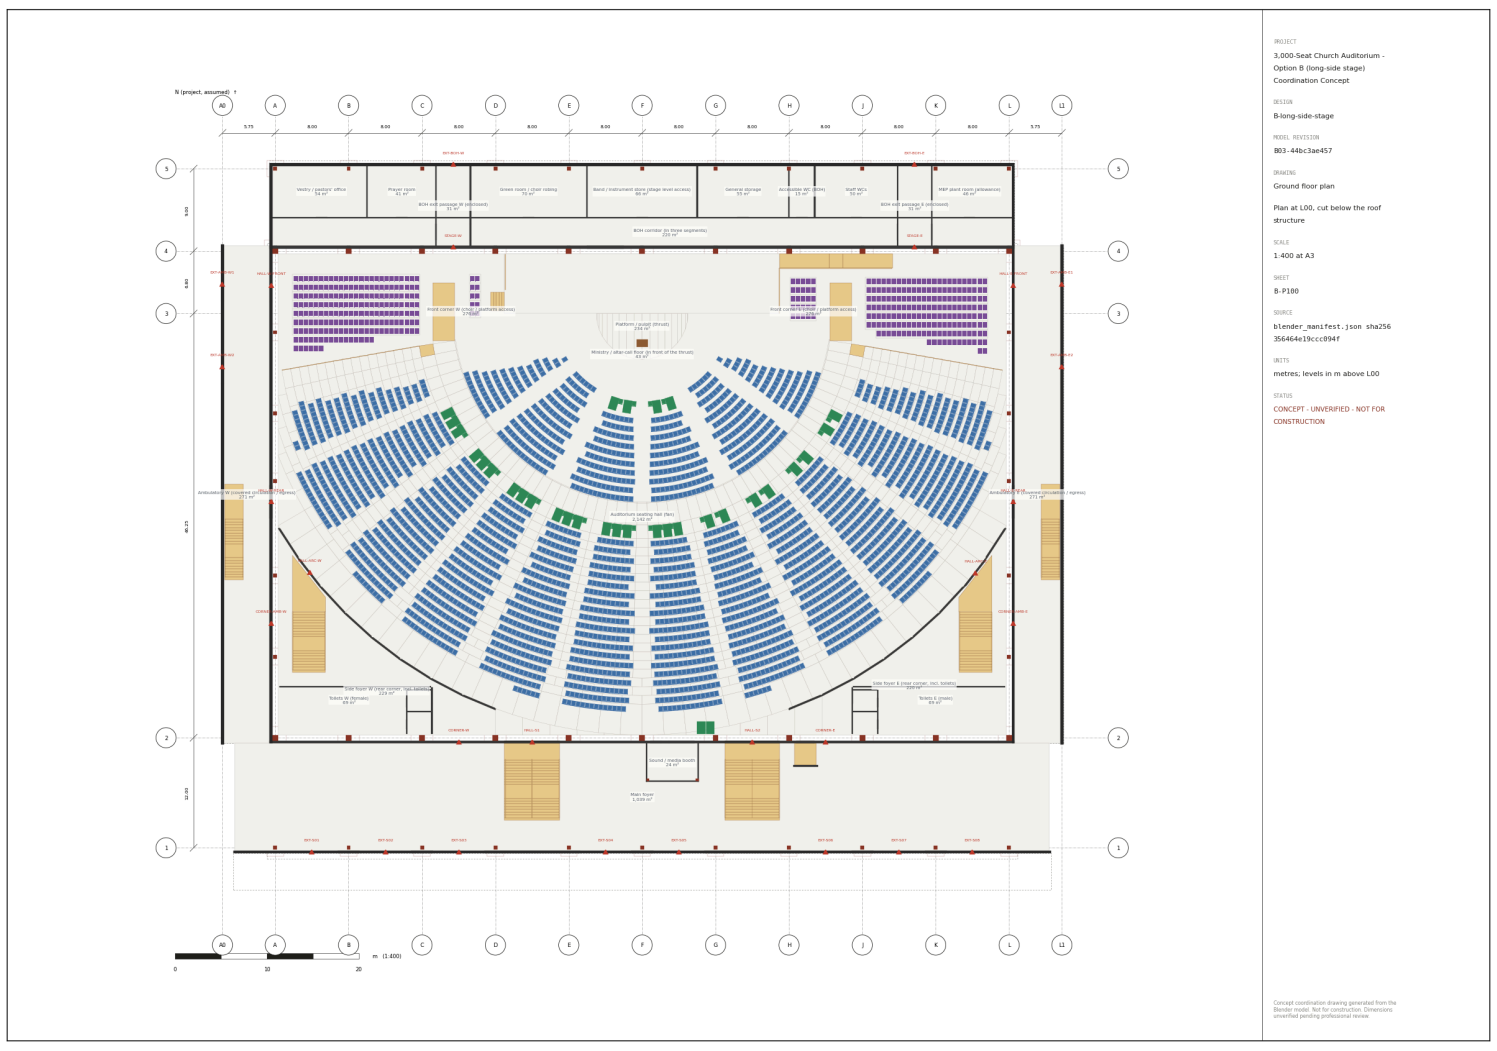
PROJECT
3,000-Seat Church Auditorium - Option B (long-side stage) Coordination Concept
DESIGN
B-long-side-stage
MODEL REVISION
B03-44bc3ae457
DRAWING
Ground floor plan
Plan at L00, cut below the roof structure
SCALE
1:400 at A3
SHEET
B-P100
SOURCE
blender_manifest.json sha256 356464e19ccc094f
UNITS
metres; levels in m above L00
STATUS
CONCEPT - UNVERIFIED - NOT FOR CONSTRUCTION

Concept plan showing circulation, exits and service allowances

01 Ten hall exits are present in the model. Travel and exit-capacity factors are placeholder checks, not code approval.

02 The two central stairs link the rear passage to the full-width foyer; stair and door capacity needs fire-engineer review.

03 The front and cross-aisle wheelchair places and concept ramps need an accessibility audit.

04 The concave rear wall carries an absorptive / diffusive finish allowance; acoustic performance is untested.

05 Three display and five speaker objects are present; screen sightlines, rigging and sound coverage require AV design.

06 A main eaves gutter and downpipes are modelled; overflow, access and harvesting capacity remain to be designed.

07 Electrical, mechanical, ventilation, lighting and detailed plumbing systems are outside the current model.

08 Site levels, storm water strategy, geotechnical conditions and utility connections require surveys and specialist input.

10

Model inventory and preliminary cost drivers

BASIS

The quantities below count model objects only. They are not measured bills, rates, amounts or a cost estimate.

GROUP	TYPE	QUANTITY	BASIS
AudioVisualAppliance	DISPLAY	3	objects
AudioVisualAppliance	SPEAKER	5	objects
Beam	BEAM	22	objects
Column	COLUMN	56	objects
Footing	PAD_FOOTING	56	objects
Furniture	CHAIR	412	objects
Furniture	CHAIR	30	objects
Furniture	CHAIR	3000	objects
Member	BRACE	100	objects
Member	CHORD	308	objects
Member	MEMBER	319	objects
Member	PURLIN	350	objects
PipeSegment	GUTTER	1	objects
PipeSegment	RIGIDSEGMENT	24	objects
SpatialZone	USERDEFINED	32	objects
SpatialZone	USERDEFINED	6	objects

Geometric cost drivers (unpriced)

DRIVER	QUANTITY	METHOD / LIMIT
All roof surfaces	6,844.1 m2	3D area of modelled roof faces; scope to reconcile
Pad-footing solids	140.0 m3	Bounding solid volumes; footing design absent
Truss member centre-lines	2,486.6 m	Length only; steel mass and sections unknown
Purlin centre-lines	2,800.0 m	Length only; steel mass and sections unknown

Pricing [QS] · project budget [QS] · site works and services [to be measured].

11

Design review and engineering risks

STATUS

Review findings R-01 to R-12. Status: open unless stated; these are concept issues, not compliance findings.

ID	PRIORITY	FINDING	NEXT ACTION / OWNER
R-01	Critical	45.4 m hall travel; 30 m flag provisional	Fire engineer: full path and discharge study
R-02	Critical	772 chairs above 60 degrees pulpit bearing	Architect/client: direct views and AV criterion
R-03	High	11 trusses span 53.05 m; no analysis	Structural engineer: load path and feasibility
R-04	High	Hall and roof figures use different boundaries	Architect/BIM: reconciled area schedule
R-05	High	3,562 provisional building occupants	Client/fire designer: approved zone loads
R-06	High	Exit and accessible routes unverified	Fire/access team: continuous route drawings
R-07	High	Object inventory is not a cost estimate	QS: measured and priced take-off
R-08	High	Acoustics and AV coverage untested	Acoustician/AV: schematic studies
R-09	Medium	Movement and roof drainage unverified	Envelope/civil: movement and overflow design
R-10	Medium	Site and MEP inputs outstanding	Survey/MEP: inputs and space reservations
R-11	Medium	A3 sheets need print-scale audit	Document lead: annotation and scale check
R-12	Low	Contents and appendices corrected	Publication lead: final register audit

12

Recommendations and next steps

NEXT PHASE

The next phase is professional design development, starting with the decisions and studies that most affect the plan and roof.

01 Confirm the long-side stage, choir orientation, fan width and ministry floor with the client.

02 Commission site survey, geotechnical investigation and a drainage strategy.

03 Develop the structural scheme, member sizes, joints, bearings, foundations and erection approach.

04 Carry out fire, egress and accessibility design against the applicable local requirements.

05 Commission acoustic, audiovisual, mechanical and electrical design studies.

06 Resolve drawings, specifications and measured quantities before cost planning.

07 Issue coordinated professional documentation only after review and sign-off.

APPENDIX A

Technical drawing register

NO.	DRAWING	SHEET	STATUS
B-P100	Ground floor plan	A3	Model schematic
B-P110	Seating, aisles and exits	A3	Model schematic
B-S100	Structural grid and roof framing	A3	Model schematic
B-S300	Section across hall depth	A3	Model schematic
A-A / B-B	Model sections	A3	Concept export

Every sheet is derived from Option B model revision B03-44bc3ae457. Scales apply only at 100% A3 print size.

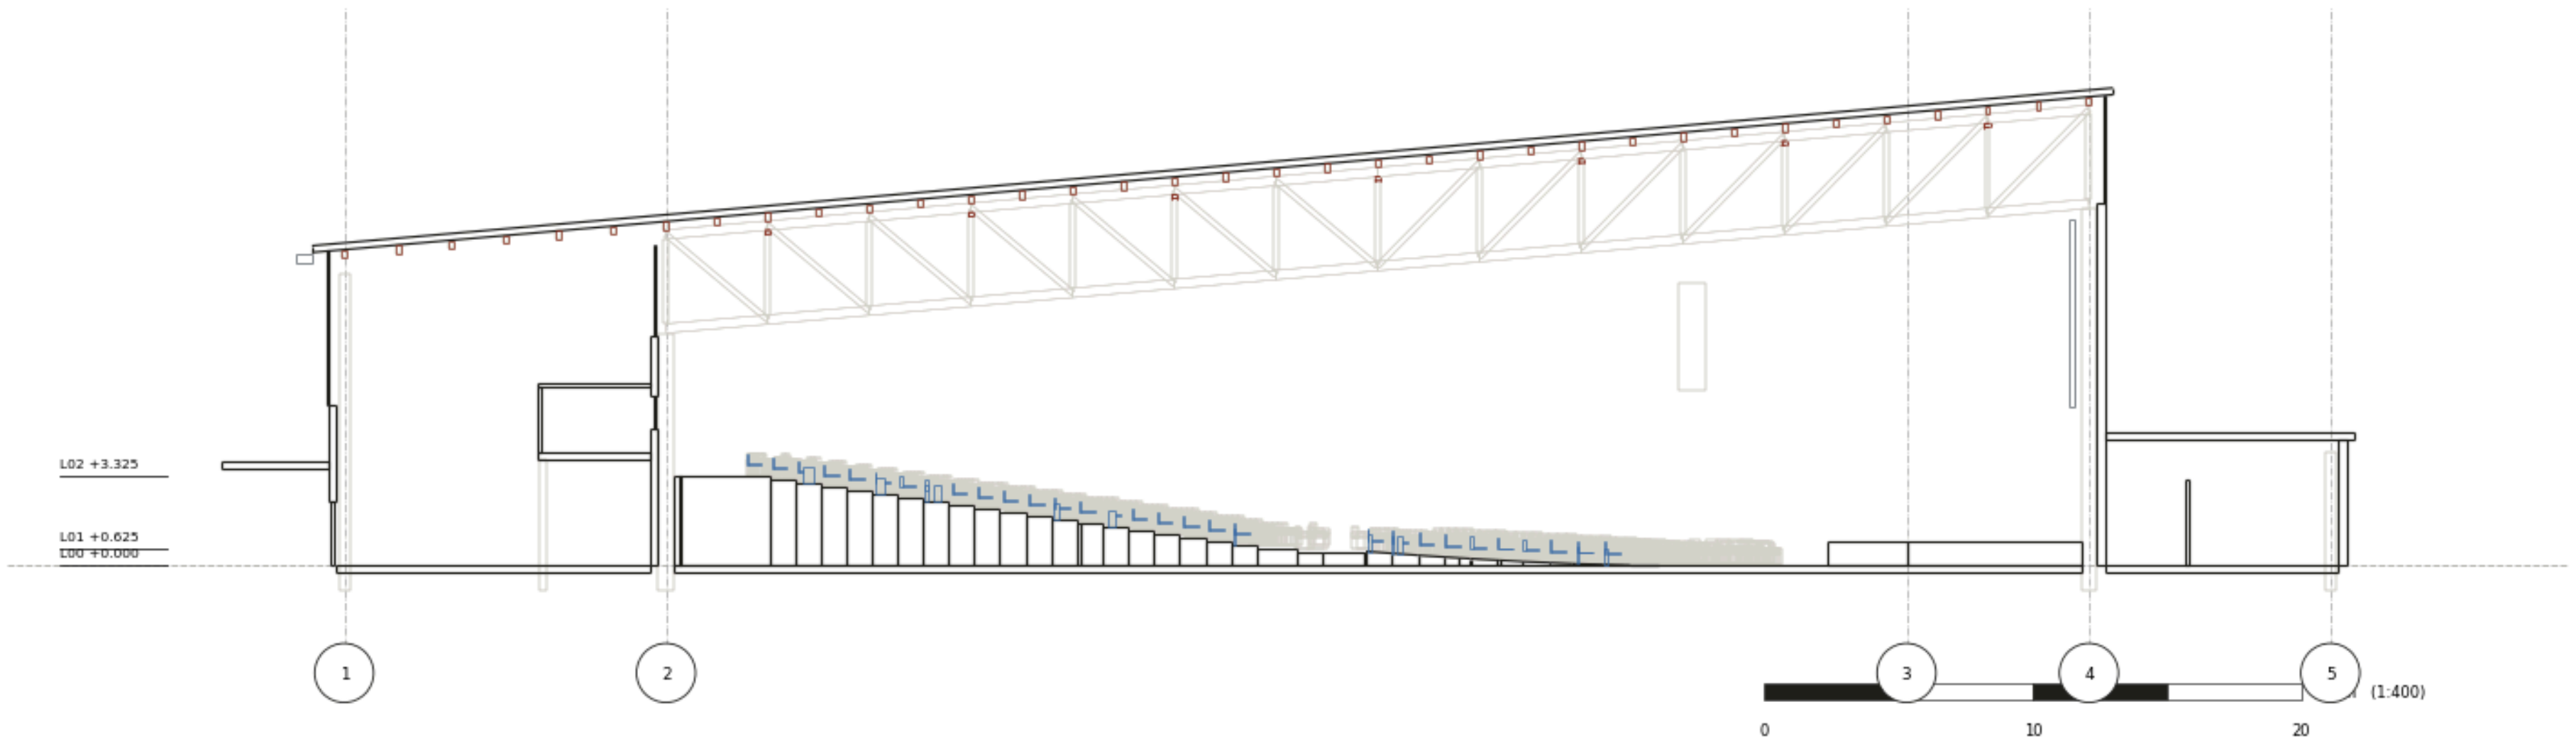

PROJECT

3,000-Seat Church Auditorium -
Option B (long-side stage)
Coordination Concept

DESIGN

B-long-side-stage

MODEL REVISION

B03-44bc3ae457

DRAWING

Section A-A

Cut on x = 44.00 m, looking
towards +x

SCALE

1:400 at A3

SHEET

B-S300

SOURCE

`blender_manifest.json sha256`
`356464e19ccc094f`

UNITS

metres; levels in m above L00

STATUS

CONCEPT - UNVERIFIED - NOT FOR
CONSTRUCTION

Concept coordination drawing generated from the Blender model. Not for construction. Dimensions unverified pending professional review.

APPENDIX C

Column schedule

Rows 1–28 of 56 · nominal sections are model placeholders, not structural design.

COLUMN	GRID	ROLE	NOMINAL SECTION
A-P1	A-P1	side-wall post (end frame)	0.40x0.40 placeholder
A-P2	A-P2	side-wall post (end frame)	0.40x0.40 placeholder
A-P3	A-P3	side-wall post (end frame)	0.40x0.40 placeholder
A-P4	A-P4	side-wall post (end frame)	0.40x0.40 placeholder
A-P5	A-P5	side-wall post (end frame)	0.40x0.40 placeholder
A1	A1	foyer facade (foyer rafter support)	0.40x0.40 placeholder
A2	A2	hall rear (truss support)	0.60x0.60 placeholder
A4	A4	stage wall (truss support)	0.60x0.60 placeholder
A5	A5	back-of-house	0.40x0.40 placeholder
B1	B1	foyer facade (foyer rafter support)	0.40x0.40 placeholder
B2	B2	hall rear (truss support)	0.60x0.60 placeholder
B4	B4	stage wall (truss support)	0.60x0.60 placeholder
B5	B5	back-of-house	0.40x0.40 placeholder
BOOTH-1		booth support	0.30x0.30 placeholder
BOOTH-2		booth support	0.30x0.30 placeholder
C1	C1	foyer facade (foyer rafter support)	0.40x0.40 placeholder
C2	C2	hall rear (truss support)	0.60x0.60 placeholder
C4	C4	stage wall (truss support)	0.60x0.60 placeholder
C5	C5	back-of-house	0.40x0.40 placeholder
D1	D1	foyer facade (foyer rafter support)	0.40x0.40 placeholder
D2	D2	hall rear (truss support)	0.60x0.60 placeholder
D4	D4	stage wall (truss support)	0.60x0.60 placeholder
D5	D5	back-of-house	0.40x0.40 placeholder
E1	E1	foyer facade (foyer rafter support)	0.40x0.40 placeholder
E2	E2	hall rear (truss support)	0.60x0.60 placeholder
E4	E4	stage wall (truss support)	0.60x0.60 placeholder
E5	E5	back-of-house	0.40x0.40 placeholder
F1	F1	foyer facade (foyer rafter support)	0.40x0.40 placeholder

APPENDIX C

Column schedule (continued)

Rows 29–56 of 56 · nominal sections are model placeholders, not structural design.

COLUMN	GRID	ROLE	NOMINAL SECTION
F2	F2	hall rear (truss support)	0.60x0.60 placeholder
F4	F4	stage wall (truss support)	0.60x0.60 placeholder
F5	F5	back-of-house	0.40x0.40 placeholder
G1	G1	foyer facade (foyer rafter support)	0.40x0.40 placeholder
G2	G2	hall rear (truss support)	0.60x0.60 placeholder
G4	G4	stage wall (truss support)	0.60x0.60 placeholder
G5	G5	back-of-house	0.40x0.40 placeholder
H1	H1	foyer facade (foyer rafter support)	0.40x0.40 placeholder
H2	H2	hall rear (truss support)	0.60x0.60 placeholder
H4	H4	stage wall (truss support)	0.60x0.60 placeholder
H5	H5	back-of-house	0.40x0.40 placeholder
J1	J1	foyer facade (foyer rafter support)	0.40x0.40 placeholder
J2	J2	hall rear (truss support)	0.60x0.60 placeholder
J4	J4	stage wall (truss support)	0.60x0.60 placeholder
J5	J5	back-of-house	0.40x0.40 placeholder
K1	K1	foyer facade (foyer rafter support)	0.40x0.40 placeholder
K2	K2	hall rear (truss support)	0.60x0.60 placeholder
K4	K4	stage wall (truss support)	0.60x0.60 placeholder
K5	K5	back-of-house	0.40x0.40 placeholder
L-P1	L-P1	side-wall post (end frame)	0.40x0.40 placeholder
L-P2	L-P2	side-wall post (end frame)	0.40x0.40 placeholder
L-P3	L-P3	side-wall post (end frame)	0.40x0.40 placeholder
L-P4	L-P4	side-wall post (end frame)	0.40x0.40 placeholder
L-P5	L-P5	side-wall post (end frame)	0.40x0.40 placeholder
L1	L1	foyer facade (foyer rafter support)	0.40x0.40 placeholder
L2	L2	hall rear (truss support)	0.60x0.60 placeholder
L4	L4	stage wall (truss support)	0.60x0.60 placeholder
L5	L5	back-of-house	0.40x0.40 placeholder

APPENDIX D

Assumptions register and calculations

BASIS

This page summarises documented Option B assumptions. Full wording remains in the source register.

ID	ASSUMPTION	CONFIDENCE
B-01	Flat site at a single grade; all floors at or above grade (no excavation). A sloping site could lower the front of the hall and shorten the ramps - review once surveyed.	Medium
B-02	Long-span roof: 11 steel Pratt trusses, simply supported grid 2 -> 4 (span = hall depth, 53.05 m), 3.5 m deep, mono-pitch 5 deg; foyer on separate rafters; member sizes are placeholders.	Low
B-03	Choir on tiers beside the platform faces the congregation; this changes the earlier inward-facing preference and needs client confirmation.	Medium
B-04	Seat, aisle, row, sightline (C-value) and egress placeholder factors identical to Option A for a like-for-like comparison; none is a verified local code value.	High

APPENDIX E

Verification report and model references

SCOPE

These automated checks verify internal consistency of the concept model. They do not approve life safety or structural performance.

CHECK SET	PASS	FAIL	WARN
Geometry checks	31	0	2
Re-opened Blender model	17	0	0
IFC validation	21	0	0

Source model

RECORD	VALUE
Design ID	B-long-side-stage
Model revision	B03-44bc3ae457
Blender	5.2.3 LTS
Manifest SHA-256	356464e19ccc094f284d8ae1a5c6...

APPENDIX F

Revision history

ISSUE	REVISION	DESCRIPTION
Publication	B03-44bc3ae457	Report assembled from saved model and verified report files

Document date is the publication date. Review scores measure QA progress only.

APPENDIX G

Dimensioned drawings

These sheets carry dimensions measured directly from the evaluated concept model: every object transform and the model units are applied before measuring. The same dimension objects sit in a separate, hideable collection of a copy of the model; the source model itself is not modified.

Conventions. Linear dimensions in millimetres; levels in metres above L00 (±0.000); angles in degrees. Values marked **(P)** in orange are modelled placeholders (column sections, truss depths, footing sizes and locations) - space reservations, not engineered specifications. Sheets are A1 originals reproduced at half size, so every scale halves on these pages.

Drawing register

SHEET	DRAWING	SCALE	LABELS
B-D-101	Ground floor plan - general arrangement dimensions	1:200 at A1 / 1:400 here	94
B-D-102	Seating - row pitch and aisle clear widths	1:200 at A1 / 1:400 here	77
B-D-103a	Stairs - plans and sections	1:50, 1:100 at A1 / 1:100, 1:200 here	19
B-D-103b	Stairs - plans and sections	1:50 at A1 / 1:100 here	17
B-D-103c	Stairs - plans and sections	1:50 at A1 / 1:100 here	9
B-D-201	Foundation plan - footing locations and modelled sizes	1:200 at A1 / 1:400 here	96
B-D-202	Roof framing plan - truss spans, pitch, ridge and eaves	1:200 at A1 / 1:400 here	26
B-D-301	Longitudinal section	1:200 at A1 / 1:400 here	18
B-D-302	Transverse section	1:200 at A1 / 1:400 here	28
B-D-401	Elevations - south and north	1:200 at A1 / 1:400 here	18
B-D-402	Elevations - east and west	1:200 at A1 / 1:400 here	20

Independent checks

CHECK	SCOPE	RESULT
Source model unchanged; building geometry identical with dimensions shown and hidden	5,035 objects	Pass
Every label equals the length of its own dimension line in the 3-D model	422 labels	Pass
Every label present as text on its sheet	422 labels	Pass
No overlapping labels; none outside its drawing	422 labels	Pass
Measured values against independent references (builder record, element data, design parameters)	1,301 values	1,299 agree, 2 differ

Findings

- 2 aisle clear width(s) measure 1467 mm, below the 1500 mm placeholder minimum. Flag for design review.
- 11 raked floor elements are modelled with reversed faces; their levels on the drawings are taken from geometry. To be corrected in the model.

Concept - unverified - not for construction. Dimensions are taken from the concept model and are not a survey or a construction setting-out.

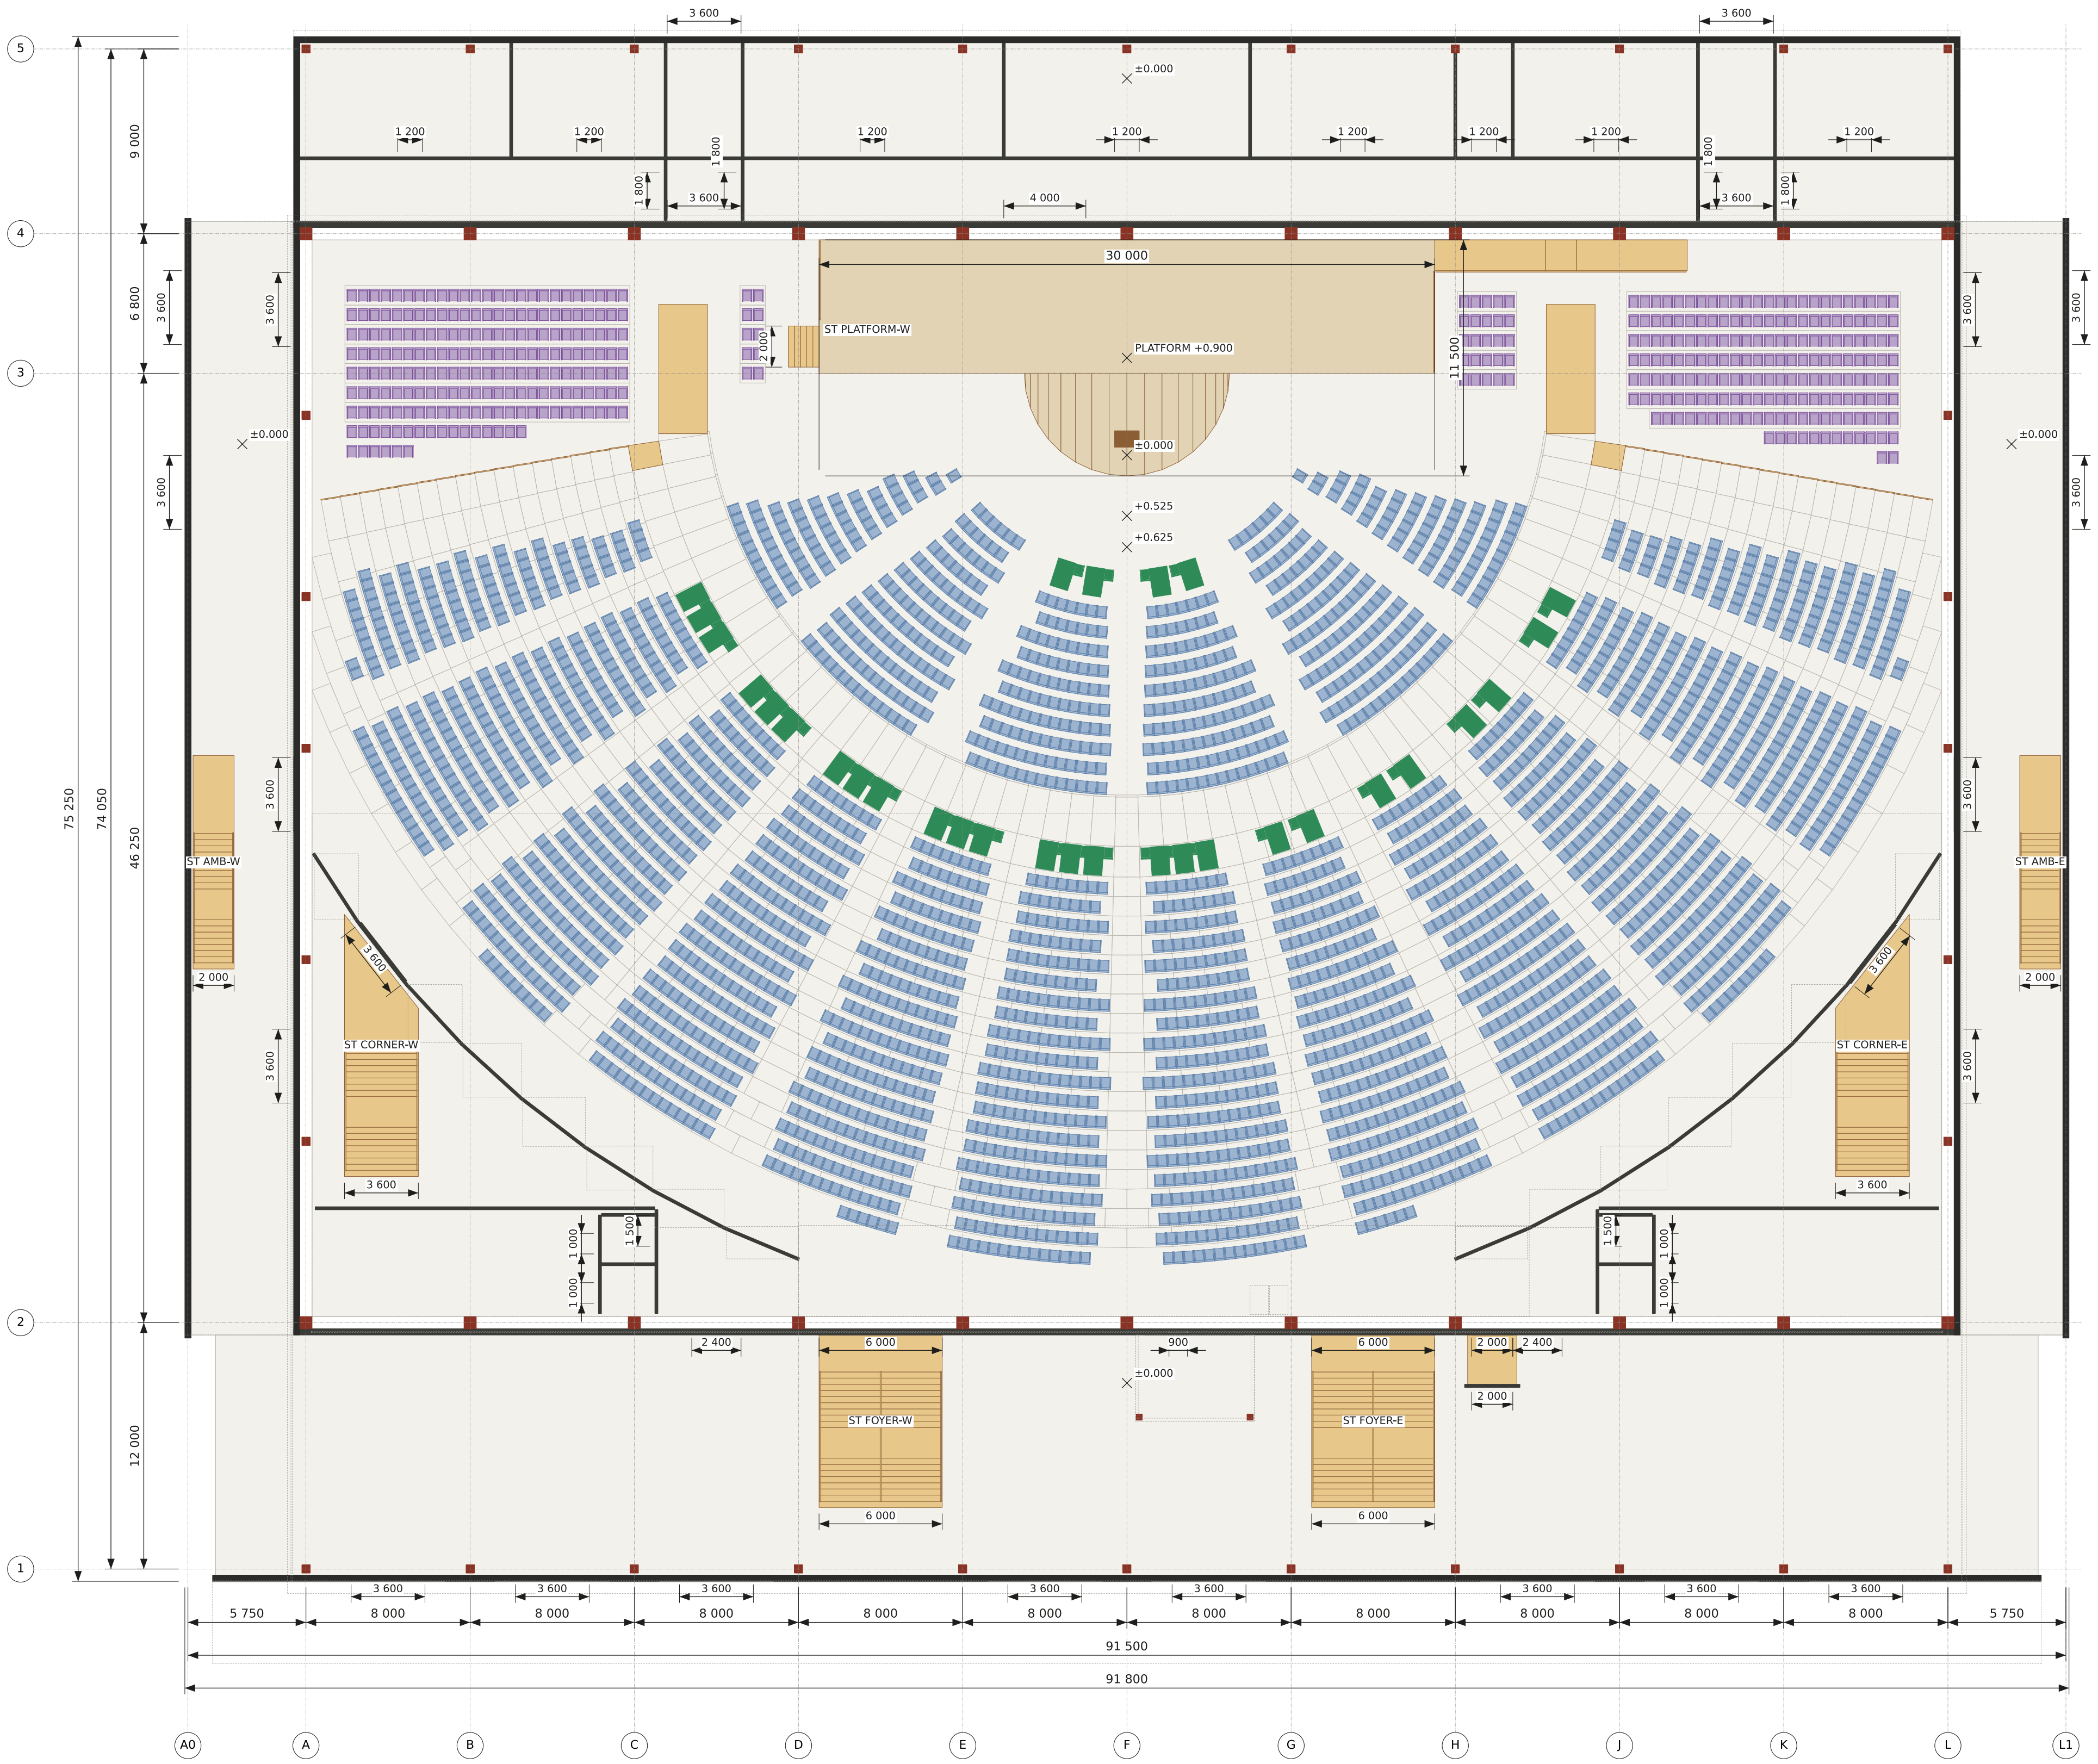
3 600
3 600
±0.000
1 200
1 200
1 200
1 200
1 200
1 200
1 200
1 200
1 800
1 800
1 800
1 800
3 600
4 000
3 600
9 000
6 800
3 600
3 600
30 000
ST PLATFORM-W
PLATFORM +0.900
11 500
2 000
±0.000
±0.000
±0.000
+0.525
+0.625
3 600
3 600
3 600
3 600
3 600
3 600
75 250
74 050
46 250
ST AMB-W
ST AMB-E
2 000
2 000
3 600
3 600
ST CORNER-W
ST CORNER-E
3 600
3 600
3 600
1 000
1 000
1 500
1 500
1 000
1 000
2 400
6 000
900
6 000
2 000
2 400
±0.000
2 000
ST FOYER-W
ST FOYER-E
6 000
6 000
12 000
5
4
3
2
1
3 600
3 600
3 600
3 600
3 600
3 600
3 600
3 600
5 750
8 000
8 000
8 000
8 000
8 000
8 000
8 000
8 000
8 000
8 000
5 750
91 500
91 800
A0
A
B
C
D
E
F
G
H
J
K
L
L1

1 GROUND FLOOR PLAN (L00) - GENERAL ARRANGEMENT

SCALE 1:200

PROJECT

3,000-Seat Church Auditorium - Option B
(long-side stage) Coordination Concept

DESIGN

Option B - long-side stage

MODEL REVISION

B03-44bc3ae457

SOURCE MODEL (read-only, unmodified)

`designs/B-long-side-stage/model/church_3000_B.blend`
`sha256 ed9987dac0e70cab`

GEOMETRY

Evaluated Blender geometry (modifiers, matrix_world, scale_length applied)

DRAWING

Ground floor plan - general arrangement dimensions

SCALES

1:200 at A1 (half at A3)

UNITS

Linear dimensions in millimetres. Levels in metres above L00 (±0.000). Angles in degrees.

(P) Modelled PLACEHOLDER / space reservation / reference location - NOT an engineered size

Door opening widths (measured)

Width	No.
900	1
1 000	4
1 200	8
1 500	2
1 800	4
2 000	2
2 400	2
3 600	24
4 000	1
6 000	2

Width = modelled door opening (longest horizontal edge of the door mesh). Effective clear width after leaf/frame deductions is not modelled.

STATUS

CONCEPT - UNVERIFIED - NOT FOR CONSTRUCTION

Dimensions are measured from the concept model and checked against independently computed values (validation_report.md). Structural member, footing and truss depth sizes are placeholders pending engineering design. Site levels unknown.

SHEET

B-D-101

Generated 2026-11-02 | A1 841 x 594

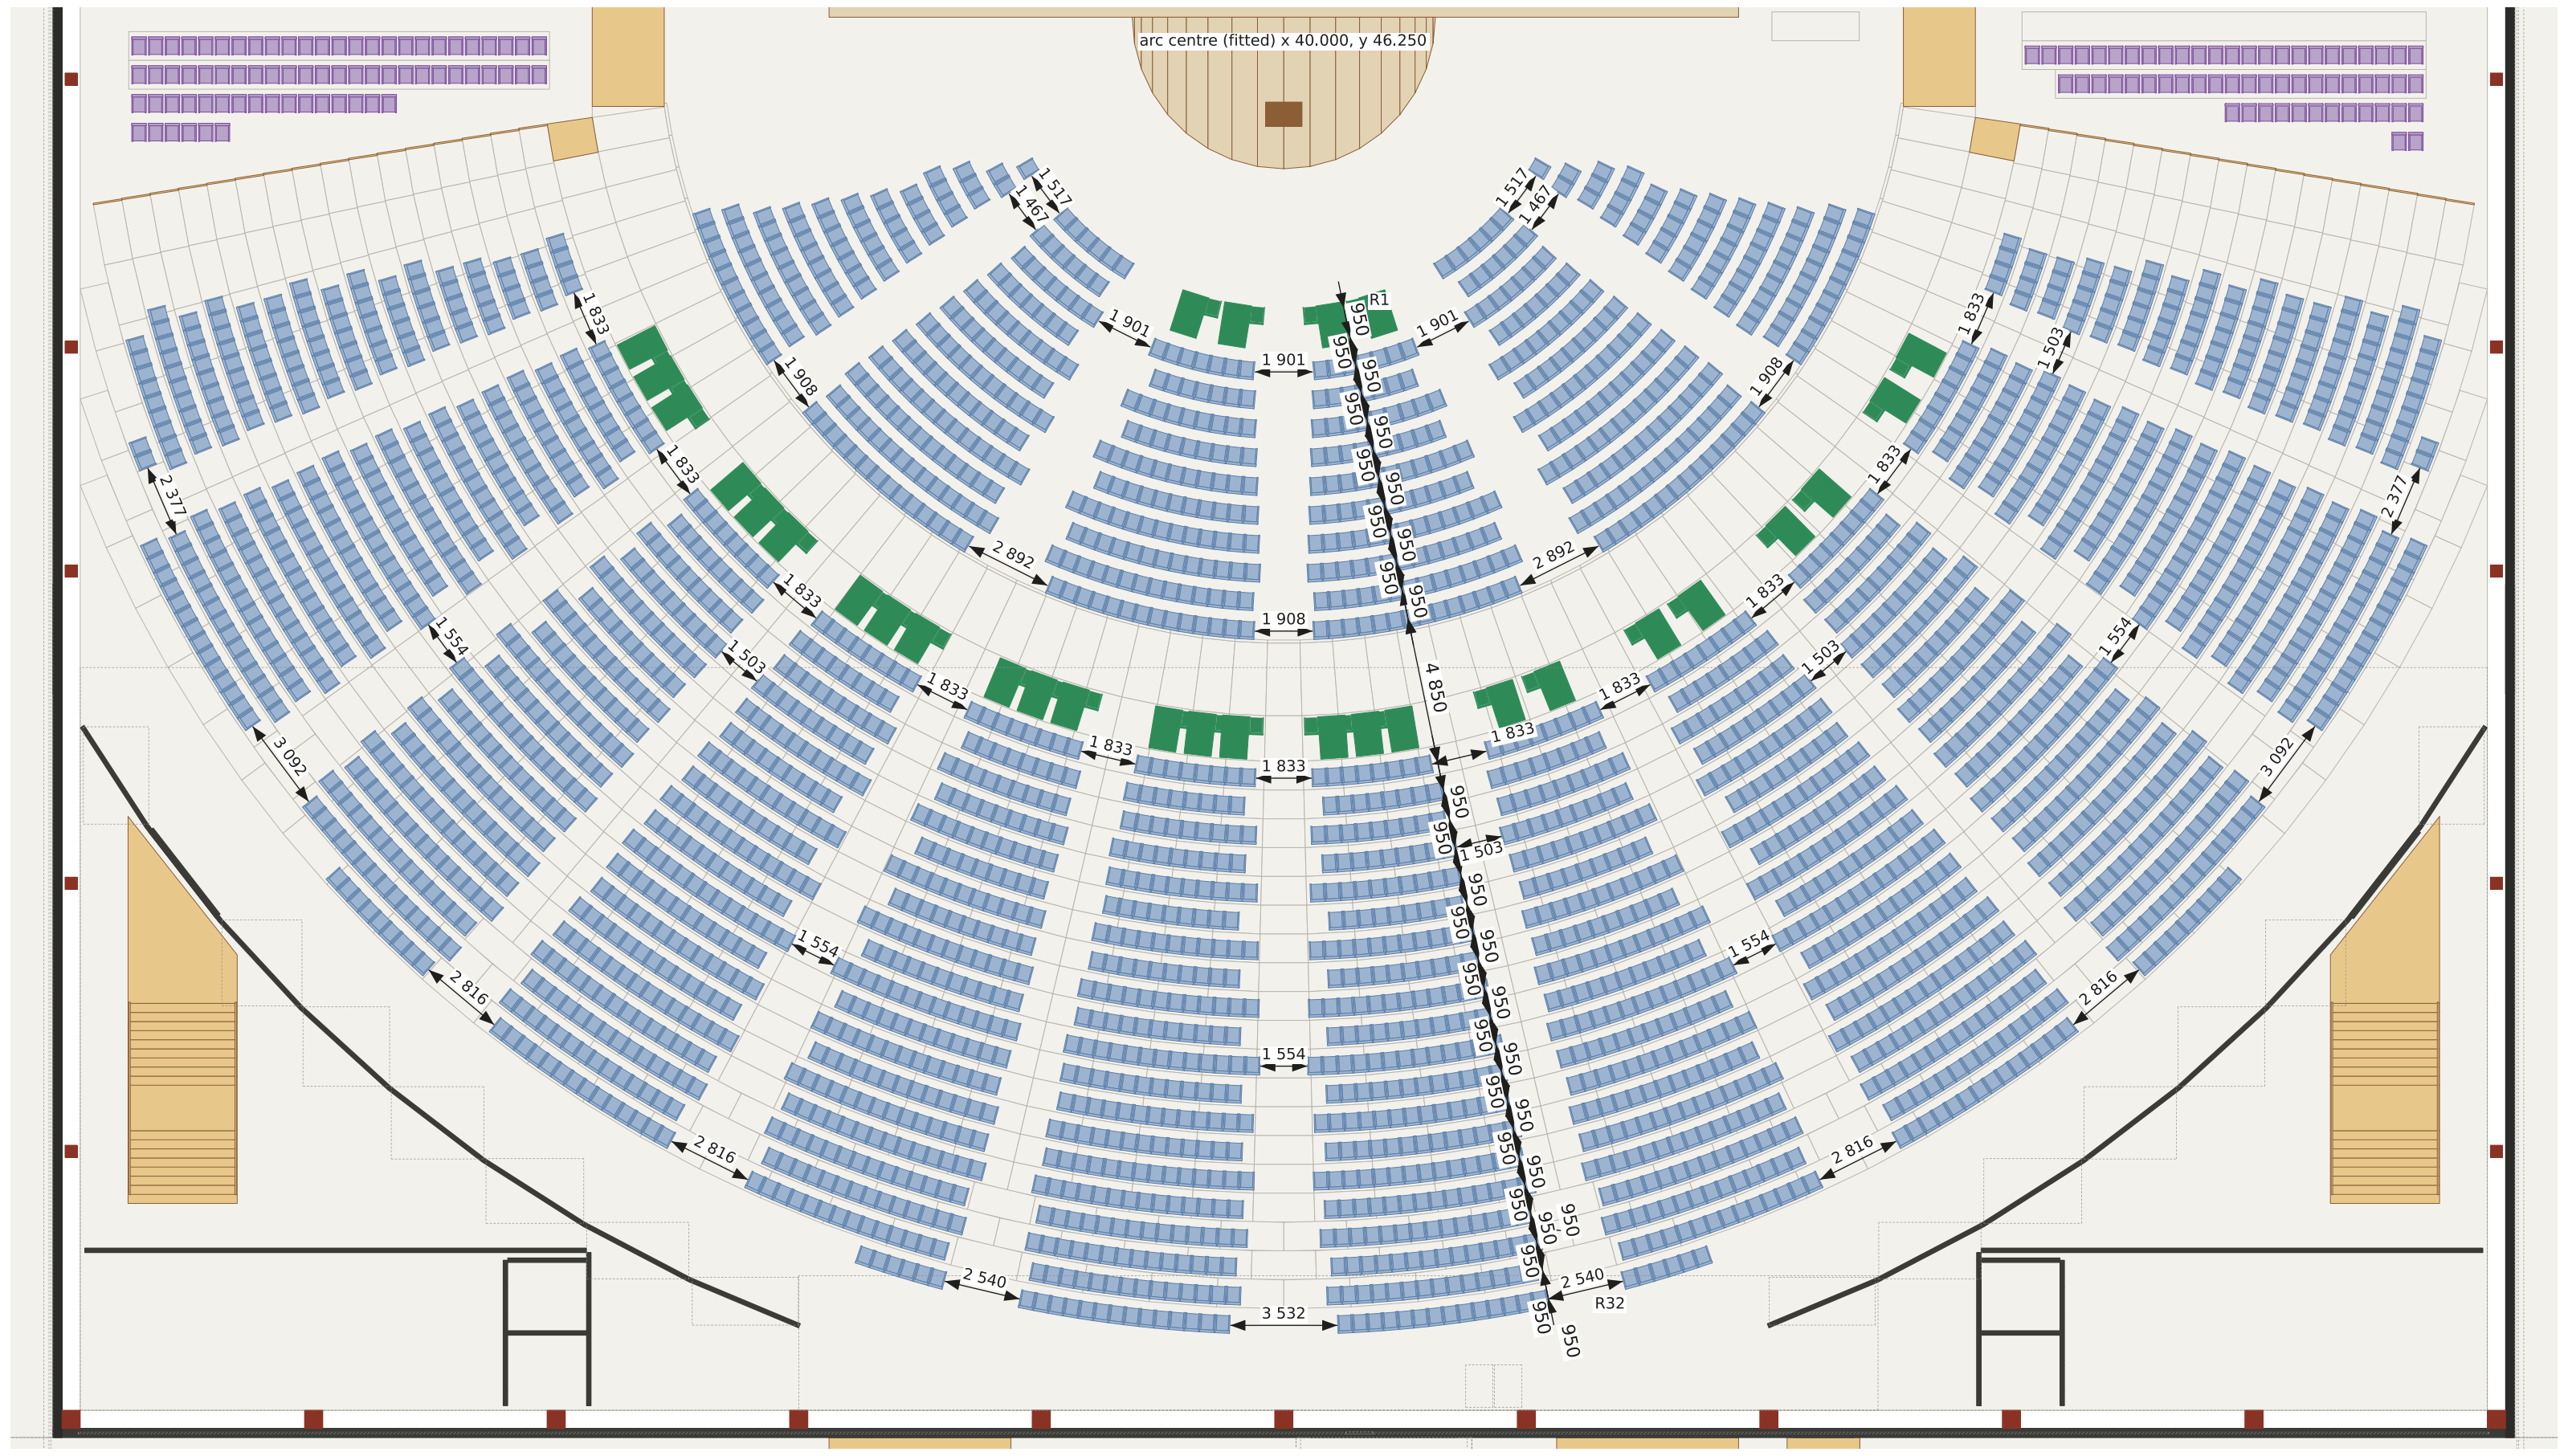

1 SEATING PLAN - ROW PITCH AND AISLE CLEAR WIDTHS

SCALE 1:200

PROJECT

3,000-Seat Church Auditorium - Option B
(long-side stage) Coordination Concept

DESIGN

Option B - long-side stage

MODEL REVISION

B03-44bc3ae457

SOURCE MODEL (read-only, unmodified)

`designs/B-long-side-stage/model/church_3000_B.blend`
`sha256 ed9987dac0e70cab`

GEOMETRY

Evaluated Blender geometry (modifiers, matrix_world, scale_length applied)

DRAWING

Seating - row pitch and aisle clear widths

SCALES

1:200 at A1 (half at A3)

UNITS

Linear dimensions in millimetres. Levels in metres above L00 (±0.000). Angles in degrees.

(P) Modelled PLACEHOLDER / space reservation / reference location - NOT an engineered size

Aisle clear widths, all rows (measured)

Aisle	Rows	Min	at	Max
B1-2	29	1 467	R2	2 377
B2-3	28	1 554	R23	3 092
B3-4	29	1 503	R16	2 816
B4-5	29	1 554	R23	3 093
B5-6	32	1 467	R2	2 816
B6-7	20	1 554	R23	3 532
B7-8	20	1 503	R16	2 816
B8-9	19	1 554	R23	3 093
B9-10	19	1 503	R16	2 816
B10-11	18	1 554	R23	3 092
B11-12	17	1 503	R16	2 377

Row pitch 950 typical (30 of 31 row intervals); other intervals are dimensioned on the plan. Aisle width = clear gap between seat meshes, perpendicular to the aisle.

STATUS

CONCEPT - UNVERIFIED - NOT FOR CONSTRUCTION

Dimensions are measured from the concept model and checked against independently computed values (validation_report.md). Structural member, footing and truss depth sizes are placeholders pending engineering design. Site levels unknown.

SHEET

B-D-102

Generated 2026-11-02 | A1 841 x 594

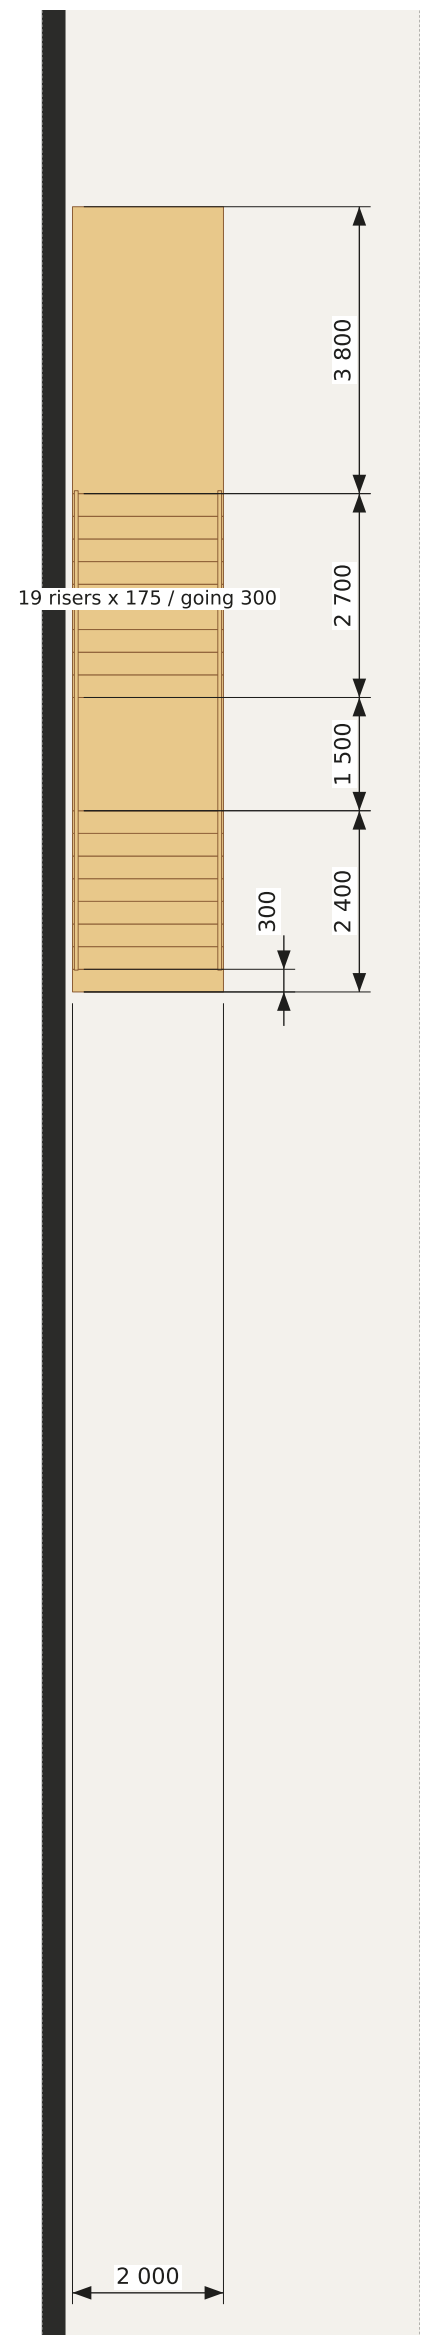

1 STAIR AMB-W - PLAN (ST AMB-E IDENTICAL)

SCALE 1:100

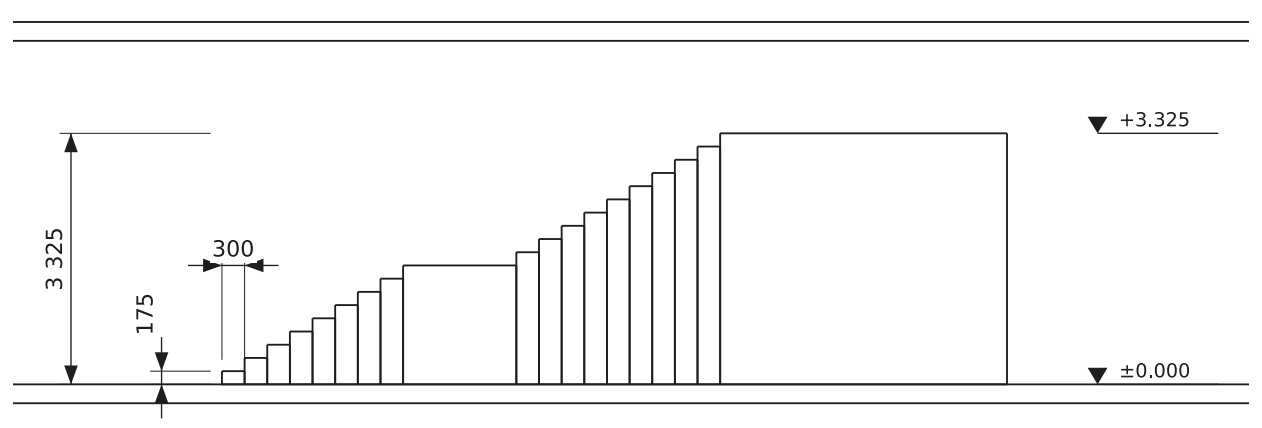

2 STAIR AMB-W - SECTION ON CENTRE LINE OF THE RUN

SCALE 1:100

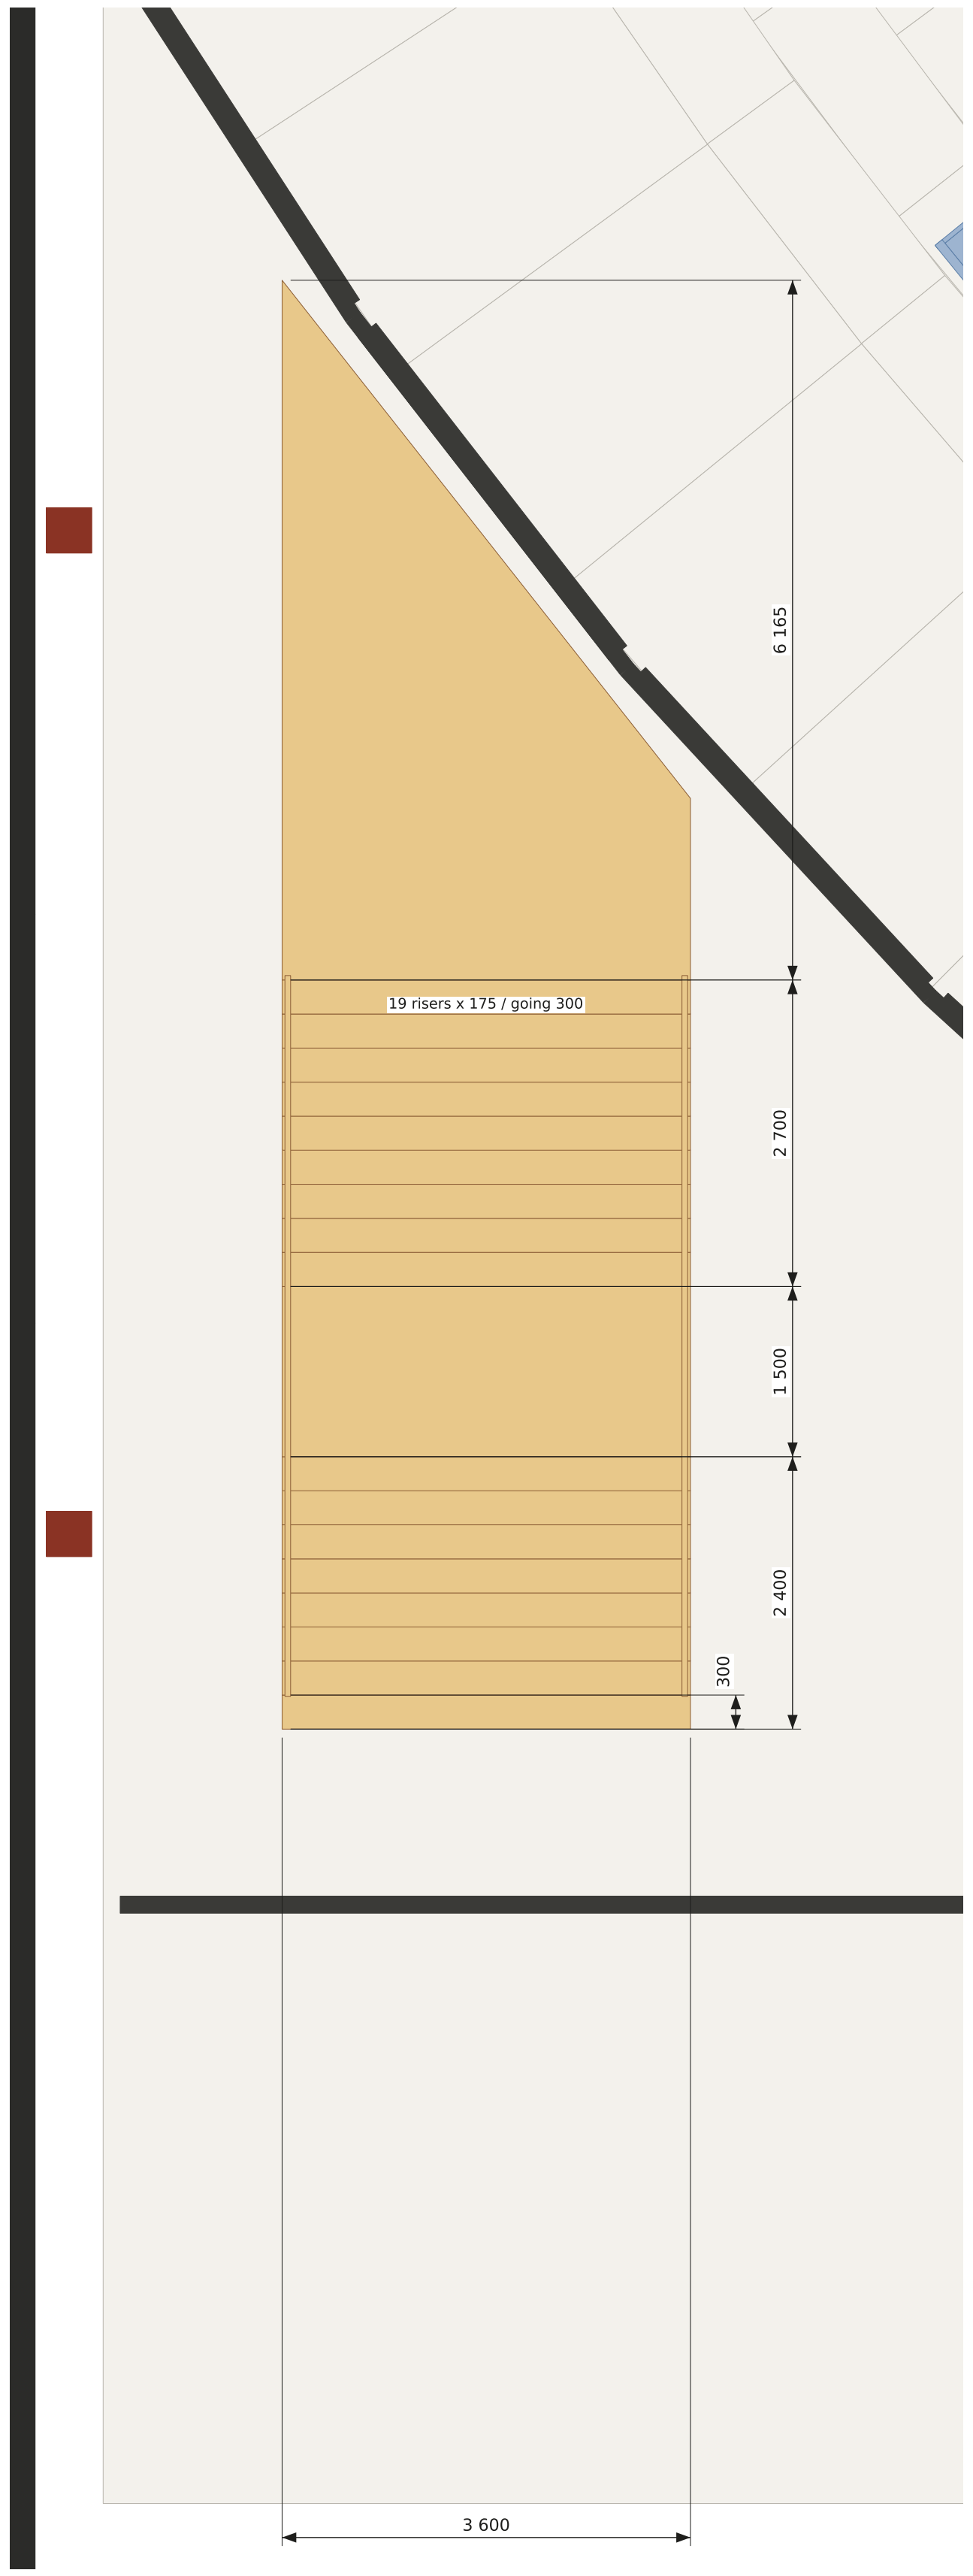

3 STAIR CORNER-W - PLAN (ST CORNER-E IDENTICAL)

SCALE 1:50

PROJECT

3,000-Seat Church Auditorium - Option B
(long-side stage) Coordination Concept

DESIGN

Option B - long-side stage

MODEL REVISION

`B03-44bc3ae457`

SOURCE MODEL (read-only, unmodified)

`designs/B-long-side-stage/model/church_3000_B.blend`
`sha256 ed9987dac0e70cab`

GEOMETRY

Evaluated Blender geometry (modifiers, matrix_world, scale_length applied)

DRAWING

Stairs - plans and sections

SCALES

1:50, 1:100 at A1 (half at A3)

UNITS

Linear dimensions in millimetres. Levels in metres above L00 (±0.000). Angles in degrees.

(P) Modelled PLACEHOLDER / space reservation / reference location - NOT an engineered size

Stair schedule (measured)

Stair	Width	Going	Riser	Risers	Rise	Flights	Runs (L=landing)
AMB-E	2 000	300	175	19	3 325	2	2 400 + L1 500 + 2 700 + L3 800
AMB-W	2 000	300	175	19	3 325	2	2 400 + L1 500 + 2 700 + L3 800
CORNER-E	3 600	300	175	19	3 325	2	2 400 + L1 500 + 2 700 + L6 165
CORNER-W	3 600	300	175	19	3 325	2	2 400 + L1 500 + 2 700 + L6 165
FOYER-E	6 000	300	175	19	3 325	2	2 400 + L1 500 + 2 700 + L1 800
FOYER-W	6 000	300	175	19	3 325	2	2 400 + L1 500 + 2 700 + L1 800
PLATFORM-W	2 000	300	150	6	900	1	1 500

Identical E/W pairs drawn once: AMB-W = AMB-E, CORNER-W = CORNER-E, FOYER-W = FOYER-E

STATUS

CONCEPT - UNVERIFIED - NOT FOR CONSTRUCTION

Dimensions are measured from the concept model and checked against independently computed values (validation_report.md). Structural member, footing and truss depth sizes are placeholders pending engineering design. Site levels unknown.

SHEET

B-D-103a (1/3)

Generated 2026-11-02 | A1 841 x 594

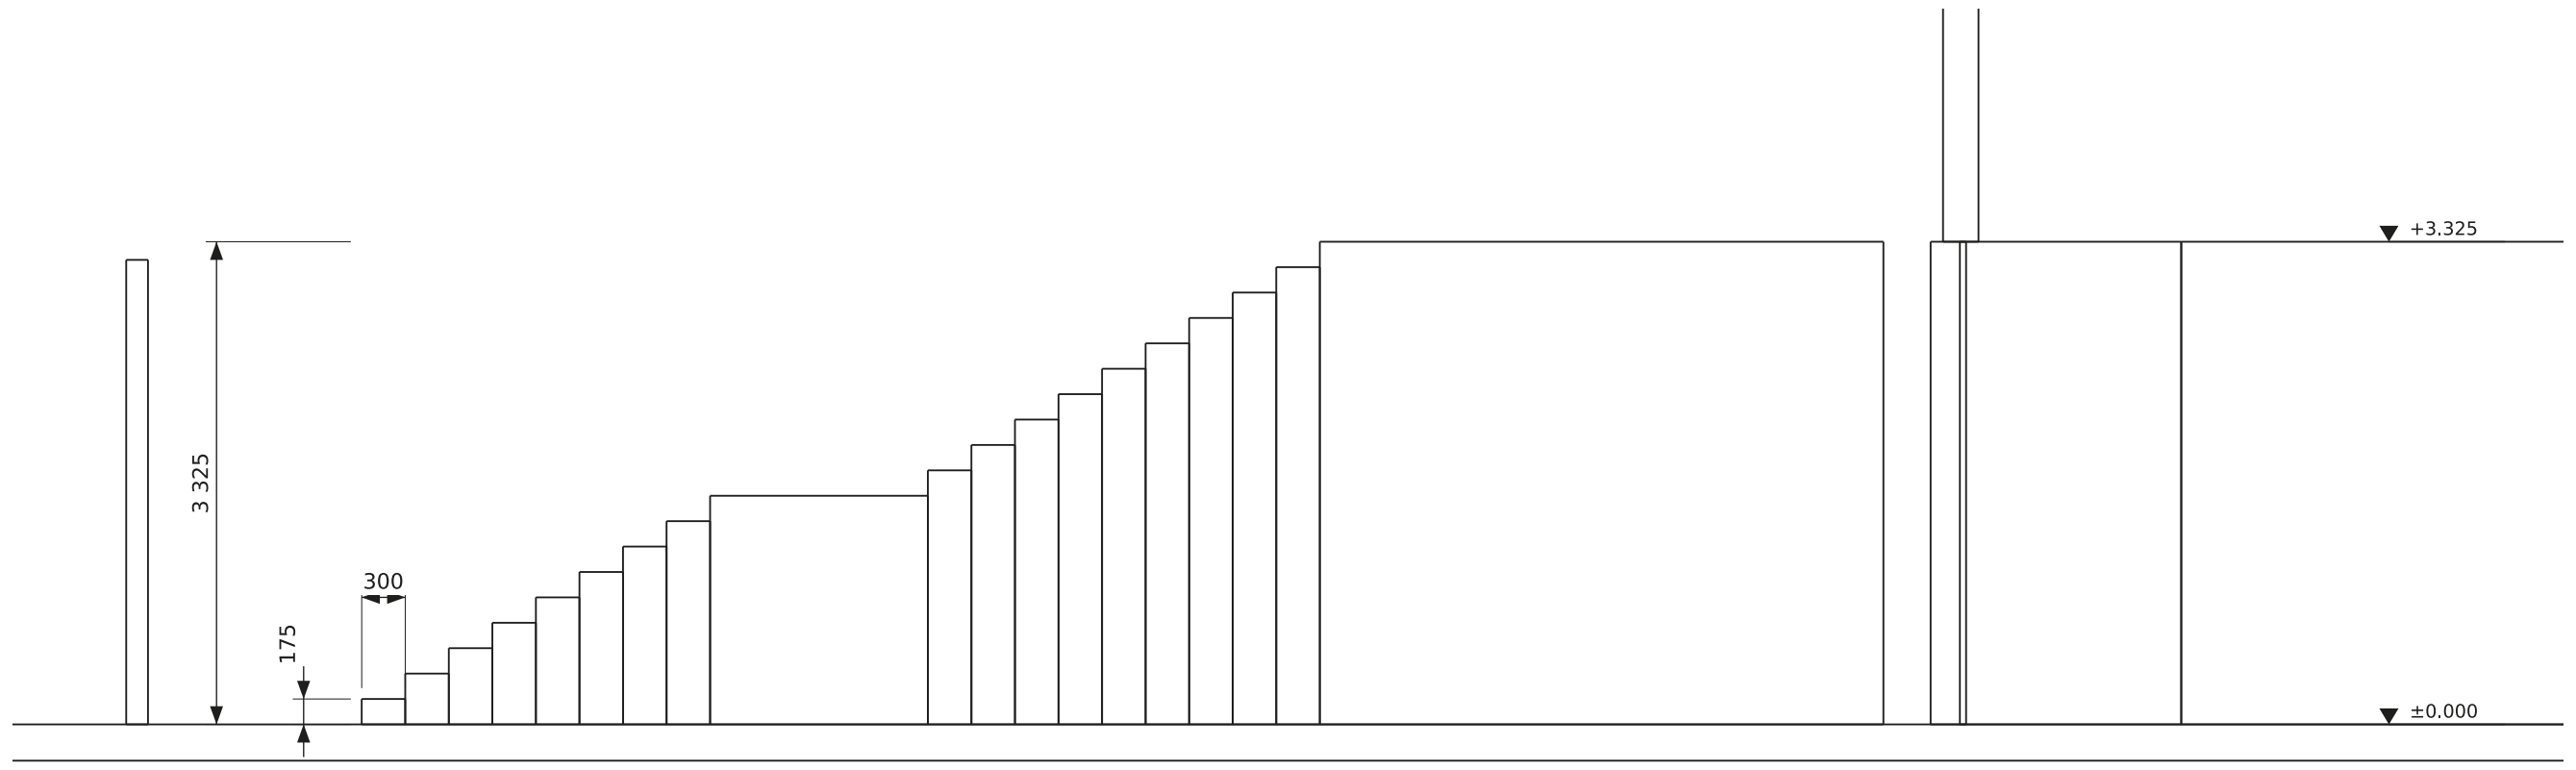

4 STAIR CORNER-W - SECTION ON CENTRE LINE OF THE RUN

SCALE 1:50

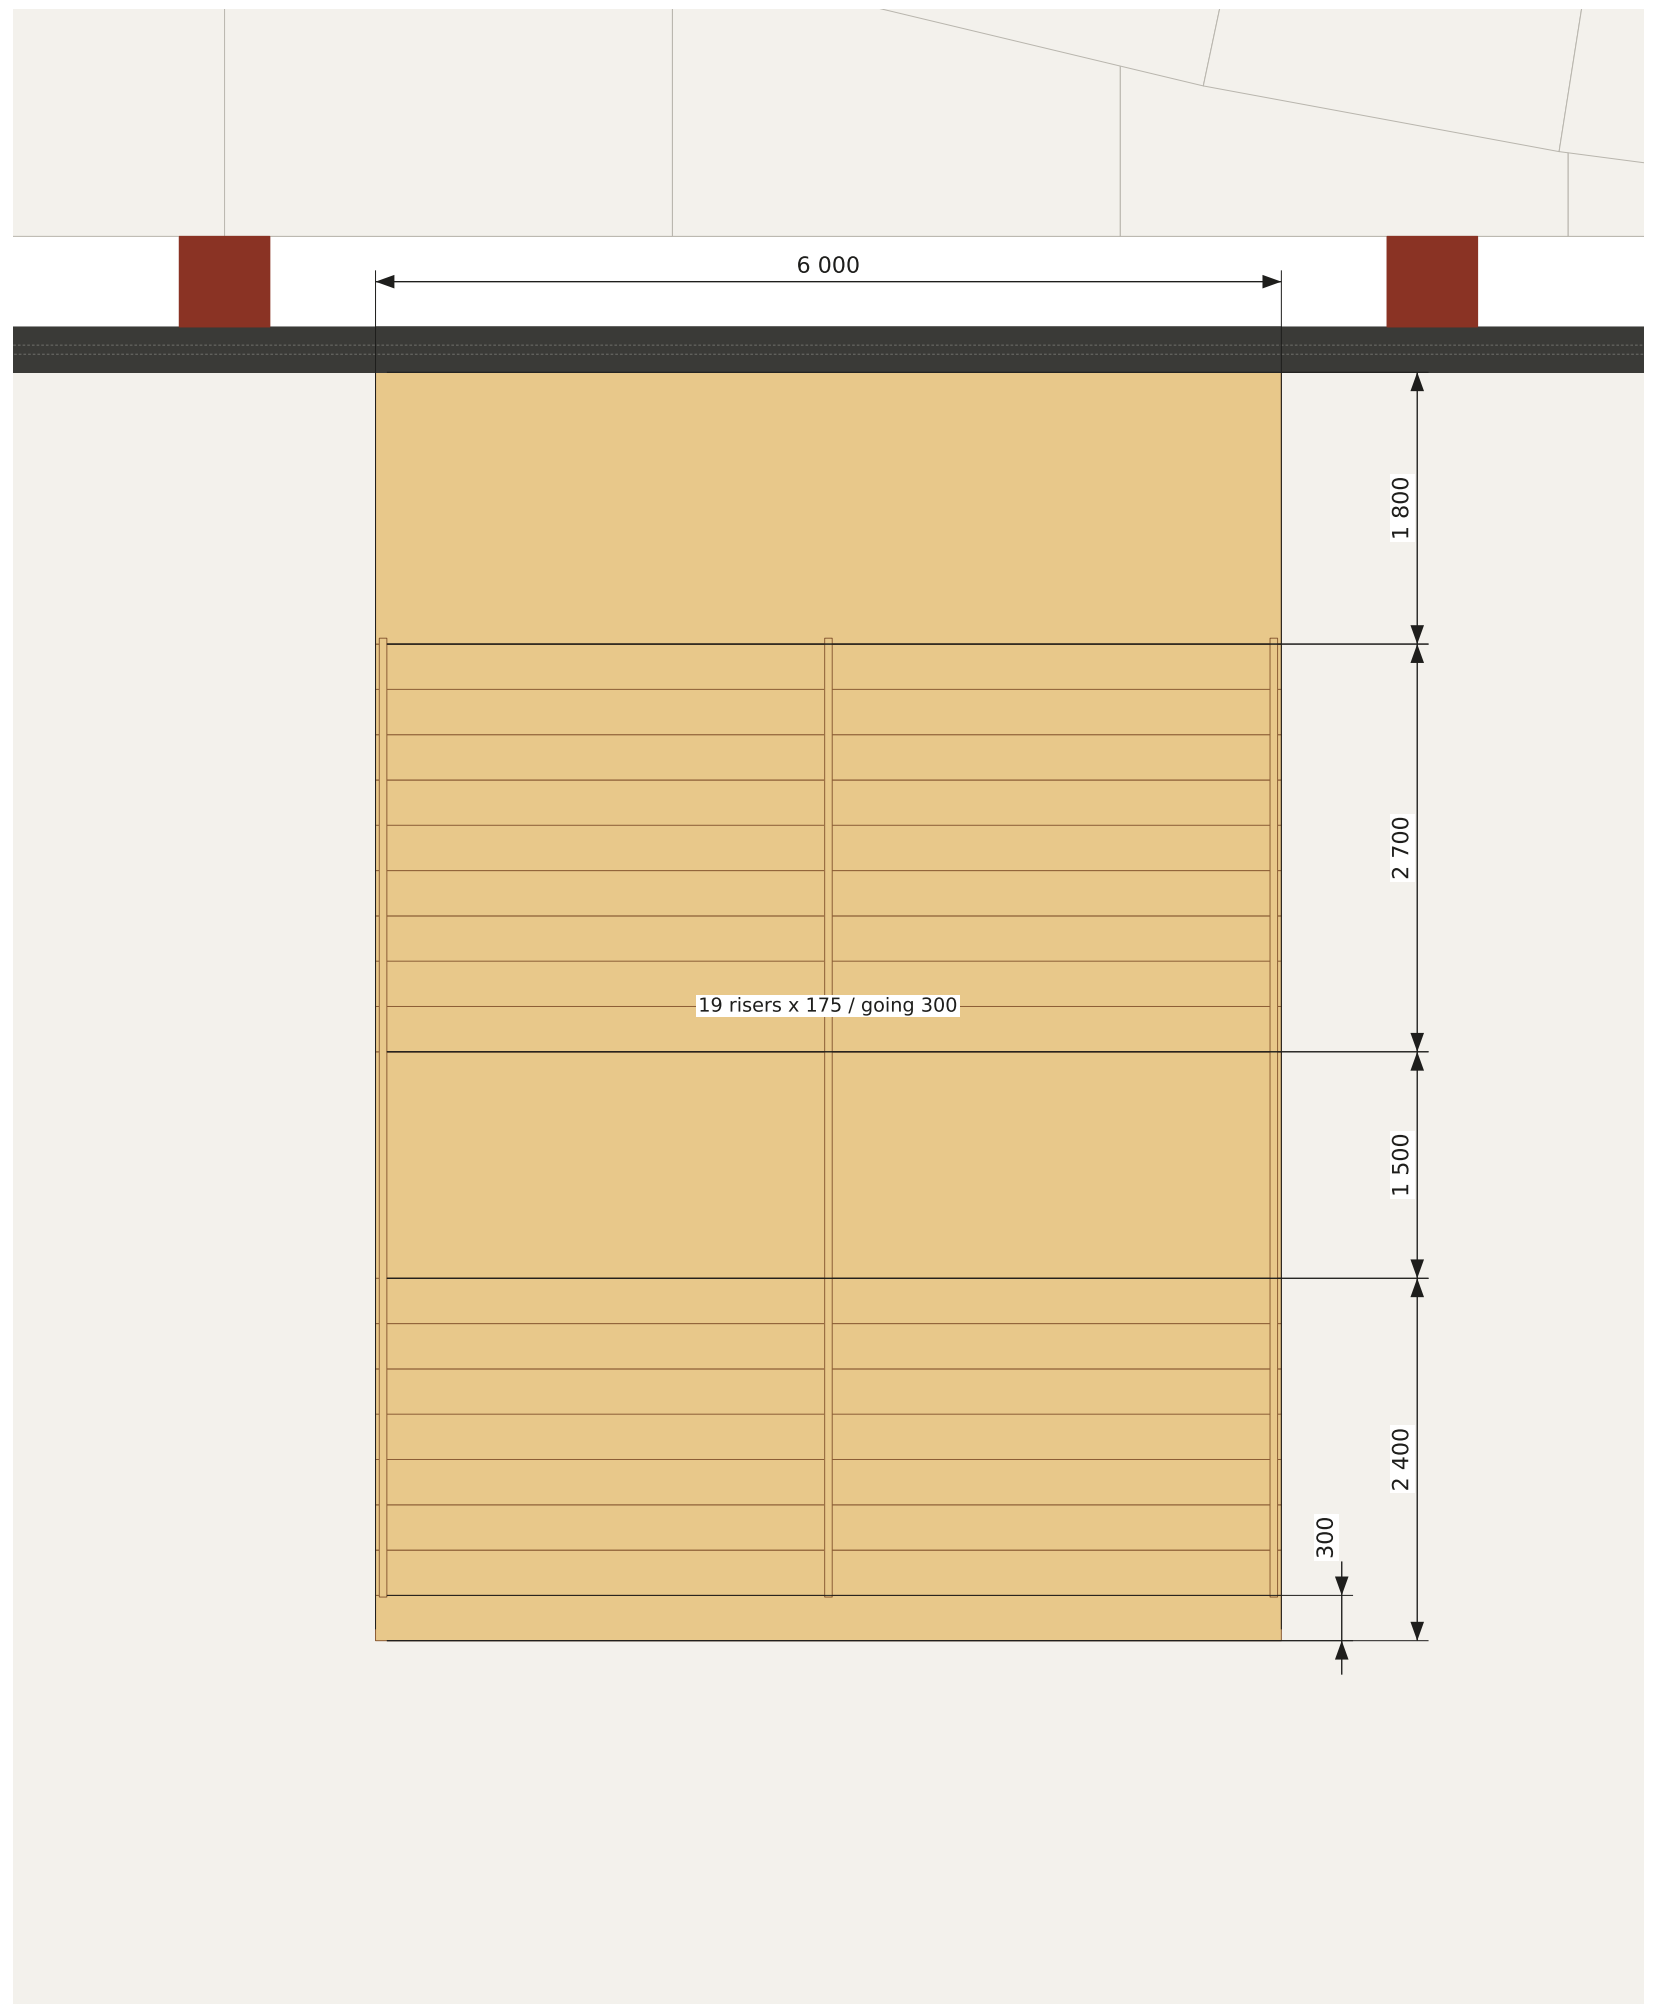

5 STAIR FOYER-W - PLAN (ST FOYER-E IDENTICAL)

SCALE 1:50

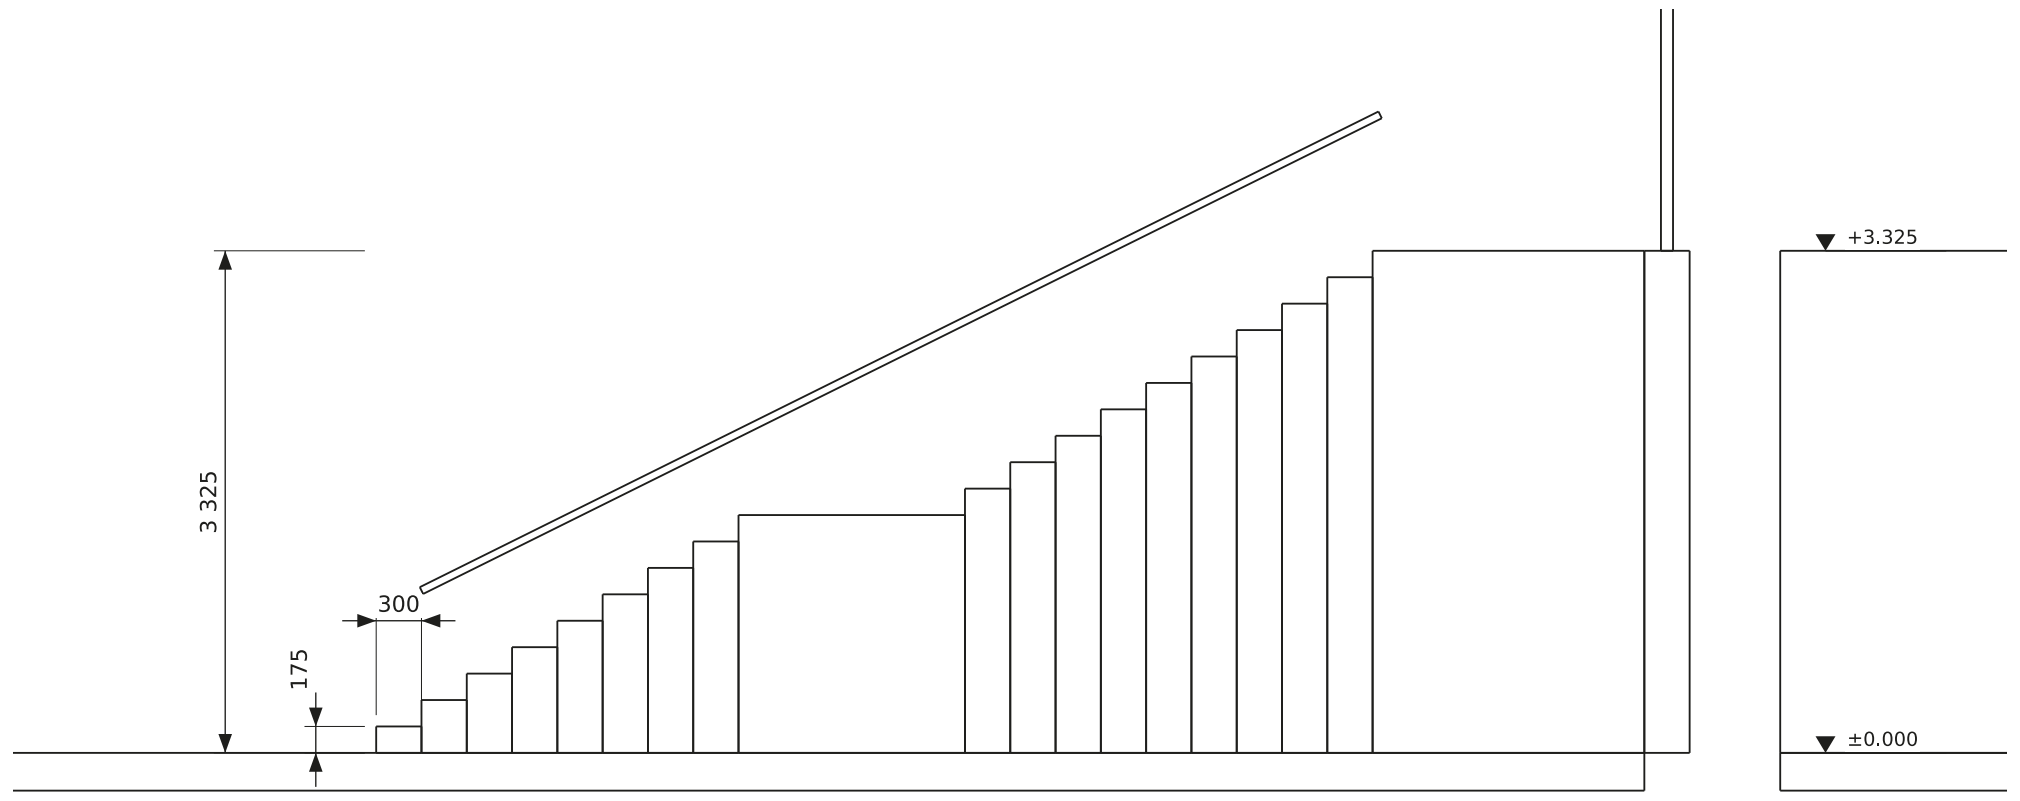

6 STAIR FOYER-W - SECTION ON CENTRE LINE OF THE RUN

SCALE 1:50

PROJECT

3,000-Seat Church Auditorium - Option B
(long-side stage) Coordination Concept

DESIGN

Option B - long-side stage

MODEL REVISION

`B03-44bc3ae457`

SOURCE MODEL (read-only, unmodified)

`designs/B-long-side-stage/model/church_3000_B.blend`
`sha256 ed9987dac0e70cab`

GEOMETRY

Evaluated Blender geometry (modifiers, matrix_world, scale_length applied)

DRAWING

Stairs - plans and sections

SCALES

1:50 at A1 (half at A3)

UNITS

Linear dimensions in millimetres. Levels in metres above L00 (±0.000). Angles in degrees.

(P) Modelled PLACEHOLDER / space reservation / reference location - NOT an engineered size

STATUS

CONCEPT - UNVERIFIED - NOT FOR CONSTRUCTION

Dimensions are measured from the concept model and checked against independently computed values (validation_report.md). Structural member, footing and truss depth sizes are placeholders pending engineering design. Site levels unknown.

SHEET

B-D-103b (2/3)

Generated 2026-11-02 | A1 841 x 594

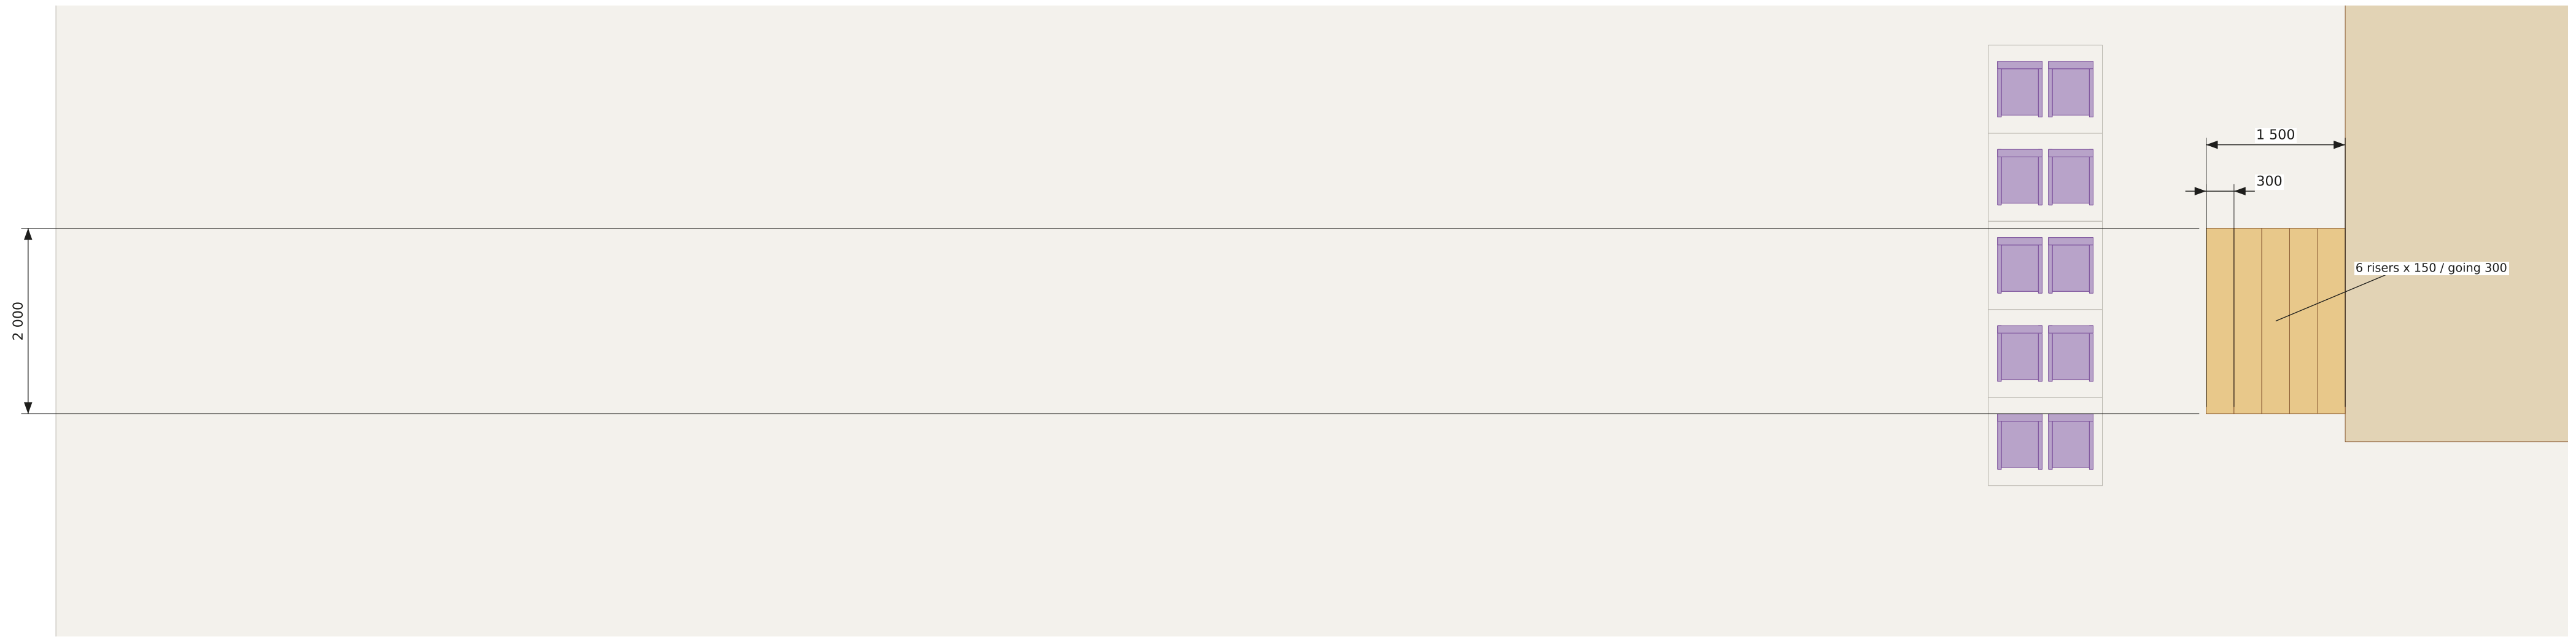

7 STAIR PLATFORM-W - PLAN

SCALE 1:50



8 STAIR PLATFORM-W - SECTION ON CENTRE LINE OF THE RUN

SCALE 1:50

PROJECT

3,000-Seat Church Auditorium - Option B
(long-side stage) Coordination Concept

DESIGN

Option B - long-side stage

MODEL REVISION

B03-44bc3ae457

SOURCE MODEL (read-only, unmodified)

`designs/B-long-side-stage/model/church_3000_B.blend`
`sha256 ed9987dac0e70cab`

GEOMETRY

Evaluated Blender geometry (modifiers, matrix_world,
scale_length applied)

DRAWING

Stairs - plans and sections

SCALES

1:50 at A1 (half at A3)

UNITS

Linear dimensions in millimetres. Levels in metres
above L00 (±0.000). Angles in degrees.

(P) Modelled PLACEHOLDER / space reservation / reference location - NOT an engineered size

STATUS

CONCEPT - UNVERIFIED - NOT FOR CONSTRUCTION

Dimensions are measured from the concept model and checked against independently computed values (validation_report.md). Structural member, footing and truss depth sizes are placeholders pending engineering design. Site levels unknown.

SHEET

B-D-103c (3/3)

Generated 2026-11-02 | A1 841 x 594

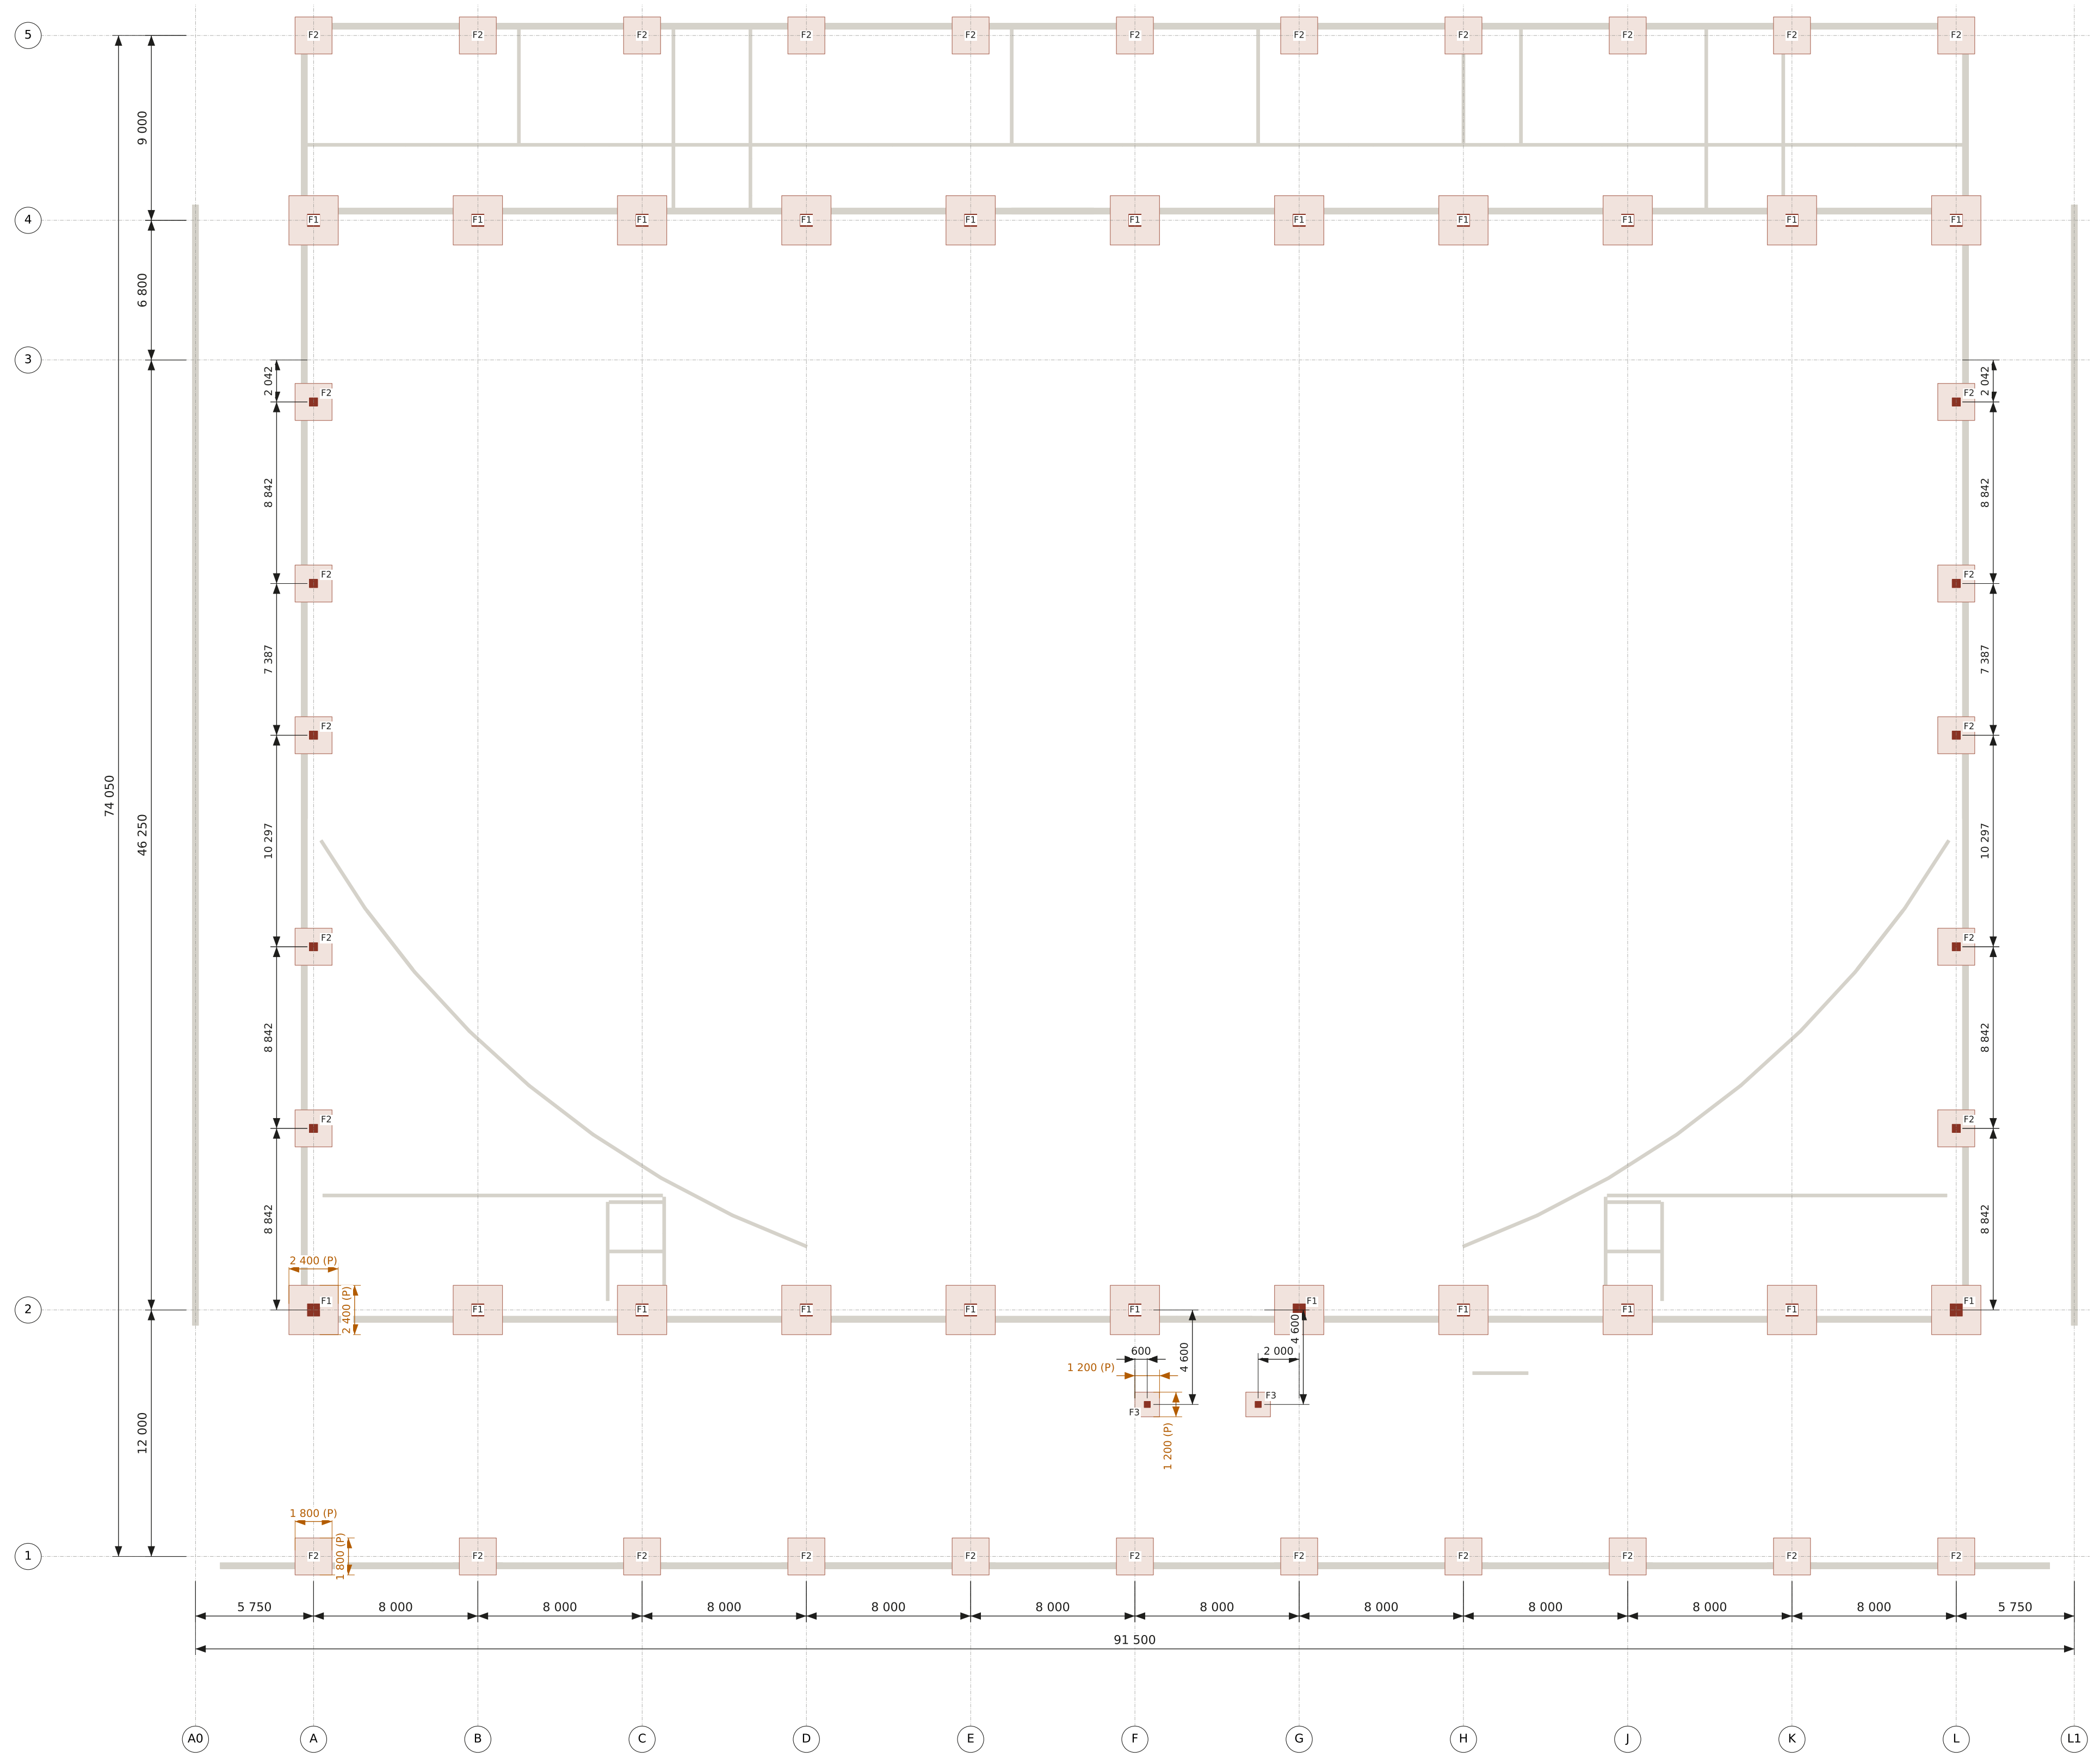

1 FOUNDATION PLAN - PAD FOOTING REFERENCE LOCATIONS

SCALE 1:200

PROJECT

3,000-Seat Church Auditorium - Option B
(long-side stage) Coordination Concept

DESIGN

Option B - long-side stage

MODEL REVISION

B03-44bc3ae457

SOURCE MODEL (read-only, unmodified)

designs/B-long-side-stage/model/church_3000_B.blend
sha256 ed9987dac0e70cab

GEOMETRY

Evaluated Blender geometry (modifiers, matrix_world,
scale_length applied)

DRAWING

Foundation plan - footing locations and modelled sizes

SCALES

1:200 at A1 (half at A3)

UNITS

Linear dimensions in millimetres. Levels in metres above L00 (±0.000). Angles in degrees.

(P) Modelled PLACEHOLDER / space reservation / reference location - NOT an engineered size

Footing types (modelled placeholders)

Type	Size x	Size y	Thick	Top	Bottom	No.
F1	2 400	2 400	600	-0.900	-1.500	22
F2	1 800	1 800	600	-0.900	-1.500	32
F3	1 200	1 200	600	-0.900	-1.500	2

Status in model: 'Reference location only - no geotechnical data, not designed'. Footing centres coincide with column centres where noted in validation. Sizes, depths and locations are NOT engineered.

Column sections (modelled placeholders)

Section	No.	Model status
300x300	2	space reservation
400x400	32	space reservation
600x600	22	space reservation

STATUS

CONCEPT - UNVERIFIED - NOT FOR CONSTRUCTION

Dimensions are measured from the concept model and checked against independently computed values (validation_report.md). Structural member, footing and truss depth sizes are placeholders pending engineering design. Site levels unknown.

SHEET

B-D-201

Generated 2026-11-02 | A1 841 x 594

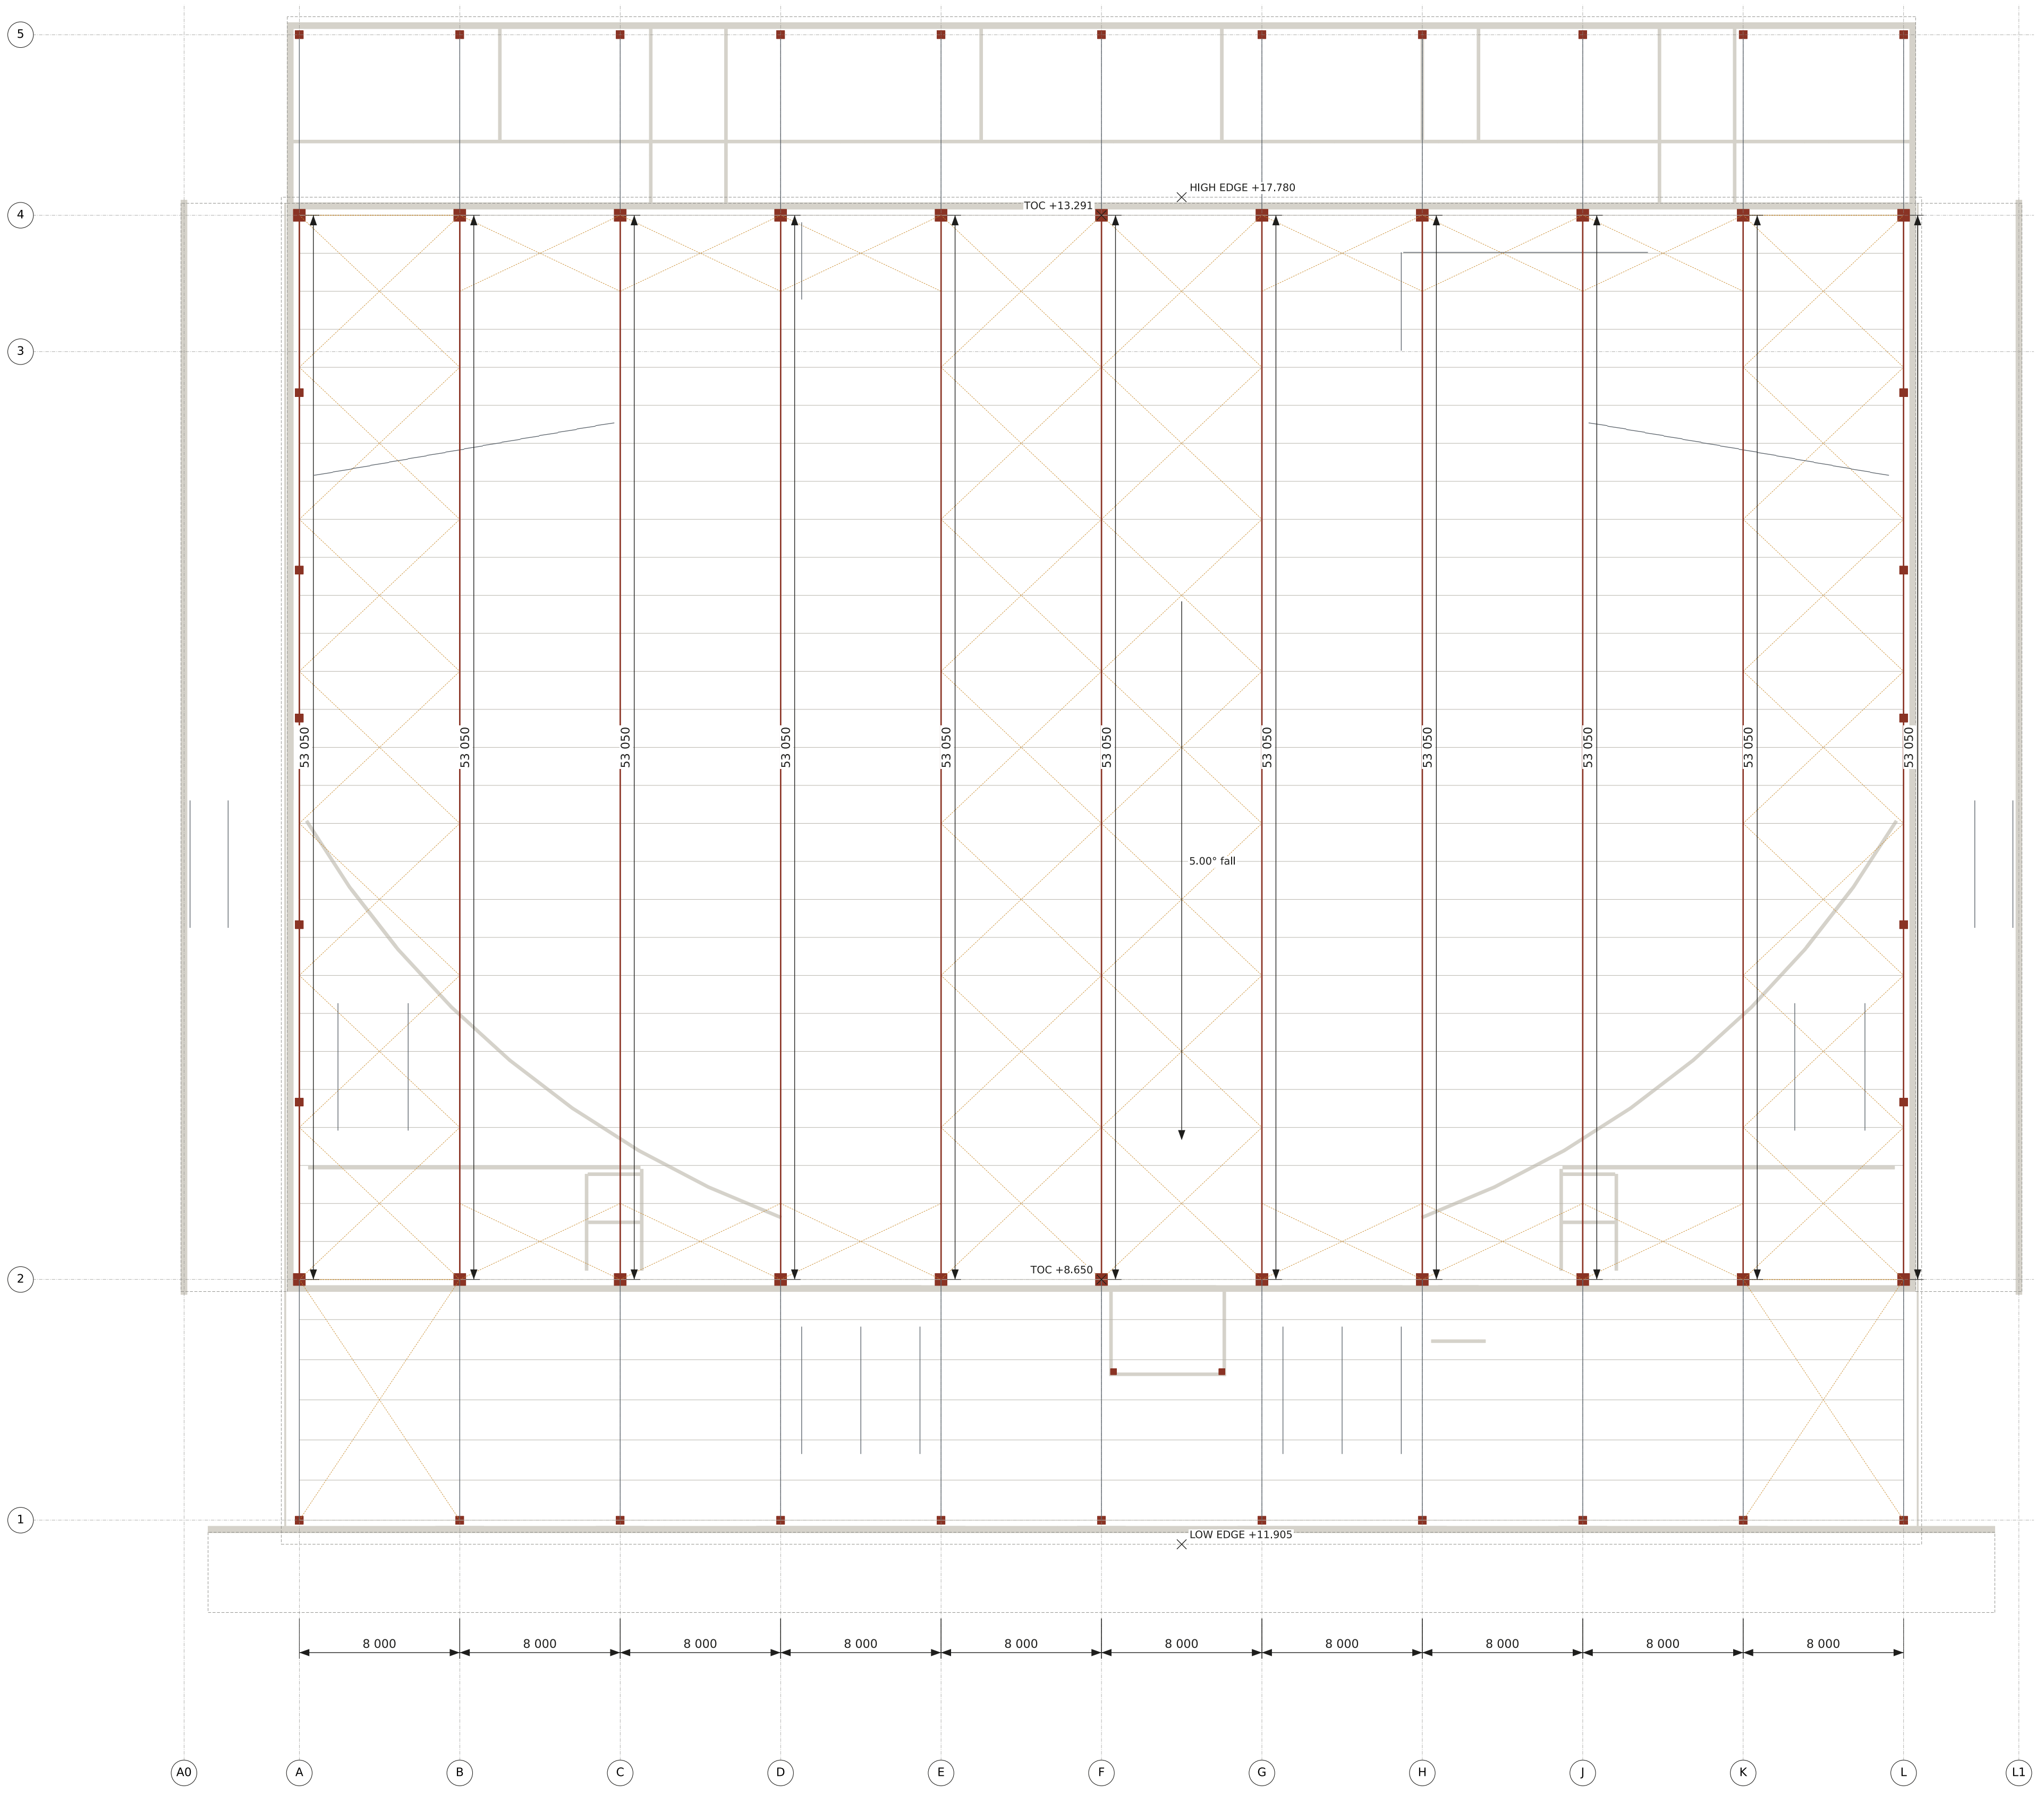
5
4
3
2
1
HIGH EDGE +17.780
TOC +13.291
53 050
53 050
53 050
53 050
53 050
53 050
53 050
53 050
53 050
53 050
53 050
5.00° fall
TOC +8.650
LOW EDGE +11.905
8 000
8 000
8 000
8 000
8 000
8 000
8 000
8 000
8 000
8 000
A0
A
B
C
D
E
F
G
H
J
K
L
L1

1 ROOF FRAMING PLAN - TRUSSES, SPANS, PITCH AND ROOF LEVELS

SCALE 1:200

PROJECT

3,000-Seat Church Auditorium - Option B
(long-side stage) Coordination Concept

DESIGN

Option B - long-side stage

MODEL REVISION

`B03-44bc3ae457`

SOURCE MODEL (read-only, unmodified)

`designs/B-long-side-stage/model/church_3000_B.blend`
`sha256 ed9987dac0e70cab`

GEOMETRY

Evaluated Blender geometry (modifiers, matrix_world,
scale_length applied)

DRAWING

Roof framing plan - truss spans, pitch,
ridge and eaves

SCALES

1:200 at A1 (half at A3)

UNITS

Linear dimensions in millimetres. Levels in metres
above L00 (±0.000). Angles in degrees.

(P) Modelled PLACEHOLDER / space reservation / reference location - NOT an engineered size

STATUS

CONCEPT - UNVERIFIED - NOT FOR CONSTRUCTION

Dimensions are measured from the concept model and checked against independently computed values (validation_report.md). Structural member, footing and truss depth sizes are placeholders pending engineering design. Site levels unknown.

SHEET

B-D-202

Generated 2026-11-02 | A1 841 x 594

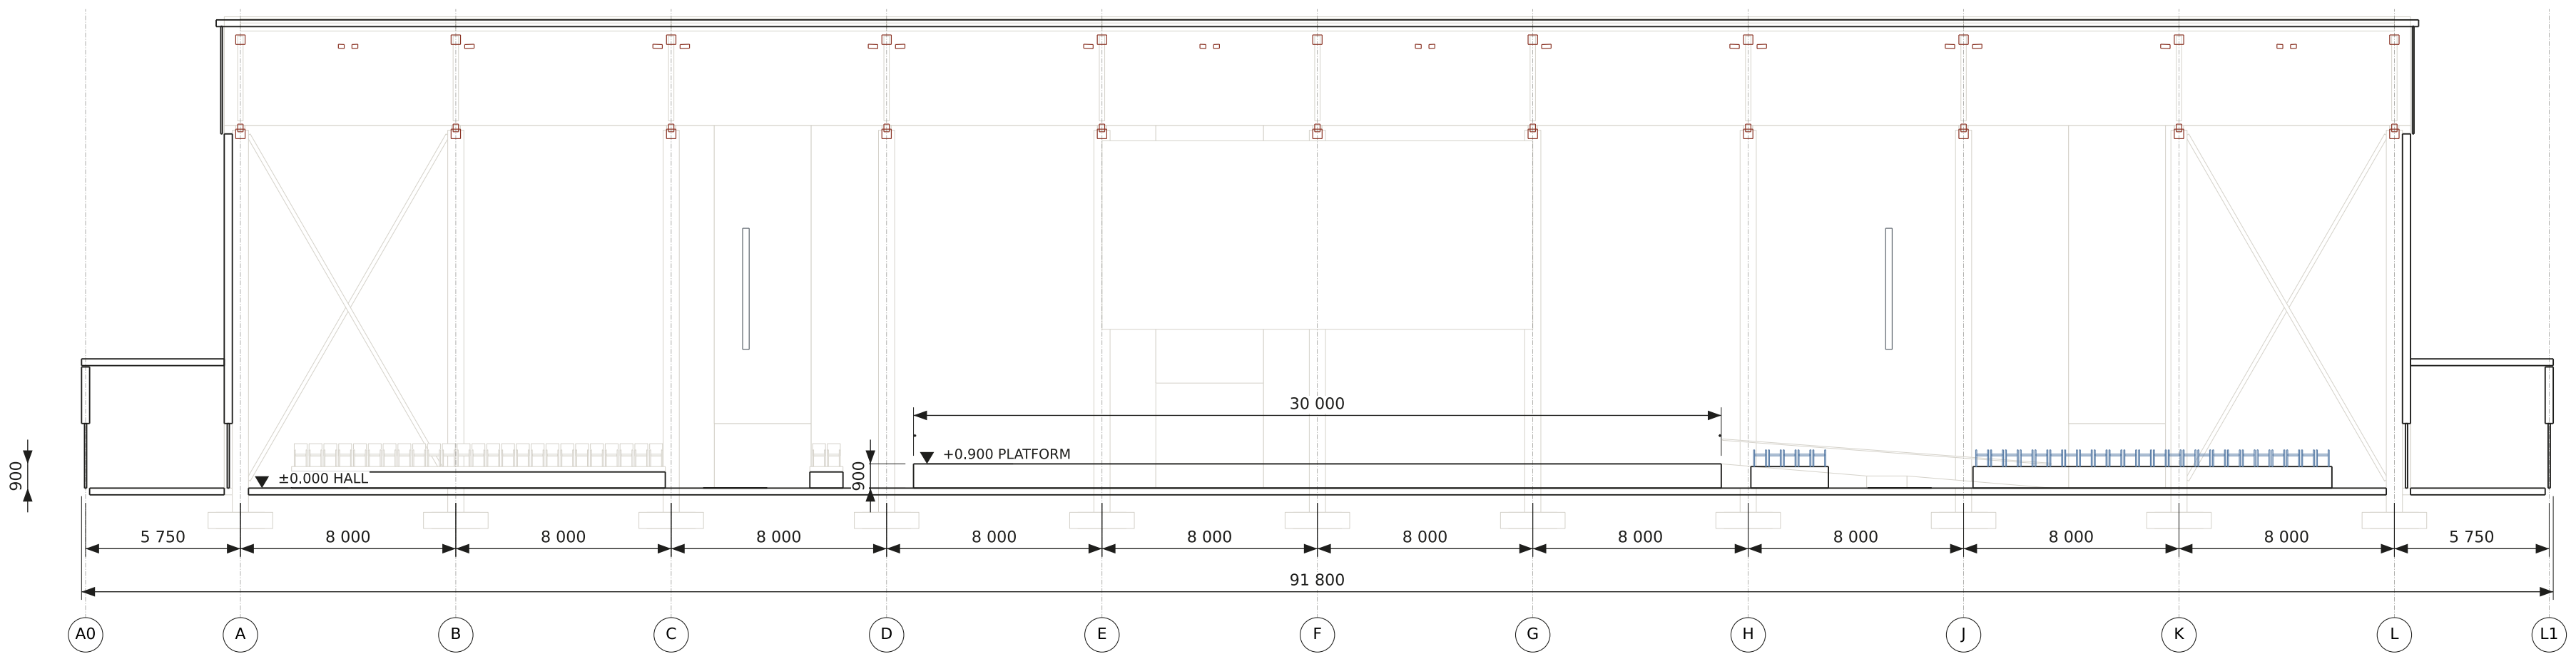
30 000
900
±0.000 HALL
900
+0.900 PLATFORM
5 750
8 000
8 000
8 000
8 000
8 000
8 000
8 000
8 000
8 000
8 000
5 750
91 800
A0
A
B
C
D
E
F
G
H
J
K
L
L1

1 LONGITUDINAL SECTION A-A (THROUGH PLATFORM REAR BAND) - CUT AT Y = 49.500 (THROUGH PLATFORM REAR BAND)

SCALE 1:200

PROJECT

3,000-Seat Church Auditorium - Option B
(long-side stage) Coordination Concept

DESIGN

Option B - long-side stage

MODEL REVISION

B03-44bc3ae457

SOURCE MODEL (read-only, unmodified)

`designs/B-long-side-stage/model/church_3000_B.blend`
`sha256 ed9987dac0e70cab`

GEOMETRY

Evaluated Blender geometry (modifiers, matrix_world, scale_length applied)

DRAWING

Longitudinal section

SCALES

1:200 at A1 (half at A3)

UNITS

Linear dimensions in millimetres. Levels in metres above L00 (±0.000). Angles in degrees.

(P) Modelled PLACEHOLDER / space reservation / reference location - NOT an engineered size

STATUS

CONCEPT - UNVERIFIED - NOT FOR CONSTRUCTION

Dimensions are measured from the concept model and checked against independently computed values (validation_report.md). Structural member, footing and truss depth sizes are placeholders pending engineering design. Site levels unknown.

SHEET

B-D-301

Generated 2026-11-02 | A1 841 x 594

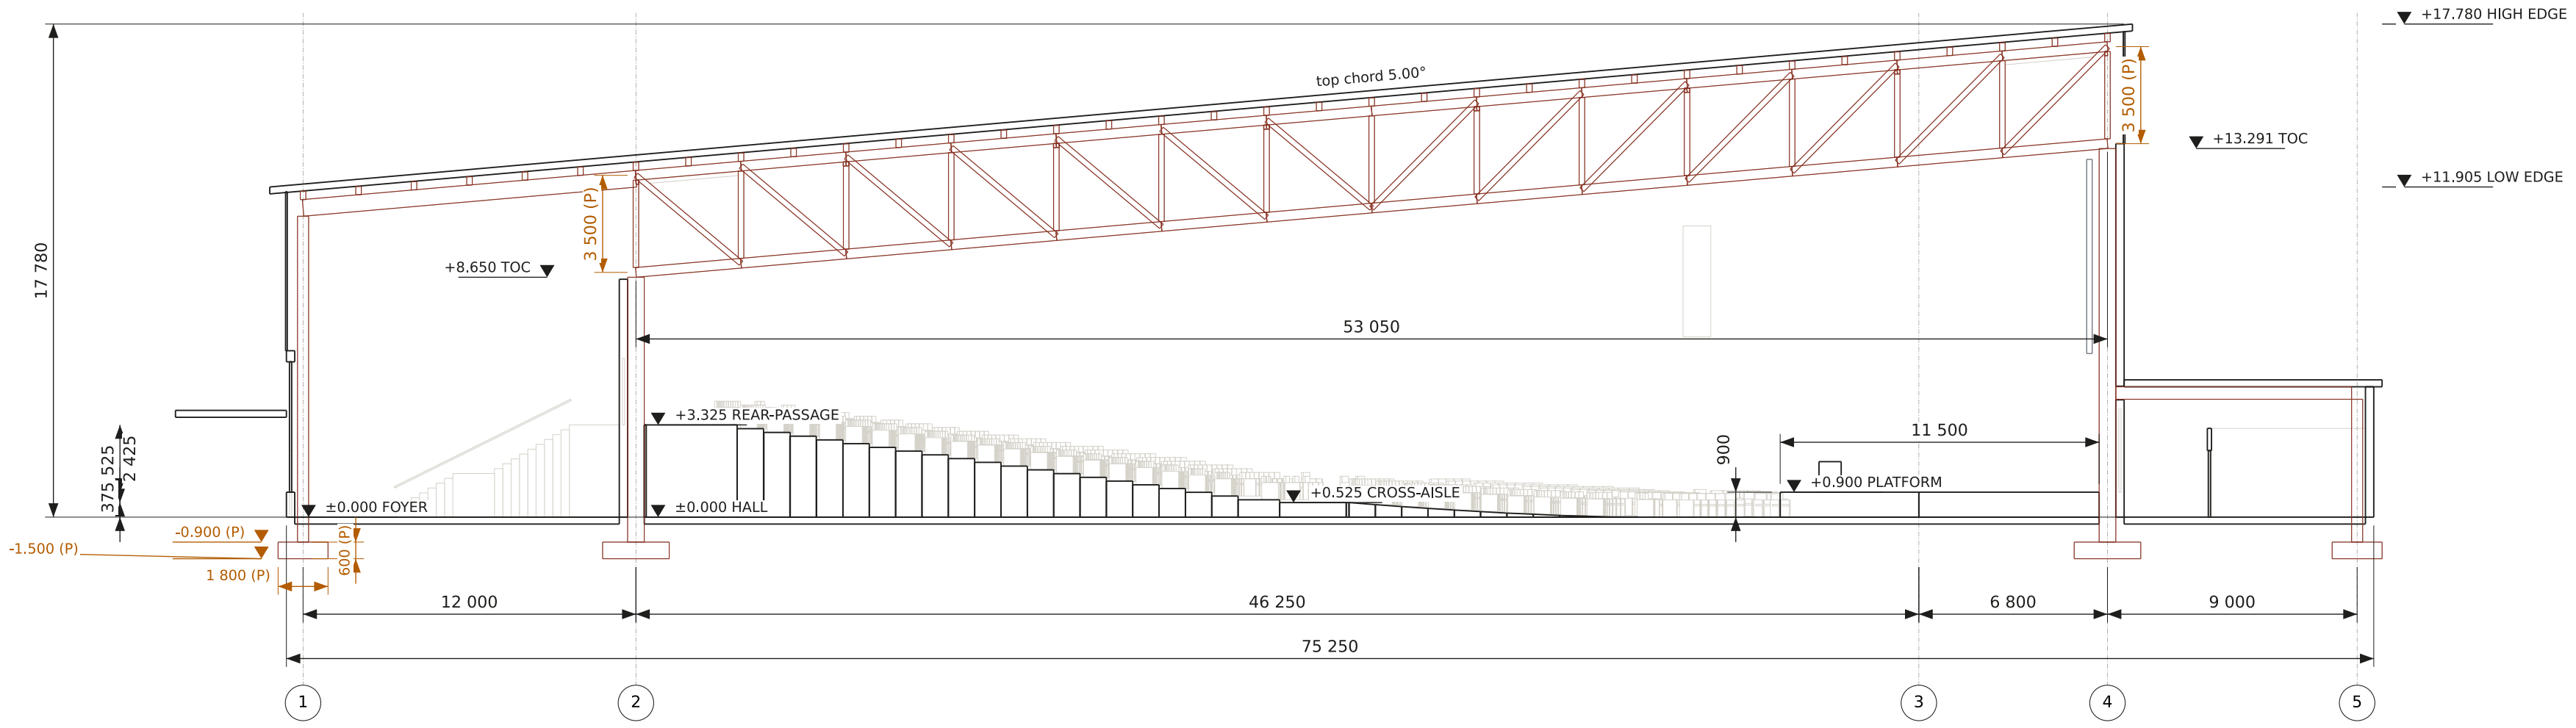
+17.780 HIGH EDGE
top chord 5.00°
3 500 (P)
+13.291 TOC
+11.905 LOW EDGE
17 780
3 500 (P)
+8.650 TOC
53 050
+3.325 REAR-PASSAGE
11 500
900
+0.900 PLATFORM
+0.525 CROSS-AISLE
375 525
2 425
±0.000 FOYER
±0.000 HALL
-0.900 (P)
-1.500 (P)
600 (P)
1 800 (P)
12 000
46 250
6 800
9 000
75 250
1
2
3
4
5

1 TRANSVERSE SECTION B-B (ON TRUSS LINE F) - CUT AT X = 40.000 (ON GRID F)

SCALE 1:200

PROJECT

3,000-Seat Church Auditorium - Option B
(long-side stage) Coordination Concept

DESIGN

Option B - long-side stage

MODEL REVISION

B03-44bc3ae457

SOURCE MODEL (read-only, unmodified)

designs/B-long-side-stage/model/church_3000_B.blend
sha256 ed9987dac0e70cab

GEOMETRY

Evaluated Blender geometry (modifiers, matrix_world, scale_length applied)

DRAWING

Transverse section

SCALES

1:200 at A1 (half at A3)

UNITS

Linear dimensions in millimetres. Levels in metres above L00 (±0.000). Angles in degrees.

(P) Modelled PLACEHOLDER / space reservation / reference location - NOT an engineered size

STATUS

CONCEPT - UNVERIFIED - NOT FOR CONSTRUCTION

Dimensions are measured from the concept model and checked against independently computed values (validation_report.md). Structural member, footing and truss depth sizes are placeholders pending engineering design. Site levels unknown.

SHEET

B-D-302

Generated 2026-11-02 | A1 841 x 594

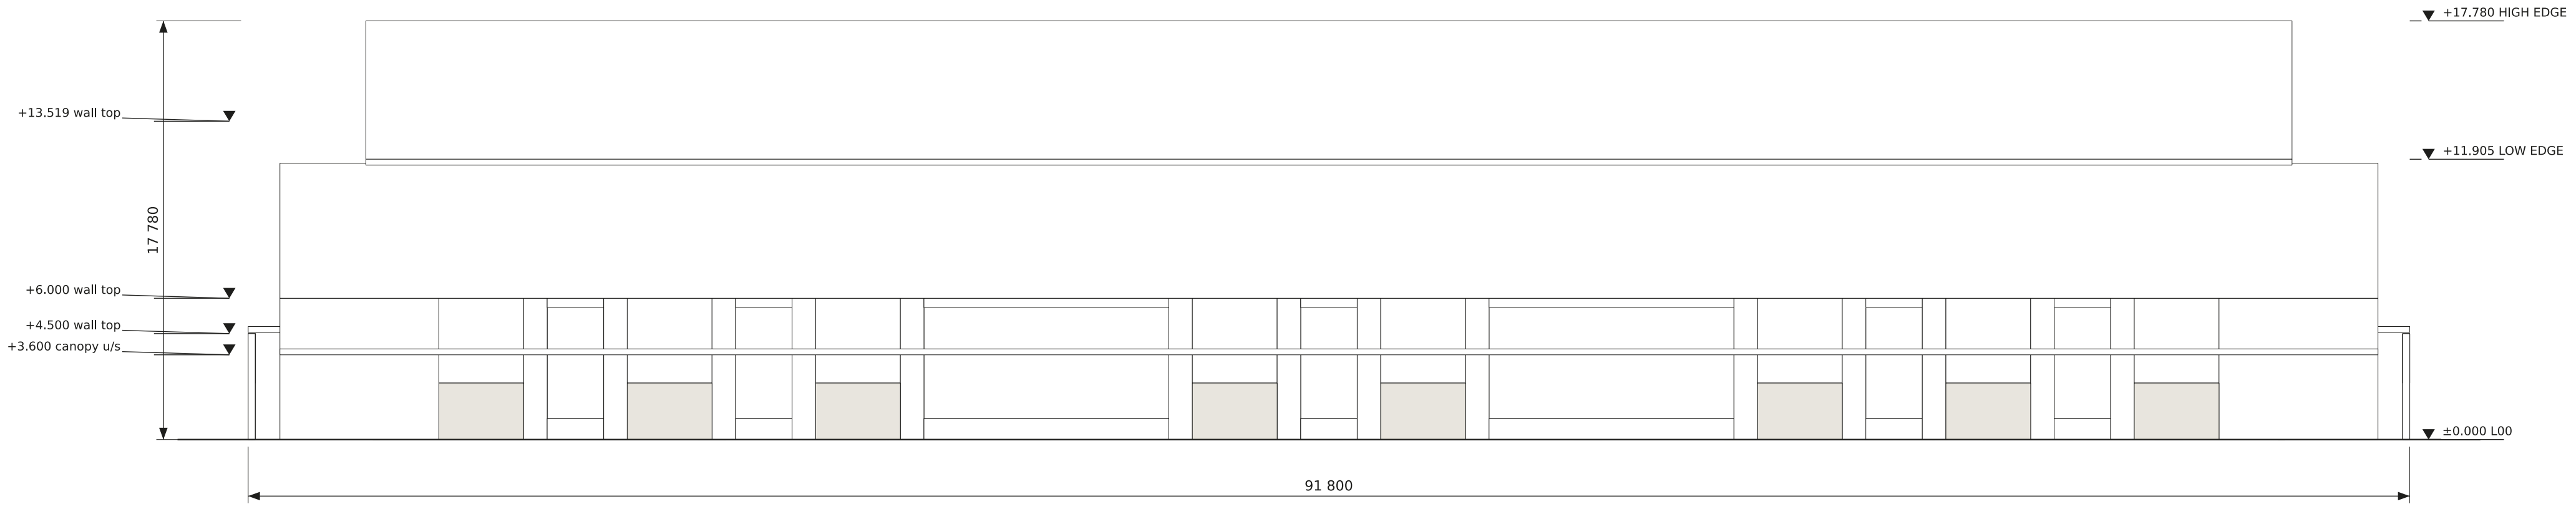
+17.780 HIGH EDGE
+13.519 wall top
+11.905 LOW EDGE
17 780
+6.000 wall top
+4.500 wall top
+3.600 canopy u/s
±0.000 L00
91 800

1 SOUTH ELEVATION (ENTRANCE)

SCALE 1:200

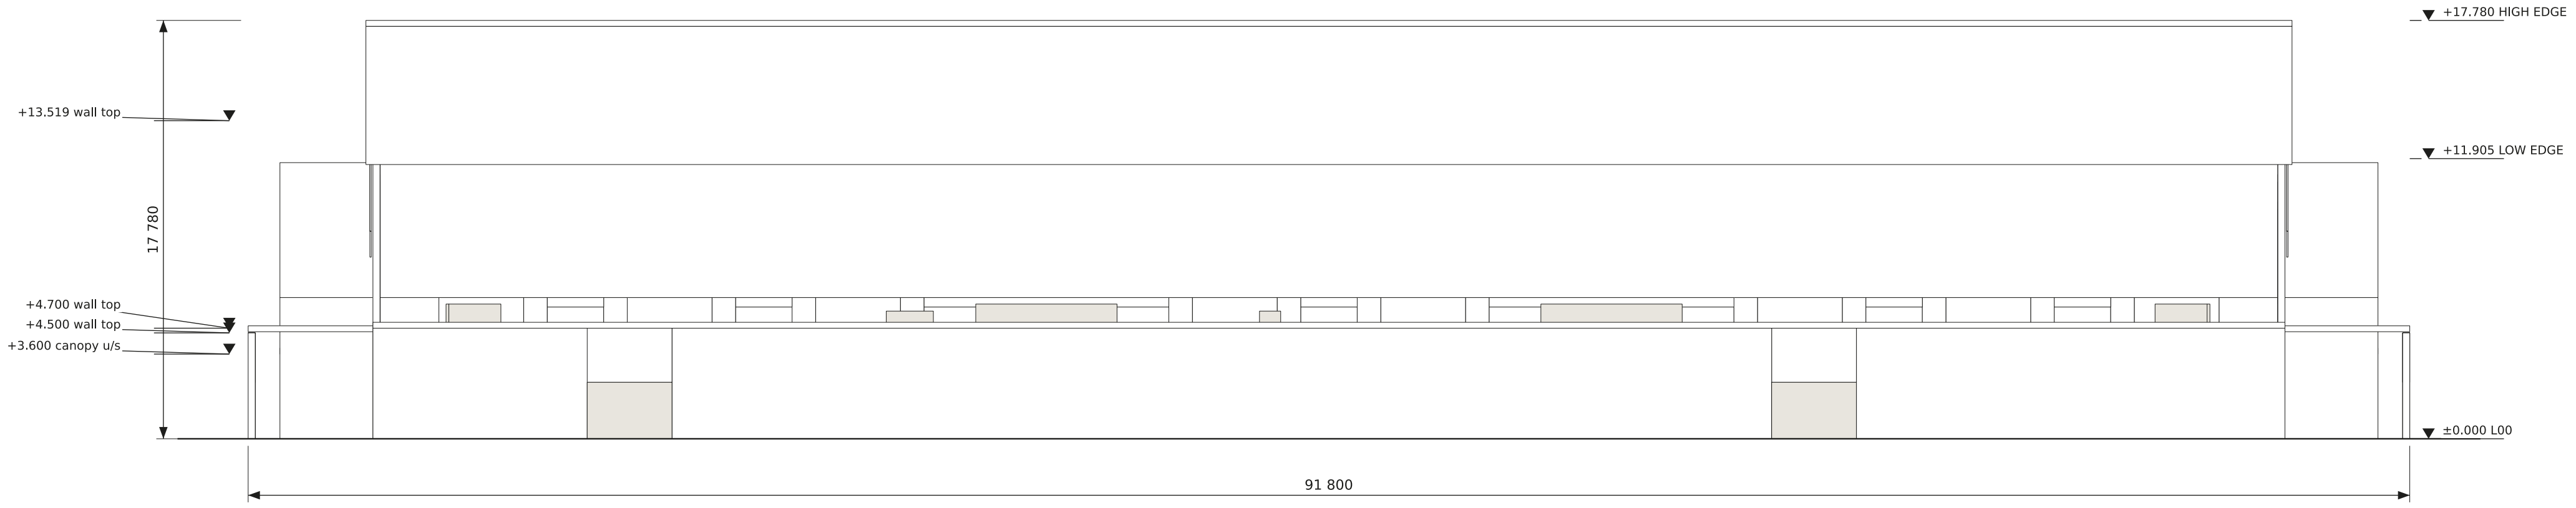
+17.780 HIGH EDGE
+13.519 wall top
+11.905 LOW EDGE
17 780
+4.700 wall top
+4.500 wall top
+3.600 canopy u/s
±0.000 L00
91 800

2 NORTH ELEVATION (STAGE SIDE)

SCALE 1:200

PROJECT

3,000-Seat Church Auditorium - Option B
(long-side stage) Coordination Concept

DESIGN

Option B - long-side stage

MODEL REVISION

`B03-44bc3ae457`

SOURCE MODEL (read-only, unmodified)

`designs/B-long-side-stage/model/church_3000_B.blend`
`sha256 ed9987dac0e70cab`

GEOMETRY

Evaluated Blender geometry (modifiers, matrix_world,
scale_length applied)

DRAWING

Elevations - south and north

SCALES

1:200 at A1 (half at A3)

UNITS

Linear dimensions in millimetres. Levels in metres above L00 (±0.000). Angles in degrees.

(P) Modelled PLACEHOLDER / space reservation / reference location - NOT an engineered size

STATUS

CONCEPT - UNVERIFIED - NOT FOR CONSTRUCTION

Dimensions are measured from the concept model and checked against independently computed values (validation_report.md). Structural member, footing and truss depth sizes are placeholders pending engineering design. Site levels unknown.

SHEET

B-D-401

Generated 2026-11-02 | A1 841 x 594

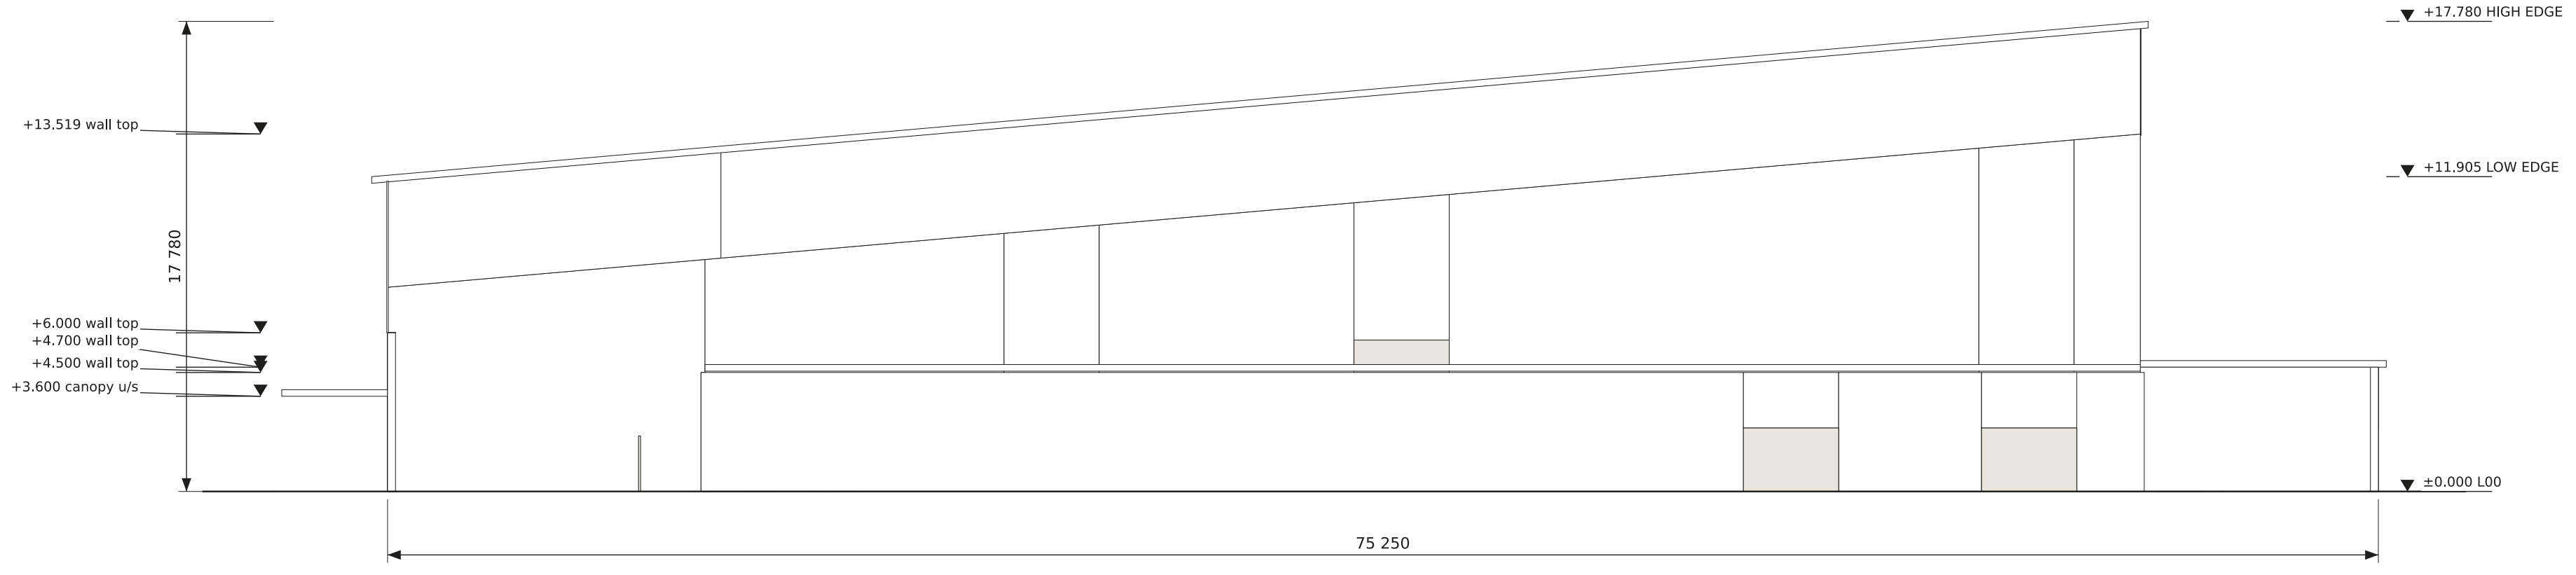
+13.519 wall top
17 780
+6.000 wall top
+4.700 wall top
+4.500 wall top
+3.600 canopy u/s
+17.780 HIGH EDGE
+11.905 LOW EDGE
±0.000 L00
75 250

1 EAST ELEVATION

SCALE 1:200

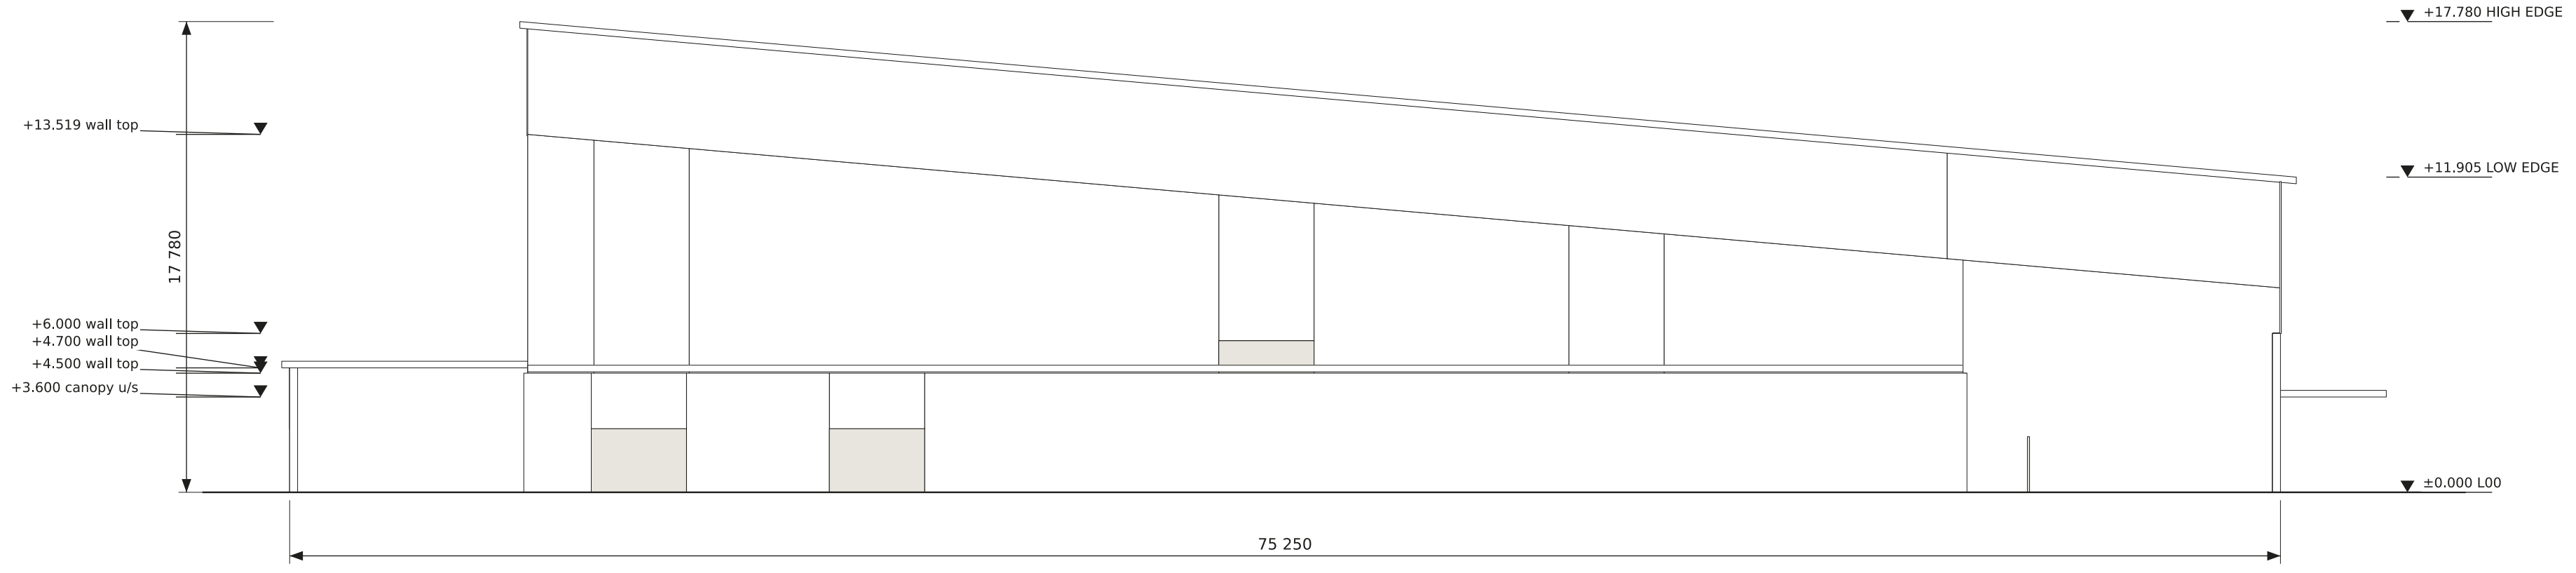
+13.519 wall top
17 780
+6.000 wall top
+4.700 wall top
+4.500 wall top
+3.600 canopy u/s
+17.780 HIGH EDGE
+11.905 LOW EDGE
±0.000 L00
75 250

2 WEST ELEVATION

SCALE 1:200

PROJECT

3,000-Seat Church Auditorium - Option B
(long-side stage) Coordination Concept

DESIGN

Option B - long-side stage

MODEL REVISION

`B03-44bc3ae457`

SOURCE MODEL (read-only, unmodified)

`designs/B-long-side-stage/model/church_3000_B.blend`
`sha256 ed9987dac0e70cab`

GEOMETRY

Evaluated Blender geometry (modifiers, matrix_world,
scale_length applied)

DRAWING

Elevations - east and west

SCALES

1:200 at A1 (half at A3)

UNITS

Linear dimensions in millimetres. Levels in metres
above L00 (±0.000). Angles in degrees.

(P) Modelled PLACEHOLDER / space reservation / reference location - NOT an engineered size

STATUS

CONCEPT - UNVERIFIED - NOT FOR CONSTRUCTION

Dimensions are measured from the concept model and checked against independently computed values (validation_report.md). Structural member, footing and truss depth sizes are placeholders pending engineering design. Site levels unknown.

SHEET

B-D-402

Generated 2026-11-02 | A1 841 x 594