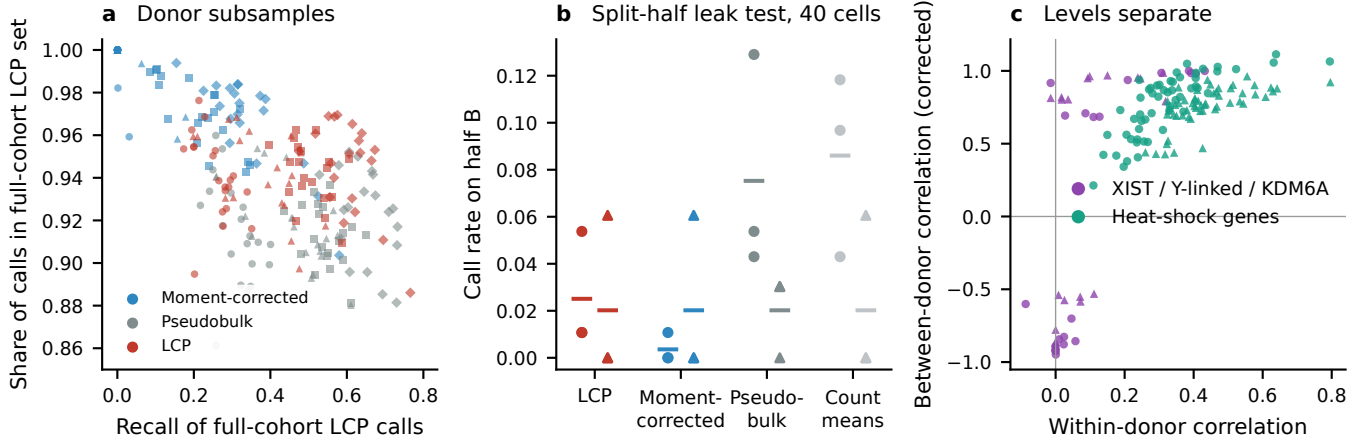
a
Donor subsamples
Share of calls in full-cohort LCP set
Recall of full-cohort LCP calls
Moment-corrected
Pseudobulk
LCP
b
Split-half leak test, 40 cells
Call rate on half B
LCP
Moment-corrected
Pseudo-bulk
Count means
c
Levels separate
Between-donor correlation (corrected)
Within-donor correlation
XIST / Y-linked / KDM6A
Heat-shock genes