Solar Inverter Modbus Interface Definitions

Issue 02

Date 2021-07-19





Copyright © Huawei Technologies Co., Ltd. 2021. All rights reserved.

No part of this document may be reproduced or transmitted in any form or by any means without prior written consent of Huawei Technologies Co., Ltd.

Trademarks and Permissions

HUAWEI and other Huawei trademarks are trademarks of Huawei Technologies Co., Ltd. All other trademarks and trade names mentioned in this document are the property of their respective holders.

Notice

The purchased products, services and features are stipulated by the contract made between Huawei and the customer. All or part of the products, services and features described in this document may not be within the purchase scope or the usage scope. Unless otherwise specified in the contract, all statements, information, and recommendations in this document are provided "AS IS" without warranties, guarantees or representations of any kind, either express or implied.

The information in this document is subject to change without notice. Every effort has been made in the preparation of this document to ensure accuracy of the contents, but all statements, information, and recommendations in this document do not constitute a warranty of any kind, express or implied.

Huawei Technologies Co., Ltd.

Address: Huawei Industrial Base

Bantian, Longgang Shenzhen 518129

People's Republic of China

Website: https://e.huawei.com

About This Document

Change History

Issue	Date	Description	
02	2021-07-19	This issue is the second official release.	
01	2019-10-31	This issue is the first official release.	

Contents

About This Document	i
1 Supported Models	1
1.1 Model Description	1
2 Overview	8
2.1 Terms and Abbreviations	8
3 Register Definitions	10
3.1 Inverter Equipment Register	
3.2 Battery Equipment Register	22
3.3 Meter Equipment Register	42
4 Customized Interfaces	45
4.1 Obtaining the System Information of Optimizers	45
4.2 Obtaining Real-time Data of Optimizers	47
5 Interface Instructions	51
5.1 Alarm Information	51
5.2 Power Grid Scheduling	54
5.2.1 cosφ-P/Pn Characteristic Curve	54
5.2.2 Q-U Characteristic Curve	55
5.2.3 PF-U Characteristic Curve	56
5.3 Grid Codes	57
5.4 Energy Storage Specifications	67
6 Overview of the Communications Protocol	72
6.1 Physical Layer	72
6.2 Data Link Layer	72
6.2.1 Modbus-RTU	73
6.2.1.1 ADU Length	73
6.2.1.2 Communications Address	73
6.2.1.3 CRC	73
6.2.2 Modbus-TCP	75
6.2.2.1 ADU Length	75
6.2.2.2 MBAP Packet Header	75
6.2.2.3 Communications Address	76

6.2.2.4 TCP Port	77
6.2.2.5 TCP Link Establishment Process	77
6.3 Application Layer	78
6.3.1 Function Code List	78
6.3.2 Exception Code List	78
6.3.3 Reading Registers (0x03)	80
6.3.3.1 Frame Format of a Request from a Master Node	80
6.3.3.2 Frame Format of a Normal Response from a Slave Node	80
6.3.3.3 Frame Format of an Abnormal Response from a Slave Node	80
6.3.3.4 Examples	80
6.3.4 Writing a Single Register (0x06)	82
6.3.4.1 Frame Format of a Request from a Master Node	82
6.3.4.2 Frame Format of a Normal Response from a Slave Node	82
6.3.4.3 Frame Format of an Abnormal Response from a Slave Node	82
6.3.4.4 Examples	83
6.3.5 Writing Multiple Registers (0x10)	84
6.3.5.1 Frame Format of a Request from a Master Node	84
6.3.5.2 Frame Format of a Normal Response from a Slave Node	85
6.3.5.3 Frame Format of an Abnormal Response from a Slave Node	85
6.3.5.4 Examples	85
6.3.6 Reading Device Identifiers (0x2B)	87
6.3.6.1 Command for Querying Device Identifiers	88
6.3.6.2 Command for Querying a Device List	89
6.3.6.3 Device Description Definition	90
6.3.7 Huawei-defined Functions (0x41)	91
6.3.7.1 Uploading Files	91
6.3.7.1.1 Starting the Upload	92
6.3.7.1.2 Uploading Data	93
6.3.7.1.3 Completing the Data Upload	94
6.3.7.1.4 Timeout Processing	95

1 Supported Models

This chapter describes the solar inverter models that use the Modbus protocol and the earliest firmware version. When a host needs to connect to these solar inverters, ensure that the firmware version is correct.

1.1 Model Description

1.1 Model Description

Table 1-1 Supported models and firmware versions

Model	Model ID	Earliest Firm Version
SUN2000-2KTL-L0	338	SUN2000L V100R001C00
SUN2000-2KTL-L1	349	SUN2000L V200R001C00
SUN2000-3KTL-CNL0	334	SUN2000L V100R001C20
SUN2000-3KTL-L0	339	SUN2000L V100R001C00
SUN2000-3KTL-L1	348	SUN2000L V200R001C00
SUN2000-3KTL-M0	410	SUN2000MA V100R001C00
SUN2000-3KTL-M1	424	SUN2000MA V100R001C00
SUN2000-3.68KTL-L10	347	SUN2000L V200R001C0
SUN2000-3.8KTL-USL0	318	SUN2000L V100R001C10
SUN2000-3.8KTL-USL0	319	SUN2000L V100R001C10
SUN2000-4KTL-CNL0	335	SUN2000L V100R001C20
SUN2000-4KTL-L0	340	SUN2000L V100R001C00
SUN2000-4KTL-L1	346	SUN2000L V200R001C00
SUN2000-4KTL-M0	411	SUN2000MA V100R001C00

Model	Model ID	Earliest Firm Version
SUN2000-4KTL-M1	425	SUN2000MA V100R001C00
SUN2000-4.6KTL-L1	345	SUN2000L V200R001C00
SUN2000-4.95KTL-JPL0	342	SUN2000L V100R001C20
SUN2000-4.95KTL-JPL1	350	SUN2000L V200R001C00
SUN2000-5KTL-CNL0	336	SUN2000L V100R001C20
SUN2000-5KTL-L0	341	SUN2000L V100R001C00
SUN2000-5KTL-L1	344	SUN2000L V200R001C00
SUN2000-5KTL-M0	400	SUN2000MA V100R001C00
SUN2000-5KTL-M0	401	SUN2000MA V100R001C00
SUN2000-5KTL-M1	426	SUN2000MA V100R001C00
SUN2000-5KTL-USL0	315	SUN2000L V100R001C10
SUN2000-5KTL-USL0	316	SUN2000L V100R001C10
SUN2000-6KTL-CNL0	337	SUN2000L V100R001C20
SUN2000-6KTL-L1	343	SUN2000L V200R001C00
SUN2000-6KTL-M0	402	SUN2000MA V100R001C00
SUN2000-6KTL-M0	403	SUN2000MA V100R001C00
SUN2000-6KTL-M1	427	SUN2000MA V100R001C00
SUN2000-7.6KTL-USL0	312	SUN2000L V100R001C10
SUN2000-7.6KTL-USL0	313	SUN2000L V100R001C10
SUN2000-8KTL	5	SUN2000 V100R001
SUN2000-8KTL	415	SUN2000MA V100R001C10
SUN2000-8KTL-M0	404	SUN2000MA V100R001C00
SUN2000-8KTL-M0	405	SUN2000MA V100R001C00
SUN2000-8KTL-M0	418	SUN2000MA V100R001C10
SUN2000-8KTL-M1	428	SUN2000MA V100R001C00
SUN2000-8KTL-M2	430	SUN2000MA V100R001C10
SUN2000-9KTL-USL0	324	SUN2000L V100R001C10
SUN2000-9KTL-USL0	325	SUN2000L V100R001C10
SUN2000-10KTL	4	SUN2000 V100R001
SUN2000-10KTL	416	SUN2000MA V100R001C10

Model	Model ID	Earliest Firm Version
SUN2000-10KTL-M0	406	SUN2000MA V100R001C00
SUN2000-10KTL-M0	407	SUN2000MA V100R001C00
SUN2000-10KTL-M0	419	SUN2000MA V100R001C10
SUN2000-10KTL-M1	429	SUN2000MA V100R001C00
SUN2000-10KTL-M2	431	SUN2000MA V100R001C10
SUN2000-10KTL-USL0	332	SUN2000L V100R001C10
SUN2000-10KTL-USL0	333	SUN2000L V100R001C10
SUN2000-11.4KTL-USL0	321	SUN2000L V100R001C10
SUN2000-11.4KTL-USL0	322	SUN2000L V100R001C10
SUN2000-12KTL	3	SUN2000 V100R001
SUN2000-12KTL	417	SUN2000MA V100R001C10
SUN2000-12KTL-M0	408	SUN2000MA V100R001C00
SUN2000-12KTL-M0	420	SUN2000MA V100R001C10
SUN2000-12KTL-M1	463	SUN2000MA V100R001C00
SUN2000-12KTL-M2	432	SUN2000MA V100R001C10
SUN2000-15KTL	2	SUN2000 V100R001
SUN2000-15KTL-M0	412	SUN2000MA V100R001C10
SUN2000-15KTL-M0	421	SUN2000MA V100R001C10
SUN2000-15KTL-M2	433	SUN2000MA V100R001C10
SUN2000-15KTL-M3	436	SUN2000MA V100R001C20
SUN2000-17KTL	1	SUN2000 V100R001
SUN2000-17KTL-M0	413	SUN2000MA V100R001C10
SUN2000-17KTL-M0	422	SUN2000MA V100R001C10
SUN2000-17KTL-M2	434	SUN2000MA V100R001C10
SUN2000-17KTL-M3	437	SUN2000MA V100R001C20
SUN2000-20KTL	0	SUN2000 V100R001
SUN2000-20KTL-M0	414	SUN2000MA V100R001C10SUN2000MA
SUN2000-20KTL-M0	423	SUN2000MA V100R001C10SUN2000MA
SUN2000-20KTL-M2	435	SUN2000MA V100R001C10
SUN2000-20KTL-M3	438	SUN2000MA V100R001C20

Model	Model ID	Earliest Firm Version
SUN2000-20KTL-M3	457	SUN2000MA V100R001C20
SUN2000-22KTL-US	25	SUN2000 V200R001C02
SUN2000-23KTL	17	SUN2000 V100R001
SUN2000-23KTL-M3	439	SUN2000MA V100R001C20
SUN2000-24.5KTL	16	SUN2000 V100R001
SUN2000-24.5KTL-M3	440	SUN2000MA V100R001C20
SUN2000-24.7KTL-JP	32	SUN2000 V200R002C00
SUN2000-25KTL-NAM3	441	SUN2000MA V100R001C20
SUN2000-25KTL-US	21	SUN2000 V200R001C02
SUN2000-28KTL	18	SUN2000 V100R001
SUN2000-28KTL-M3	442	SUN2000MA V100R001C20
SUN2000-29.9KTL	60	SUN2000 V200R002C00
SUN2000-29.9KTL-M3	443	SUN2000MA V100R001C20
SUN2000-29.9KTL-M3	458	SUN2000MA V100R001C20
SUN2000-30KTL-A	23	SUN2000 V200R001C90
SUN2000-30KTL-M3	444	SUN2000MA V100R001C20
SUN2000-30KTL-M3	459	SUN2000MA V100R001C20
SUN2000-30KTL-M3	462	SUN2000MA V100R001C20
SUN2000-30KTL-NAM3	450	SUN2000MA V100R001C20
SUN2000-30KTL-US	22	SUN2000 V200R001C02
SUN2000-33KTL	19	SUN2000 V200R001C90
SUN2000-33KTL-A	43	SUN2000 V200R002C00
SUN2000-33KTL-E001	44	SUN2000 V200R001C90
SUN2000-33KTL-JP	28	SUN2000 V200R002C00
SUN2000-33KTL-NAM3	451	SUN2000MA V100R001C20
SUN2000-33KTL-NHM3	455	SUN2000MA V100R001C20
SUN2000-33KTL-US	36	SUN2000 V200R002C20
SUN2000-36KTL	27	SUN2000 V200R002C00
SUN2000-36KTL-M3	445	SUN2000MA V100R001C20
SUN2000-36KTL-M3	460	SUN2000MA V100R001C20

Model	Model ID	Earliest Firm Version
SUN2000-36KTL-NAM3	452	SUN2000MA V100R001C20
SUN2000-36KTL-US	37	SUN2000 V200R002C20
SUN2000-40KTL	20	SUN2000 V200R001C90
SUN2000-40KTL-JP	29	SUN2000 V200R002C00
SUN2000-40KTL-M3	446	SUN2000MA V100R001C20
SUN2000-40KTL-M3	461	SUN2000MA V100R001C20
SUN2000-40KTL-NAM3	453	SUN2000MA V100R001C20
SUN2000-40KTL-NHM3	456	SUN2000MA V100R001C20
SUN2000-40KTL-US	35	SUN2000 V200R002C20
SUN2000-42KTL	26	SUN2000 V200R002C00
SUN2000-42KTL-M3	447	SUN2000MA V100R001C20
SUN2000-43KTL-IN-C1	31	SUN2000 V200R002C00
SUN2000-43KTL-INM3	454	SUN2000MA V100R001C20
SUN2000-44KTL-M3	448	SUN2000MA V100R001C20
SUN2000-45KTL-US-HV-D0	34	SUN2000HA V100R001
SUN2000-50KTL	30	SUN2000 V200R002C00
SUN2000-50KTL-C1	24	SUN2000 V200R002C00
SUN2000-50KTL-JPM0	53	SUN2000 V300R001C00
SUN2000-50KTL-JPM1	59	SUN2000 V300R001C00
SUN2000-50KTL-M0	50	SUN2000 V300R001C00
SUN2000-50KTL-M3	449	SUN2000MA V100R001C20
SUN2000-55KTL-HV-D1	38	SUN2000HA V100R001
SUN2000-55KTL-HV-D1-001	40	SUN2000HA V100R001
SUN2000-55KTL-IN-HV-D1	39	SUN2000HA V100R001
SUN2000-60KTL-HV-D1	33	SUN2000HA V100R001
SUN2000-60KTL-HV-D1-001	41	SUN2000HA V100R001
SUN2000-60KTL-M0	55	SUN2000 V300R001C00
SUN2000-63KTL-JPH0	76	SUN2000HA V200R001C00
SUN2000-63KTL-JPM0	51	SUN2000 V300R001C00
SUN2000-65KTL-M0	46	SUN2000 V300R001C00

Model	Model ID	Earliest Firm Version
SUN2000-70KTL-C1	45	SUN2000 V300R001C00
SUN2000-70KTL-INM0	48	SUN2000 V300R001C00
SUN2000-75KTL-C1	56	SUN2000 V300R001C00
SUN2000-90KTL-H0	75	SUN2000HA V200R001C00
SUN2000-90KTL-H1	73	SUN2000HA V200R001C00
SUN2000-90KTL-H2	81	SUN2000HA V200R001C00
SUN2000-95KTL-INH0	74	SUN2000HA V200R001C00
SUN2000-95KTL-INH1	82	SUN2000HA V200R001C00
SUN2000-100KTL-H0	72	SUN2000HA V200R001C00
SUN2000-100KTL-H1	71	SUN2000HA V200R001C00
SUN2000-100KTL-H2	78	SUN2000HA V200R001C00
SUN2000-100KTL-INM0	143	SUN2000 V500R001C00
SUN2000-100KTL-M0	141	SUN2000 V500R001C00
SUN2000-100KTL-M1	142	SUN2000 V500R001C00
SUN2000-100KTL-USH0	70	SUN2000HA V200R001C00
SUN2000-105KTL-H1	79	SUN2000HA V200R001C00
SUN2000-110KTL-M0	144	SUN2000 V500R001C00
SUN2000-125KTL-JPH0	110	SUN2000HA V300R001C00
SUN2000-125KTL-M0	145	SUN2000 V500R001C00
SUN2000-168KTL-H1	103	SUN2000HA V300R001C00
SUN2000-175KTL-H0	101	SUN2000HA V300R001C00
SUN2000-185KTL-H1	104	SUN2000HA V300R001C00
SUN2000-185KTL-INH0	102	SUN2000HA V300R001C00
SUN2000-193KTL-H0	105	SUN2000HA V300R001C00
SUN2000-196KTL-H0	106	SUN2000HA V300R001C00
SUN2000-196KTL-H1	107	SUN2000HA V300R001C00
SUN2000-196KTL-H3	111	SUN2000HA V300R001C00
SUN2000-200KTL-H2	108	SUN2000HA V300R001C00
SUN2000-215KTL-H0	109	SUN2000HA V300R001C00
SUN2000L-2KTL	305	SUN2000L V100R001C00

Model	Model ID	Earliest Firm Version
SUN2000L-3KTL	304	SUN2000L V100R001C00
SUN2000L-3KTL-CN	310	SUN2000L V100R001C00
SUN2000L-3KTL-CN-4G	311	SUN2000L V100R001C00
SUN2000L-3.68KTL	303	SUN2000L V100R001C00
SUN2000L-4KTL	302	SUN2000L V100R001C00
SUN2000L-4KTL-CN	308	SUN2000L V100R001C00
SUN2000L-4KTL-CN-4G	309	SUN2000L V100R001C00
SUN2000L-4.125KTL-JP	331	SUN2000L V100R001C12
SUN2000L-4.6KTL	301	SUN2000L V100R001C00
SUN2000L-4.95KTL-JP	330	SUN2000L V100R001C12
SUN2000L-5KTL	300	SUN2000L V100R001C00
SUN2000L-5KTL-CN	306	SUN2000L V100R001C00
SUN2000L-5KTL-CN-4G	307	SUN2000L V100R001C00
SUN8000-500KTL	9	SUN8000 V100R001

MOTE

The maximum active power (P_{max}) , maximum reactive power (Q_{max}) , and rated power (P_n) corresponding to each model can be obtained from the register interface. The model ID is the unique code of the model.

2 Overview

Modbus is a widely used protocol for device communications. This document describes the Modbus protocol used by Huawei solar inverters, and can be used to regulate follow-up third-party integrated development. Huawei solar inverters comply with the standard Modbus protocol, and this document focuses on the information specific to Huawei solar inverters. For other information about Modbus, see the standard documents about the Modbus protocol. For details about the standard protocols used by Huawei solar inverters and customized interaction modes and examples, see chapter 6.

2.1 Terms and Abbreviations

2.1 Terms and Abbreviations

Table 2-1 Terms and abbreviations

Name	Description
Master node	During master-slave communication, the party that initiates a communication request is referred to as the master node.
Slave node	During master-slave communication, the party that responds to a communication request is referred to as the slave node.
Broadcast address	Fixed to 0.
Register address	A register address is recorded in two bytes.
U16	Unsigned integer (16 bits)
U32	Unsigned integer (32 bits)
116	Signed integer (16 bits)
132	Signed integer (32 bits)
STR	Character string
MLD	Multiple bytes

Name	Description	
Bitfield16	16-bit data expressed by bit	
Bitfield32	32-bit data expressed by bit	
N/A	Not applicable	
S	Second	
Epoch seconds	The number of seconds that have elapsed since 1970-01-01 00:00:00	
RO	Data that is readable only	
RW	Data that is readable and writable	
WO	Data that is writable only	

3 Register Definitions

3.1 Inverter Equipment Register

Table 3-1 Inverter Equipment Register definitions

No.	Signal Name	Read/ Write	Туре	Unit	Gain	Address	Quantit y	Scope
1	Model	RO	STR	N/A	1	30000	15	For details, see 1.1.
2	SN	RO	STR	N/A	1	30015	10	N/A
3	PN	RO	STR	N/A	1	30025	10	N/A
4	Model ID	RO	U16	N/A	1	30070	1	For details, see
5	Number of PV strings	RO	U16	N/A	1	30071	1	N/A
6	Number of MPP trackers	RO	U16	N/A	1	30072	1	N/A
7	Rated power (P _n)	RO	U32	kW	1000	30073	2	N/A
8	Maximum active power (P _{max})	RO	U32	kW	1000	30075	2	N/A
9	Maximum apparent power (S _{max})	RO	U32	kVA	1000	30077	2	N/A

No.	Signal Name	Read/ Write	Туре	Unit	Gain	Address	Quantit y	Scope
10	Maximum reactive power (Q _{max} , fed to the power grid)	RO	132	kVar	1000	30079	2	N/A
11	Maximum reactive power (Q _{max} , absorbed from the power grid)	RO	132	kVar	1000	30081	2	N/A
12	State 1	RO	Bitfield1	N/A	1	32000	1	Bit 0: standby Bit 1: grid- connected Bit 2: grid- connected normally Bit 3: grid connection with derating due to power rationing Bit 4: grid connection with derating due to internal causes of the solar inverter Bit 5: normal stop Bit 6: stop due to faults Bit 7: stop due to power rationing Bit 8: shutdown Bit 9: spot check

No.	Signal Name	Read/ Write	Туре	Unit	Gain	Address	Quantit y	Scope
13	State 2	RO	Bitfield1 6	N/A	1	32002	1	Bit 0: locking status (0: locked; 1: unlocked) Bit 1: PV connection status (0: disconnected; 1: connected) Bit 2: DSP data collection (0: no;
								1: yes)
14	State 3	RO	Bitfield3 2	N/A	1	32003	2	Bit 0: off-grid (0: on-grid; 1: off-grid) Bit 1: off-grid switch (0: disable; 1: enable)
15	Alarm 1	RO	Bitfield1 6	N/A	1	32008	1	For details, see 5.1.
16	Alarm 2	RO	Bitfield1 6	N/A	1	32009	1	For details, see 5.1 .
17	Alarm 3	RO	Bitfield1 6	N/A	1	32010	1	For details, see 5.1 .
18	PV1 voltage	RO	I16	V	10	32016	1	A maximum of
19	PV1 current	RO	I16	Α	100	32017	1	24 PV strings are supported. The
20	PV2 voltage	RO	I16	V	10	32018	1	number of PV strings read by
21	PV2 current	RO	I16	Α	100	32019	1	the host is
22	PV3 voltage	RO	I16	V	10	32020	1	defined by the Number of PV
23	PV3 current	RO	I16	Α	100	32021	1	strings signal. The voltage and
24	PV4 voltage	RO	116	V	10	32022	1	current register addresses for each PV string are as follows: PVn voltage: 32014 + 2n PVn current: 32015 + 2n n indicates the PV string

No.	Signal Name	Read/ Write	Туре	Unit	Gain	Address	Quantit y	Scope
25	PV4 current	RO	I16	A	100	32023	1	number, which ranges from 1 to 24.
26	Input power	RO	132	kW	1000	32064	2	N/A
27	Power grid voltage/Line voltage between phases A and B	RO	U16	V	10	32066	1	When the output mode is L/N, L1/L2/N, or L1/L2, Power grid voltage is used.
28	Line voltage between phases B and C	RO	U16	V	10	32067	1	When the output mode is L/N, L1/L2/N, or L1/L2, the information is invalid.
29	Line voltage between phases C and A	RO	U16	V	10	32068	1	When the output mode is L/N, L1/L2/N, or L1/L2, the information is invalid.
30	Phase A voltage	RO	U16	V	10	32069	1	When the output mode is L/N, L1/L2/N, or L1/L2, the information is invalid.
31	Phase B voltage	RO	U16	V	10	32070	1	When the output mode is L/N, L1/L2/N, or L1/L2, the information is invalid.
32	Phase C voltage	RO	U16	V	10	32071	1	When the output mode is L/N, L1/L2/N, or L1/L2, the information is invalid.

No.	Signal Name	Read/ Write	Туре	Unit	Gain	Address	Quantit y	Scope
33	Power grid current/Phase A current	RO	132	A	1000	32072	2	When the output mode is L/N, L1/L2/N, or L1/L2, Power grid current is used.
34	Phase B current	RO	132	A	1000	32074	2	When the output mode is L/N, L1/L2/N, or L1/L2, the information is invalid.
35	Phase C current	RO	132	A	1000	32076	2	When the output mode is L/N, L1/L2/N, or L1/L2, the information is invalid.
36	Peak active power of current day	RO	132	kW	1000	32078	2	N/A
37	Active power	RO	132	kW	1000	32080	2	N/A
38	Reactive power	RO	132	kVar	1000	32082	2	N/A
39	Power factor	RO	I16	N/A	1000	32084	1	N/A
40	Grid frequency	RO	U16	Hz	100	32085	1	N/A
41	Efficiency	RO	U16	%	100	32086	1	N/A
42	Internal temperature	RO	I16	°C	10	32087	1	N/A
43	Insulation resistance	RO	U16	МΩ	1000	32088	1	N/A

No.	Signal Name	Read/ Write	Туре	Unit	Gain	Address	Quantit y	Scope
44	Device status	RO	U16	N/A	1	32089	1	0x0000 Standby: initializing
								0x0001 Standby: detecting insulation resistance
								0x0002 Standby: detecting irradiation
								0x0003 Standby: drid detecting
								0x0100 Starting
								0x0200 On-grid (Off-grid mode: running)
								0x0201 Grid connection: power limited
								(Off-grid mode: running: power limited)
								0x0202 Grid connection: self- derating
								(Off-grid mode: running: self- derating)
								0x0203 Off-grid Running
								0x0300 Shutdown: fault
								0x0301 Shutdown: command
								0x0302 Shutdown: OVGR
								0x0303 Shutdown: communication
								disconnected
								0x0304 Shutdown: power limited

No.	Signal Name	Read/ Write	Туре	Unit	Gain	Address	Quantit y	Scope
								0x0305 Shutdown: manual startup required 0x0306 Shutdown: DC switches disconnected
								0x0307 Shutdown: rapid cutoff
								0x0308 Shutdown: input underpower
								0x0401 Grid scheduling: cosф-P curve
								0x0402 Grid scheduling: Q-U curve
								0x0403 Grid scheduling: PF-U curve
								0x0404 Grid scheduling: dry contact
								0x0405 Grid scheduling: Q-P curve
								0x0500 Spot- check ready
								0x0501 Spot- checking
								0x0600 Inspecting
								0X0700 AFCI self check
								0X0800 I-V scanning
								0X0900 DC input detection
								0X0A00 Running: off-grid charging

No.	Signal Name	Read/ Write	Туре	Unit	Gain	Address	Quantit y	Scope
								0xA000 Standby: no irradiation
45	Fault code	RO	U16	N/A	1	32090	1	N/A
46	Startup time	RO	U32	N/A	1	32091	2	Epoch seconds, local time
47	Shutdown time	RO	U32	N/A	1	32093	2	Epoch seconds, local time
48	Accumulated energy yield	RO	U32	kWh	100	32106	2	N/A
49	Daily energy yield	RO	U32	kWh	100	32114	2	N/A
50	[Active] Adjustment mode	RO	U16	N/A	1	35300	1	0: percentage 1: fixed value NOTICE Addresses 35300 to 35303 need to be read at a time.
51	[Active] Adjustment value	RO	U32	N/A	*	35302	2	Percentage: 0.1% Fixed value: 0.001 kW Note: For details about the adjustment value precision, see the corresponding adjustment command precision.

No.	Signal Name	Read/ Write	Туре	Unit	Gain	Address	Quantit y	Scope
52	[Active] Adjustment command	RO	U16	N/A	1	35303	1	40125: active power derating by percentage (0.1%) 40120: active power derating by fixed value 40126: active power derating by fixed value (W) 42178: maximum active power
53	[Reactive] Adjustment mode	RO	U16	N/A	1	35304	1	0: power factor 1: absolute value 2: Q/S 3: Q-U characteristic curve (command ID: 0) 4: cosφ-P/P _n characteristic curve (command ID: 0) 5: PF-U characteristic curve (command ID: 0) 6: Q-P characteristic curve (command ID: 0) NOTICE Addresses 35304 to 35306 need to be read at a time.

No.	Signal Name	Read/ Write	Туре	Unit	Gain	Address	Quantit y	Scope
54	[Reactive] Adjustment	RO	U32	N/A	*	35305	2	Power factor: 0.001
	value							Absolute value: 0.001 kVar
								Q/S: 0.001
								Q-U characteristic curve: 0
								cosф-P/P _n characteristic curve: 0
								PF-U characteristic curve: 0
								Q-P characteristic curve: 0
55	[Reactive] Adjustment	RO	U16	N/A	1	35307	1	40122: power factor
	command							40123: Q/S adjustment
								40129: reactive power compensation at night (kVar)
								42809: reactive power at night Q/S
56	[Power meter collection] Active power*	RO	132	W	1	37113	2	> 0: feeding power to the power grid
								< 0: obtaining power from the power grid
57	[Optimizer] Total number of optimizers*	RO	U16	N/A	1	37200	1	N/A
58	[Optimizer] Number of online optimizers*	RO	U16	N/A	1	37201	1	N/A

No.	Signal Name	Read/ Write	Туре	Unit	Gain	Address	Quantit y	Scope
59	[Optimizer] Feature data [*]	RO	U16	N/A	1	37202	1	N/A
60	System time	RW	U32	N/A	1	40000	2	[946684800, 3155759999] Epoch seconds, local time
61	[Power grid scheduling] Q-U characteristic curve mode*	RW	U16	N/A	1	40037	1	0: non-hysteresis 1: hysteresis
62	[Power grid scheduling] Q-U dispatch trigger power (%)*	RW	U16	%	1	40038	1	[0, 100]
63	[Power grid scheduling] Fixed active power derated	RW	U16	kW	10	40120	1	Scope: [0, P _{max}]
64	[Power grid scheduling] Reactive power compensatio n (PF)	RW	116	N/A	1000	40122	1	(-1, -0.8]U[0.8, 1]
65	[Power grid scheduling] Reactive power compensatio n (Q/S)	RW	116	N/A	1000	40123	1	[-1, 1] The device converts the value to a fixed value of Q for reactive power control. S indicates S _{max} .
66	[Power grid scheduling] Active power percentage derating (0.1%)	RW	U16	%	10	40125	1	Scope: [0, 100] Interface for fine adjustment of active power

No.	Signal Name	Read/ Write	Туре	Unit	Gain	Address	Quantit y	Scope
67	[Power grid scheduling] Fixed active power derated (W)	RW	U32	W	1	40126	2	Scope: [0, P _{max}]
68	[Power grid scheduling] Reactive power compensatio n at night (kVar)	RW	132	kVar	1000	40129	2	[-Q _{max} , Q _{max}]
69	[Power grid scheduling] cosφ-P/P _n characteristic curve	RW	MLD	N/A	1	40133	21	For details, see 5.2.
70	[Power grid scheduling] Q-U characteristic curve	RW	MLD	N/A	1	40154	21	For details, see 5.2.
71	[Power grid scheduling] PF-U characteristic curve	RW	MLD	N/A	1	40175	21	For details, see 5.2.
72	[Power grid scheduling] Reactive power adjustment time	RW	U16	S	1	40196	1	[1, 120]. The default value is 10.
73	[Power grid scheduling] Q-U power percentage to exit scheduling*	RW	U16	%	1	40198	1	[0, 100]
74	Startup	wo	U16	N/A	1	40200	1	N/A
75	Shutdown	wo	U16	N/A	1	40201	1	N/A
76	Grid code	RW	U16	NA	1	42000	1	For details, see 5.3.

No.	Signal Name	Read/ Write	Туре	Unit	Gain	Address	Quantit y	Scope
77	[Power grid scheduling] Reactive power change gradient	RW	U32	%/s	1000	42015	2	[0.1, 1000]
78	[Power grid scheduling] Active power change gradient	RW	U32	%/s	1000	42017	2	[0.1, 1000]
79	[Power grid scheduling] Schedule instruction valid duration	RW	U32	S	1	42019	2	[0, 86400] The value 0 indicates that the command is valid permanently.
80	Time zone	RW	I16	min	1	43006	1	[-720, 840]

NOTICE

Signals marked with * are supported only by certain models or standard codes.

3.2 Battery Equipment Register

Table 3-2 Battery Equipment Register definitions

No.	Signal Name	Re ad / Wr ite	Туре	Un it	Ga in	Addr ess	Qua ntity	Scope	HUA WEI- LUNA 2000	LG- RESU
1	[Energy storage unit 1] ^[1] Running status	RO	UINT1 6	N/ A	1	3700 0	1	0: offline 1: standby 2: running 3: fault 4: sleep mode	✓	(√) [2]

No.	Signal Name	Re ad / Wr ite	Туре	Un it	Ga in	Addr ess	Qua ntity	Scope	HUA WEI- LUNA 2000	LG- RESU
2	[Energy storage unit 1] Charge and discharge power	RO	INT32	W	1	3700 1	2	> 0: charging < 0: discharging	√	(\(\)
3	[Energy storage unit 1] Bus voltage	RO	UINT1 6	V	10	3700 3	1	Energy storage module output voltage	√	(√)
4	[Energy storage unit 1] Battery SOC	RO	UINT1 6	%	10	3700 4	1	Battery's state of capacity	√	(√)
5	[Energy storage unit 1] Working mode	RO	UINT1 6	N/ A	1	3700 6	1	0:none 1:Forcible charge/ discharge 2:Time of Use(LG) 3:Fixed charge/ discharge 4:Maximise self consumption 5:Fully fed to grid 6:Time of Use(LUNA2000)	✓	✓
6	[Energy storage unit 1] Rated charge power	RO	UINT3 2	W	1	3700 7	2	-	√	√
7	[Energy storage unit 1] Rated discharge power	RO	UINT3 2	W	1	3700 9	2	-	√	√

No.	Signal Name	Re ad / Wr ite	Туре	Un it	Ga in	Addr ess	Qua ntity	Scope	HUA WEI- LUNA 2000	LG- RESU
8	[Energy storage unit 1] Fault ID	RO	UINT1 6	N/ A	1	3701 4	1	-	√	√
9	[Energy storage unit 1] Current- day charge capacity	RO	UINT3 2	kW h	10	3701 5	2	-	√	(√)
10	[Energy storage unit 1] Current- day discharge capacity	RO	UINT3 2	kW h	10	3701 7	2	-	√	(\(\sqrt{)}
11	[Energy storage unit 1] Bus current	RO	INT16	A	10	3702 1	1	Energy storage module output current	√	√
12	[Energy storage unit 1] battery temperature	RO	INT16	င	10	3702 2	1	-	√	√
13	[Energy storage unit 1] Remaining charge/ discharge time	RO	UINT1 6	mi ns	1	3702 5	1	[0,1440]	√	✓
14	[Energy storage unit 1] DCDCversion	RO	STRIN G	N/ A	1	3702 6	10	eg. 7kW-V1.3		√
15	[Energy storage unit 1] BMSversion	RO	STRIN G	N/ A	1	3703 6	10	eg. 001. 002. 003. 004		√

No.	Signal Name	Re ad / Wr ite	Туре	Un it	Ga in	Addr ess	Qua ntity	Scope	HUA WEI- LUNA 2000	LG- RESU
16	[Energy storage]Maxi mum charge power	RO	UINT3 2	W	1	3704 6	2	The value is the smaller value of the sum of the maximum charge and discharge capability of the solar inverter and the charge and discharge capability of the connected energy storage unit (ESU).	√	✓
17	[Energy storage] Maximum discharge power	RO	UINT3 2	W	1	3704 8	2	The value is the smaller value of the sum of the maximum charge and discharge capability of the solar inverter and the charge and discharge capability of the connected ESU.	✓	✓
18	[Energy storage unit 1] SN	RO	STRIN G	N/ A	1	3705 2	10	-	√	√
19	[Energy storage unit 1] Total charge	RO	UINT3 2	kW h	10 0	3706 6	2	-	√	√
20	[Energy storage unit 1] Total discharge	RO	UINT3 2	kW h	10 0	3706 8	2	-	√	√

No.	Signal Name	Re ad / Wr ite	Туре	Un it	Ga in	Addr ess	Qua ntity	Scope	HUA WEI- LUNA 2000	LG- RESU
21	[Energy storage unit 2] SN	RO	BYTES	N/ A	1	3770 0	10	-	√	
22	[Energy storage unit 2] Battery SOC	RO	UINT1 6	%	10	3773 8	1	Battery's state of capacity	√	
23	[Energy storage unit 2] Running status	RO	UINT1 6	N/ A	1	3774 1	1	0: offline 1: standby 2: running 3: fault 4: sleep mode	√	
24	[Energy storage unit 2] Charge and discharge power	RO	INT32	W	1	3774 3	2	> 0: charging < 0: discharging	√	
25	[Energy storage unit 2] Current- day charge capacity	RO	UINT3 2	kW h	10	3774 6	2	-	√	
26	[Energy storage unit 2] Current- day discharge capacity	RO	UINT3 2	kW h	10	3774 8	2	-	√	
27	[Energy storage unit 2] Bus voltage	RO	UINT1 6	V	10	3775 0	1	-	√	
28	[Energy storage unit 2] Bus current	RO	INT16	A	10	3775 1	1	-	√	

No.	Signal Name	Re ad / Wr ite	Туре	Un it	Ga in	Addr ess	Qua ntity	Scope	HUA WEI- LUNA 2000	LG- RESU
29	[Energy storage unit 2] Battery temperature	RO	INT16	${\mathbb C}$	10	3775 2	1		√	
30	[Energy storage unit 2] Total charge	RO	UINT3 2	kW h	10 0	3775 3	2	-	√	
31	[Energy storage unit 2] Total discharge	RO	UINT3 2	kW h	10 0	3775 5	2	-	√	
32	[Energy storage]Rate d capacity	RO	UINT3 2	Wh	1	3775 8	2		√	
33	[Energy storage]SOC	RO	UINT1 6	%	10	3776 0	1	[0.0,100.0]	√	
34	[Energy storage]Run ning status	RO	UINT1 6	N/ A	1	3776 2	1	0: offline 1: standby 2: running 3: fault 4: sleep mode	√	
35	[Energy storage]Bus voltage	RO	UINT1 6	V	10	3776 3	1	-	√	
36	[Energy storage]Bus current	RO	INT16	A	10	3776 4	1	-	√	
37	[Energy storage]Char ge/Discharge power	RO	INT32	W	1	3776 5	2	-	√	
38	[Energy storage]Total charge	RO	UINT3 2	kW h	10 0	3778 0	2	Life-cycle accumulation	√	√
39	[Energy storage]Total discharge	RO	UINT3 2	kW h	10 0	3778 2	2	Life-cycle accumulation	√	√

No.	Signal Name	Re ad / Wr ite	Туре	Un it	Ga in	Addr ess	Qua ntity	Scope	HUA WEI- LUNA 2000	LG- RESU
40	[Energy storage] Current-day charge capacity	RO	UINT3 2	kW h	10 0	3778 4	2	Current-day accumulation	√	✓
41	[Energy storage] Current-day discharge capacity	RO	UINT3 2	kW h	10	3778 6	2	Current-day accumulation	✓	✓
42	[Energy storage unit 2] software version	RO	STRIN G	N/ A	1	3779 9	15	-	√	
43	[Energy storage unit 1] software version	RO	STRIN G	N/ A	1	3781 4	15	-	√	
44	[Energy storage unit 1] [Battery pack1]SN	RO	STRIN G	N/ A	N/ A	3820 0	10	-	√	
45	[Energy storage unit 1] [Battery pack1]Firmw are version	RO	STRIN G	N/ A	N/ A	3821 0	15	-	√	
46	[Energy storage unit 1] [Battery pack1]Worki ng status	RO	UINT1 6	N/ A	N/ A	3822 8	1	-	√	
47	[Energy storage unit 1] [Battery pack1]SOC	RO	UINT1 6	%	10	3822 9	1	-	√	

No.	Signal Name	Re ad / Wr ite	Туре	Un it	Ga in	Addr ess	Qua ntity	Scope	HUA WEI- LUNA 2000	LG- RESU
48	[Energy storage unit 1] [Battery pack1]Charg e/Discharge power	RO	INT32	kW	10 00	3823 3	2	-	√	
49	[Energy storage unit 1] [Battery pack1]Voltag e	RO	UINT1 6	V	10	3823 5	1	-	√	
50	[Energy storage unit 1] [Battery pack1]Curre nt	RO	INT16	A	10	3823 6	1	-	√	
51	[Energy storage unit 1] [Battery pack1]Total charge	RO	UINT3 2	kW h	10	3823 8	2	-	√	
52	[Energy storage unit 1] [Battery pack1]Total discharge	RO	UINT3 2	kW h	10	3824 0	2	-	√	
53	[Energy storage unit 1] [Battery pack2]SN	RO	STRIN G	N/ A	N/ A	3824 2	10	-	√	
54	[Energy storage unit 1] [Battery pack2]Firmw are version	RO	STRIN G	N/ A	N/ A	3825 2	15	-	√	
55	[Energy storage unit 1] [Battery pack2]Worki ng status	RO	UINT1 6	N/ A	N/ A	3827 0	1	-	√	

No.	Signal Name	Re ad / Wr ite	Туре	Un it	Ga in	Addr ess	Qua ntity	Scope	HUA WEI- LUNA 2000	LG- RESU
56	[Energy storage unit 1] [Battery pack2]SOC	RO	UINT1 6	%	10	3827 1	1	-	√	
57	[Energy storage unit 1] [Battery pack2]Charg e/Discharge power	RO	INT32	kW	10 00	3827 5	2	-	√	
58	[Energy storage unit 1] [Battery pack2]Voltag e	RO	UINT1 6	V	10	3827 7	1	-	√	
59	[Energy storage unit 1] [Battery pack2]Curre nt	RO	INT16	A	10	3827 8	1	-	√	
60	[Energy storage unit 1] [Battery pack2]Total charge	RO	UINT3 2	kW h	10	3828 0	2	-	√	
61	[Energy storage unit 1] [Battery pack2]Total discharge	RO	UINT3 2	kW h	10 0	3828 2	2	-	√	
62	[Energy storage unit 1] [Battery pack3]SN	RO	STRIN G	N/ A	N/ A	3828 4	10	-	√	
63	[Energy storage unit 1] [Battery pack3]Firmw are version	RO	STRIN G	N/ A	N/ A	3829 4	15	-	√	

No.	Signal Name	Re ad / Wr ite	Туре	Un it	Ga in	Addr ess	Qua ntity	Scope	HUA WEI- LUNA 2000	LG- RESU
64	[Energy storage unit 1] [Battery pack3]Worki ng status	RO	UINT1 6	N/ A	N/ A	3831	1	-	√	
65	[Energy storage unit 1] [Battery pack3]SOC	RO	UINT1 6	%	10	3831 3	1	-	√	
66	[Energy storage unit 1] [Battery pack3]Charg e/Discharge power	RO	INT32	kW	10 00	3831 7	2	-	√	
67	[Energy storage unit 1] [Battery pack3]Voltag e	RO	UINT1 6	V	10	3831 9	1	-	√	
68	[Energy storage unit 1] [Battery pack3]Curre nt	RO	INT16	A	10	3832 0	1	-	√	
69	[Energy storage unit 1] [Battery pack3]Total charge	RO	UINT3 2	kW h	10	3832 2	2	-	√	
70	[Energy storage unit 1] [Battery pack3]Total discharge	RO	UINT3 2	kW h	10 0	3832 4	2	-	√	
71	[Energy storage unit 2] [Battery pack1]SN	RO	STRIN G	N/ A	N/ A	3832 6	10	-	√	

No.	Signal Name	Re ad / Wr ite	Туре	Un it	Ga in	Addr ess	Qua ntity	Scope	HUA WEI- LUNA 2000	LG- RESU
72	[Energy storage unit 2] [Battery pack1]Firmw are version	RO	STRIN G	N/ A	N/ A	3833 6	15	-	√	
73	[Energy storage unit 2] [Battery pack1]Worki ng status	RO	UINT1 6	N/ A	N/ A	3835 4	1	-	√	
74	[Energy storage unit 2] [Battery pack1]SOC	RO	UINT1 6	%	10	3835 5	1	-	√	
75	[Energy storage unit 2] [Battery pack1]Charg e/Discharge power	RO	INT32	kW	10 00	3835 9	2	-	√	
76	[Energy storage unit 2] [Battery pack1]Voltag e	RO	UINT1 6	V	10	3836 1	1	-	√	
77	[Energy storage unit 2] [Battery pack1]Curre nt	RO	INT16	А	10	3836 2	1	-	√	
78	[Energy storage unit 2] [Battery pack1]Total charge	RO	UINT3 2	kW h	10 0	3836 4	2	-	√	
79	[Energy storage unit 2] [Battery pack1]Total discharge	RO	UINT3 2	kW h	10 0	3836 6	2	-	√	

No.	Signal Name	Re ad / Wr ite	Туре	Un it	Ga in	Addr ess	Qua ntity	Scope	HUA WEI- LUNA 2000	LG- RESU
80	[Energy storage unit 2] [Battery pack2]SN	RO	STRIN G	N/ A	N/ A	3836 8	10	1	√	
81	[Energy storage unit 2] [Battery pack2]Firmw are version	RO	STRIN G	N/ A	N/ A	3837 8	15	-	√	
82	[Energy storage unit 2] [Battery pack2]Worki ng status	RO	UINT1 6	N/ A	N/ A	3839 6	1	-	√	
83	[Energy storage unit 2] [Battery pack2]SOC	RO	UINT1 6	%	10	3839 7	1	-	√	
84	[Energy storage unit 2] [Battery pack2]Charg e/Discharge power	RO	INT32	kW	10 00	3840 1	2	-	√	
85	[Energy storage unit 2] [Battery pack2]Voltag e	RO	UINT1 6	V	10	3840 3	1	-	√	
86	[Energy storage unit 2] [Battery pack2]Curre nt	RO	INT16	Α	10	3840 4	1	-	√	
87	[Energy storage unit 2] [Battery pack2]Total charge	RO	UINT3 2	kW h	10 0	3840 6	2	-	√	

No.	Signal Name	Re ad / Wr ite	Туре	Un it	Ga in	Addr ess	Qua ntity	Scope	HUA WEI- LUNA 2000	LG- RESU
88	[Energy storage unit 2] [Battery pack2]Total discharge	RO	UINT3 2	kW h	10	3840 8	2	-	√	
89	[Energy storage unit 2] [Battery pack3]SN	RO	STRIN G	N/ A	N/ A	3841 0	10	-	√	
90	[Energy storage unit 2] [Battery pack3]Firmw are version	RO	STRIN G	N/ A	N/ A	3842 0	15	-	√	
91	[Energy storage unit 2] [Battery pack3]Worki ng status	RO	UINT1 6	N/ A	N/ A	3843 8	1	-	√	
92	[Energy storage unit 2] [Battery pack3]SOC	RO	UINT1 6	%	10	3843 9	1	-	√	
93	[Energy storage unit 2] [Battery pack3]Charg e/Discharge power	RO	INT32	kW	10 00	3844	2	-	√	
94	[Energy storage unit 2] [Battery pack3]Voltag e	RO	UINT1 6	V	10	3844 5	1	-	√	
95	[Energy storage unit 2] [Battery pack3]Curre nt	RO	INT16	A	10	3844 6	1	-	√	

No.	Signal Name	Re ad / Wr ite	Туре	Un it	Ga in	Addr ess	Qua ntity	Scope	HUA WEI- LUNA 2000	LG- RESU
96	[Energy storage unit 2] [Battery pack3]Total charge	RO	UINT3 2	kW h	10 0	3844 8	2	-	√	
97	[Energy storage unit 2] [Battery pack3]Total discharge	RO	UINT3 2	kW h	10	3845 0	2	-	√	
98	[Energy storage unit 1] [Battery pack1]Maxi mum temperature	RO	INT16	${\mathbb C}$	10	3845 2	1	-	√	
99	[Energy storage unit 1] [Battery pack1]Minim um temperature	RO	INT16	\mathbb{C}	10	3845 3	1	-	√	
100	[Energy storage unit 1] [Battery pack2]Maxi mum temperature	RO	INT16	${\mathbb C}$	10	3845 4	1	-	√	
101	[Energy storage unit 1] [Battery pack2]Minim um temperature	RO	INT16	\mathbb{C}	10	3845 5	1	-	√	
102	[Energy storage unit 1] [Battery pack3]Maxi mum temperature	RO	INT16	\mathbb{C}	10	3845 6	1	-	✓	

No.	Signal Name	Re ad / Wr ite	Туре	Un it	Ga in	Addr ess	Qua ntity	Scope	HUA WEI- LUNA 2000	LG- RESU
103	[Energy storage unit 1] [Battery pack3]Minim um temperature	RO	INT16	C	10	3845 7	1	-	√	
104	[Energy storage unit 2] [Battery pack1]Maxi mum temperature	RO	INT16	င	10	3845 8	1	-	√	
105	[Energy storage unit 2] [Battery pack1]Minim um temperature	RO	INT16	${\mathbb C}$	10	3845 9	1	-	√	
106	[Energy storage unit 2] [Battery pack2]Maxi mum temperature	RO	INT16	C	10	3846 0	1	-	√	
107	[Energy storage unit 2] [Battery pack2]Minim um temperature	RO	INT16	င	10	3846 1	1	-	√	
108	[Energy storage unit 2] [Battery pack3]Maxi mum temperature	RO	INT16	${\mathbb C}$	10	3846 2	1	-	√	
109	[Energy storage unit 2] [Battery pack3]Minim um temperature	RO	INT16	${\mathbb C}$	10	3846 3	1	-	√	

No.	Signal Name	Re ad / Wr ite	Туре	Un it	Ga in	Addr ess	Qua ntity	Scope	HUA WEI- LUNA 2000	LG- RESU
110	[Energy storage unit 1] Product mode	R W	UINT1 6	N/ A	1	4700 0	1	0: None 1: LG-RESU 2: HUAWEI- LUNA2000	√	√
111	[Energy storage] Time-of-use electricity price periods	R W	MULTI DATA	N/ A	1	4702 8	41	For details, see 5.4		√
112	[Energy storage]Maxi mum charging power	R W	UINT3 2	W	1	4707 5	2	[0, Upper threshold] Default value: 3500;	√	√
113	[Energy storage]Maxi mum discharging power	R W	UINT3 2	W	1	4707 7	2	[0, Upper threshold] Default value: 3500;	√	√
114	[Energy storage]Char ging cutoff capacity	R W	UINT1 6	%	10	4708 1	1	[90,100] Default value: 100	√	(√)
115	[Energy storage] Discharge cutoff capacity	R W	UINT1 6	%	10	4708 2	1	[12,20] Default value: 15	√	(√)
116	[Energy storage]Forc ed charging and discharging period	R W	UINT1 6	mi ns	1	4708 3	1	[0,1440] The value is not stored.	√	(√)

No.	Signal Name	Re ad / Wr ite	Туре	Un it	Ga in	Addr ess	Qua ntity	Scope	HUA WEI- LUNA 2000	LG- RESU
117	[Energy storage]Wor king mode settings	R W	UINT1 6	N/ A	1	4708 6	1	0:Adaptive(Fixe d charge/ discharge/ Maximise self consumption); 1:Fixed charge/ discharge; 2:Maximise self consumption; 3:Time Of Use(LG); 4:Fully fed to grid; 5:Time Of Use(Luna)	→	(√)
118	[Energy storage] Charge from grid Function	R W	UINT1 6	N/ A	1	4708 7	1	0: Disable 1: Enable	√	(√)
119	[Energy storage] Grid charge cutoff SOC	R W	UINT1 6	%	10	4708 8	1	[30,70] Default: 50	√	(√)
120	[Energy storage unit 2] Product model	R W	UINT1 6	N/ A	1	4708 9	1	0: none 1: LG-RESU 2: HUAWEI- LUNA2000	√	
121	[Energy storage] Forcible charge/ discharge	W O	UINT1 6	N/ A	1	4710 0	1	0: Stop 1: Charge 2: Discharge	√	√

No.	Signal Name	Re ad / Wr ite	Туре	Un it	Ga in	Addr ess	Qua ntity	Scope	HUA WEI- LUNA 2000	LG- RESU
122	[Energy storage] Backup power SOC	R W	UINT1 6	%	10	4710 2	1	Definition: Reseved energy storage capacity in backup mode Setting range: [0,100] Execution range: LG: [12,100], Default value: 15 Luna: [0,100], Default value: 0	√	✓
123	[Energy storage unit 1] No.	R W	UINT1 6	N/ A	1	4710 7	1	[0,65534] Default: 0. Which means no equipment.	√	
124	[Energy storage unit 2] No.	R W	UINT1 6	N/ A	1	4710 8	1	[0,65534] Default: 0. Which means no equipment.	√	
125	[Energy storage] Fixed charging and discharging periods	R W	MULTI DATA	N/ A	1	4720 0	41	For details, see 5.4		√
126	[Energy storage] Power of charge from grid	R W	UINT3 2	kW	10 00	4724 2	2	[0, maximum power of charge from grid]	√	√
127	[Energy storage]Maxi mum power of charge from grid	R W	UINT3 2	kW	10 00	4724 4	2	Default:2000	√	√

No.	Signal Name	Re ad / Wr ite	Туре	Un it	Ga in	Addr ess	Qua ntity	Scope	HUA WEI- LUNA 2000	LG- RESU
128	[Energy storage]Forci ble charge/ discharge setting mode	R W	UINT1 6	N/ A	1	4724 6	1	0: Duration	√	√
129	[Energy storage] Forcible charge power	R W	UINT3 2	kW	10 00	4724 7	2	[0,maximum charge power]	√	√
130	[Energy storage] Forcible discharge power	R W	UINT3 2	kW	10 00	4724 9	2	[0,maximum discharge power]	√	√
131	[Energy storage]Time of Use charging and discharging periods	R W	Bytes	N/ A	1	4725 5	43	For details, see 5.4	√	
132	[Energy storage] Excess PV energy use in TOU	R W	UINT1 6	N/ A	1	4729 9	1	0: Fed to grid 1: Charge Note: Bound with the grid code. Japan: Fed to grid Other countries: Charge	√	
133	[Dongle] [Plant]maxi mum charge-from- grid power	R W	UINT3 2	Kw	10 00	4759 0	2	[0,30]	√	√
134	[Backup]Swit ch to off- grid	R W	UINT1 6	N/ A	1	4760 4	1	0: Switch from grid-tied to off-grid	√	√

No.	Signal Name	Re ad / Wr ite	Туре	Un it	Ga in	Addr ess	Qua ntity	Scope	HUA WEI- LUNA 2000	LG- RESU
135	[Backup] Voltage in independent operation	R W	UINT1 6	V	1	4760 5	1	0: 101V 1: 202V	√	√
136	[Energy storage unit 1] [Battery pack1]No.	R W	UINT1 6	N/ A	N/ A	4775 0	1	[0,65534] Default: 0. Which means no equipment.	√	
137	[Energy storage unit 1] [Battery pack2]No.	R W	UINT1 6	N/ A	N/ A	4775 1	1	[0,65534] Default: 0. Which means no equipment.	√	
138	[Energy storage unit 1] [Battery pack3]No.	R W	UINT1 6	N/ A	N/ A	4775 2	1	[0,65534] Default: 0. Which means no equipment.	√	
139	[Energy storage unit 2] [Battery pack1]No.	R W	UINT1 6	N/ A	N/ A	4775 3	1	[0,65534] Default: 0. Which means no equipment.	√	
140	[Energy storage unit 2] [Battery pack2]No.	R W	UINT1 6	N/ A	N/ A	4775 4	1	[0,65534] Default: 0. Which means no equipment.	√	
141	[Energy storage unit 2] [Battery pack3]No.	R W	UINT1 6	N/ A	N/ A	4775 5	1	[0,65534] Default: 0. Which means no equipment.	√	

[1]Two sets of energy storage devices at most can be connected to one inverter. If the inverter is connected to only one set of energy storage devices, the energy storage unit(ESU) corresponds to [Energy storage unit 1]. If two ESUs are connected, the second ESU corresponds to [Energy storage unit 2]. Currently, only one set of LG-RESU can be connected, and two sets of HUAWEI-LUNA2000 can be connected.

[2] ($\sqrt{}$) indicates that the register is used by LG energy storage devices in the old inverter but is no longer used in the new version.

3.3 Meter Equipment Register

Table 3-3 Meter Register Defination List

No.	Signal Name	Read/ Write	Туре	Unit	Gain	Address	Quantit y	Scope
1	Meter status	RO	UINT16	N/A	1	37100	1	0: offline 1: normal
2	Grid voltage (A phase)	RO	INT32	V	10	37101	2	
3	B phase voltage	RO	INT32	V	10	37103	2	
4	C phase voltage	RO	INT32	V	10	37105	2	
5	Grid current(A phase)	RO	INT32	А	100	37107	2	
6	B phase current	RO	INT32	А	100	37109	2	
7	C phase current	RO	INT32	А	100	37111	2	
8	Active power	RO	INT32	W	1	37113	2	>0: feed-in to the power grid. <0: supply from the power grid.
9	Reactive power	RO	INT32	Var	1	37115	2	
10	Power factor	RO	INT16	NA	1000	37117	1	
11	Grid frequency	RO	INT16	Hz	100	37118	1	

No.	Signal Name	Read/ Write	Туре	Unit	Gain	Address	Quantit y	Scope
12	Positive active electricity	RO	INT32	kWh	100	37119	2	Electricity fed by the inverter to the power grid.
13	Reverse active power	RO	INT32	kWh	100	37121	2	Power supplied to a distributed system from the power grid.
14	Accumulated reactive power	RO	INT32	kVar h	100	37123	2	
15	Meter type	RO	UINT16	N/A	1	37125	1	0: single-phase. 1: three-phase.
16	A-B line voltage	RO	INT32	V	10	37126	2	
17	B-C line voltage	RO	INT32	V	10	37128	2	
18	CA line voltage	RO	INT32	V	10	37130	2	
19	A phase active power	RO	INT32	W	1	37132	2	> 0: feed-in to the power grid. <0: supply from the power grid
20	B phase active power	RO	INT32	W	1	37134	2	> 0: feed-in to the power grid. <0: supply from the power grid
21	C phase active power	RO	INT32	W	1	37136	2	> 0: feed-in to the power grid. <0: supply from the power grid

No.	Signal Name	Read/ Write	Туре	Unit	Gain	Address	Quantit y	Scope
22	Meter model detection result	RO	UINT16	N/A	1	37138	1	0: being identified 1: The selected model is the same as the actual model of the connected meter. 2: The selected model is different from the actual model of the connected meter.

4 Customized Interfaces

4.1 Obtaining the System Information of Optimizers

Data synchronization mechanism: The host is driven to refresh the system information of optimizers by the change of the serial number (SN).

Synchronization process: For details, see **6.3.7.1 Uploading Files**.

Data storage of the solar inverters: After the device search and positioning are complete, the record is updated. The record format is as follows:

File type: 0x45

Table 4-1 File format(V102)

Data	Length (Bytes)	Remarks
File version	4	V102
Feature data sequence number	2	
Length	2	
Reserved	1	The reserved byte 0 is defined as the status. bit0: inverter disconnection status (1=disconnected)
	3	
Number of optimizers	2	Total number, including the offline optimizers.
Feature data of optimizer 1	108	For details about the data domain definition, see the Optimizer Feature Data Domain Definition.
Feature data of optimizer 2	108	

Data	Length (Bytes)	Remarks
Feature data of optimizer	108	
Feature data of optimizer N	108	

Table 4-2 Feature data unit format(V102)

Data	Length (Bytes)	Remarks
Optimizer address	2	RS485 address
Online status	2	0: offline
		1: online
		2: disconnected
String number	2	
Position in current string	2	relative positive connection starting point
SN	20	
Software version	30	
Alias	20	
Model	30	

Table 4-3 Record format(V101)

Data	Length (Byte)	Remarks
Format version	4	V101
SN	2	-
Length	2	-
Reserved	4	-
Number of optimizers	2	n, including the offline optimizers
Feature data of optimizer 1	78	-
Feature data of optimizer 2	78	-
		-
Feature data of optimizer <i>n</i>	78	-

Table 4-4 Feature data format (V101)

Data	Length (Byte)	Remarks
Optimizer address	2	Logical communication address
Status	2	0: offline 1: online
String number	2	-
Relative position of the PV string	2	1: near DC wiring terminals of the solar inverters
SN	20	-
Software version	30	-
Alias	20	-

4.2 Obtaining Real-time Data of Optimizers

Data synchronization mechanism: five-minute interval

Synchronization process: uploads the files and synchronizes data according to the time period; uploads the most recent data if there is no filter condition. For details, see **6.3.7.1 Uploading Files**.

Data storage: stores real-time data at five-minute intervals.

File type: 0x44

Table 4-5 Record format

Data	Length (Byte)	Remarks
File version	4	V101
Reserved	8	-
Optimizer data unit 1	N	12 + 26 x Number of optimizers , For details about the definition of this unit, see the data unit format.
Optimizer data unit 2	N	-
	-	-
Optimizer data unit <i>n</i>	N	n indicates the number of data records that meet the filter condition. Each piece of data contains all optimizer data for a time node.

Table 4-6 Data unit format (V101)

Data	Length (Byte)	Remarks
Time	4	Epoch seconds, local time
Reserved	4	-
Length	2	-
Number of optimizers	2	-
Real-time data of optimizer 1	26	For details about the definition of this unit, see the real-time data format.
Real-time data of optimizer 2	26	-
	-	-
Real-time data of optimizer <i>n</i>	26	<i>n</i> is the number of optimizers.

Table 4-7 Real-time data format

Data	Length (Byte)	Remarks
Optimizer address	2	Logical communication address
Output power	2	Gain: 10 Unit: W
Voltage to ground	2	Gain: 10 Unit: V

Data	Length (Byte)	Remarks
Alarm	4	Bit00: input overvoltage
		Bit01: input undervoltage
		Bit02: output overvoltage
		Bit04: overtemperature
		Bit06: output short circuit
		Bit07: EEPROM fault
		Bit08: internal hardware fault
		Bit09: abnormal voltage to ground
		Bit 10: power-off due to heartbeat timeout
		Bit 11: fast shutdown
		Bit 12: request escape alarm
		Bit 13: version mismatch alarm
		Bit 16: input overvoltage
		Bit 17: overtemperature
		Bit 18: output short circuit
		Bit 19: internal hardware fault
		Bit 20: version mismatch alarm
		Bit 21: backfeed alarm
		Bit 22: abnormal output voltage
		Bit 23: upgrade failure
		Bit 31: alarm display selection, 1=Display bit 16 to bit 30 alarms, 0: Bits 0 to 15 are displayed.
Output voltage	2	Gain: 10
		Unit: V
Output current	2	Gain: 100
		Unit: A
Input voltage	2	Gain: 10
		Unit: V
Input current	2	Gain: 100
		Unit: A
Temperature	2	Gain: 10
		Unit: °C

Data	Length (Byte)	Remarks
Running status	2	0: offline 1: standby 3: faulty 4: running 12: power-off
Accumulated energy yield	4	Gain: 1000 Unit: kWh

5 Interface Instructions

- **5.1 Alarm Information**
- **5.2 Power Grid Scheduling**
- **5.3 Grid Codes**
- **5.4 Energy Storage Specifications**

5.1 Alarm Information

Table 5-1 Alarm information

No.	Alarm	Bit	Alarm Name	Alarm ID	Level
1	Alarm 1	0	High String Input Voltage	2001	Major
2	Alarm 1	1	DC Arc Fault ^[1]	2002	Major
3	Alarm 1	2	String Reverse Connection	2011	Major
4	Alarm 1	3	String Current Backfeed	2012	Warning
5	Alarm 1	4	Abnormal String Power	2013	Warning
6	Alarm 1	5	AFCI Self-Check Fail. ^[1]	2021	Major
7	Alarm 1	6	Phase Wire Short-Circuited to PE	2031	Major
8	Alarm 1	7	Grid Loss	2032	Major

No.	Alarm	Bit	Alarm Name	Alarm ID	Level
9	Alarm 1	8	Grid Undervoltage	2033	Major
10	Alarm 1	9	Grid Overvoltage	2034	Major
11	Alarm 1	10	Grid Volt. Imbalance	2035	Major
12	Alarm 1	11	Grid Overfrequency	2036	Major
13	Alarm 1	12	Grid Underfrequency	2037	Major
14	Alarm 1	13	Unstable Grid Frequency	2038	Major
15	Alarm 1	14	Output Overcurrent	2039	Major
16	Alarm 1	15	Output DC Component Overhigh	2040	Major
17	Alarm 2	0	Abnormal Residual Current	2051	Major
18	Alarm 2	1	Abnormal Grounding	2061	Major
19	Alarm 2	2	Low Insulation Resistance	2062	Major
20	Alarm 2	3	Overtemperature	2063	Minor
21	Alarm 2	4	Device Fault	2064	Major
22	Alarm 2	5	Upgrade Failed or Version Mismatch	2065	Minor
23	Alarm 2	6	License Expired	2066	Warning
24	Alarm 2	7	Faulty Monitoring Unit	61440	Minor
25	Alarm 2	8	Faulty Power Collector ^[2]	2067	Major
26	Alarm 2	9	Battery abnormal	2068	Minor
27	Alarm 2	10	Active Islanding	2070	Major

No.	Alarm	Bit	Alarm Name	Alarm ID	Level
28	Alarm 2	11	Passive Islanding	2071	Major
29	Alarm 2	12	Transient AC Overvoltage	2072	Major
30	Alarm 2	13	Peripheral port short circuit ^[3]	2075	Warning
31	Alarm 2	14	Churn output overload ^[4]	2077	Major
32	Alarm 2	15	Abnormal PV module configuration	2080	Major
33	Alarm 3	0	Optimizer fault ^[5]	2081	Warning
34	Alarm 3	1	Built-in PID operation abnormal ^[6]	2085	Minor
35	Alarm 3	2	High input string voltage to ground.	2014	Major
36	Alarm 3	3	External Fan Abnormal	2086	Major
37	Alarm 3	4	Battery Reverse Connection ^[7]	2069	Major
38	Alarm 3	5	On-grid/Off-grid controller abnormal ^[4]	2082	Major
39	Alarm 3	6	PV String Loss	2015	Warning
40	Alarm 3	7	Internal Fan Abnormal	2087	Major
41	Alarm 3	8	DC Protection Unit Abnormal ^[8]	2088	Major
42	Alarm 3	9	EL Unit Abnormal	2089	Minor
43	Alarm 3	10	Active Adjustment Instruction Abnormal	2090	Major
44	Alarm 3	11	Reactive Adjustment Instruction Abnormal	2091	Major
45	Alarm 3	12	CT Wiring Abnormal	2092	Major
46	Alarm 3	13	DC Arc Fault(ADMC Alarm to be clear manually)	2003	Major

The preceding table lists the alarm information about Huawei solar inverters. Some alarms can be detected only after corresponding functional modules are configured.

∩ NOTE

- [1] AFCI functional unit
- [2] Power collector or power meter connected to the solar inverters
- [3] Detection of the external ports of the solar inverters that provide the 12 V power supply
- [4] This item can be detected when a built-in or external on-grid/off-grid functional unit is configured.
- [5] This item can be detected when optimizers are configured on the DC side.
- [6] This item can be detected when the solar inverters are configured with PID functional units.
- [7] This item can be detected when energy storage units (ESUs) are configured.
- [8] Some models have DC protection units.

5.2 Power Grid Scheduling

This section describes the curve configuration format and precautions for power grid scheduling by curve.

5.2.1 cosφ-P/Pn Characteristic Curve

Table 5-2 $\cos\phi$ -P/P_n characteristic curve definition

Description	Data Type	Gain	Unit	Value Range
Number of points	U16	1	N/A	[2, 10]
P/P _n value at point 1	U16	10	%	[0, 100]
cosф value at point 1	I16	1000	N/A	(-1, -0.8]U[0.8, 1]
P/P _n value at point 2	U16	10	%	[0, 100]
cosф value at point 2	I16	1000	N/A	(-1, -0.8]U[0.8, 1]
P/P _n value at point 3	U16	10	%	[0, 100]
cosф value at point 3	I16	1000	N/A	(-1, -0.8]U[0.8, 1]
P/P _n value at point 4	U16	10	%	[0, 100]
cosф value at point 4	I16	1000	N/A	(-1, -0.8]U[0.8, 1]
P/P _n value at point 5	U16	10	%	[0, 100]

Description	Data Type	Gain	Unit	Value Range
cosφ value at point 5	I16	1000	N/A	(-1, -0.8]U[0.8, 1]
P/P _n value at point 6	U16	10	%	[0, 100]
cosф value at point 6	I16	1000	N/A	(-1, -0.8]U[0.8, 1]
P/P _n value at point 7	U16	10	%	[0,100]
cosф value at point 7	I16	1000	N/A	(-1,-0.8]U[0.8,1]
P/P _n value at point 8	U16	10	%	[0, 100]
cosф value at point 8	I16	1000	N/A	(-1, -0.8]U[0.8, 1]
P/P _n value at point 9	U16	10	%	[0, 100]
cosф value at point 9	I16	1000	N/A	(-1, -0.8]U[0.8, 1]
P/P _n value at point 10	U16	10	%	[0, 100]
cosф value at point 10	I16	1000	N/A	(-1, -0.8]U[0.8, 1]

5.2.2 Q-U Characteristic Curve

Table2 Q-U Characteristic Curve definition

Description	Data Type	Gain	Unit	Value Range
Number of points	U16	1	N/A	[2, 10]
U/U _n value at point 1	U16	10	%	[80, 136]
Q/S value at point 1	I16	1000	N/A	[-0.6, 0.6]
U/U _n value at point 2	U16	10	%	[80, 136]
Q/S value at point 2	I16	1000	N/A	[-0.6, 0.6]
U/U _n value at point 3	U16	10	%	[80, 136]
Q/S value at point 3	I16	1000	N/A	[-0.6, 0.6]
U/U _n value at point 4	U16	10	%	[80, 136]
Q/S value at point 4	I16	1000	N/A	[-0.6, 0.6]
U/U _n value at point 5	U16	10	%	[80, 136]
Q/S value at point 5	I16	1000	N/A	[-0.6, 0.6]
U/U _n value at point 6	U16	10	%	[80, 136]

Description	Data Type	Gain	Unit	Value Range
Q/S value at point 6	116	1000	N/A	[-0.6, 0.6]
U/U _n value at point 7	U16	10	%	[80, 136]
Q/S value at point 7	I16	1000	N/A	[-0.6, 0.6]
U/U _n value at point 8	U16	10	%	[80, 136]
Q/S value at point 8	I16	1000	N/A	[-0.6, 0.6]
U/U _n value at point 9	U16	10	%	[80, 136]
Q/S value at point 9	I16	1000	N/A	[-0.6, 0.6]
U/U _n value at point 10	U16	10	%	[80, 136]
Q/S value at point 10	I16	1000	N/A	[-0.6, 0.6]

In Italian standards, this curve may be used together with the **Q-U characteristic** curve mode, **Q-U dispatch trigger power (%)**, and **Q-U power percentage to exit scheduling** parameters.

5.2.3 PF-U Characteristic Curve

Table3 PF-U Characteristic Curve definition

Description	Data Type	Gain	Unit	Value Range
Number of points	U16	1	N/A	[2, 10]
U/U _n value at point 1	U16	10	%	[80, 136]
PF value at point 1	116	1000	N/A	(-1, -0.8]U[0.8, 1]
U/U _n value at point 2	U16	10	%	[80, 136]
PF value at point 2	I16	1000	N/A	(-1, -0.8]U[0.8, 1]
U/U _n value at point 3	U16	10	%	[80, 136]
PF value at point 3	I16	1000	N/A	(-1, -0.8]U[0.8, 1]
U/U _n value at point 4	U16	10	%	[80, 136]
PF value at point 4	I16	1000	N/A	(-1, -0.8]U[0.8, 1]
U/U _n value at point 5	U16	10	%	[80, 136]
PF value at point 5	I16	1000	N/A	(-1, -0.8]U[0.8, 1]

Description	Data Type	Gain	Unit	Value Range
U/U _n value at point 6	U16	10	%	[80, 136]
PF value at point 6	I16	1000	N/A	(-1, -0.8]U[0.8, 1]
U/U _n value at point 7	U16	10	%	[80, 136]
PF value at point 7	I16	1000	N/A	(-1, -0.8]U[0.8, 1]
U/U _n value at point 8	U16	10	%	[80, 136]
PF value at point 8	I16	1000	N/A	(-1, -0.8]U[0.8, 1]
U/U _n value at point 9	U16	10	%	[80, 136]
PF value at point 9	I16	1000	N/A	(-1, -0.8]U[0.8, 1]
U/U _n value at point 10	U16	10	%	[80, 136]
PF value at point 10	I16	1000	N/A	(-1, -0.8]U[0.8, 1]

5.3 Grid Codes

Table 5-3 List of grid codes

No.	Standard	Applicable Country or Region
0	VDE-AR-N-4105	Germany
1	NB/T 32004	China
2	UTE C 15-712-1(A)	France
3	UTE C 15-712-1(B)	France
4	UTE C 15-712-1(C)	France
5	VDE 0126-1-1-BU	Bulgaria
6	VDE 0126-1-1-GR(A)	Greece
7	VDE 0126-1-1-GR(B)	Greece
8	BDEW-MV	Germany
9	G59-England	UK
10	G59-Scotland	UK
11	G83-England	UK
12	G83-Scotland	UK
13	CEI0-21	Italy

No.	Standard	Applicable Country or Region
14	EN50438-CZ	Czech Republic
15	RD1699/661	Spain
16	RD1699/661-MV480	Spain
17	EN50438-NL	Netherlands
18	C10/11	Belgium
19	AS4777	Australia
20	IEC61727	General
21	Custom (50 Hz)	Custom
22	Custom (60 Hz)	Custom
23	CEI0-16	Italy
24	CHINA-MV480	China
25	CHINA-MV	China
26	TAI-PEA	Thailand
27	TAI-MEA	Thailand
28	BDEW-MV480	Germany
29	Custom MV480 (50 Hz)	Custom
30	Custom MV480 (60 Hz)	Custom
31	G59-England-MV480	UK
32	IEC61727-MV480	General
33	UTE C 15-712-1-MV480	France
34	TAI-PEA-MV480	Thailand
35	TAI-MEA-MV480	Thailand
36	EN50438-DK-MV480	Denmark
37	Japan standard (50 Hz)	Japan
38	Japan standard (60 Hz)	Japan
39	EN50438-TR-MV480	Turkey
40	EN50438-TR	Turkey
41	C11/C10-MV480	Belgium
42	Philippines	Philippines

No.	Standard	Applicable Country or Region
43	Philippines-MV480	Philippines
44	AS4777-MV480	Australia
45	NRS-097-2-1	South Africa
46	NRS-097-2-1-MV480	South Africa
47	KOREA	South Korea
48	IEEE 1547-MV480	USA
49	IEC61727-60Hz	General
50	IEC61727-60Hz-MV480	General
51	CHINA_MV500	China
52	ANRE	Romania
53	ANRE-MV480	Romania
54	ELECTRIC RULE NO.21- MV480	California, USA
55	HECO-MV480	Hawaii, USA
56	PRC_024_Eastern-MV480	Eastern USA
57	PRC_024_Western- MV480	Western USA
58	PRC_024_Quebec-MV480	Quebec, Canada
59	PRC_024_ERCOT-MV480	Texas, USA
60	PO12.3-MV480	Spain
61	EN50438_IE-MV480	Ireland
62	EN50438_IE	Ireland
63	IEEE 1547a-MV480	USA
64	Japan standard (MV420-50 Hz)	Japan
65	Japan standard (MV420-60 Hz)	Japan
66	Japan standard (MV440-50 Hz)	Japan
67	Japan standard (MV440-60 Hz)	Japan
68	IEC61727-50Hz-MV500	General

No.	Standard	Applicable Country or Region
70	CEI0-16-MV480	Italy
71	PO12.3	Spain
72	Japan standard (MV400-50 Hz)	Japan
73	Japan standard (MV400-60 Hz)	Japan
74	CEI0-21-MV480	Italy
75	KOREA-MV480	South Korea
76	Egypt ETEC	Egypt
77	Egypt ETEC-MV480	Egypt
78	CHINA_MV800	China
79	IEEE 1547-MV600	USA
80	ELECTRIC RULE NO.21- MV600	California, USA
81	HECO-MV600	Hawaii, USA
82	PRC_024_Eastern-MV600	Eastern USA
83	PRC_024_Western- MV600	Western USA
84	PRC_024_Quebec-MV600	Quebec, Canada
85	PRC_024_ERCOT-MV600	Texas, USA
86	IEEE 1547a-MV600	USA
87	EN50549-LV	Ireland
88	EN50549-MV480	Ireland
89	Jordan-Transmission	Jordan
90	Jordan-Transmission- MV480	Jordan
91	NAMIBIA	Namibia
92	ABNT NBR 16149	Brazil
93	ABNT NBR 16149- MV480	Brazil
94	SA_RPPs	South Africa
95	SA_RPPs-MV480	South Africa

No.	Standard	Applicable Country or Region	
96	INDIA	India	
97	INDIA-MV500	India	
98	ZAMBIA	Zambia	
99	ZAMBIA-MV480	Zambia	
100	Chile	Chile	
101	Chile-MV480	Chile	
102	CHINA-MV500-STD	China	
103	CHINA-MV480-STD	China	
104	Mexico-MV480	Mexico	
105	Malaysian	Malaysia	
106	Malaysian-MV480	Malaysia	
107	KENYA_ETHIOPIA	East Africa	
108	KENYA_ETHIOPIA- MV480	East Africa	
109	G59-England-MV800	UK	
110	NIGERIA	Nigeria	
111	NIGERIA-MV480	Nigeria	
112	DUBAI	Dubai	
113	DUBAI-MV480	Dubai	
114	Northern Ireland	Northern Ireland	
115	Northern Ireland-MV480 Northern Ireland		
116	Cameroon Cameroon		
117	Cameroon-MV480 Cameroon		
118	Jordan-Distribution	Jordan	
119	Jordan-Distribution- MV480	Jordan	
120	Custom MV600-50 Hz	Custom	
121	AS4777-MV800	Australia	
122	INDIA-MV800	India	
123	IEC61727-MV800	General	

No.	Standard	Applicable Country or Region	
124	BDEW-MV800	Germany	
125	ABNT NBR 16149- MV800	Brazil	
126	UTE C 15-712-1-MV800	France	
127	Chile-MV800	Chile	
128	Mexico-MV800	Mexico	
129	EN50438-TR-MV800	Turkey	
130	TAI-PEA-MV800	Thailand	
131	Philippines-MV800	Philippines	
132	Malaysian-MV800	Malaysia	
133	NRS-097-2-1-MV800	South Africa	
134	SA_RPPs-MV800	South Africa	
135	Jordan-Transmission- MV800	Jordan	
136	Jordan-Distribution- MV800	Jordan	
137	Egypt ETEC-MV800	Egypt	
138	DUBAI-MV800	Dubai	
139	SAUDI-MV800	Saudi Arabia	
140	EN50438_IE-MV800	Ireland	
141	EN50549-MV800	Ireland	
142	Northern Ireland-MV800	Northern Ireland	
143	CEI0-21-MV800	Italy	
144	IEC 61727-MV800-60Hz General		
145	NAMIBIA_MV480	Namibia	
146	Japan (LV202-50 Hz)	Japan	
147	Japan (LV202-60 Hz)	Japan	
148	Pakistan-MV800	Pakistan	
149	BRASIL-ANEEL-MV800	Brazil	
150	Israel-MV800	Israel	
151	CEI0-16-MV800	Italy	

No.	Standard	Applicable Country or Region	
152	ZAMBIA-MV800	Zambia	
153	KENYA_ETHIOPIA- MV800	East Africa	
154	NAMIBIA_MV800	Namibia	
155	Cameroon-MV800	Cameroon	
156	NIGERIA-MV800	Nigeria	
157	ABUDHABI-MV800	Abu Dhabi	
158	LEBANON	Lebanon	
159	LEBANON-MV480	Lebanon	
160	LEBANON-MV800	Lebanon	
161	ARGENTINA-MV800	Argentina	
162	ARGENTINA-MV500	Argentina	
163	Jordan-Transmission-HV	Jordan	
164	Jordan-Transmission- HV480	Jordan	
165	Jordan-Transmission- HV800	Jordan	
166	TUNISIA	Tunisia	
167	TUNISIA-MV480	Tunisia	
168	TUNISIA-MV800	Tunisia	
169	JAMAICA-MV800 Jamaica		
170	AUSTRALIA-NER	Australia	
171	AUSTRALIA-NER-MV480	Australia	
172	AUSTRALIA-NER-MV800	Australia	
173	SAUDI	Saudi Arabia	
174	SAUDI-MV480	Saudi Arabia	
175	Ghana-MV480	Ghana	
176	Israel	Israel	
177	Israel-MV480	Israel	
178	Chile-PMGD	Chile	
179	Chile-PMGD-MV480	Chile	

No.	Standard	Applicable Country or Region	
180	VDE-AR-N4120-HV	Germany	
181	VDE-AR-N4120-HV480	Germany	
182	VDE-AR-N4120-HV800	Germany	
183	IEEE 1547-MV800	USA	
184	Nicaragua-MV800	Nicaragua	
185	IEEE 1547a-MV800	USA	
186	ELECTRIC RULE NO.21- MV800	California, USA	
187	HECO-MV800	Hawaii, USA	
188	PRC_024_Eastern-MV800	Eastern USA	
189	PRC_024_Western- MV800	Western USA	
190	PRC_024_Quebec-MV800	Quebec, Canada	
191	PRC_024_ERCOT-MV800	Texas, USA	
192	Custom-MV800-50Hz	Custom	
193	RD1699/661-MV800	Spain	
194	PO12.3-MV800	Spain	
195	Mexico-MV600	Mexico	
196	Vietnam-MV800	Vietnam	
197	CHINA-LV220/380	China	
198	SVG-LV Dedicated		
199	Vietnam Vietnam		
200	Vietnam-MV480 Vietnam		
201	Chile-PMGD-MV800	Chile	
202	Ghana-MV800	Ghana	
203	TAIPOWER	Taiwan	
204	TAIPOWER-MV480	Taiwan	
205	TAIPOWER-MV800	Taiwan	
206	IEEE 1547-LV208	USA	
207	IEEE 1547-LV240	USA	

No.	Standard	Applicable Country or Region	
208	IEEE 1547a-LV208	USA	
209	IEEE 1547a-LV240	USA	
210	ELECTRIC RULE NO.21- LV208	USA	
211	ELECTRIC RULE NO.21- LV240	USA	
212	HECO-O+M+H-LV208	USA	
213	HECO-O+M+H-LV240	USA	
214	PRC_024_Eastern-LV208	USA	
215	PRC_024_Eastern-LV240	USA	
216	PRC_024_Western-LV208	USA	
217	PRC_024_Western-LV240	USA	
218	PRC_024_ERCOT-LV208	USA	
219	PRC_024_ERCOT-LV240	USA	
220	PRC_024_Quebec-LV208	USA	
221	PRC_024_Quebec-LV240	USA	
222	ARGENTINA-MV480	Argentina	
223	Oman	Oman	
224	Oman-MV480	Oman	
225	Oman-MV800	Oman	
226	Kuwait	Kuwait	
227	Kuwait-MV480	Kuwait	
228	Kuwait-MV800	Kuwait	
229	Bangladesh	Bangladesh	
230	Bangladesh-MV480	Bangladesh	
231	Bangladesh-MV800	Bangladesh	
232	Chile-Net_Billing	Chile	
233	EN50438-NL-MV480	Netherlands	
234	Bahrain	Bahrain	
235	Bahrain-MV480	Bahrain	

No.	Standard	Applicable Country or Region	
236	Bahrain-MV800	Bahrain	
238	Japan-MV550-50Hz	Japan	
239	Japan-MV550-60Hz	Japan	
241	ARGENTINA	Argentina	
242	KAZAKHSTAN-MV800	Kazakhstan	
243	Mauritius	Mauritius	
244	Mauritius-MV480	Mauritius	
245	Mauritius-MV800	Mauritius	
246	Oman-PDO-MV800	Oman	
247	EN50438-SE	Sweden	
248	TAI-MEA-MV800	Thailand	
249	Pakistan	Pakistan	
250	Pakistan-MV480	Pakistan	
251	PORTUGAL-MV800	Portugal	
252	HECO-L+M-LV208	USA	
253	HECO-L+M-LV240	USA	
254	C10/11-MV800	Belgium	
255	Austria	Austria	
256	Austria-MV480 Austria		
257	G98	UK	
258	G99-TYPEA-LV	UK	
259	G99-TYPEB-LV UK		
260	G99-TYPEB-HV	UK	
261	G99-TYPEB-HV-MV480	UK	
262	G99-TYPEB-HV-MV800 UK		
263	G99-TYPEC-HV-MV800 UK		
264	G99-TYPED-MV800	UK	
265	G99-TYPEA-HV	UK	
266	CEA-MV800 India		

No.	Standard	Applicable Country or Region	
267	EN50549-MV400	Europe	
268	VDE-AR-N4110	Germany	
269	VDE-AR-N4110-MV480	Germany	
270	VDE-AR-N4110-MV800	Germany	
271	Panama-MV800	Panama	
272	North Macedonia- MV800	Nprth Macedonia	
273	NTS	Spain	
274	NTS-MV480	Spain	
275	NTS-MV800 Spain		

Set the grid code based on local laws and regulations.

5.4 Energy Storage Specifications

Table 5-4 Format description of parameters for time-of-use electricity price periods(LG-RESU)

Description	Data Type	Gain	Unit	Value Range
Number of periods	U16	1	N/A	[0, 10]
Start time of period 1	U16	1	min	[0, 1440]. The value is the elapsed minutes since 00:00 a.m. The start time should be earlier than the end time.
End time of period 1	U16	1	min	[0, 1440]. The value is the elapsed minutes since 00:00 a.m. The start time should be earlier than the end time.
Electricity price in period 1	U32	1000	N/A	N/A

Description	Data Type	Gain	Unit	Value Range
Start time of period 2	U16	1	min	[0, 1440]. The value is the elapsed minutes since 00:00 a.m. The start time should be earlier than the end time.
End time of period 2	U16	1	min	[0, 1440]. The value is the elapsed minutes since 00:00 a.m. The start time should be earlier than the end time.
Electricity price in period 2	U32	1000	N/A	N/A
Start time of period 10	U16	1	min	[0, 1440]. The value is the elapsed minutes since 00:00 a.m. The start time should be earlier than the end time.
End time of period 10	U16	1	min	[0, 1440]. The value is the elapsed minutes since 00:00 a.m. The start time should be earlier than the end time.
Electricity price in period 10	U32	1000	N/A	N/A

Table 5-5 Format description of parameters for fixed charging and discharging periods

Description	Data Type	Gain	Unit	Value Range
Number of periods	U16	1	N/A	[0, 10]
Start time of period 1	U16	1	min	[0, 1440]. The value is the elapsed minutes since 00:00 a.m. The start time should be earlier than the end time.
End time of period 1	U16	1	min	[0, 1440]. The value is the elapsed minutes since 00:00 a.m. The start time should be earlier than the end time.

Description	Data Type	Gain	Unit	Value Range
Charging and discharging power in period 1	132	1	W	[Discharging power limit, Charging power limit]. For details, see the description of the supported model.
Start time of period 2	U16	1	min	[0, 1440]. The value is the elapsed minutes since 00:00 a.m. The start time should be earlier than the end time.
End time of period 2	U16	1	min	[0, 1440]. The value is the elapsed minutes since 00:00 a.m. The start time should be earlier than the end time.
Charging and discharging power in period 2	132	1	W	[Discharging power limit, Charging power limit]. For details, see the description of the supported model.
Start time of period 10	U16	1	min	[0, 1440]. The value is the elapsed minutes since 00:00 a.m. The start time should be earlier than the end time.
End time of period 10	U16	1	min	[0, 1440]. The value is the elapsed minutes since 00:00 a.m. The start time should be earlier than the end time.
Charging and discharging power in period 10	132	1	W	[Discharging power limit, Charging power limit]. For details, see the description of the supported model.

Table 5-6 Format description of parameters for time-of-use electricity price periods(HUAWEI-LUNA2000)

Description	Data Type	Gain	Unit	Value Range
Number of periods	U16	1	-	[0, 14]

Description	Data Type	Gain	Unit	Value Range
Start time of period 1	U16	1	min	[0, 1440]. The value is the elapsed minutes since 00:00 a.m. The start time should be earlier than the end time.
End time of period 1	U16	1	min	[0, 1440]. The value is the elapsed minutes since 00:00 a.m. The start time should be earlier than the end time.
Charge/Discharge flag of period 1	U8	-	-	0:Charge 1:Discharge
Effective time flag of period 1	U8	-	-	There are 7 bits (from bit 0 to bit 6) standing for each day of a week (from Sunday to Saturday). 0: invalid 1: valid
Start time of period 2	U16	1	min	[0, 1440]. The value is the elapsed minutes since 00:00 a.m. The start time should be earlier than the end time.
End time of period 2	U16	1	min	[0, 1440]. The value is the elapsed minutes since 00:00 a.m. The start time should be earlier than the end time.
Charge/Discharge flag of period 2	U8	-	-	0:Charge 1:Discharge
Effective time flag of period 2	U8	-	-	There are 7 bits (from bit 0 to bit 6) standing for each day of a week (from Sunday to Saturday). 0: invalid 1: valid
	-	-	-	-

Description	Data Type	Gain	Unit	Value Range
Start time of period 14	U16	1	min	[0, 1440]. The value is the elapsed minutes since 00:00 a.m. The start time should be earlier than the end time.
End time of period 14	U16	1	min	[0, 1440]. The value is the elapsed minutes since 00:00 a.m. The start time should be earlier than the end time.
Charge/Discharge flag of period 14	U8	-	-	0:Charge 1:Discharge
Effective time flag of period 14	U8	-	-	There are 7 bits (from bit 0 to bit 6) standing for each day of a week (from Sunday to Saturday). 0: invalid 1: valid

6 Overview of the Communications Protocol

The Modbus communications protocol consists of the following layers.

Figure 6-1 Modbus protocol layers

Application layer	
Data link layer	
Physical layer	

- **6.1 Physical Layer**
- 6.2 Data Link Layer
- **6.3 Application Layer**


6.1 Physical Layer

Huawei solar inverters provide Modbus communication based on physical media such as MBUS, RS485, WLAN, FE, and 4G. MBUS and RS485 comply with the Modbus-RTU format. The communication through the WLAN, FE, and 4G media is based on the TCP link and complies with the Modbus-TCP format.

6.2 Data Link Layer


The following figure shows the generic frame structure of the Modbus protocol.

Figure 6-2 Modbus generic frame format



6.2.1 Modbus-RTU

Figure 6-3 Modbus-RTU frame format



6.2.1.1 ADU Length

The application data unit (ADU) consists of 256 bytes based on the serial bus.

- 1. Slave address: 1 byte
- 2. Cyclic redundancy check (CRC): 2 bytes
- 3. PDU: 253 bytes

6.2.1.2 Communications Address

As shown in **Figure 6-3**, Modbus-RTU is usually used for serial communication. Slave address represents the address of a slave solar inverter. The address range is allocated as follows:

Table 6-1 Serial link address allocation

Broadcast Address	Slave Node Address	Reserved Address	
0	1–247	248-255	

Reserved addresses are used for access control of the communication extension modules. Huawei reserves the right to allocate the reserved addresses.

6.2.1.3 CRC

CRC applies to all bytes in front of the CRC code, which consists of 16 bits. The reference code is as follows:


```
static unsigned char auchCRCHi[] = {
0x00, 0xC1, 0x81, 0x40, 0x01, 0xC0, 0x80, 0x41, 0x01, 0xC0, 0x80, 0x41, 0x00, 0xC1, 0x81,
0x40, 0x01, 0xC0, 0x80, 0x41, 0x00, 0xC1, 0x81, 0x40, 0x00, 0xC1, 0x81, 0x40, 0x01, 0xC0,
0x80, 0x41, 0x01, 0xC0, 0x80, 0x41, 0x00, 0xC1, 0x81, 0x40, 0x00, 0xC1, 0x81, 0x40, 0x01,
0xC0, 0x80, 0x41, 0x00, 0xC1, 0x81, 0x40, 0x01, 0xC0, 0x80, 0x41, 0x01, 0xC0, 0x80, 0x41,
```

```
0x00, 0xC1, 0x81, 0x40, 0x01, 0xC0, 0x80, 0x41, 0x00, 0xC1, 0x81, 0x40, 0x00, 0xC1, 0x81,
0x40, 0x01, 0xC0, 0x80, 0x41, 0x00, 0xC1, 0x81, 0x40, 0x01, 0xC0, 0x80, 0x41, 0x01, 0xC0,
0x80, 0x41, 0x00, 0xC1, 0x81, 0x40, 0x00, 0xC1, 0x81, 0x40, 0x01, 0xC0, 0x80, 0x41, 0x01,
0xC0, 0x80, 0x41, 0x00, 0xC1, 0x81, 0x40, 0x01, 0xC0, 0x80, 0x41, 0x00, 0xC1, 0x81, 0x40,
0x00, 0xC1, 0x81, 0x40, 0x01, 0xC0, 0x80, 0x41, 0x01, 0xC0, 0x80, 0x41, 0x00, 0xC1, 0x81,
0x40, 0x00, 0xC1, 0x81, 0x40, 0x01, 0xC0, 0x80, 0x41, 0x00, 0xC1, 0x81, 0x40, 0x01, 0xC0,
0x80,\,0x41,\,0x01,\,0xC0,\,0x80,\,0x41,\,0x00,\,0xC1,\,0x81,\,0x40,\,0x00,\,0xC1,\,0x81,\,0x40,\,0x01,\\
0xC0, 0x80, 0x41, 0x01, 0xC0, 0x80, 0x41, 0x00, 0xC1, 0x81, 0x40, 0x01, 0xC0, 0x80, 0x41,
0x00, 0xC1, 0x81, 0x40, 0x00, 0xC1, 0x81, 0x40, 0x01, 0xC0, 0x80, 0x41, 0x00, 0xC1, 0x81,
0x40, 0x01, 0xC0, 0x80, 0x41, 0x01, 0xC0, 0x80, 0x41, 0x00, 0xC1, 0x81, 0x40, 0x01, 0xC0,
0x80, 0x41, 0x00, 0xC1, 0x81, 0x40, 0x00, 0xC1, 0x81, 0x40, 0x01, 0xC0, 0x80, 0x41, 0x01,
0xC0, 0x80, 0x41, 0x00, 0xC1, 0x81, 0x40, 0x00, 0xC1, 0x81, 0x40, 0x01, 0xC0, 0x80, 0x41,
0x00, 0xC1, 0x81, 0x40, 0x01, 0xC0, 0x80, 0x41, 0x01, 0xC0, 0x80, 0x41, 0x00, 0xC1, 0x81,
0x40
/*CRC values for the low-order byte*/
static char auchCRCLo[] = {
0x00, 0xC0, 0xC1, 0x01, 0xC3, 0x03, 0x02, 0xC2, 0xC6, 0x06, 0x07, 0xC7, 0x05, 0xC5, 0xC4,
0x04, 0xCC, 0x0C, 0x0D, 0xCD, 0x0F, 0xCF, 0xCE, 0x0E, 0x0A, 0xCA, 0xCB, 0x0B, 0xC9, 0x09,
0x08, 0xC8, 0xD8, 0x18, 0x19, 0xD9, 0x1B, 0xDB, 0xDA, 0x1A, 0x1E, 0xDE, 0xDF, 0x1F, 0xDD,
0x1D, 0x1C, 0xDC, 0x14, 0xD4, 0xD5, 0x15, 0xD7, 0x17, 0x16, 0xD6, 0xD2, 0x12, 0x13, 0xD3,
0x11, 0xD1, 0xD0, 0x10, 0xF0, 0x30, 0x31, 0xF1, 0x33, 0xF3, 0xF2, 0x32, 0x36, 0xF6, 0xF7,
0x37, 0xF5, 0x35, 0x34, 0xF4, 0x3C, 0xFC, 0xFD, 0x3D, 0xFF, 0x3F, 0x3E, 0xFE, 0xFA, 0x3A,
0x3B, 0xFB, 0x39, 0xF9, 0xF8, 0x38, 0x28, 0xE8, 0xE9, 0x29, 0xEB, 0x2B, 0x2A, 0xEA, 0xEE,
0x2E,\,0x2F,\,0xEF,\,0x2D,\,0xED,\,0xEC,\,0x2C,\,0xE4,\,0x24,\,0x25,\,0xE5,\,0x27,\,0xE7,\,0xE6,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26,\,0x26
0x22, 0xE2, 0xE3, 0x23, 0xE1, 0x21, 0x20, 0xE0, 0xA0, 0x60, 0x61, 0xA1, 0x63, 0xA3, 0xA2,
0x62, 0x66, 0xA6, 0xA7, 0x67, 0x65, 0x65, 0x64, 0xA4, 0x6C, 0xAC, 0xAD, 0x6D, 0xAF, 0x6F,
0x6E, 0xAE, 0xAA, 0x6A, 0x6B, 0xAB, 0x69, 0xA9, 0xA8, 0x68, 0x78, 0xB8, 0xB9, 0x79, 0xBB,
0x7B, 0x7A, 0xBA, 0xBE, 0x7E, 0x7F, 0xBF, 0x7D, 0xBD, 0xBC, 0x7C, 0xB4, 0x74, 0x75, 0xB5,
0x77, 0xB7, 0xB6, 0x76, 0x72, 0xB2, 0xB3, 0x73, 0xB1, 0x71, 0x70, 0xB0, 0x50, 0x90, 0x91,
0x51, 0x93, 0x53, 0x52, 0x92, 0x96, 0x56, 0x57, 0x97, 0x55, 0x95, 0x94, 0x54, 0x9C, 0x5C,
0x5D, 0x9D, 0x5F, 0x9F, 0x9E, 0x5E, 0x5A, 0x9A, 0x9B, 0x5B, 0x99, 0x59, 0x58, 0x98, 0x88,
0x48, 0x49, 0x89, 0x4B, 0x8B, 0x8A, 0x4A, 0x4E, 0x8E, 0x8F, 0x4F, 0x8D, 0x4D, 0x4C, 0x8C,
0x44, 0x84, 0x85, 0x45, 0x87, 0x47, 0x46, 0x86, 0x82, 0x42, 0x43, 0x83, 0x41, 0x81, 0x80, 0x40
unsigned short CRC16 (puchMsq, usDataLen) /* The function returns the CRC as a unsigned short type */
unsigned char *puchMsg; /* message to calculate CRC upon */
unsigned short usDataLen; /* quantity of bytes in message */
unsigned char uchCRCHi = 0xFF; /* high byte of CRC initialized */
unsigned char uchCRCLo = 0xFF; /* low byte of CRC initialized */
unsigned uIndex; /* will index into CRC lookup table */
while (usDataLen--) /* pass through message buffer */
uIndex = uchCRCLo ^ *puchMsq++ ; /* calculate the CRC */
uchCRCLo = uchCRCHi ^ auchCRCHi[uIndex];
uchCRCHi = auchCRCLo[uIndex];
return (uchCRCHi << 8 | uchCRCLo);
```

Code source: *MODBUS over Serial Line Specification and Implementation Guide V1.02*

6.2.2 Modbus-TCP

Figure 6-4 Modbus-TCP frame format

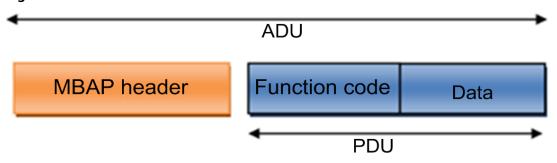

6.2.2.1 ADU Length

The recommended frame length is 260 bytes based on the standard. When some extended functions are applied, the data service provider may extend the ADU to a proper length based on the resources it possesses, to improve network transmission efficiency. The ADU length is indicated by the length field in the MBAP packet header.

6.2.2.2 MBAP Packet Header

If Modbus is applied to TCP/IP, a dedicated MBAP packet header (Modbus application protocol packet header) is used to identify the Modbus ADU. The Modbus packet header consists of four fields and seven bytes, which are defined as follows.

Table 6-2 MBAP definition

Data Field	Length (Byte)	Description	Client	Server
Transmissio n identifier	2	Matching identifier between a request frame and a response frame	Assigned by the client; better be unique for each data frame	The identifier of the response frame from the server must be consistent with that of the request frame.

Data Field	Length (Byte)	Description	Client	Server
Protocol type	2	0 = Modbus protocol	Assigned by the client; 0 by default	The identifier of the response frame from the server must be consistent with that of the request frame.
Data length	2	Follow-up data length	Assigned by the client based on the actual data frame	Assigned by the server based on the actual frame length
Logical device ID	1	0	Assigned by the client based on the actual data frame request	The identifier of the response frame from the server must be consistent with that of the request frame.

6.2.2.3 Communications Address

Based on the TCP communications host, unit 0 is used by default to access the directly connected slave node, and other addresses are used to access the downstream devices of the slave node. The default address of the slave node is 0. The address is adjustable.

Modbus-TCP / Ethernet

Slave address: 0

Modbus-RTU / RS485

Sub-slave address: 1

Sub-slave address: 2

Sub-slave address: n

Figure 6-5 Communications address of the three-layer object structure

6.2.2.4 TCP Port

In a local area network or VPN environment, the master node may actively initiate TCP socket link establishment to the slave node. The master node can use the 502 port to request data services from the slave node.

In a non-VPN environment across the public network, the device deployed on the internal network needs to initiate TCP socket link establishment to the master node exposed on the public network. In this case, you need to preset the fixed access port number of the master node on the slave node. To ensure security and reduce traffic, the master node must provide at least one encrypted port and one non-encrypted port.

6.2.2.5 TCP Link Establishment Process

This section focuses on the cross-public network application.

The following figure shows the process of connecting a slave node.

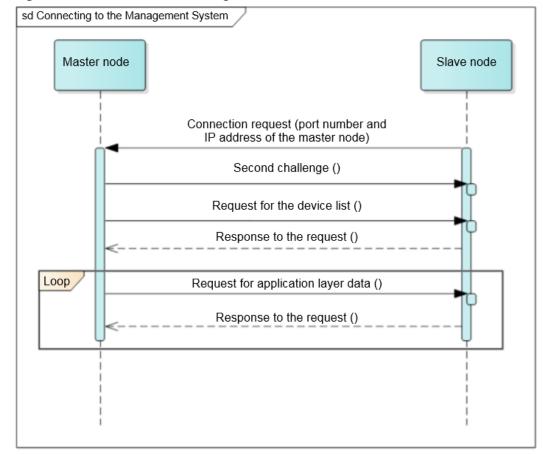


Figure 6-6 Process of establishing a secure TCP connection

6.3 Application Layer

6.3.1 Function Code List

Table 6-3 Function code list

Function Code	Meaning	Remarks
0x03	Read registers.	Continuously reads a single register or multiple registers.
0x06	Write a single register.	Writes into a single register.
0x10	Write multiple registers.	Continuously writes into multiple registers.

6.3.2 Exception Code List

The exception codes must be unique for each network element (NE) type. The names and descriptions should be provided in both the Chinese and English NE

interface document. Different versions of the same NE type must be backward compatible. Exception codes in use cannot be assigned to other exceptions.

Table 6-4 Exception codes returned by an NE (0x00–0x8F are for common exception codes)

Code	Name	Description
0x01	Illegal function	The function code received in the query is not an allowable action for the server (or slave node). This may be because the function code is only applicable to newer devices, and was not implemented in the unit selected. It could also indicate that the server (or slave node) is in the wrong state to process a request of this type, for example because it is not configured and is being asked to return register values.
0x02	Illegal data address	The data address received in the query is not an allowable address for the server. More specifically, the combination of reference number and transfer length is invalid. For a controller with 100 registers, the PDU addresses the first register as 0, and the last one as 99. If a request is submitted with a starting register address of 96 and a quantity of registers of 4, then this request will successfully operate (address-wise at least) on registers 96, 97, 98, 99. If a request is submitted with a starting register address of 96 and a quantity of registers of 5, then this request will fail with Exception Code 0x02 "Illegal Data Address" since it attempts to operate on registers 96, 97, 98, 99 and 100, and there is no register with address 100.
0x03	Illegal data value	The value contained in the query data field is not an allowable value for the server (or slave). The value indicates a fault in the structure of the remainder of a complex request, such as an incorrectly implied length. It specifically does not mean that a data item submitted for storage in a register has a value outside the expectation of the application program since the Modbus protocol is unaware of the significance of any particular value of any particular register.
0x04	Slave node failure	An error occurred while the server was attempting to perform the requested action.
0x06	Slave device busy	The server cannot accept a Modbus request PDU. A client application determines whether and when to resend the request.

Code	Name	Description
0x80	No permission	An operation is not allowed because of a permission authentication failure or permission expiration.

6.3.3 Reading Registers (0x03)

6.3.3.1 Frame Format of a Request from a Master Node

Data Field	Length (Byte)	Description
Function code	1	0x03
Register start address	2	0x0000-0xFFFF
Number of registers	2	1–125

6.3.3.2 Frame Format of a Normal Response from a Slave Node

Data Field	Length (Byte)	Description
Function code	1	0x03
Number of bytes	1	2 x N
Register value	2 x N	N/A

N refers to the number of registers.

6.3.3.3 Frame Format of an Abnormal Response from a Slave Node

Data Field	Length (Byte)	Description
Function code	1	0x83
Exception code	1	See 6.3.2 .

6.3.3.4 Examples

This section takes the Modbus-TCP communications frames as an example. The differences between Modbus-RTU and Modbus-TCP lie in the additional address field and the CRC. Pay attention to the differences when using the Modbus-RTU frames. This also works for the follow-up examples.

The master node sends a query request (register address: 32306/0X7E32) to the slave node (logical device ID: 00).

Description		Frame Data
MBAP header	Protocol identifier	00
		01
	Protocol type	00
		00
	Data length	00
		06
	Logical device ID	00
Function code		03
Data	Register address	7E
		32
	Number of registers	00
		02

Normal response from the slave node

Description		Frame Data
MBAP header	Protocol identifier	00
		01
	Protocol type	00
		00
	Data length	00
		07
	Logical device ID	00
Function code		03
Data	Number of bytes	04
	Register data	00
		00
		00
		01

Abnormal response from the slave node

Description		Frame data
MBAP header	Protocol identifier	00
		01
	Protocol type	00
		00
	Data length	00
		03
	Logical device ID	00
Function code		83
Data	Error code	03

6.3.4 Writing a Single Register (0x06)

6.3.4.1 Frame Format of a Request from a Master Node

Data Field	Length (Byte)	Description
Function code	1	0x06
Register address	2	0x0000-0xFFFF
Register value	2	0x0000-0xFFFF

6.3.4.2 Frame Format of a Normal Response from a Slave Node

Data Field	Length (Byte)	Description
Function code	1	0x06
Register address	2	0x0000-0xFFFF
Register value	2	0x0000-0xFFFF

6.3.4.3 Frame Format of an Abnormal Response from a Slave Node

Data Field	Length (Byte)	Description
Function code	1	0x86

Data Field	Length (Byte)	Description
Exception code	1	See 6.3.2 .

6.3.4.4 Examples

A master node sends a command (register address: 40200/0X9D08) to a slave node (address: 00).

Description		Frame data
MBAP header	Protocol identifier	00
		01
	Protocol type	00
		00
	Data length	00
		06
	Logical device ID	00
Function code		06
Data	Register address	9D
		08
	Register data	00
		00

Normal response from the slave node

Description		Frame Data
MBAP header	Protocol identifier	00
		01
	Protocol type	00
		00
	Data length	00
		06
	Logical device ID	00
Function code		06

Description		Frame Data
Data	Register address	9D
		08
	Register data	00
		00

Abnormal response from the slave node

Description		Frame Data
MBAP header	Protocol identifier	00
		01
	Protocol type	00
		00
	Data length	00
		03
	Logical device ID	00
Function code		86
Data	Error code	04

6.3.5 Writing Multiple Registers (0x10)

6.3.5.1 Frame Format of a Request from a Master Node

Data Field	Length (Byte)	Description	
Function code	1	0x10	
Register start address	2	0x0000-0xFFFF	
Number of registers	2	0x0000-0x007b	
Number of bytes	1	2 x N	
Register value	2 x N	Value	

N refers to the number of registers.

6.3.5.2 Frame Format of a Normal Response from a Slave Node

Data Field	Length (Byte)	Description	
Function code	1	0x10	
Register address	2	0x0000-0xFFFF	
Number of registers	2	0x0000-0x007b	

6.3.5.3 Frame Format of an Abnormal Response from a Slave Node

Data Field	Length (Byte) Description	
Function code	ode 1 0x90	
Exception code	1	See 6.3.2 .

6.3.5.4 Examples

The master node sets the register address 40118/0X9CB6 to 2 and the register address 40119/0X9CB7 to 50 for the slave node (address: 00). The request frame format is as follows.

Description		Frame Data
MBAP header	Protocol identifier	00
		01
	Protocol type	00
		00
	Data length	00
		ОВ
	Logical device ID	00
Function code		10
Data	Register address	9C
		В6
	Number of registers	00
		02
	Number of bytes	04
	Register data	00

Description		Frame Data
		02
		00
		32

Normal response from the slave node

Description		Frame Data
MBAP header	Protocol identifier	00
		01
	Protocol type	00
		00
	Data length	00
		06
	Logical device ID	00
Function code		10
Data	Register address	9C
		В6
	Number of registers	00
		02

Abnormal response from the slave node

Description		Frame Data
MBAP header	Protocol identifier	00
		01
	Protocol type	00
		00
	Data length	00
		03
	Logical device ID	00
Function code		90

Description		Frame Data
Data	Data Error code	

6.3.6 Reading Device Identifiers (0x2B)

This command code allows reading identifiers and added packets that are relevant to the physical and function description of the remote devices.

Simulate the interface of the read device identifier as an address space. This address space consists of a set of addressable data elements. The data elements are objects to be read, and the object IDs determine these data elements.

A data element consists of three objects:

- 1. Basic device identifier: All objects of this type are mandatory, such as the vendor name, product code, and revision version.
- Normal device identifier: Except basic data objects, the device provides
 additional and optional identifiers and data object description. Define all
 types of objects according to definitions in the standard, but the execution of
 this type of objects is optional.
- 3. Extended device identifier: In addition to the normal data objects, the device provides additional and optional identifiers and special data object description. All the data is related to the device.

Table 6-5 Reading device identifiers

Object ID	Object Name or Description	Туре	Mandatory or Optional (M/O)	Туре
0x00	Manufacturer name	ASCII character string	М	Basic
0x01	Product code	ASCII character string	М	
0x02	Main revision version	ASCII character string	М	
0x03-0x7F	-	-	-	Normal
0x80-0xFF	-	-	-	Expansion

6.3.6.1 Command for Querying Device Identifiers

Table 6-6 Request frame format

Data Field	Length (Byte)	Description
Function code	1	0x2B
MEI type	1	0x0E
ReadDevId code	1	01
Object ID	1	0x00

Table 6-7 Frame format for a normal response

Data Field	Data Field		Length (Byte)	Description
Function co	Function code		1	0x2B
MEI type			1	0x0E
ReadDevId o	code		1	01
Consistency	level		1	01
More			1	-
Next object	ID		1	-
Number of	objects		1	-
Object list	First object	Object ID	1	0x00
		Object length	1	N
		Object value	N	-

Table 6-8 Object list

Object ID	Object Name or Description	Description	Туре
0x00	Manufacturer name	HUAWEI	Basic
0x01	Product code	SUN2000	

Object ID	Object Name or Description	Description	Туре
0x02	Main revision version	ASCII character string, software version	

Table 6-9 Frame format for an abnormal response

Data Field	Length (Byte)	Description
Function code	1	0xAB
Exception code	1	See 6.3.2 .

6.3.6.2 Command for Querying a Device List

Table 6-10 Request frame format

Data Field	Length (Byte)	Description
Function code	1	0x2B
MEI type	1	0x0E
ReadDevId code	1	03
Object ID	1 byte	0x87

Table 6-11 Frame format for a normal response

Data Field			Length (Byte)	Description
Function code	!		1	0x2B
MEI type	MEI type		1	0x0E
ReadDevId co	de		1	03
Consistency le	evel		1	03
More		1	-	
Next object ID			1	-
Number of objects		1	-	
Object list	First object	Object ID	1	0x87

Data Field		Length (Byte)	Description	
		Object length	1	N
		Object value	N	-

Table 6-12 Object list

Object ID	Object Name	Туре	Description
0x80-0x86	Reserved		Returns a null object with a length of 0.
0x87	Number of devices	int	Returns the number of devices connected to the RS485 address.
0x88	Description about the first device	ASCII character string See the device description definitions.	Returns only description about the first device if a NE allows only one device to be connected to each RS485 address.
0x8A	Description about the second device	-	-
-	-	-	-
0xFF	Description about the 120th device	-	-

6.3.6.3 Device Description Definition

Each device description consists of all "attribute=value" character strings.

"Attribute ID=%s;... attribute ID=%s"

For example: "1=SUN2000MA-XXKTL;2=V100R001C00SPC100;3=P1.0-D5.0;4=123232323;5=1;6=1.1"

Table 6-13 Attribute definition

Attribut e ID	Name	Туре	Description
1	Device model	ASCII character string	SUN2000
2	Device software version	ASCII character string	-
3	Port protocol version	ASCII character string	See the interface protocol version definitions.
4	ESN	ASCII character string	-
5	Device ID	int	0, 1, 2, 3(assigned by NEs; 0 indicates the master device into which the Modbus card is inserted)
6	Feature version	ASCII character string	-

Table 6-14 Frame format for an abnormal response

Data Field	Length (Byte)	Description
Function code	1	0xAB
Exception code	1	See 6.3.2 .

6.3.7 Huawei-defined Functions (0x41)

6.3.7.1 Uploading Files

Uploading files means uploading them by stream data from a slave node to a master node. The following figure shows the file uploading process.

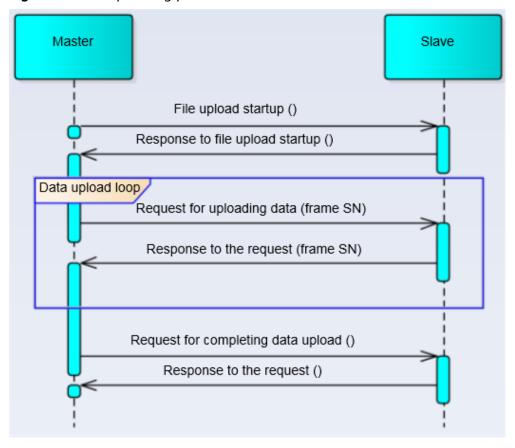


Figure 6-7 File uploading process

6.3.7.1.1 Starting the Upload

Frame format of a request from a master node

Table 6-15 PDU data field of the request frame for starting upload (0x05)

PDU Data Field	Length (Byte)	Description
Function code	1	0x41
Sub- function code	1	0x05
Data length	1	1 + N
File type	1	Unique ID of a file
Customiz ed data	N	-

Table 6-16 PDU data field of the response frame for starting upload (0x05)

Data Field	Length (Byte)	Description
Function code	1	0x41
Sub- function code	1	0x05
Data length	1	6 + N
File type	1	Unique ID of a file
File length	4	-
Data frame length	1	-
Customiz ed data	N	-

Table 6-17 PDU data field in the abnormal response frame of the slave node

PDU Data Field	Length (Byte)	Description
Error code	1	0xC1
Exception code	1	See 6.3.2 .

If the exception code is 0x06, resend the request after 10 seconds. A request can be resent for no more than six times.

6.3.7.1.2 Uploading Data

Table 6-18 Request frame for uploading data (0x06)

PDU Data Field	Length (Byte)	Description
Function code	1	0x41
Sub-function code	1	0x06
Data length	1	3
File type	1	Unique ID of a file

PDU Data Field	Length (Byte)	Description
Frame No.	2	0x0000-0xFFFF

Table 6-19 Response frame for uploading data (0x06)

PDU Data Field	Length (Byte)	Description
Function code	1	0x41
Sub-function code	1	0x06
Data length	1	3 + N
File type	1	-
Frame No.	2	0x0000-0xFFFF
Frame data	N	-

Table 6-20 Abnormal response frame for uploading data

PDU Data Field	Length (Byte)	Description
Error code	1	0xC1
Exception code	1	See 6.3.2 .

6.3.7.1.3 Completing the Data Upload

Table 6-21 Request frame for completing the data upload

PDU Data Field	Length (Byte)	Description
Function code	1	0x41
Sub-function code	1	0x0c
Data length	1	1
File type	1	-

Table 6-22 Response frame for completing the data upload

PDU Data Field	Length (Byte)	Description
Function code	1	0x41
Sub-function code	1	0x0c
Data length	1	3
File type	1	-
File CRC	2	-

Table 6-23 Abnormal response frame for completing the data upload

Data Field	Length (Byte)	Description
Error code	1	0xC1
Exception code	1	See 6.3.2 .

6.3.7.1.4 Timeout Processing

Table 6-24 Processing specifications of sub-process timeout

Name	Restraints
Response timeout period for starting an upload	10s
Response timeout period for uploading data	10s
Number of times of resending a data upload command	6
Response timeout period for completing a data upload	10s