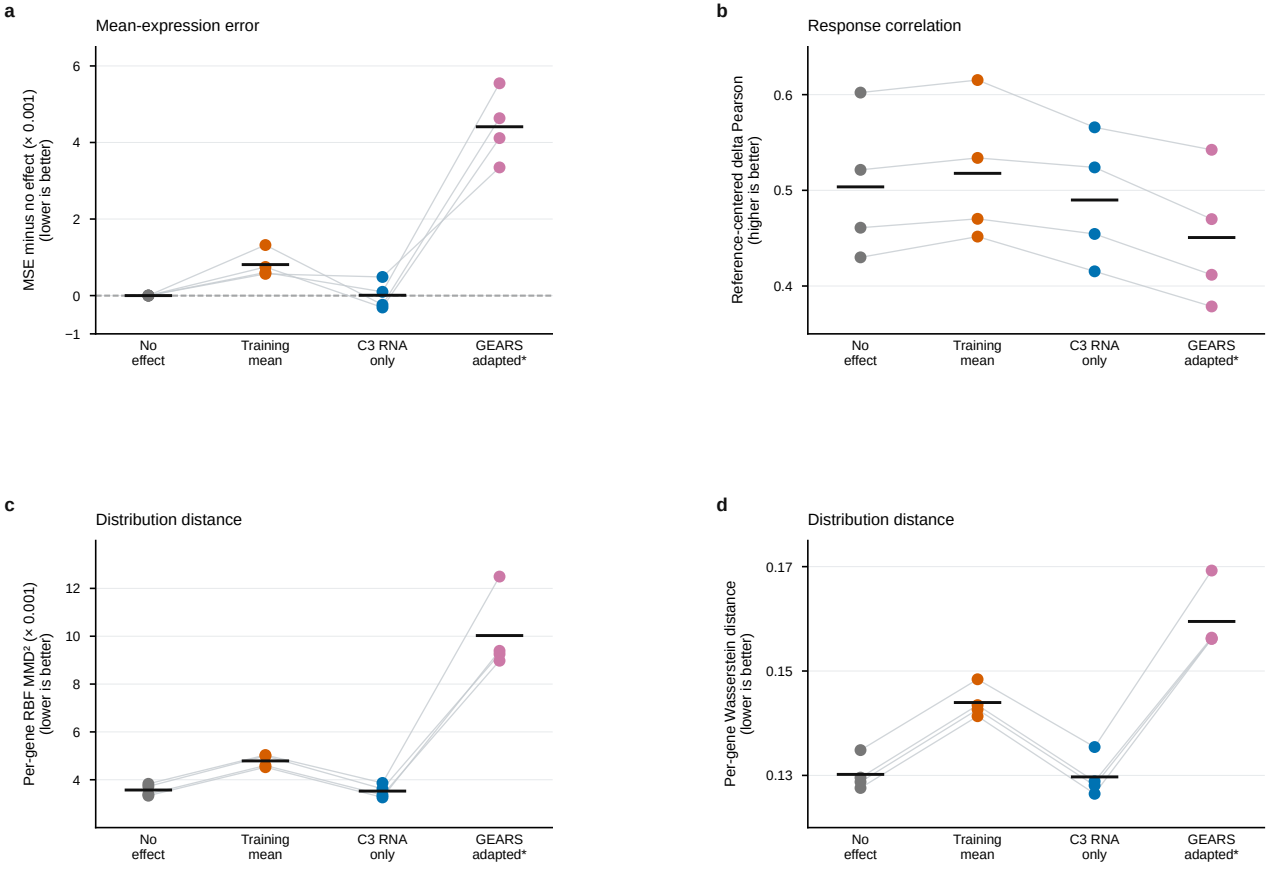

Each line joins one of four test genes; black bars show means. Two guides per gene.

Fixed stimulated background; target treatment and controls are from different wells.

C3 is RNA-only, with strength 0.5 selected on four validation genes.

* GEARS uses public GO and a batch-graph adaptation; 47.5% of its raw values were projected to zero.

Training mean projected 38.9% of values; MMD and Wasserstein were not independently recomputed.

Controls are shared; genes are not biological replicates. Internal analysis, not an official score.