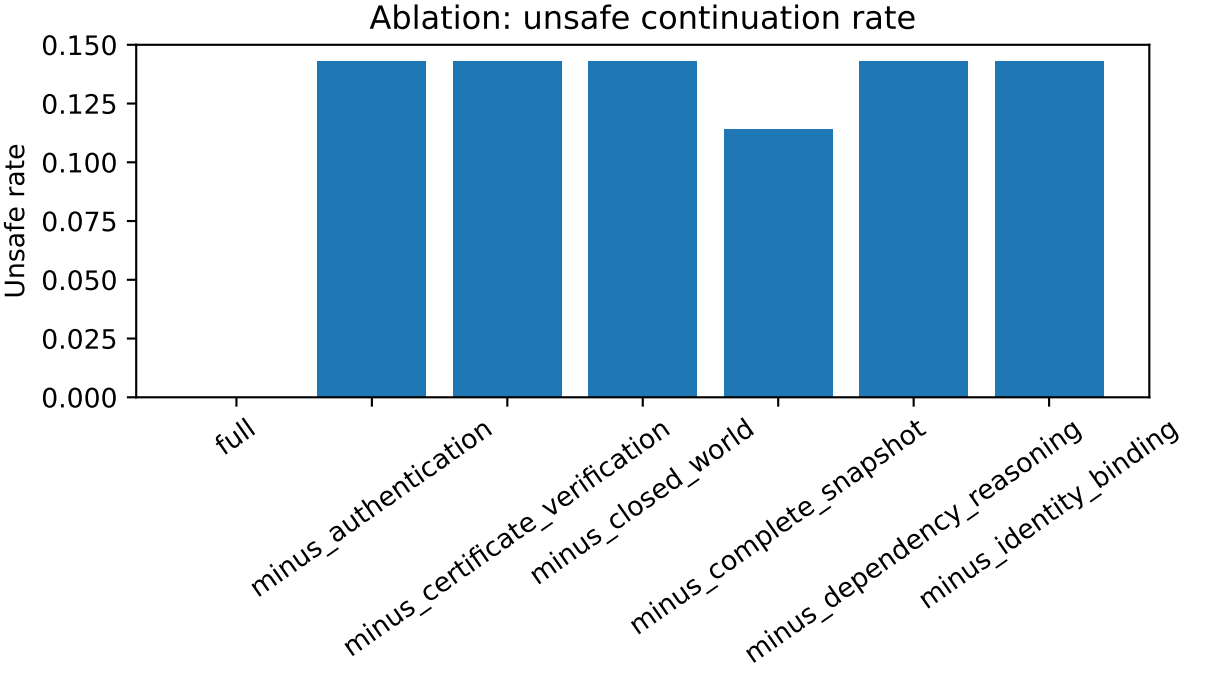
Ablation: unsafe continuation rate
Unsafe rate
0.150
0.125
0.100
0.075
0.050
0.025
0.000
full
minus_authentication
minus_certificate_verification
minus_closed_world
minus_complete_snapshot
minus_dependency_reasoning
minus_identity_binding