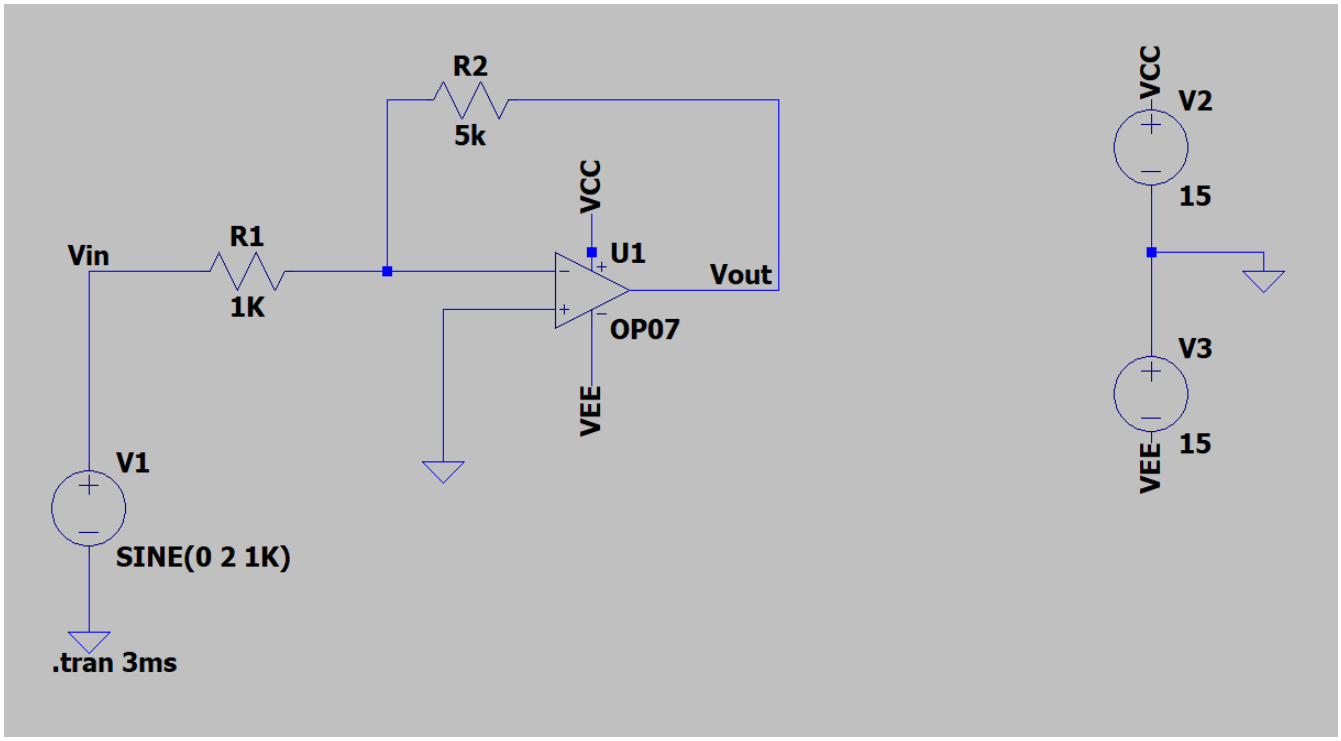

Inverting Amp

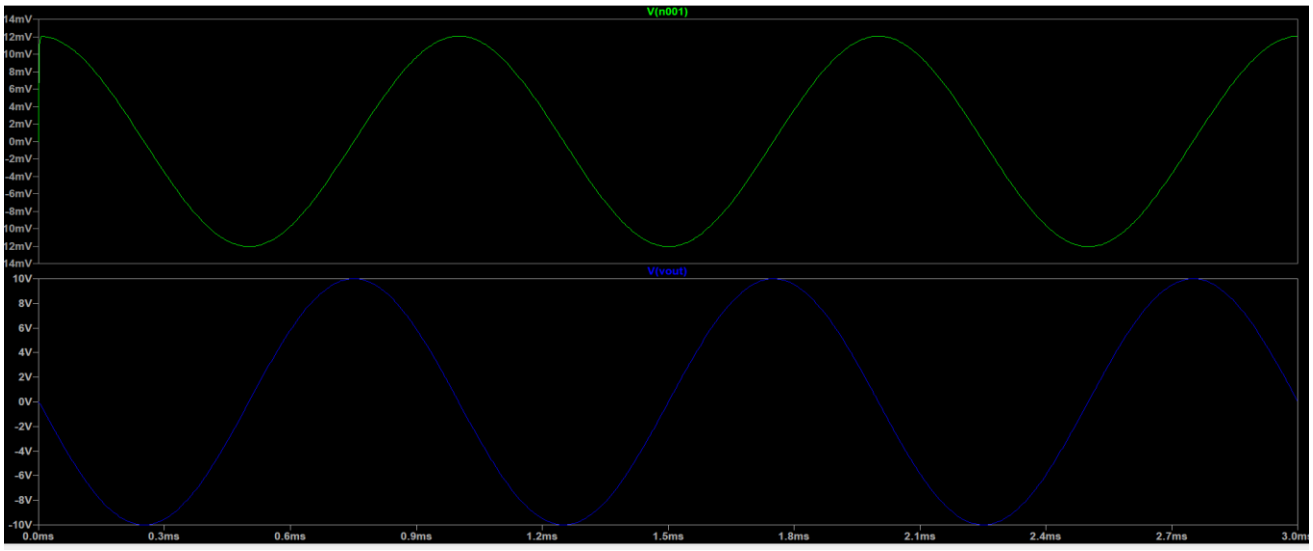

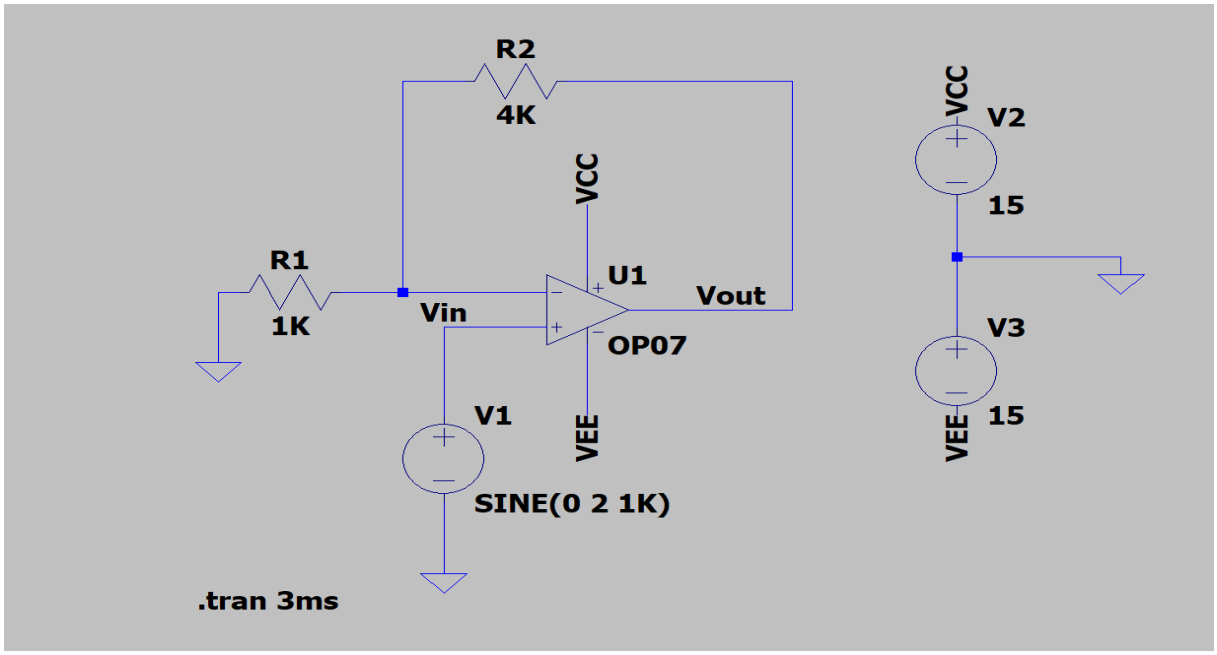

NonInverting

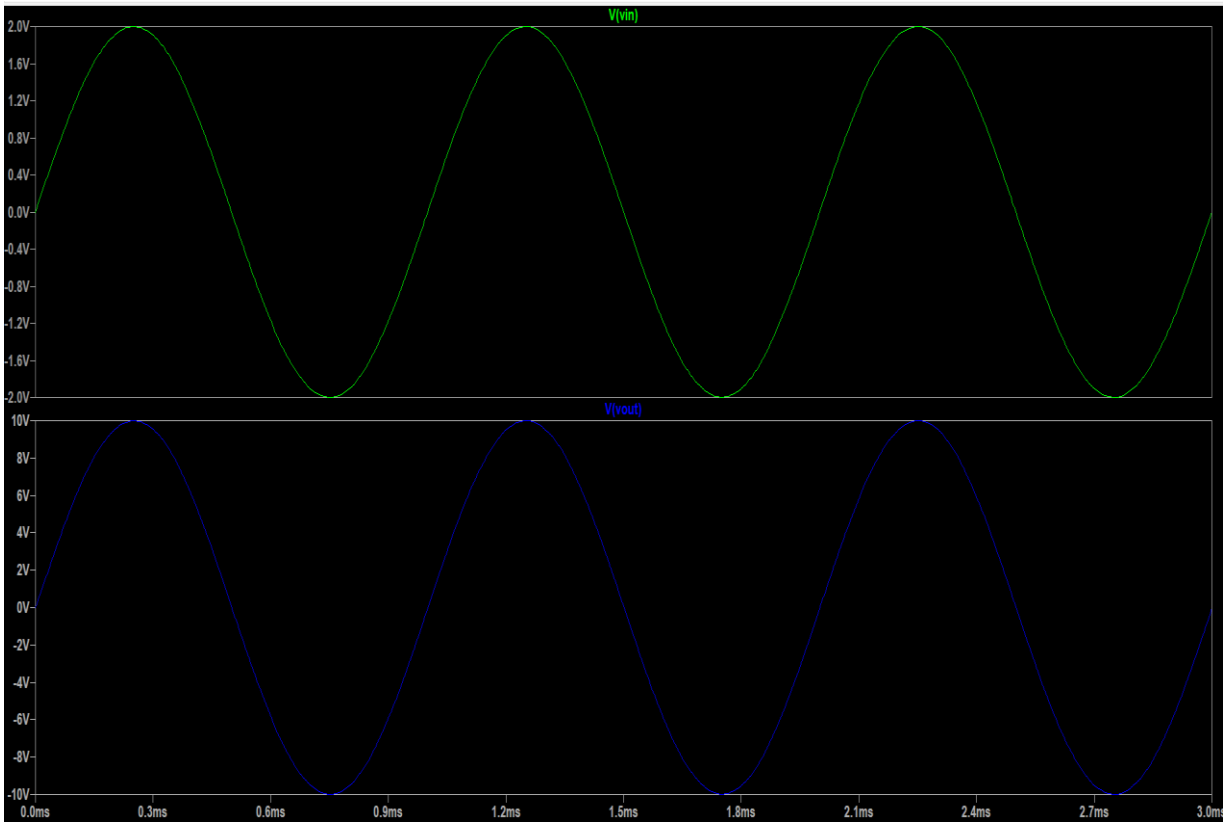

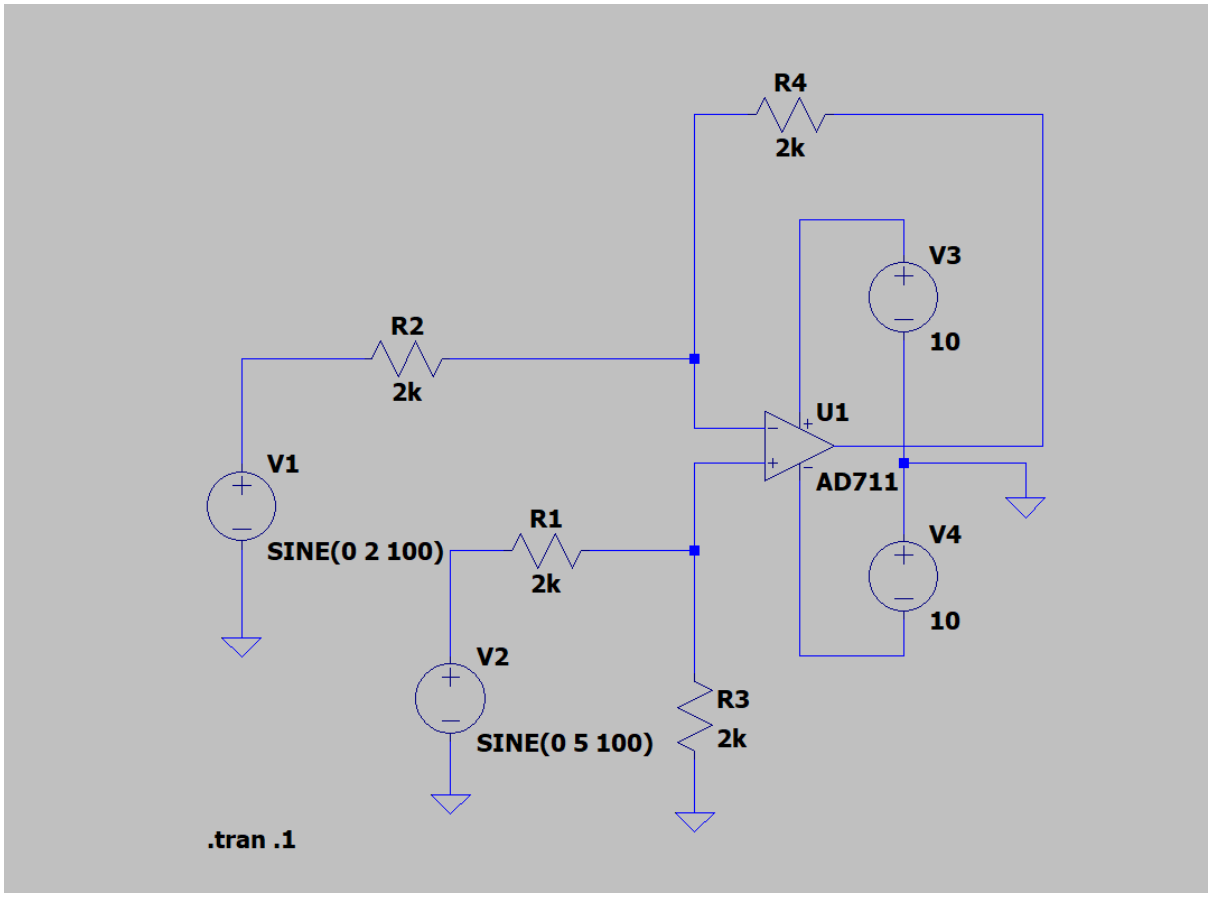

Differential Amp

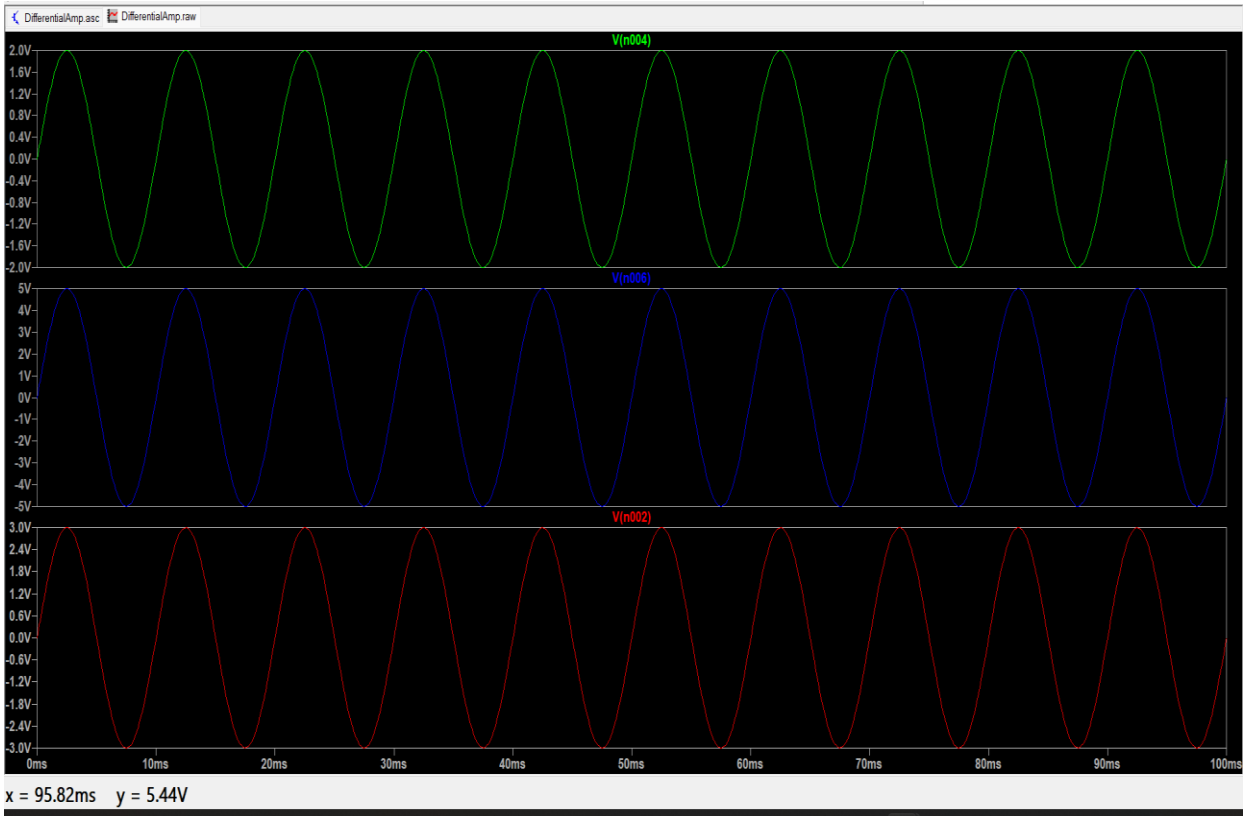

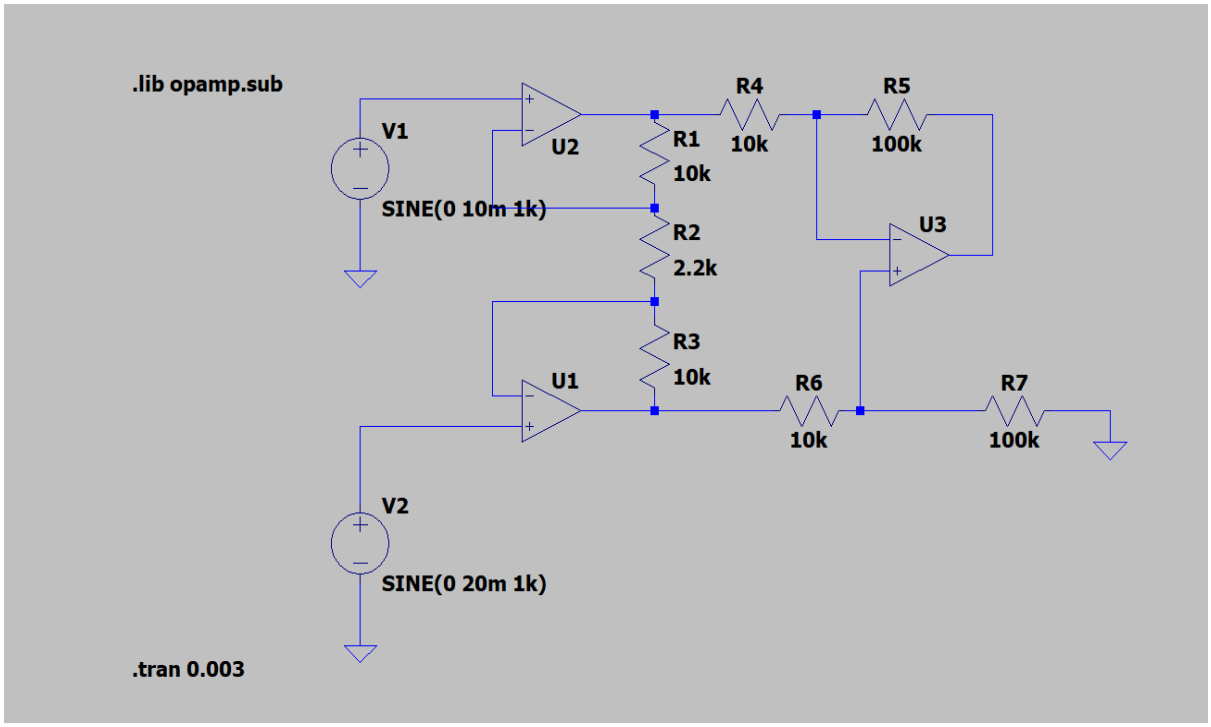

Instrumentation Amp

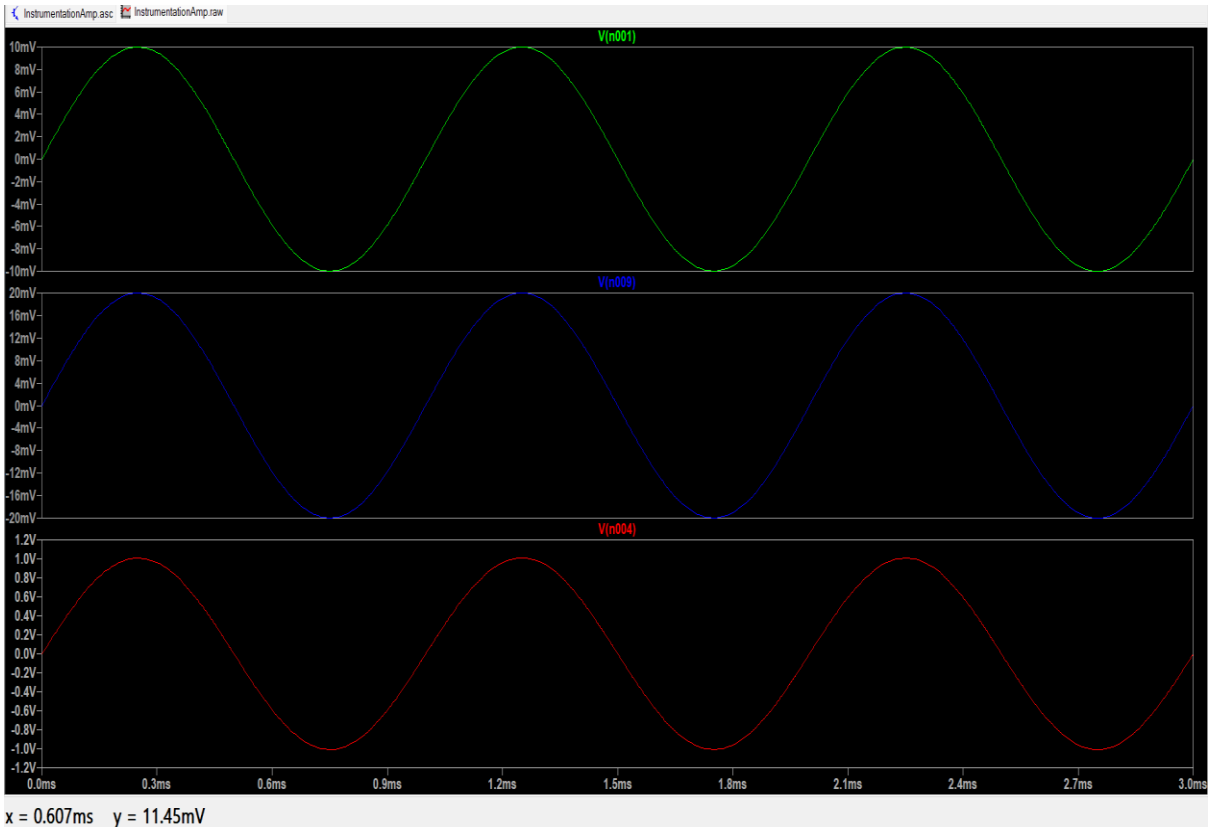

x = 0.607ms y = 11.45mV

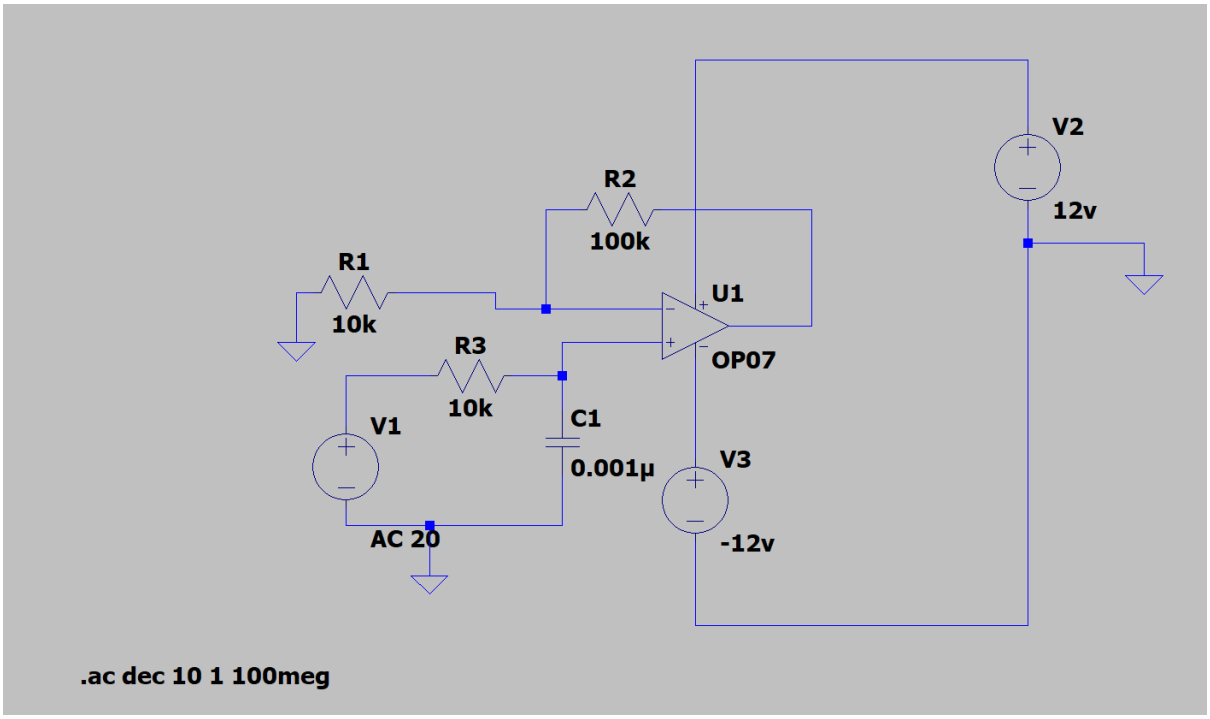

Low Pass Filter

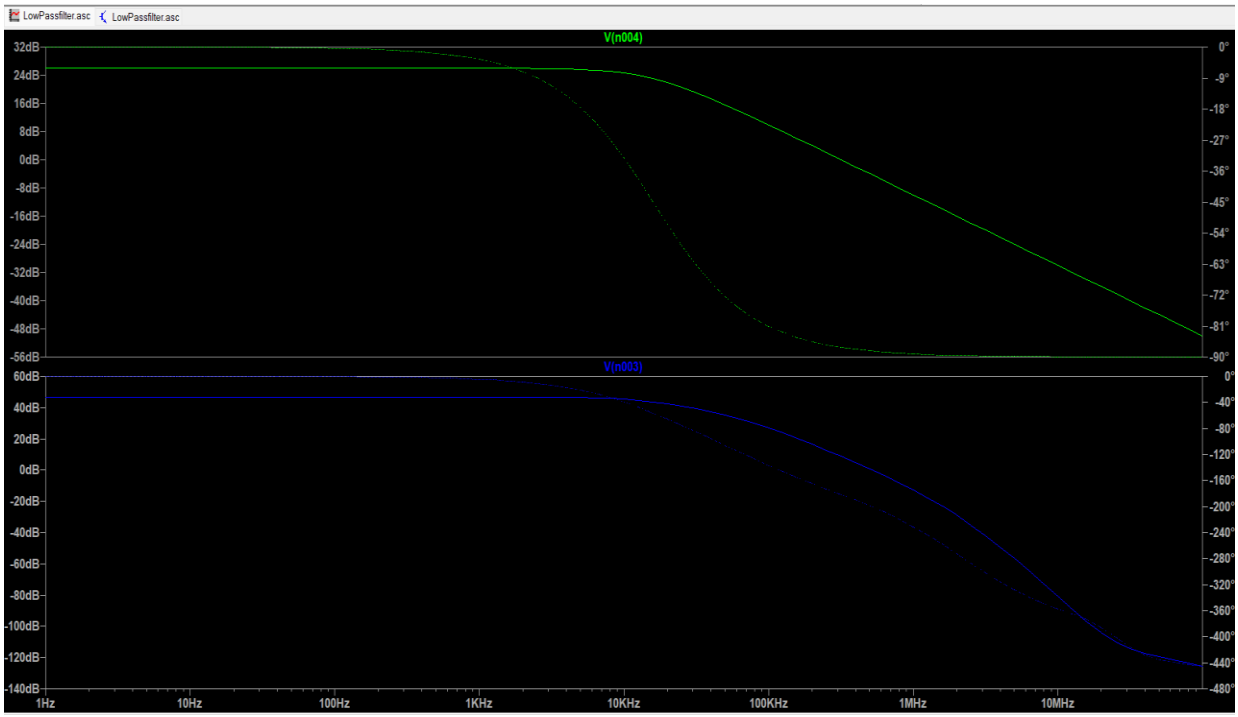

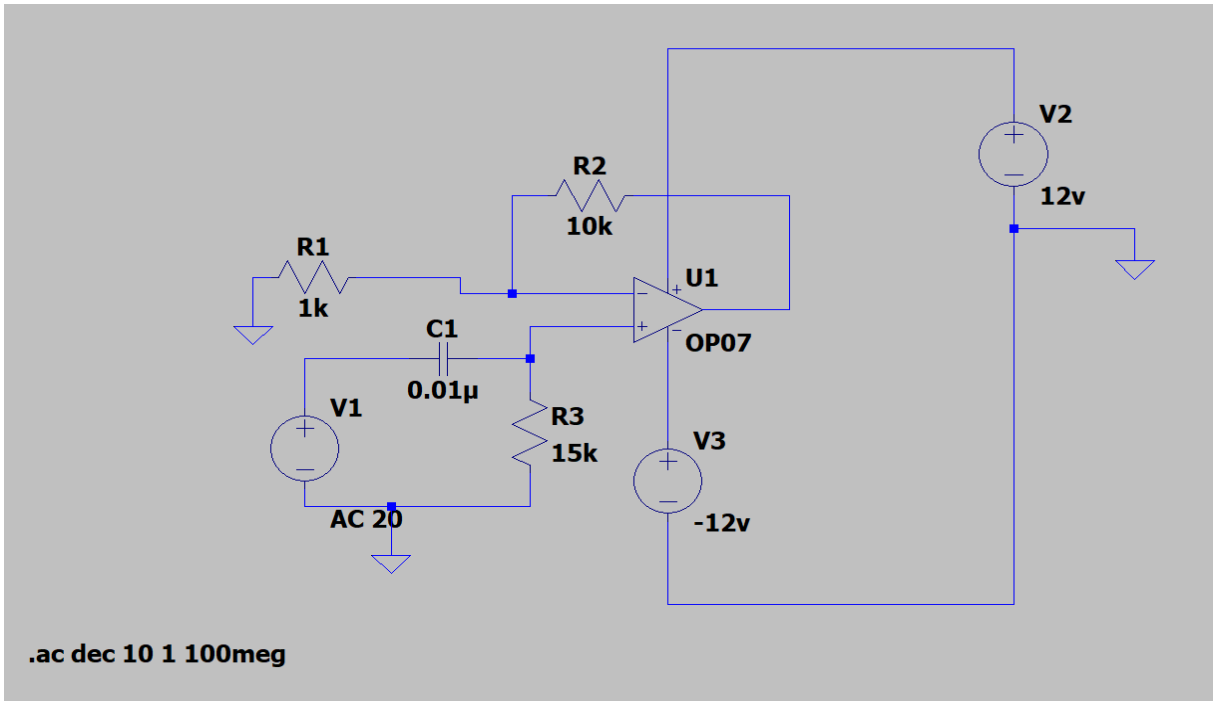

High pass filter

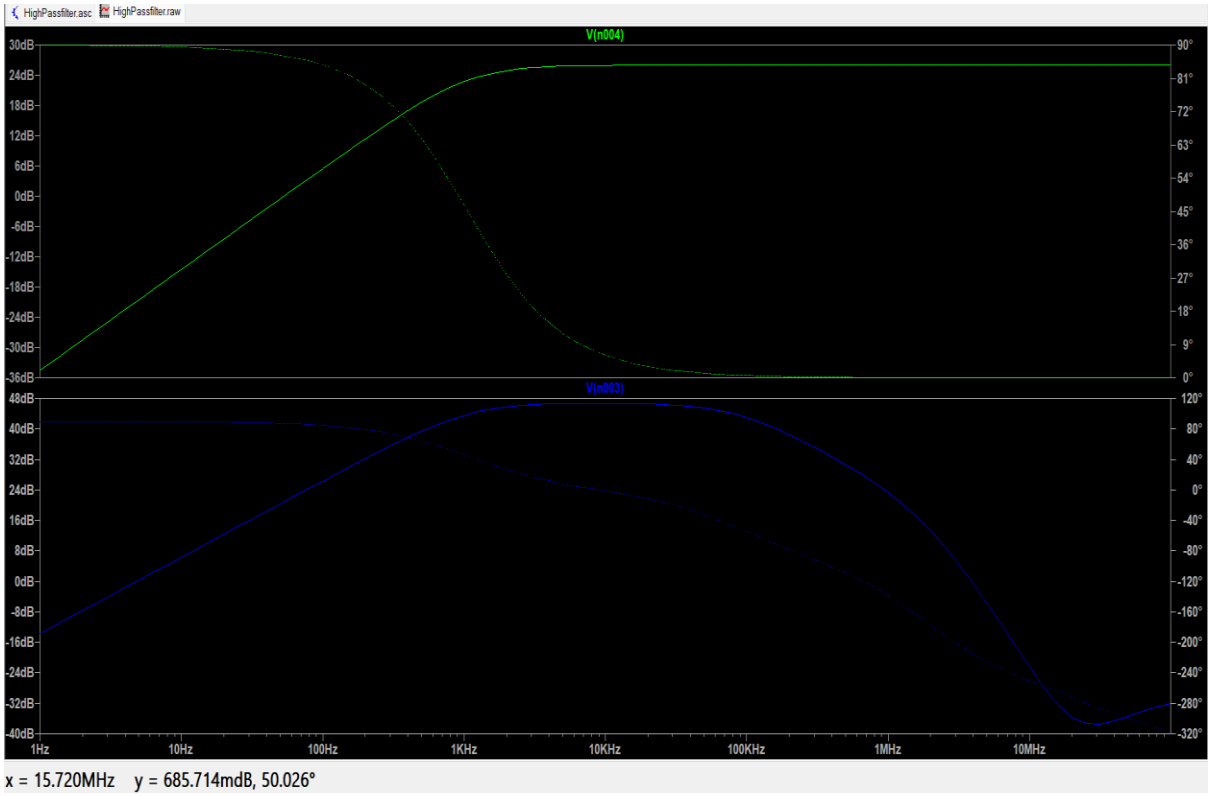

x = 15.720MHz y = 685.714mdB, 50.026°

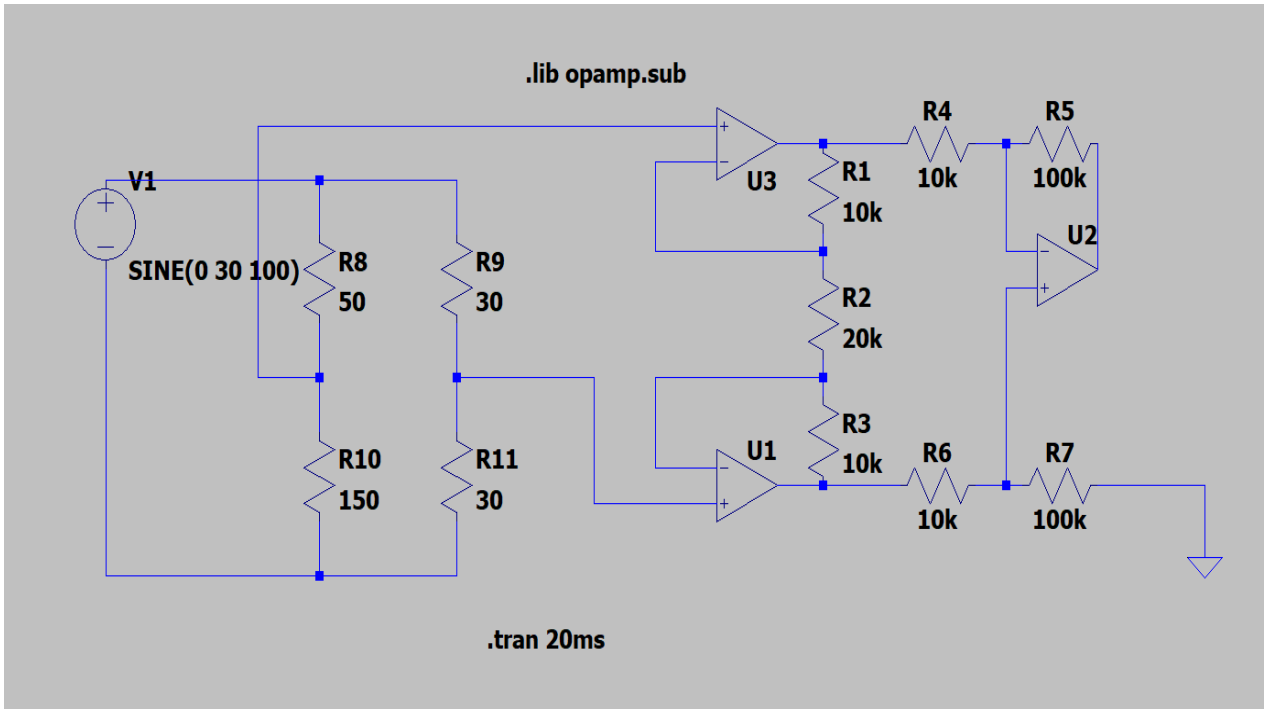
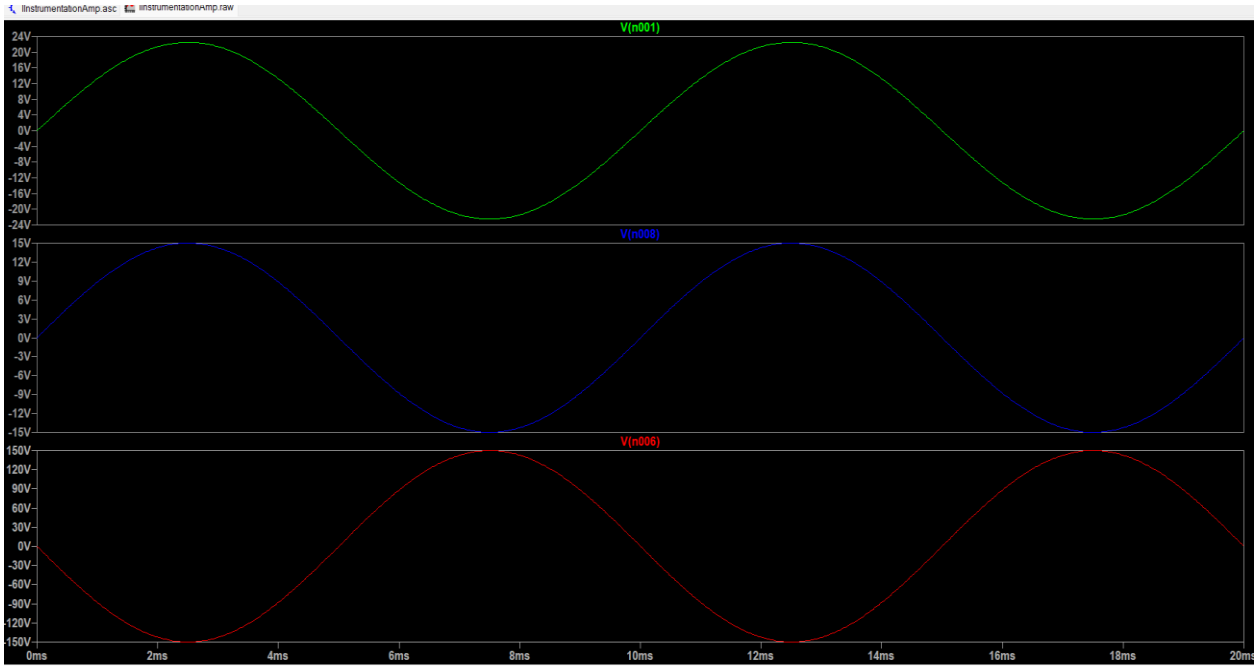
WheatStoneBridge