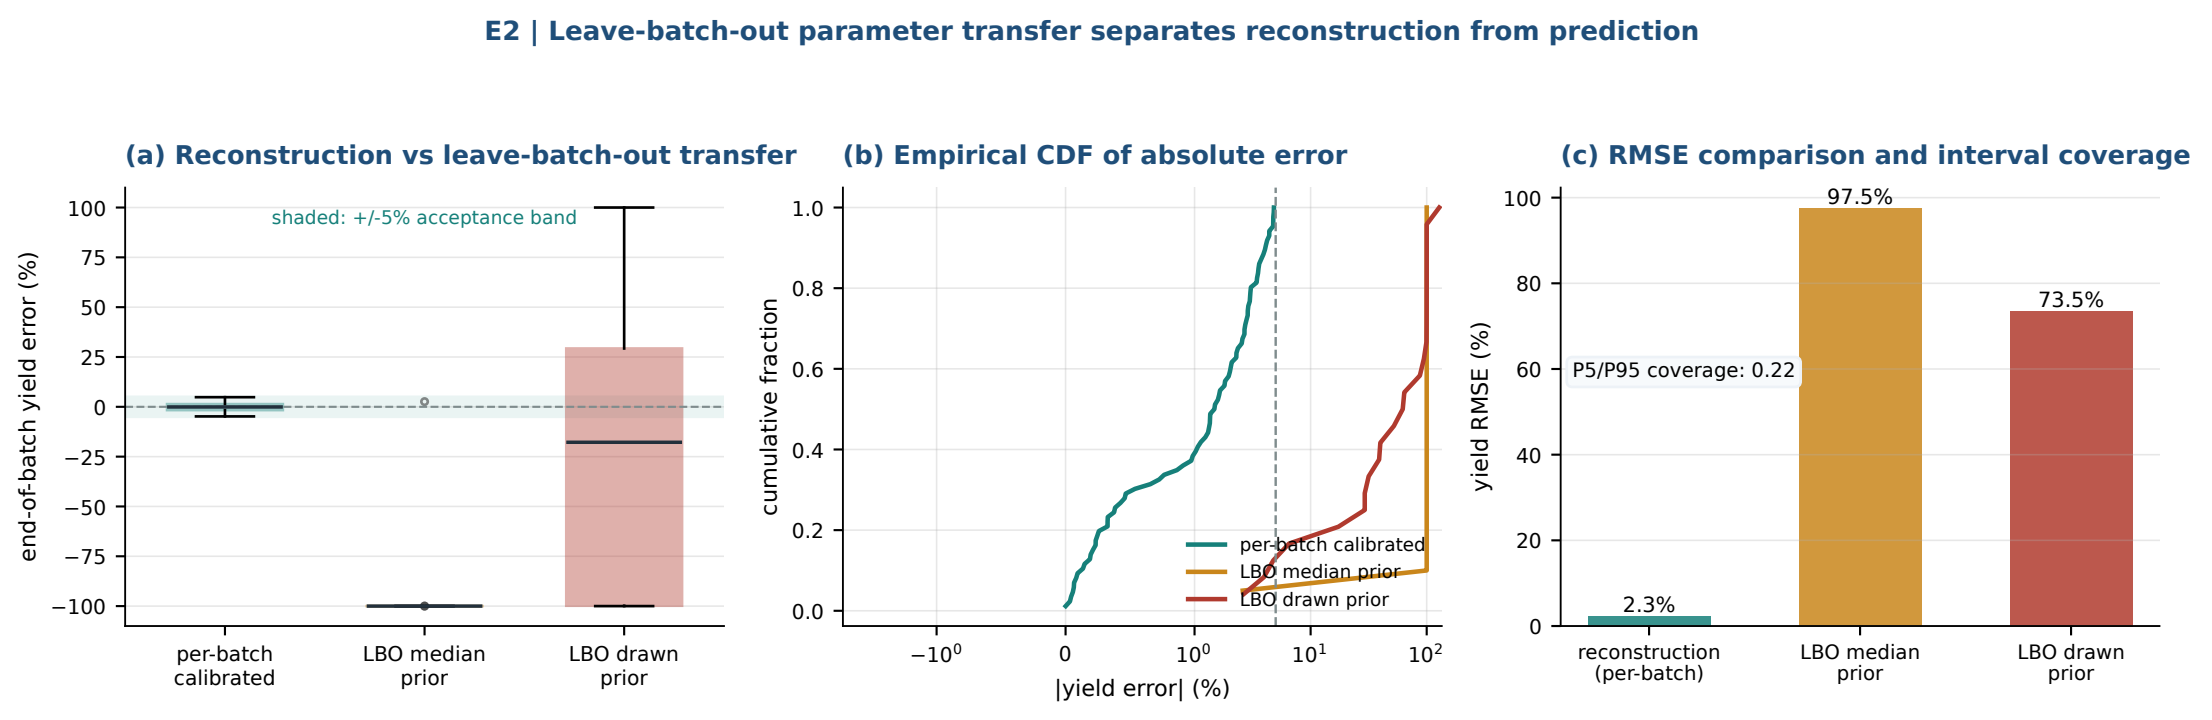
E2 | Leave-batch-out parameter transfer separates reconstruction from prediction
(a) Reconstruction vs leave-batch-out transfer
shaded: +/-5% acceptance band
end-of-batch yield error (%)
100
75
50
25
0
−25
−50
−75
−100
per-batch calibrated
LBO median prior
LBO drawn prior
(b) Empirical CDF of absolute error
cumulative fraction
1.0
0.8
0.6
0.4
0.2
0.0
−10^0
0
10^0
10^1
10^2
|yield error| (%)
per-batch calibrated
LBO median prior
LBO drawn prior
(c) RMSE comparison and interval coverage
yield RMSE (%)
100
80
60
40
20
0
97.5%
73.5%
P5/P95 coverage: 0.22
2.3%
reconstruction (per-batch)
LBO median prior
LBO drawn prior