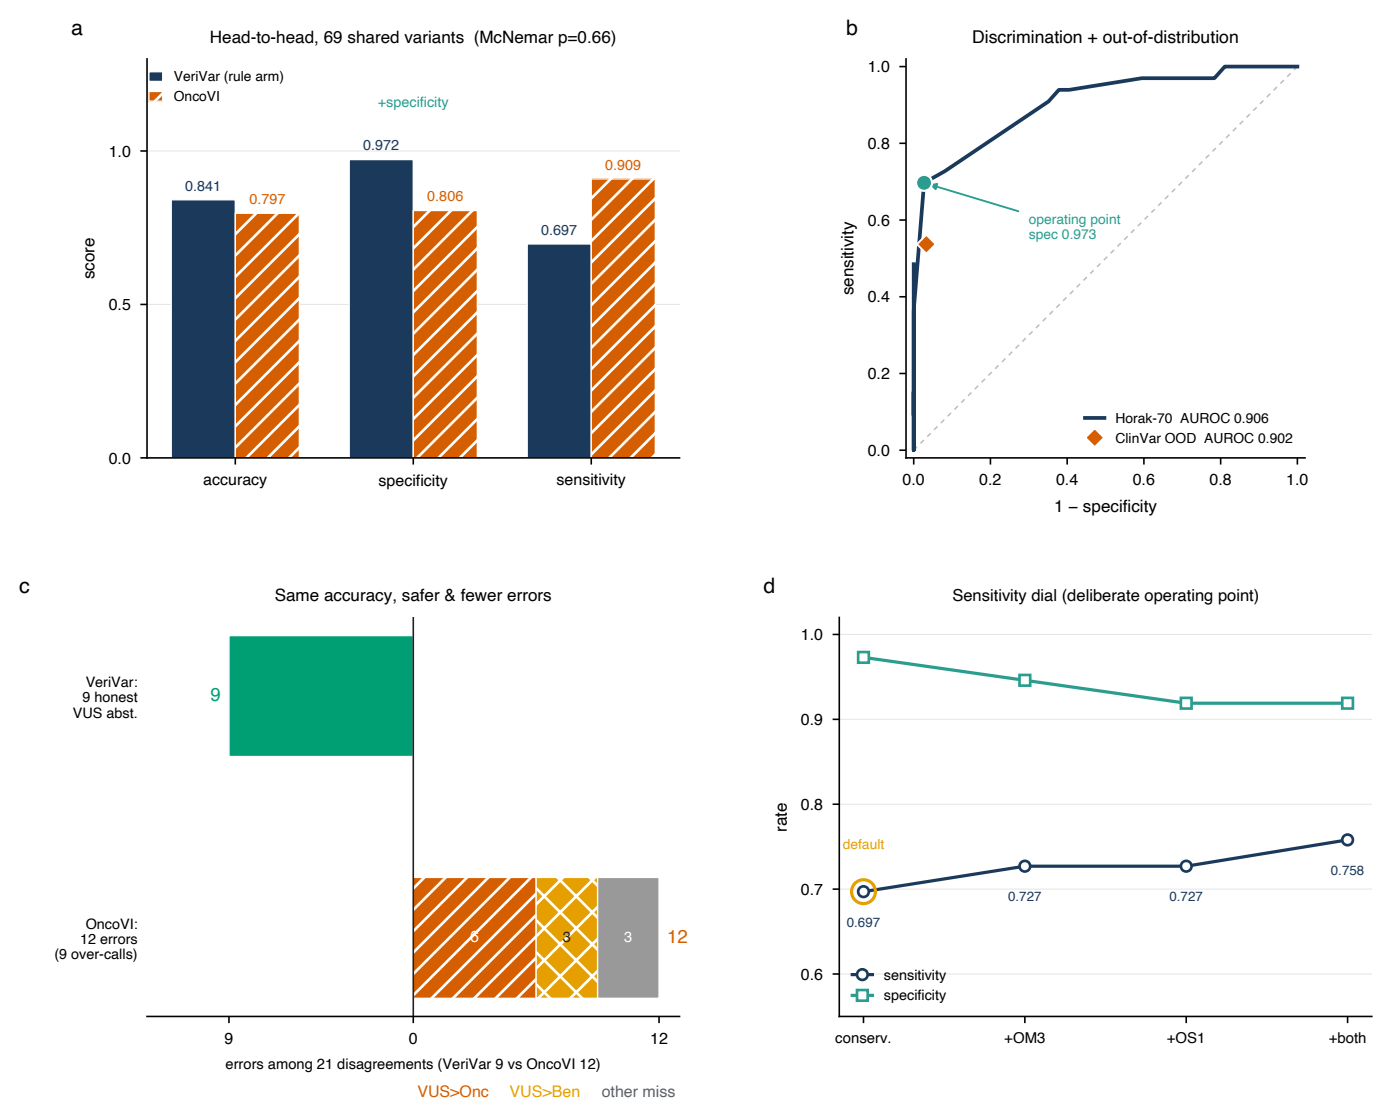
a
Head-to-head, 69 shared variants (McNemar p=0.66)
VeriVar (rule arm)
OncoVI
+specificity
score
1.0
0.5
0.0
0.841
0.797
0.972
0.806
0.697
0.909
accuracy
specificity
sensitivity
b
Discrimination + out-of-distribution
sensitivity
1.0
0.8
0.6
0.4
0.2
0.0
operating point
spec 0.973
Horak-70 AUROC 0.906
ClinVar OOD AUROC 0.902
0.0
0.2
0.4
0.6
0.8
1.0
1 – specificity
c
Same accuracy, safer & fewer errors
VeriVar:
9 honest
VUS abst.
9
OncoVI:
12 errors
(9 over-calls)
5
3
3
12
9
0
12
errors among 21 disagreements (VeriVar 9 vs OncoVI 12)
VUS>Onc
VUS>Ben
other miss
d
Sensitivity dial (deliberate operating point)
rate
1.0
0.9
0.8
0.7
0.6
default
0.697
0.727
0.727
0.758
sensitivity
specificity
conserv.
+OM3
+OS1
+both