This drawing is the property of Larsen & Toubro Limited , EDRC – B&F OC and must not be passed on to any person or body not authorised by us to receive it nor be copied or otherwise made use either in full or in part by such person or body without our prior permission in writing

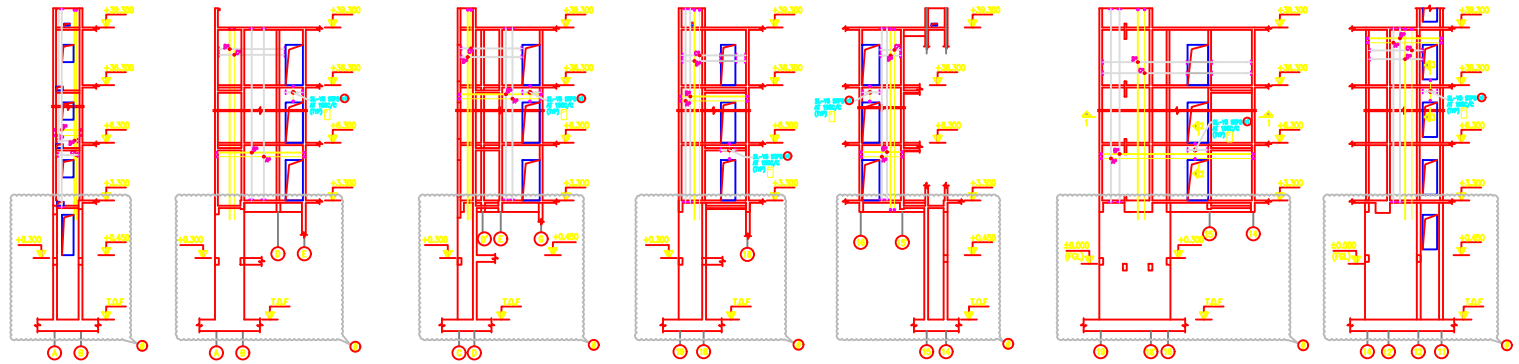

ELEVATION OF WALL W2 ALONG GRID (1)
(FOLLOW THE SAME RC DET. FOR W14)
(FOLLOW THE MIRROR RC DET. FOR W2M, W14M)

ELEVATION OF WALL W4 ALONG GRID (3)
(FOLLOW THE SAME RC DET. FOR W12)
(FOLLOW THE MIRROR RC DET. FOR W4M, W12M)

ELEVATION OF WALL W6 ALONG GRID (5)
(FOLLOW THE SAME RC DET. FOR W9)
(FOLLOW THE MIRROR RC DET. FOR W6M, W9M)

ELEVATION OF WALL W17 ALONG GRID (N)
(FOLLOW THE SAME RC DET. FOR W26)
(FOLLOW THE MIRROR RC DET. FOR W17M, W26M)

ELEVATION OF WALL W18 ALONG GRID (P)
(FOLLOW THE SAME RC DET. FOR W24)
(FOLLOW THE MIRROR RC DET. FOR W18M, W24M)

ELEVATION OF WALL W20 ALONG GRID (R)
(FOLLOW THE SAME RC DET. FOR W22)
(FOLLOW THE MIRROR RC DET. FOR W20M, W22M)

ELEVATION OF WALL W21 ALONG GRID (S)

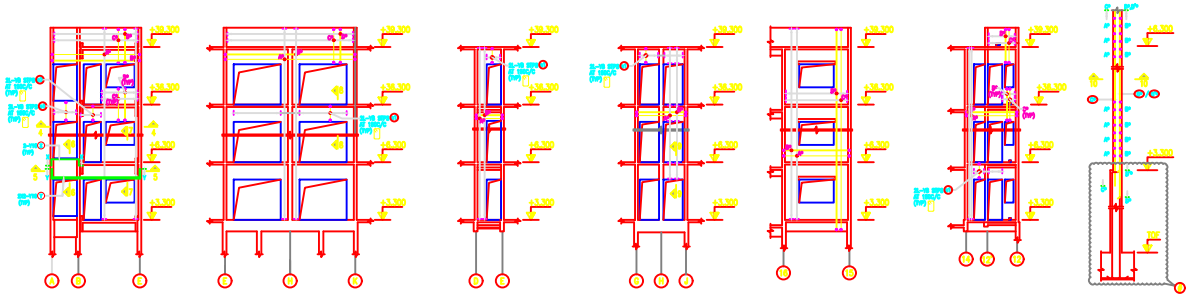

ELEVATION OF WALL W1 ALONG GRID (10)
(FOLLOW THE SAME RC DET. FOR W15)
(FOLLOW THE MIRROR RC DET. FOR W1M, W15M)

ELEVATION OF WALL W3 ALONG GRID (12)
(FOLLOW THE SAME RC DET. FOR W13)

ELEVATION OF WALL W5 ALONG GRID (14)
(FOLLOW THE SAME RC DET. FOR W11)
(FOLLOW THE MIRROR RC DET. FOR W5M, W11M)

ELEVATION OF WALL W7 ALONG GRID (17)
(FOLLOW THE SAME RC DET. FOR W8)

ELEVATION OF WALL W16 ALONG GRID (L)
(FOLLOW THE SAME RC DET. FOR W27)
(FOLLOW THE MIRROR RC DET. FOR W16M, W27M)

ELEVATION OF WALL W19 ALONG GRID (M)
(FOLLOW THE SAME RC DET. FOR W23)
(FOLLOW THE MIRROR RC DET. FOR W19M, W23M)

TYP. DETAILS OF RC WALL (SOLID WALL)
(NOT TO SCALE)

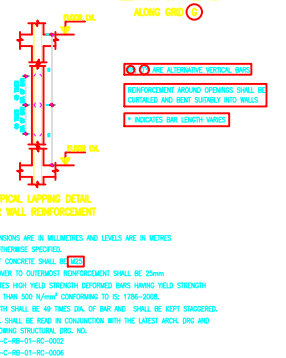

TYPICAL LAPPING DETAIL FOR WALL REINFORCEMENT

(O) (O) ARE ALTERNATIVE VERTICAL BARS

REINFORCEMENT AROUND OPENINGS SHALL BE CURTAILED AND BENT SUITABLY INTO WALLS

* INDICATES BAR LENGTH VARIES

NOTES :
1. ALL DIMENSIONS ARE IN MILLIMETRES AND LEVELS ARE IN METRES UNLESS OTHERWISE SPECIFIED.
2. GRADE OF CONCRETE SHALL BE M25
3. CLEAR COVER TO OUTERMOST REINFORCEMENT SHALL BE 25mm
4. Y– DENOTES HIGH YIELD STRENGTH DEFORMED BARS HAVING YIELD STRENGTH NOT LESS THAN 500 N/mm² CONFORMING TO IS: 1786–2008.
5. LAP LENGTH SHALL BE 49 TIMES DIA. OF BAR AND SHALL BE KEPT STAGGERED.
6. THIS DRG. SHALL BE READ IN CONJUNCTION WITH THE LATEST ARCH. DRG AND THE FOLLOWING STRUCTURAL DRG. NO.
   a. 09150–C–RB–01–RC–0002
   b. 09150–C–RB–01–RC–0006
   c. 09150–C–RB–01–NU–0012(SH 1 OF 2 & SH 2 OF 2)
   d. 09150–C–RB–01–RC–0014
   e. 09150–C–RB–01–NR–0015
   f. 09150–C–RB–01–RC–0016(SH 1 OF 2)
   g. 09150–C–RB–01–RC–0016(SH 2 OF 2)

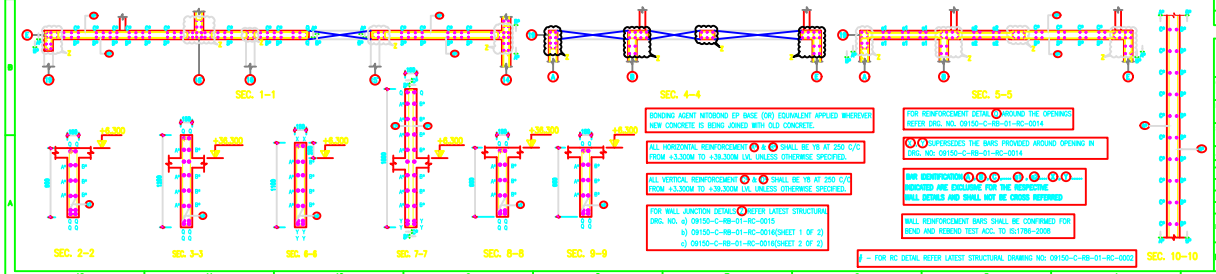

SEC. 1–1
SEC. 4–4
SEC. 5–5
SEC. 2–2
SEC. 3–3
SEC. 6–6
SEC. 7–7
SEC. 8–8
SEC. 9–9
SEC. 10–10

BONDING AGENT NITOBOND EP BASE (OR) EQUIVALENT APPLIED WHEREVER NEW CONCRETE IS BEING JOINED WITH OLD CONCRETE.

ALL HORIZONTAL REINFORCEMENT (8) & (9) SHALL BE Y6 AT 250 C/C FROM +3.300M TO +39.300M LVL UNLESS OTHERWISE SPECIFIED.

ALL VERTICAL REINFORCEMENT (8) & (9) SHALL BE Y8 AT 250 C/C FROM +3.300M TO +39.300M LVL UNLESS OTHERWISE SPECIFIED.

FOR WALL JUNCTION DETAILS (A) REFER LATEST STRUCTURAL DRG. NO. a) 09150–C–RB–01–RC–0015
b) 09150–C–RB–01–RC–0016(SHEET 1 OF 2)
c) 09150–C–RB–01–RC–0016(SHEET 2 OF 2)

FOR REINFORCEMENT DETAIL (A) AROUND THE OPENINGS REFER DRG. NO. 09150–C–RB–01–RC–0014

(O) (O) SUPERSEDES THE BARS PROVIDED AROUND OPENING IN DRG. NO: 09150–C–RB–01–RC–0014

BAR IDENTIFICATION (A) (B) ---- (X) (B) (X) (A) ---- MODIFIED ARE EXCLUSIVE FOR THE RESPECTIVE WALL DETAILS AND SHALL NOT BE CROSS REFERRED

WALL REINFORCEMENT BARS SHALL BE CONFIRMED FOR BEND AND REBEND TEST ACC. TO IS1786–2008

A – FOR RC DETAIL REFER LATEST STRUCTURAL DRAWING NO: 09150–C–RB–01–RC–0002

REV.	DESCRIPTION	DRAWN	CHECKED	APPROVED
0	ISSUED FOR CONSTRUCTION			

REVISIONS

LARSEN & TOUBRO LIMITED
EDRC - B&F OC

CLIENT : GODREJ PROPERTIES LTD.
CONSULTANT : P.G.PATKI ARCHITECTS PVT. LTD.
PROJECT : GODREJ GARDEN CITY AT AHMEDABAD
SUPPLIER / CONTRACTOR :

JOB No. : O9150

	NAME	SIGN	DATE
DRN	SPM		20.07.10
DSN	VDM		20.07.10
CHD	GHS		04.08.10
APPD	TMS		04.08.10

TITLE : 2BHK STANDARD
RC DET. OF WALLS FROM FIRST FLOOR LEVEL TO TERRACE FLOOR LEVEL (+3.300M TO +39.300M LVL)

SCALE 1:100,125
PROJECION

DRG. No. O 9 1 5 0 - C - R B - 0 1 - R C - 0 0 1 3
SHEET 1 OF 1

SIZE A1 REV. 0

ISSUED FOR: ☐ PRELIMINARY ☐ TENDER ☐ INFORMATION ☐ APPROVAL ☑ CONSTRUCTION