
a Data-centre portfolio

Per-site physical model

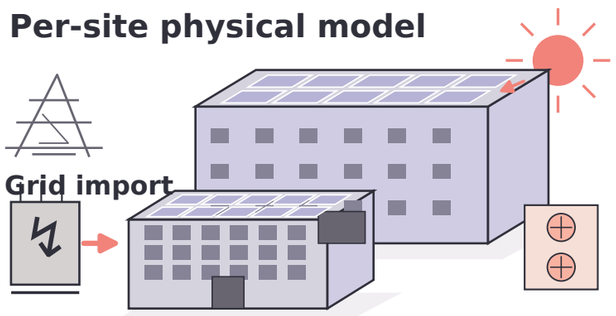


≤ 2.15 MW **PV 1.00 MW**

IT 1.64 MW + idle 0.23 MW

PUE 1.02–1.09 · zero exports

Configured NYISO locations

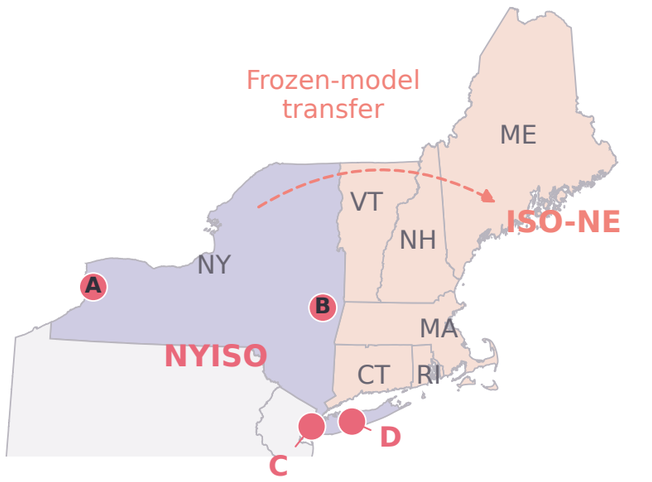


A WEST · Buffalo **B CAPITL · Albany**


C N.Y.C. · New York **D LONGIL · Long Island**

Modelled sites; Census state outlines

b WorldMoE architecture

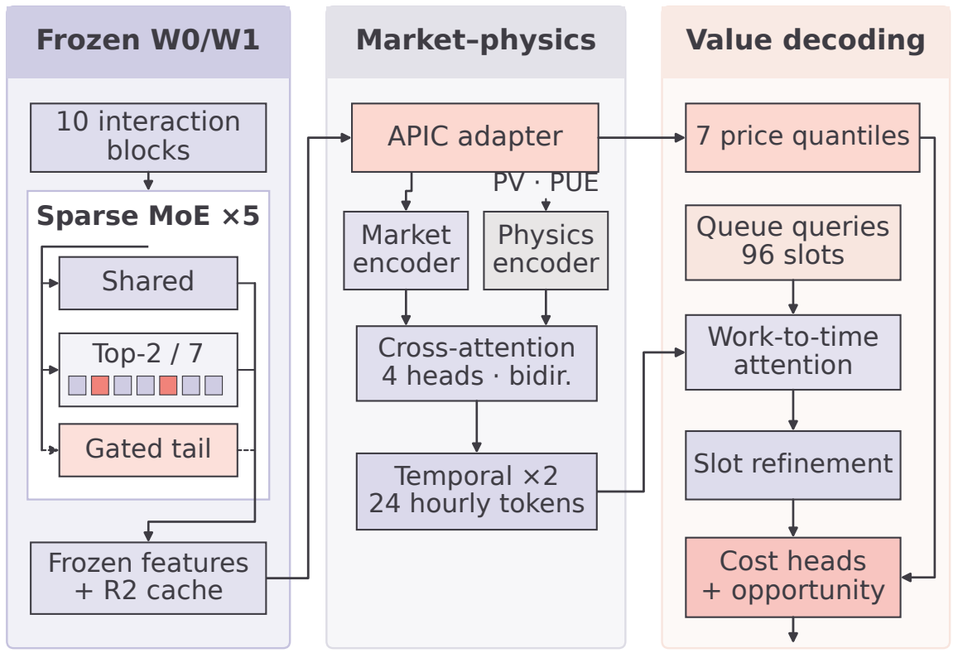

$$q_{t+1} = q_t + a_t - x_t$$

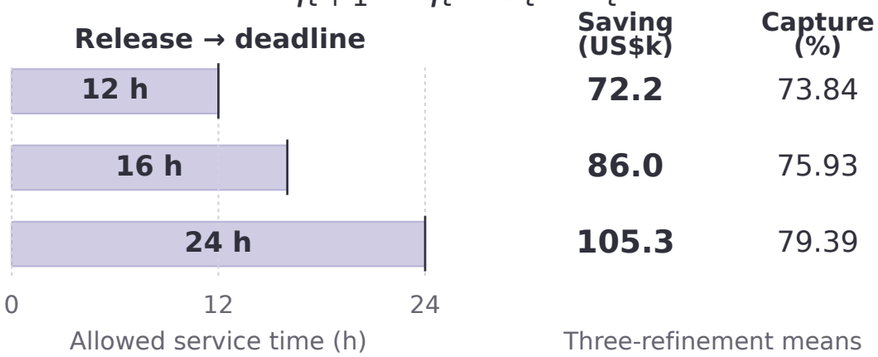

Execute the current 15 min action

Capacity · deadlines · power balance


All windows: late $< 10^{-8}$ IT MWh; closing work = 0

c Value and grid response

2025 · 24 h · archived pipelines


US$105,271

WorldMoE saving · 18.96%

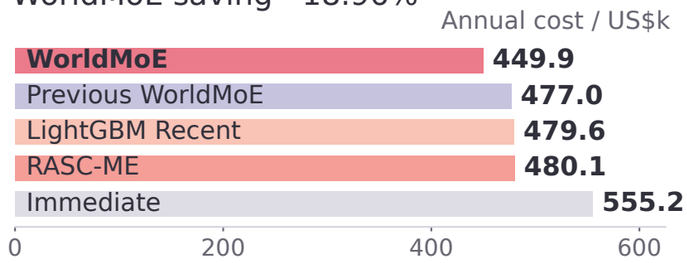

Captured 79.39% of US$132.6k ceiling

Full-year mean hourly imports

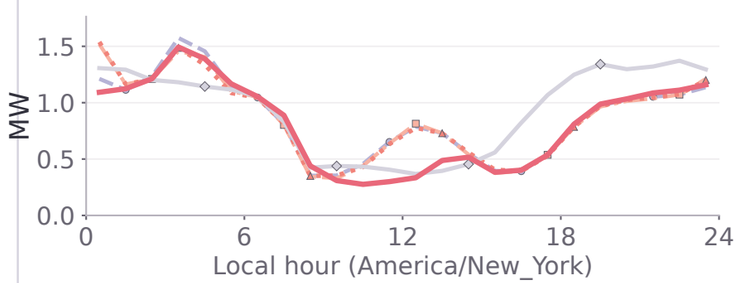

WorldMoE vs immediate execution

High-price imports −23.82%

95th-percentile absolute ramp

1.2432 → 0.7607 MW / 15 min

Annual hourly peak

8.1737 → 8.1742 MW