

Total Cooling Load (TR)
297.30K

Total Compressor Energy (kWh)
1.62M

Total Energy Cost (INR)
13.78M

Avg Fouling Factor
1.08

Avg COP
4.60

Chiller_ID	Chiller_Type	Avg COP	Avg Fouling Factor	Avg Vibration	Max Run Hours	Mode	Chiller Statu
CH-01	Centrifugal	5.71	1.07	3.33	16,183.90	Critical	
CH-02	Centrifugal	5.71	1.07	3.32	16,050.90	Critical	
CH-03	Screw	4.96	1.08	3.23	14,793.30	Critical	
CH-04	Screw	4.96	1.07	3.22	14,755.40	Critical	
CH-05	Absorption	0.70	1.08	3.55	15,866.70	Critical	
Total		4.60	1.08	3.32	16,183.90	Critical	

Chiller_ID

- ☐ CH-01
- ☐ CH-02
- ☐ CH-03
- ☐ CH-04
- ☐ CH-05

Chiller_Status

- ☒ Critical
- ☐ Healthy
- ☐ Warning


Year

- > ☐ 2023
- > ☐ 2024
- > ☐ 2025

Chiller_Type

- ☐ Absorption
- ☐ Centrifugal
- ☐ Screw


Avg COP and Sum of Hour_of_Day

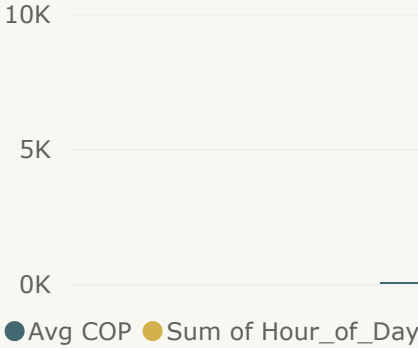

Record Count
by Chiller_Status




Avg COP
by MonthName

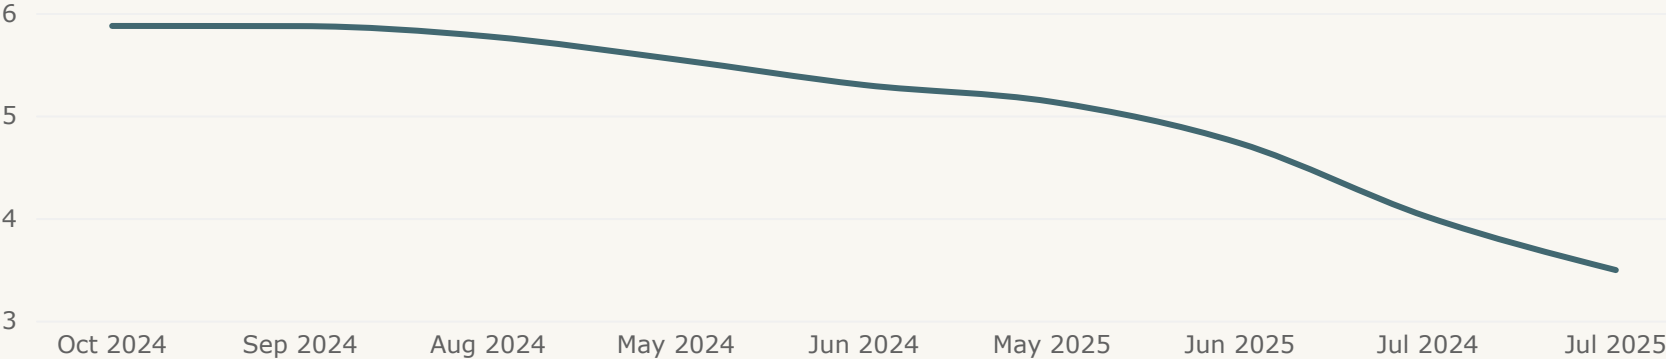


Sum of Cumulative_Run_Hours and Sum of Vibration_mm_s
by Chiller_ID




Sum of Fouling_Factor and Sum of COP
by Chiller_ID

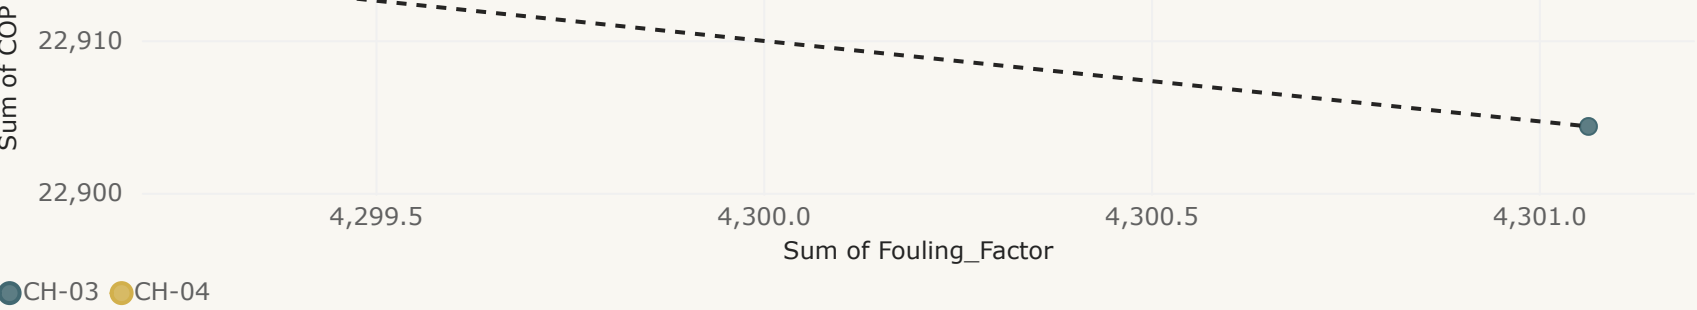

Sum of Ambient_WetBulb_C and Sum of COP
by Chiller_ID

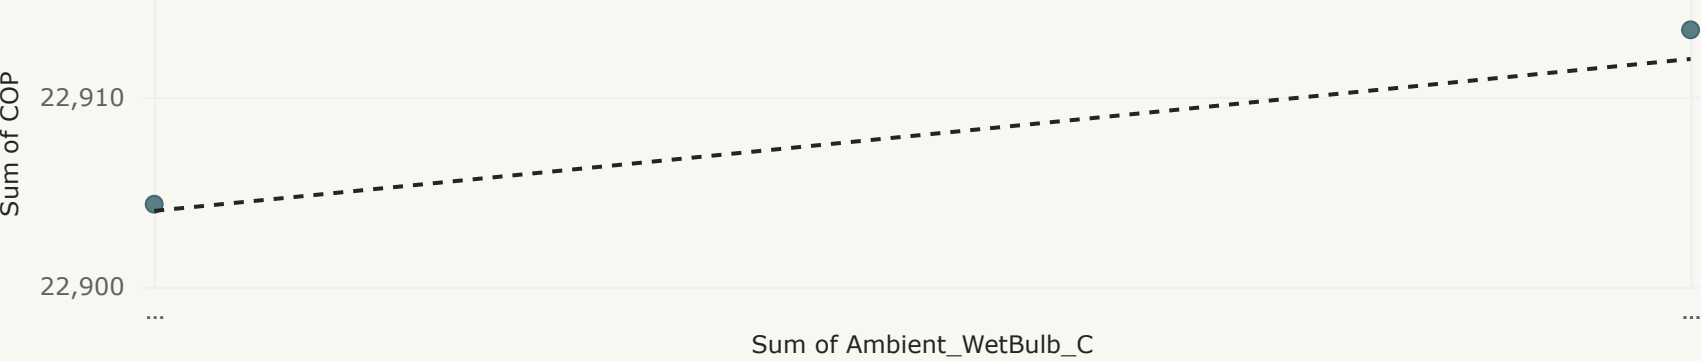

Record Count
by Fault_Code and Chiller_Type

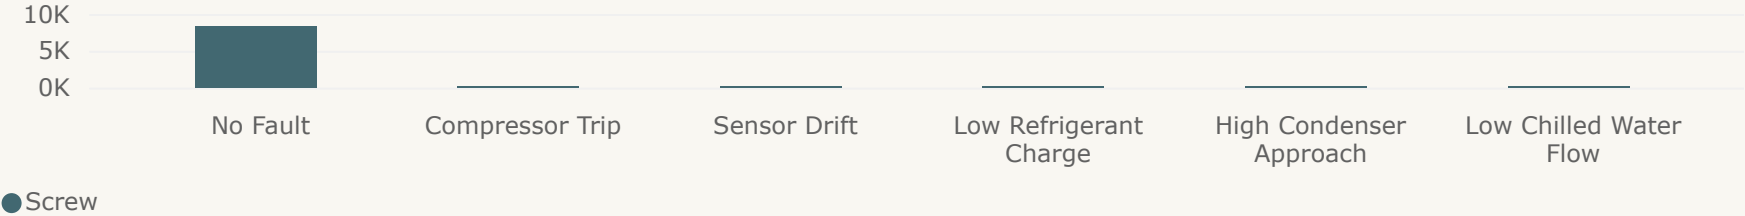


Chiller_Type

- ☐ Absorption
- ☐ Centrifugal
- ☒ Screw

Chiller_ID
CH-01

Fault_Code
No Fault

Chiller_

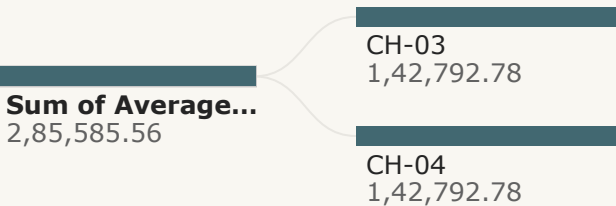

Key influencers Top segments

What influences Is_Critical to Increase ?

When...

Sum of Condenser_Approa... is more than 4.74

Sum of Condenser_Approa... is 4.59 - 4.74

Sum of Ambient_WetBulb_C is 29.6 - 32.1

Sum of Condenser_Approa... is 4.18 - 4.59

Sum of Vibration_mm_s is more than 3.54

Sum of Fouling_Factor is more than 1.103

Sum of Fouling_Factor is 1.048 - 1.103

....the average of Is_Critical increases by

0.93

0.7

0.38


0.27

0.22

0.21

0.14

Is_Critical is more likely to increase when Sum of Condenser_Approach_C is more than 4.74 than otherwise (on average).

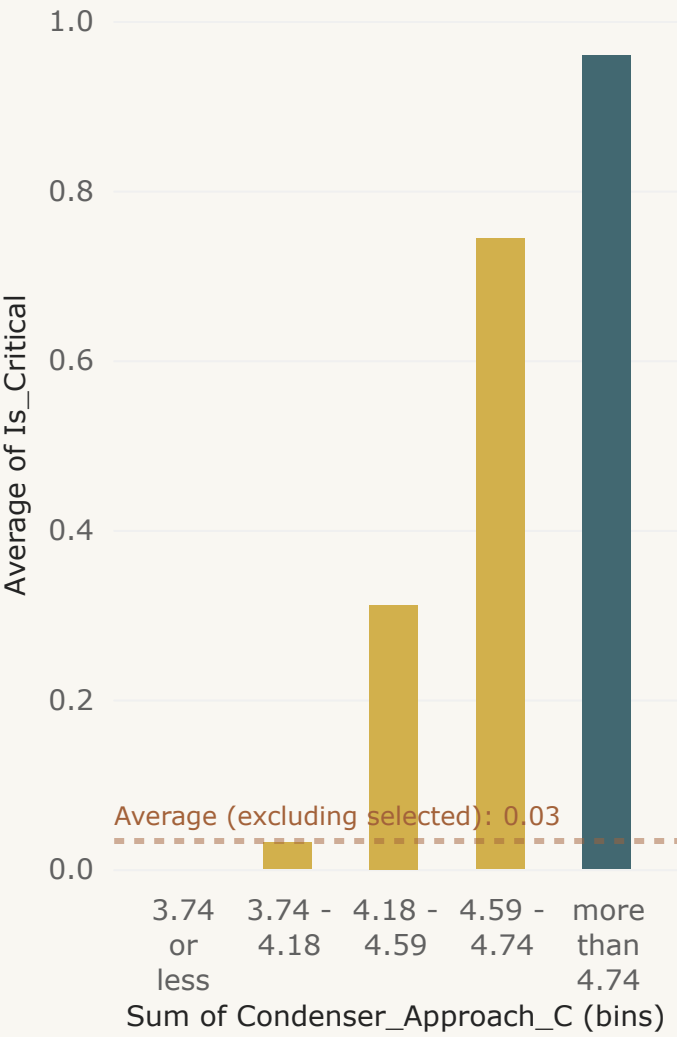

Only show values that are influencers