

Total Cost (INR)

9.43M

Total Energy (kWh)

1.09M

Total Solar (kWh)

128.16K

Total CO2 (kg)


800.20K

Solar Offset %

11.75%


Sum of Total_Energy_kWh

by MonthName

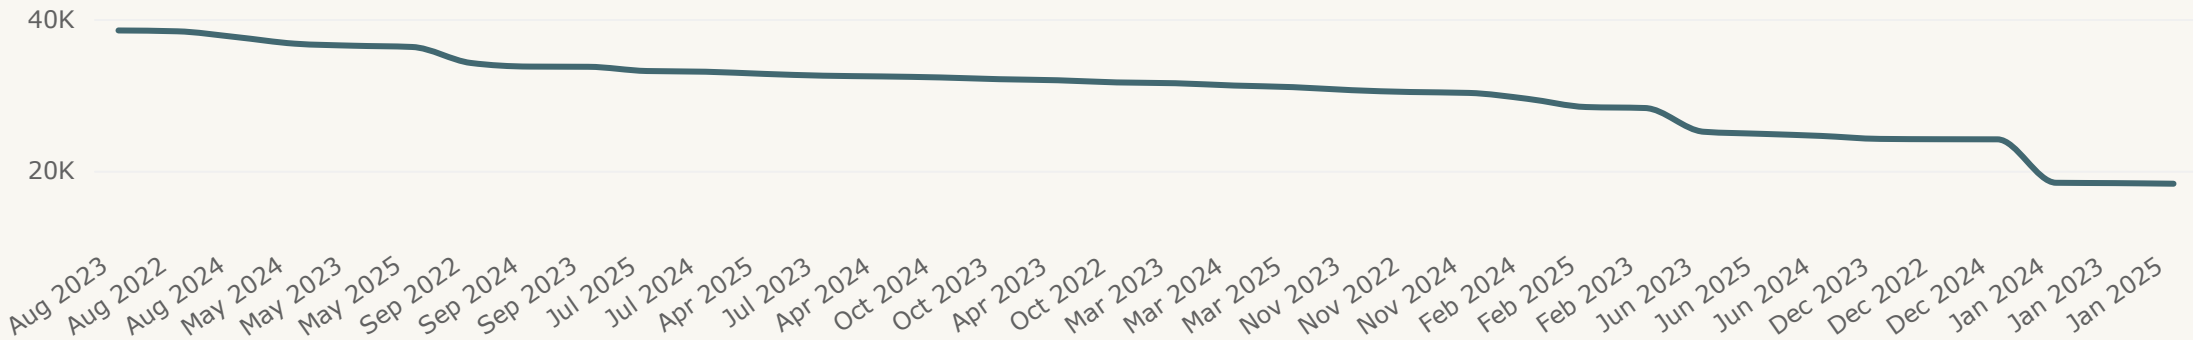


Sum of Total_Energy_kWh

by Day_Type

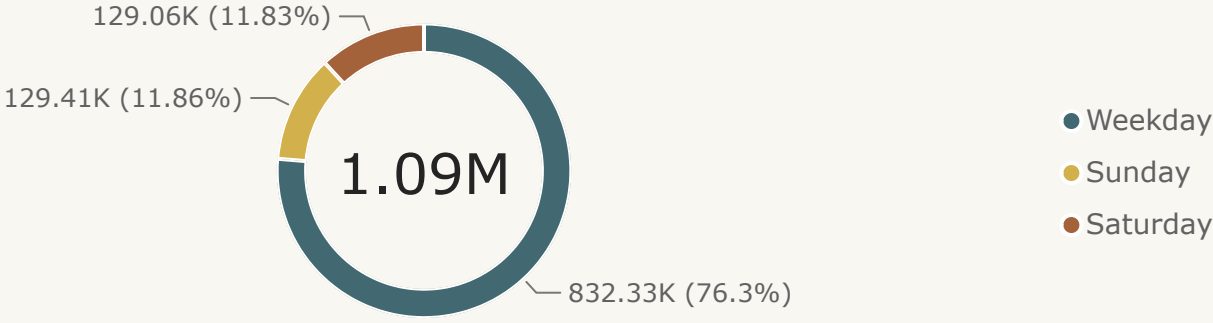


Sum of Total_Energy_kWh

by Column2

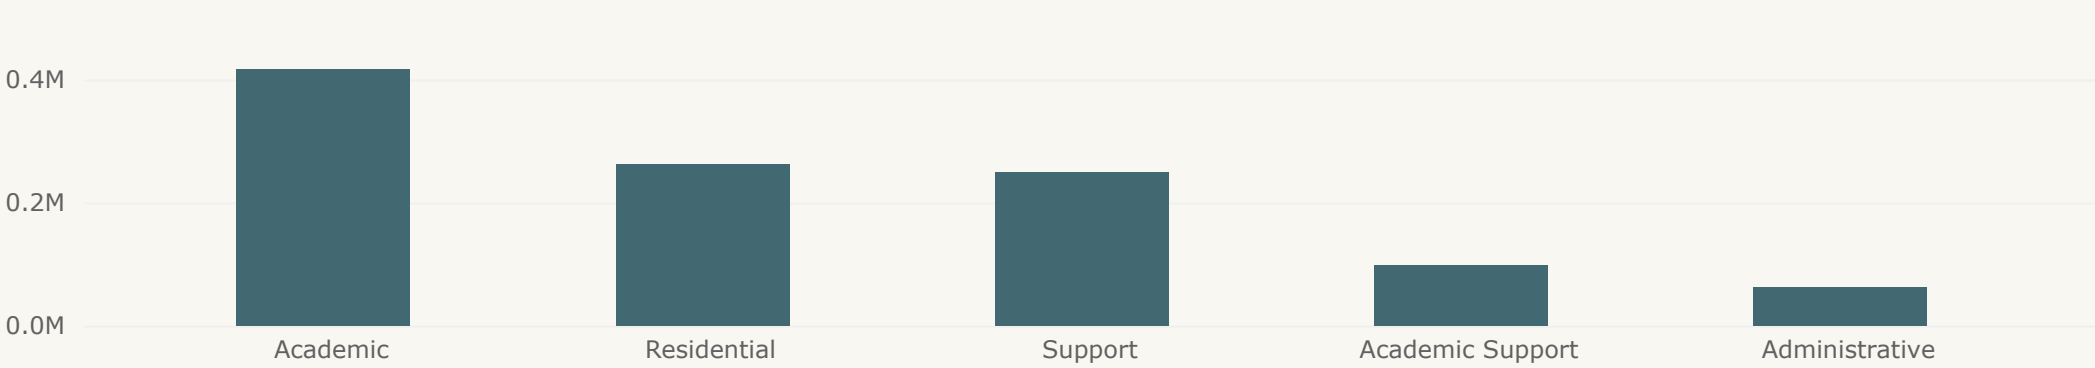

Sum of Total_Energy_kWh

by Academic_Period

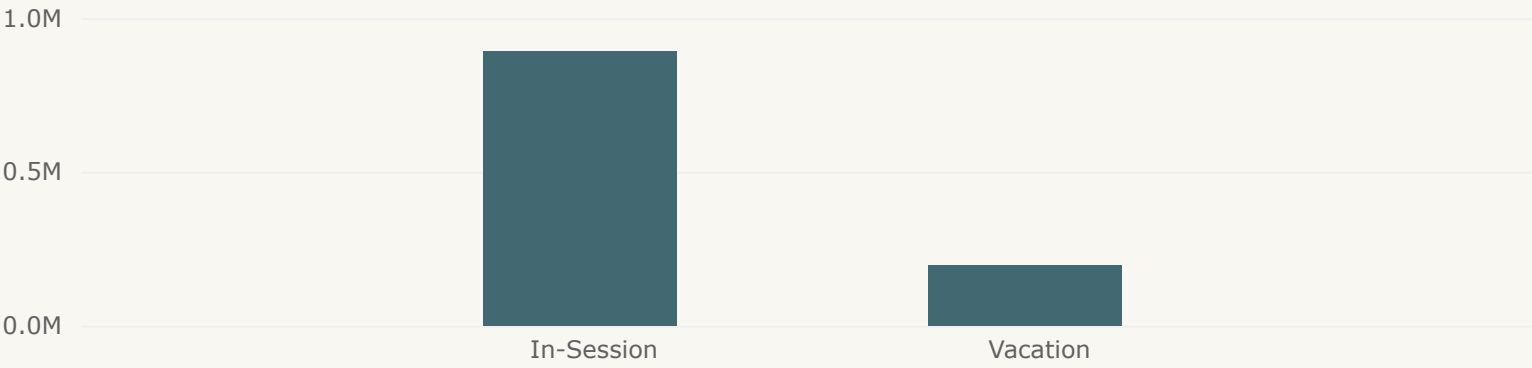

Building	Sum of Total_Energy_kWh	Total Cost (INR)	Total CO2 (kg)	Solar Off
Admin Block	62,453.66	3,84,207.56	30,242.47	5.1
Auditorium	77,188.77	7,34,237.41	63,294.82	(
Boys Hostel	1,39,028.91	13,22,775.21	1,14,003.62	(
Canteen	99,059.48	9,41,859.67	81,228.55	(
Total	10,90,802.35	94,34,518.47	8,00,197.45	11

Year

- > ☐ 2022
- > ☐ 2023
- > ☐ 2024
- > ☐ 2025

Building_Type

- ☐ Academic
- ☐ Academic Support
- ☐ Administrative
- ☐ Residential
- ☐ Support

Academic_Peri...

- ☐ In-Session
- ☐ Vacation


Day_Type

- ☐ Saturday
- ☐ Sunday
- ☐ Weekday


Shift

- ☐ Day
- ☐ Night

Building_Type, Ambient_Temp_C and HVAC_Load_kWh

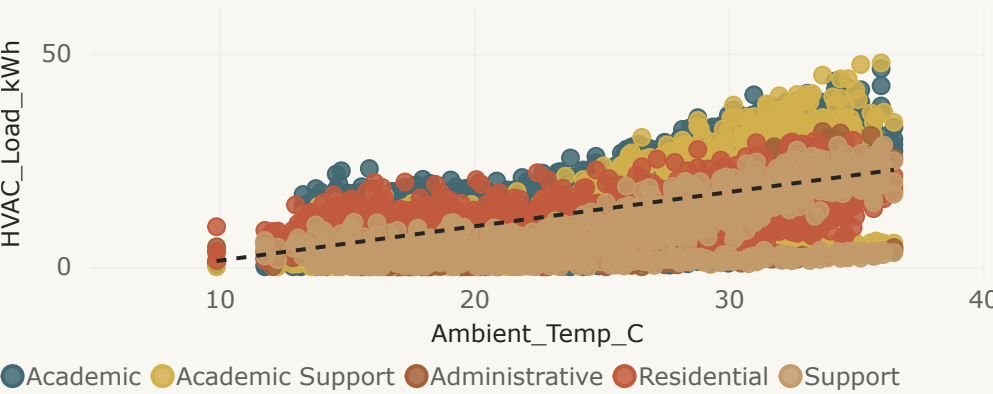

Total Energy (kWh)
by Building_Type and Occupancy_Count

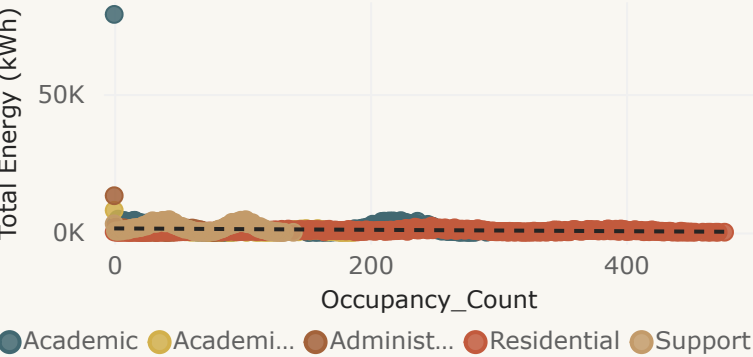

Building	Sum of Grid_Outage_Flag	Total CO2 (kg)	Sum of Diesel_Backup_Hours
Admin Block	86	30,242.47	111
Auditorium	86	63,294.82	63
Boys Hostel	86	1,14,003.62	104
Canteen	86	81,228.55	117
Central Library	86	56,803.30	104
Civil Dept	86	77,190.33	86
Computer Science Dept	86	72,349.37	122
Electrical Dept	86	62,206.01	105
Girls Hostel	86	1,01,814.64	112
Mechanical Dept	86	80,821.98	89
Sports Complex	86	60,242.36	108
Total	946	8,00,197.45	1121

Key influencers Top segments

What influences Is_High_Consumption to be ?

When...

Sum of
Occupancy_Count
goes up 98.56

Academic_Period is In-Session

Building_Type is Residential

Day_Type is Weekday

Shift is Day

Sum of
Ambient_Temp_C is
23.2 - 30.2

Building_Type is Academic Support

Sum of
Ambient_Temp_C is
more than 30.2

....the likelihood of
Is_High_Consumption
being High increases
by

33.28x

3.60x

2.53x

1.91x


1.67x

1.43x

1.36x

1.15x

← On average when Sum of Occupancy_Count increases, the likelihood of Is_High_Consumption being High increases.

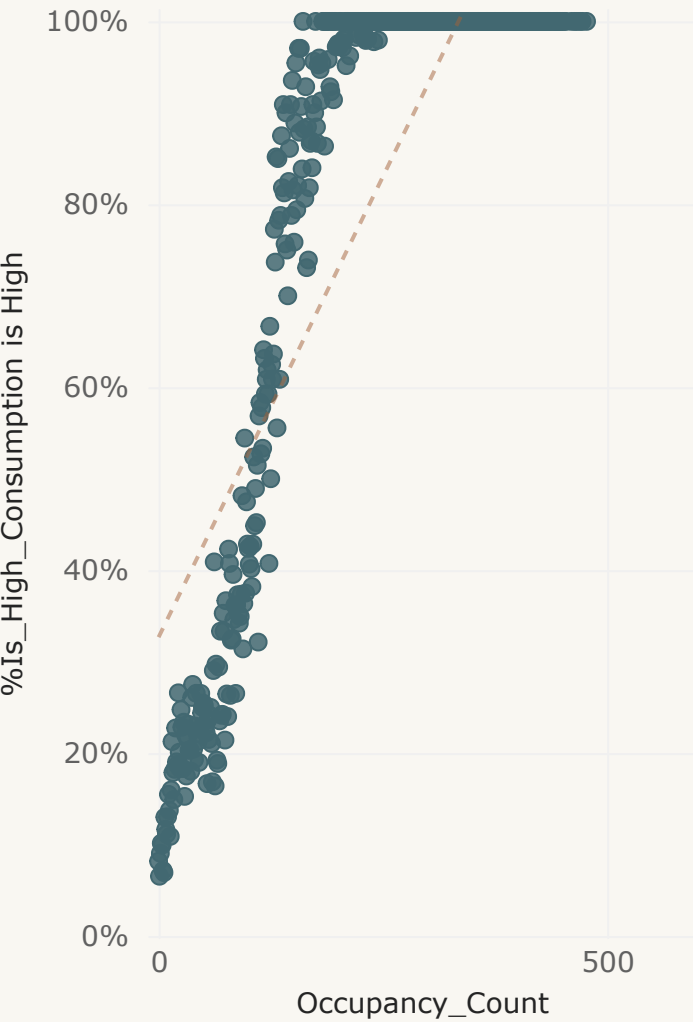

Average of Equipment_Load_kWh and Average of Power_Factor

