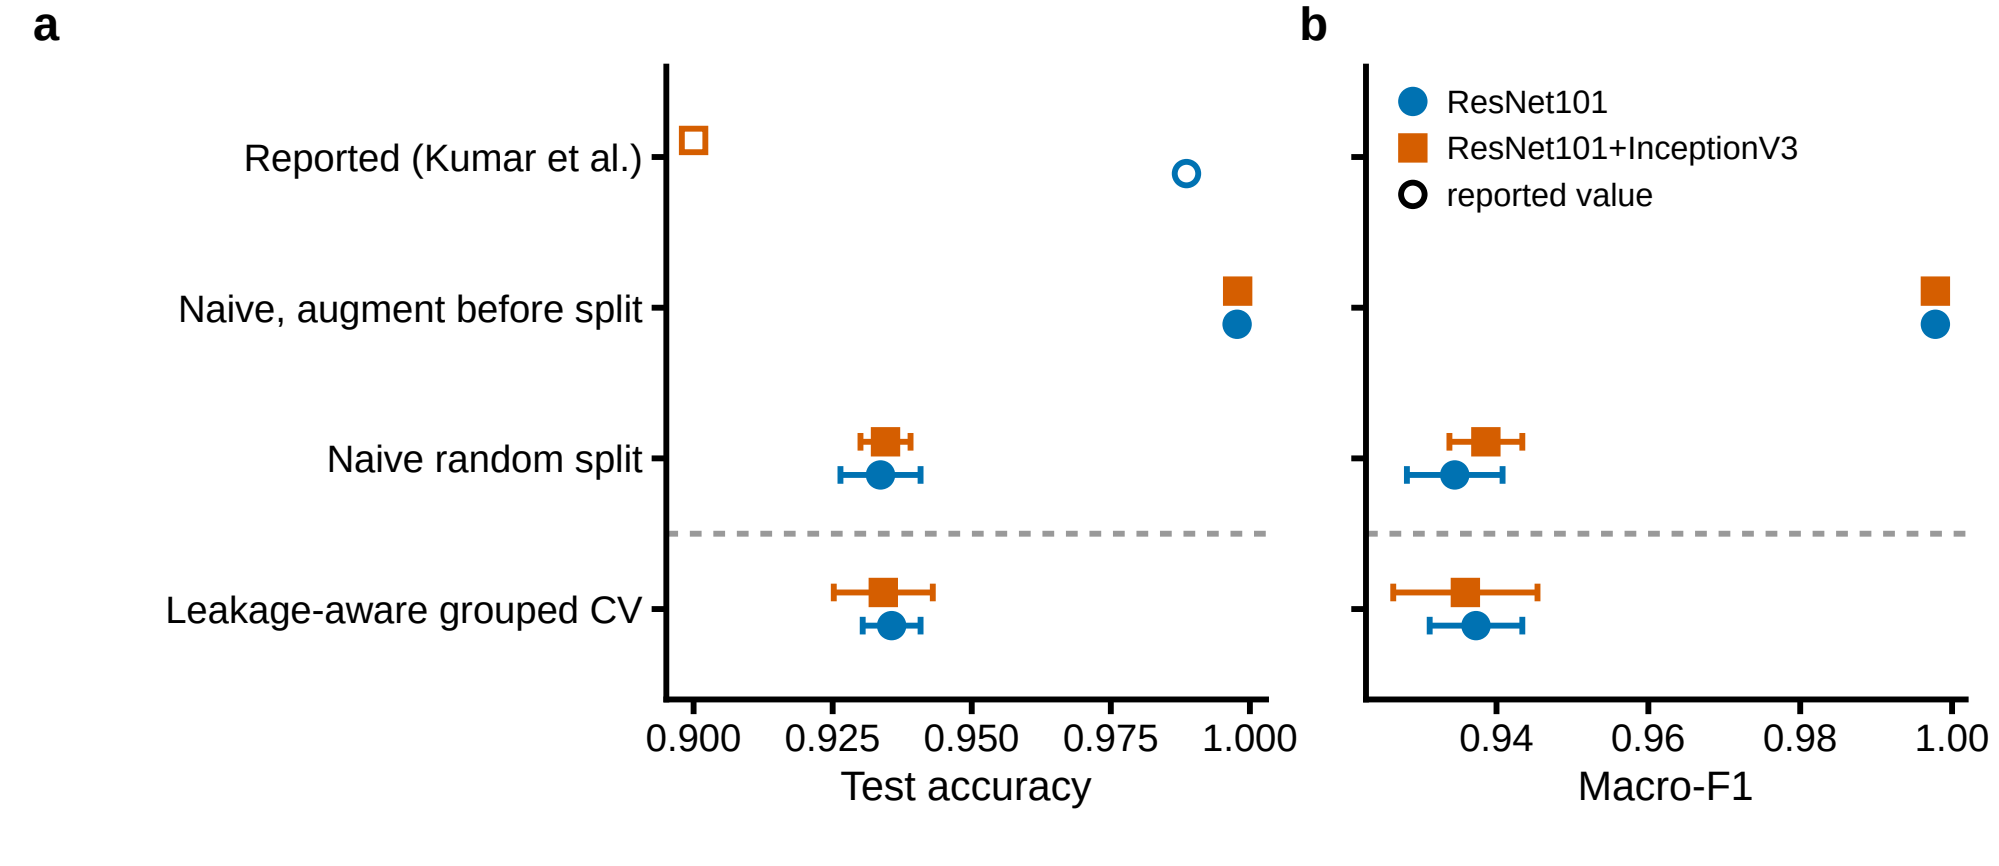
a
b
Reported (Kumar et al.)
Naive, augment before split
Naive random split
Leakage-aware grouped CV
0.900
0.925
0.950
0.975
1.000
Test accuracy
ResNet101
ResNet101+InceptionV3
reported value
0.94
0.96
0.98
1.00
Macro-F1