



STD-WW-04. TYPICAL SEWER/SERVICE PIPE CONNECTION.
NTS

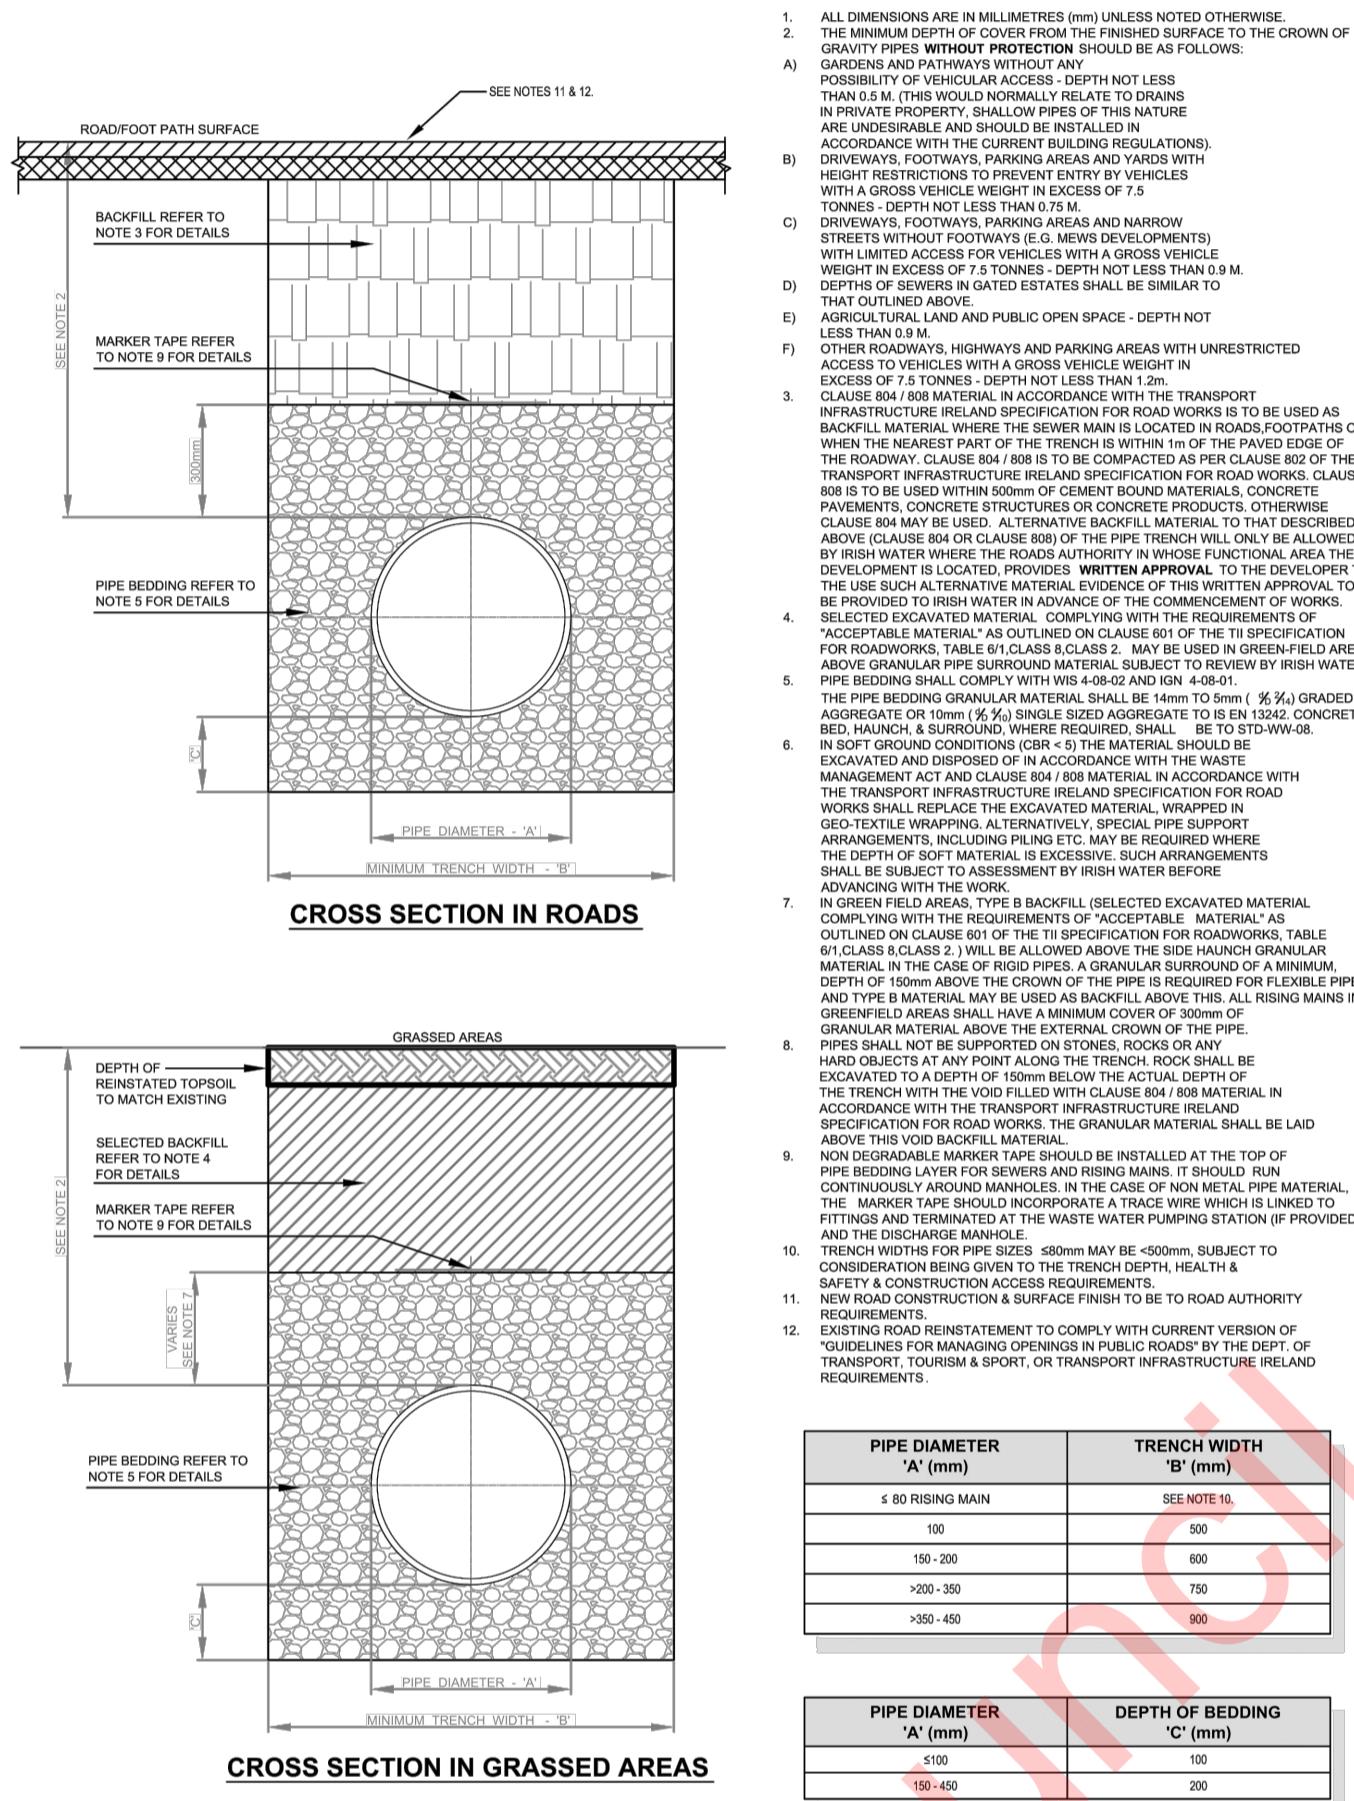

STD-WW-07. TRENCH BACKFILL AND BEDDING.
NTS

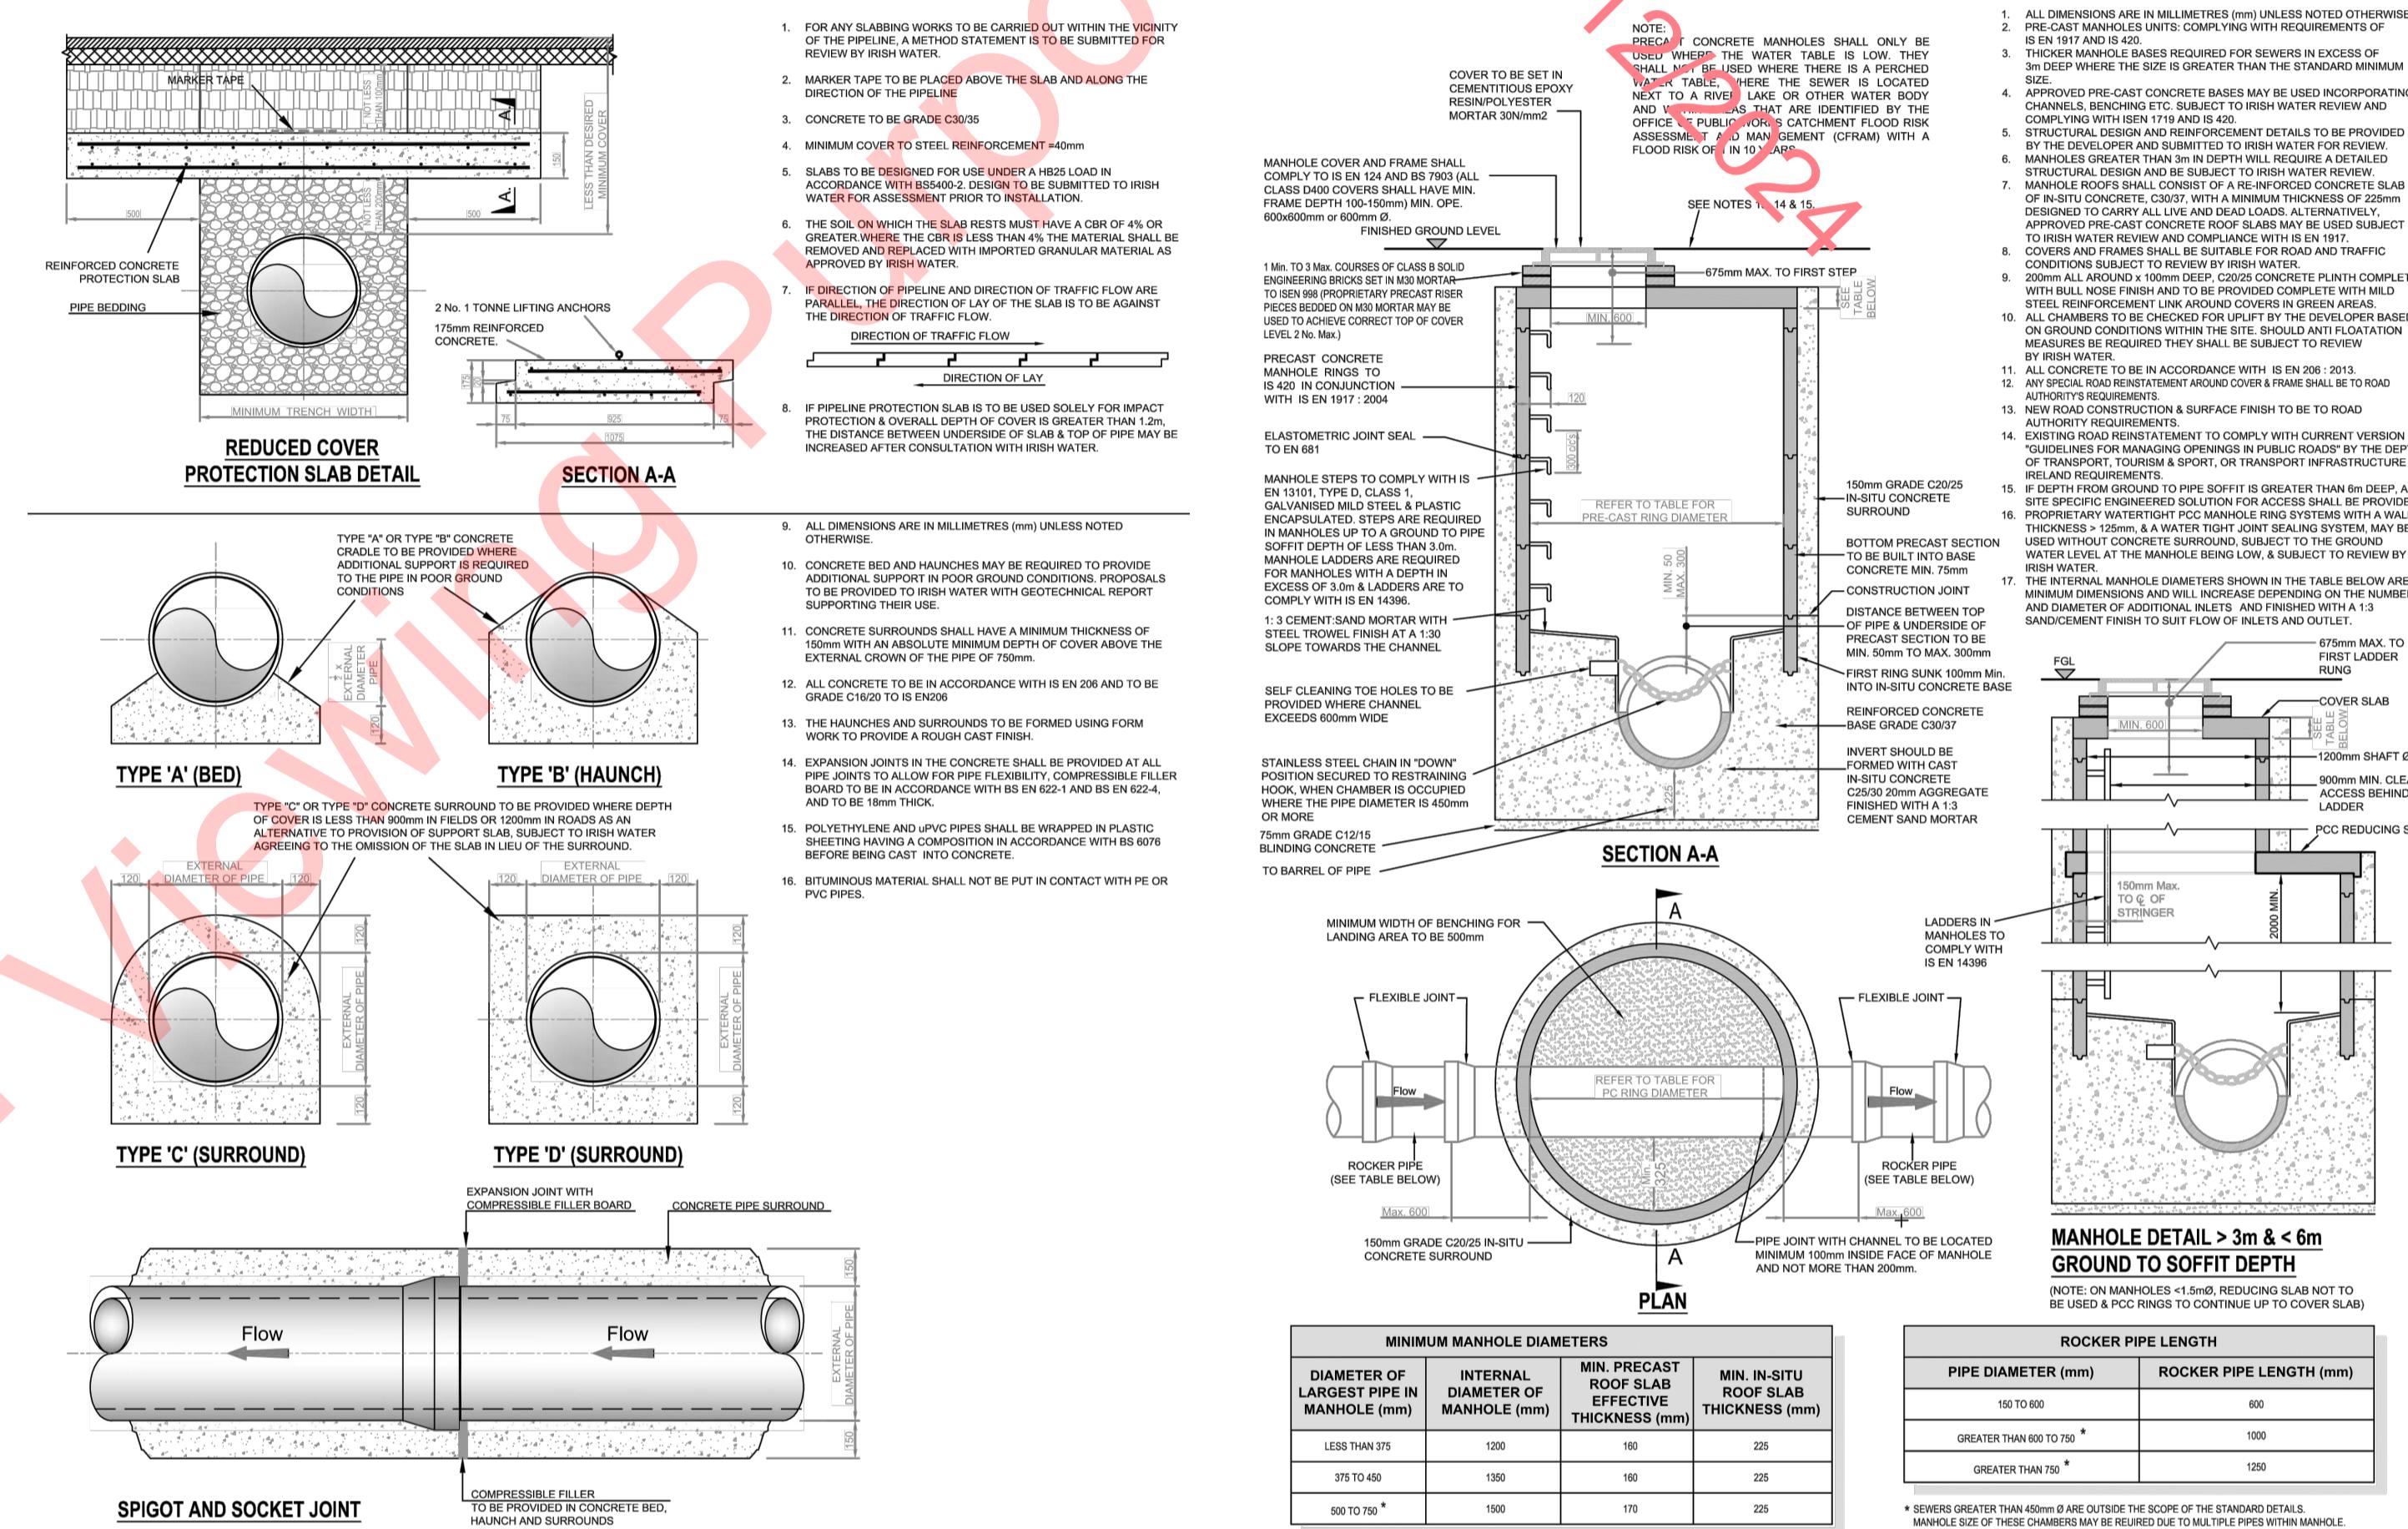

STD-WW-08. CONCRETE PROTECTION SLAB, BED,
HAUNCH, AND SURROUND, TO WASTEWATER PIPES.
NTS

STD-WW-10. PRECAST CONCRETE MANHOLE
WITH CAST IN-SITU BASE.
NTS

DRAFT

PLANNING DRAWING.
NOT FOR CONSTRUCTION.
ALL LEVELS GIVEN ARE
RELATIVE TO ORDNANCE DATUM.
THIS DRAWING HAS BEEN ISSUED FOR INFORMATION
PURPOSES ONLY AND MUST NOT BE USED
FOR CONSTRUCTION UNDER ANY CIRCUMSTANCES

NOTES

- For setting out refer to Architect's drawings.
- This drawing to be read in conjunction with all other Architectural and Engineering drawings and all other relevant drawings and Specifications.
- DO NOT SCALE THIS DRAWING. Use figured dimensions only.
- No part of this document may be reproduced or transmitted in any form or stored in any retrieval system of any nature without the written permission as copyright holder except as agreed.
- Ordnance Survey Ireland Licence Number EN 0074024

Rev. No.	Date	REVISION NOTE	Dm. By	Chkd. By

Architect	Darmody Architecture				
Project	Johnstown Estate				
Title	FOUL WATER DETAILS				
Dwg. No.					
L118-CSC-ZZ-XX-DR-C-0103					
Date	Dm. by	Chkd. by	Aprvd. by	Scale	Revision
Oct 2024	AB	CF	MME	AS SHOWN	

CS Consulting Group	I.S. EN ISO 9001:2008
Quality	I.S. EN ISO 14001:2004
Environment	I.S. EN ISO 50001:2011
NSAI Certified	OHSAS 18001:2007