


## 4.4 Elevator Maintenance Barricades

- (a) Barricade shall be positioned to restrict public access to the hoistway where doors are open greater than 5 in. (125 mm).
- (b) Barricade shall be a minimum of 42 in. (1067 mm) high.
- (c) Barricade shall cover entire entrance area.
- (d) All sections shall be connected.
- (e) A system shall be in place to keep the barricade rigid.
- (f) See Figure 4g.

**Figure 4g**

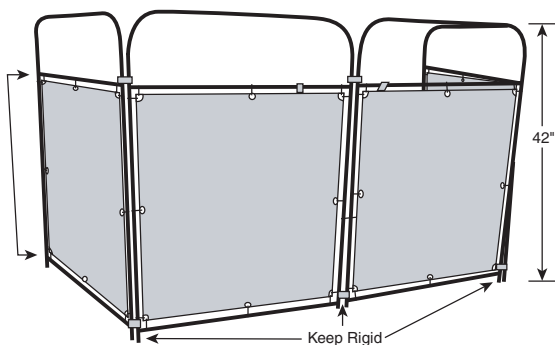

**Barricade**