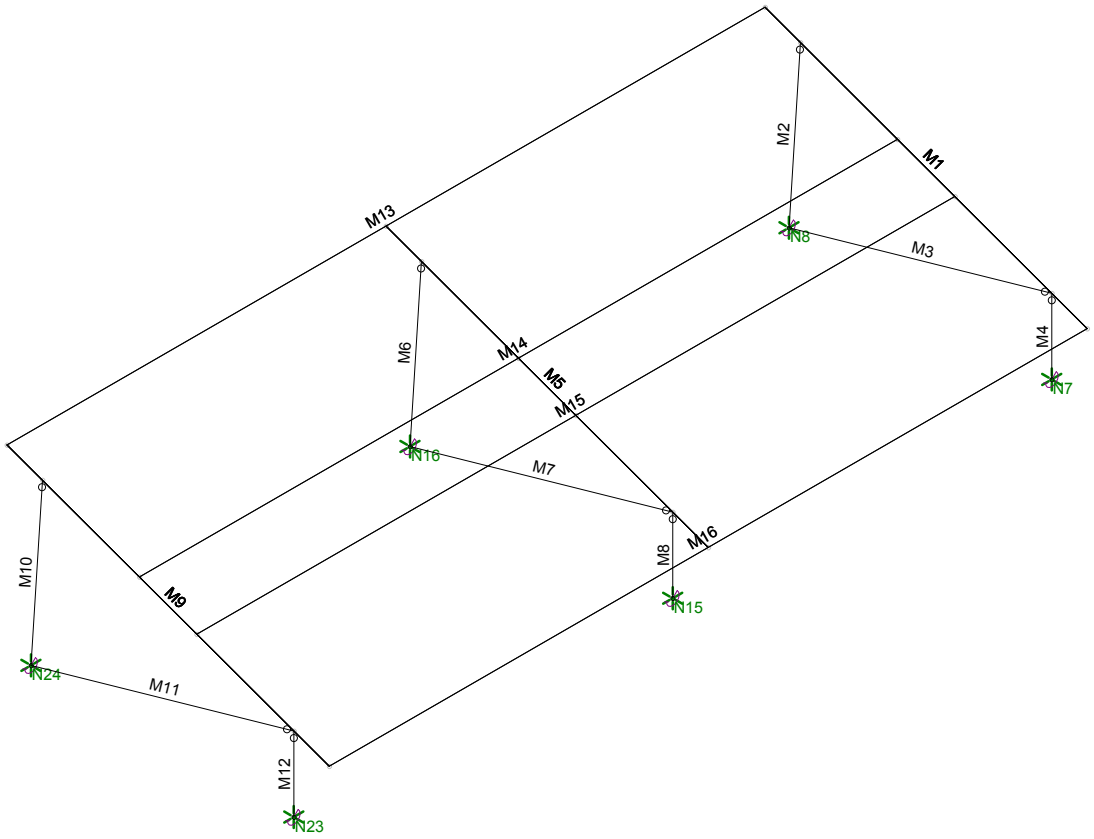

Schletter, Inc.		20° Tilt w/ Seismic Design
HCV	Standard PVMax Racking System	
	Representative Calculations - ASCE 7-10	

1. INTRODUCTION

1.1 Project Description

The following sections will cover the determination of forces and structural design calculations for the Schletter, Inc. PVMax ground mount system.

1.2 Construction

Photovoltaic modules are attached to aluminum purlins using clamp fasteners. Purlins are clamped to inclined aluminum girders, which are then connected to aluminum struts. Each support structure is equally spaced.

PV modules are required to meet the following specifications:

	Maximum		Minimum	
Height =	1700	mm	1550	mm
Width =	1050	mm	970	mm
Dead Load =	3.00	psf	1.75	psf

Modules Per Row =	2
Module Tilt =	20°
Maximum Height Above Grade =	3 ft

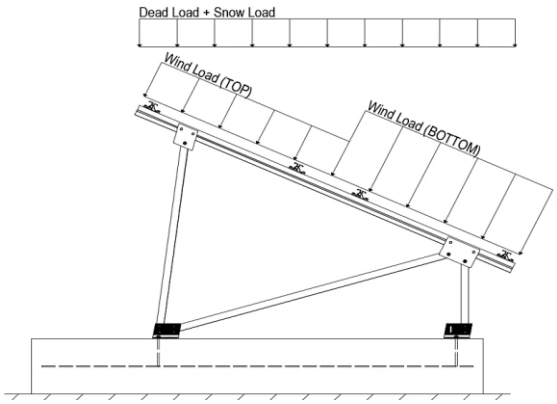

Typical loading conditions of the module dead loads, snow loads, and wind loads are shown on the left.

1.3 Technical Codes

- ASCE 7-10 - Chapter 26-31, Wind Loads
- ASCE 7-10 - Chapter 7, Snow Loads
- ASCE 7-10 - Chapter 2, Combination of Loads
- International Building Code, IBC, 2012, 2015
- Aluminum Design Manual, Eighth Edition, 2005

2. LOAD ACTIONS

2.1 Permanent Loads

g_{MAX} =	3.00	psf	*Self-weight of the PV modules.*
g_{MIN} =	1.75	psf	

2.2 Snow Loads

Ground Snow Load, P_g =	30.00	psf	
Sloped Roof Snow Load, P_s =	20.62	psf	*(ASCE 7-10, Eq. 7.4-1)*
I_s =	1.00		
C_s =	0.91		
C_e =	0.90		
C_t =	1.20		

2.3 Wind Loads

Design Wind Speed, V =	115	mph	Exposure Category = C
Height <	15	ft	Importance Category = II
Peak Velocity Pressure, q_z =	20.76	psf	*Including the gust factor, G=0.85. (ASCE 7-10, Eq. 27.3-1)*

Pressure Coefficients

$Cf+_{TOP}$ =	1.050	*(Pressure)*	*Provided pressure coefficients are the result of wind tunnel testing done by Ruscheweyh Consult. Coefficients are located in test report # 1127/0611-1e. Negative forces are applied away from the surface.*
$Cf+_{BOTTOM}$ =	1.650		
$Cf-_{TOP, OUTER PURLIN}$ =	-2.400		
$Cf-_{TOP, INNER PURLIN}$ =	-1.840	*(Suction)*	
$Cf-_{BOTTOM}$ =	-1.000		

2.4 Seismic Loads

S_S =	2.50	R =	1.25	*ASCE 7, Section 12.8.1.3: A maximum S_s of 1.5 may be used to calculate the base shear, C_s, of structures under five stories and with a period, T, of 0.5 or less. Therefore, a S_{ds} of 1.0 was used to calculate C_s.*
S_{DS} =	1.67	C_S =	0.8	
S_1 =	1.00	ρ =	1.3	
S_{D1} =	1.00	Ω =	1.25	
T_a =	0.05	C_d =	1.25	

2.5 Combination of Loads

ASCE 7 requires that all structures be checked by specified combinations of loads. Applicable load combinations are provided below.

Strength Design, LRFD

Component stresses are checked using the following LRFD load combinations:

1.2D + 1.6S + 0.5W
1.2D + 1.0W + 0.5S
0.9D + 1.0W [M]
1.54D + 1.3E + 0.2S [R]
0.56D + 1.3E [R]
1.54D + 1.25E + 0.2S [O]
0.56D + 1.25E [O]

(ASCE 7, Eq 2.3.2-1 through 2.3.2-7) & (ASCE 7, Section 12.4.3.2)

Allowable Stress Design, ASD

Member deflection checks and foundation designs are done according to the following ASD load combinations:

1.0D + 1.0S
1.0D + 0.6W
1.0D + 0.75L + 0.45W + 0.75S
0.6D + 0.6W [M]
1.238D + 0.875E [O]
1.1785D + 0.65625E + 0.75S [O]
0.362D + 0.875E [O]

(ASCE 7, Eq 2.4.1-1 through 2.4.1-8) & (ASCE 7, Section 12.4.3.2)

[M] *Uses the minimum allowable module dead load.*
[R] *Include redundancy factor of 1.3.*
[O] *Includes overstrength factor of 1.25. Used to check seismic drift.*

3. STRUCTURAL ANALYSIS

3.1 RISA Results

Appendix B.1 contains outputs from the structural analysis software package, RISA. These outputs are used to accurately determine resultant member and reaction forces from the loads seen throughout Section 2.

3.2 RISA Components

A member and node list has been provided below to correlate the RISA components with the design calculations in Section 4. Items of significance have been listed.

Purlins	Location
M13	Top
M14	Mid-Top
M15	Mid-Bottom
M16	Bottom

Girders	Location
M1	Outer
M5	Inner
M9	Outer

Front Struts	Location
M4	Outer
M8	Inner
M12	Outer

Diagonal Struts	Location
M3	Outer
M7	Inner
M11	Outer

Rear Struts	Location
M2	Outer
M6	Inner
M10	Outer

Front Reactions	Location
N7	Outer
N15	Inner
N23	Outer

Rear Reactions	Location
N8	Outer
N16	Inner
N24	Outer

4. MEMBER DESIGN CALCULATIONS

4.1 Purlin Design

Aluminum purlins are used to transfer loads to the support structure. Purlins are designed as continous beams with cantilevers. These are considered beams with internal hinges that can be joined with splices at 25% of the support respective span. See Appendix A.1 for detailed member calculations. Section units are in (mm).

Purlin Type =	**S1.5**	
Aluminum Type =	6105-T5	
F_{ty} =	35	ksi
L_b =	126	in
$\Phi F_{ty\ STRONG\text{-}AXIS}$ =	25.07	ksi
$\Phi F_{ty\ WEAK\text{-}AXIS}$ =	23.08	ksi
S_y =	1.33	in^3
S_x =	0.60	in^3
E =	10100	ksi
I_y =	2.16	in^4
I_x =	1.07	in^4
A =	1.25	in^2
g =	1.50	lbs/ft
M_y =	1.978	k-ft
M_z =	0.332	k-ft
$M_{y\ allowable}$ =	2.779	k-ft
$M_{z\ allowable}$ =	1.154	k-ft
Utilization =	100%	

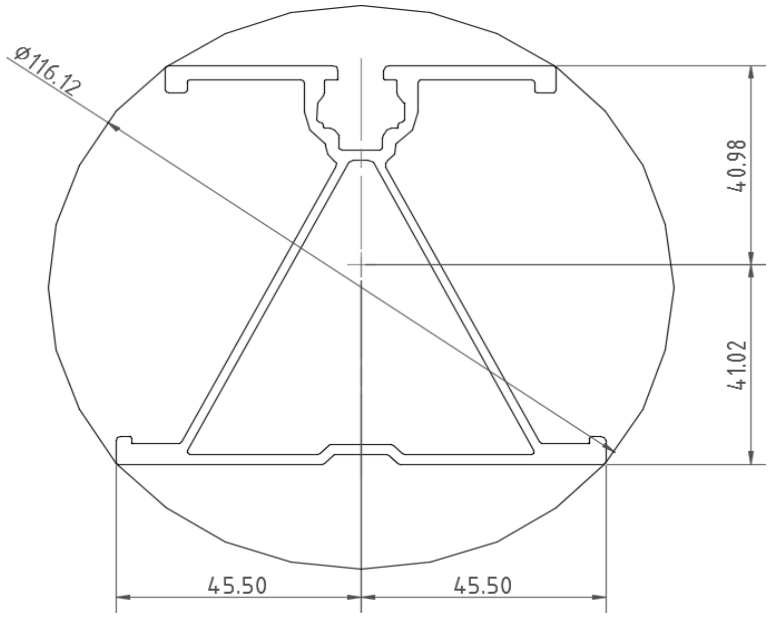

DETAIL VIEW

4.2 Girder Design

Loads from purlins are transferred using an inclined girder, which is connected to a set of aluminum struts. Loads on the girder result from the support reactions of the purlins. See Appendix A.2 for detailed member calculations. Section units are in (mm).

Girder Type =	**BF0**	
Aluminum Type =	6105-T5	
F_{ty} =	35	ksi
L_b =	88.90	in
$\Phi F_{ty\ AXIAL}$ =	31.09	ksi
$\Phi F_{ty\ STRONG\text{-}AXIS}$ =	29.35	ksi
$\Phi F_{ty\ WEAK\text{-}AXIS}$ =	33.25	ksi
S_y =	1.42	in^3
S_x =	1.41	in^3
E =	10100	ksi
I_y =	2.39	in^4
I_x =	2.22	in^4
A =	1.88	in^2
g =	2.26	lbs/ft
M_y =	-3.000	k-ft
M_z =	0.000	k-ft
P_n =	-0.212	k
$M_{y\ allowable}$ =	3.464	k-ft
$M_{z\ allowable}$ =	3.907	k-ft
$P_{n\ allowable}$ =	58.535	k
Utilization =	87%	

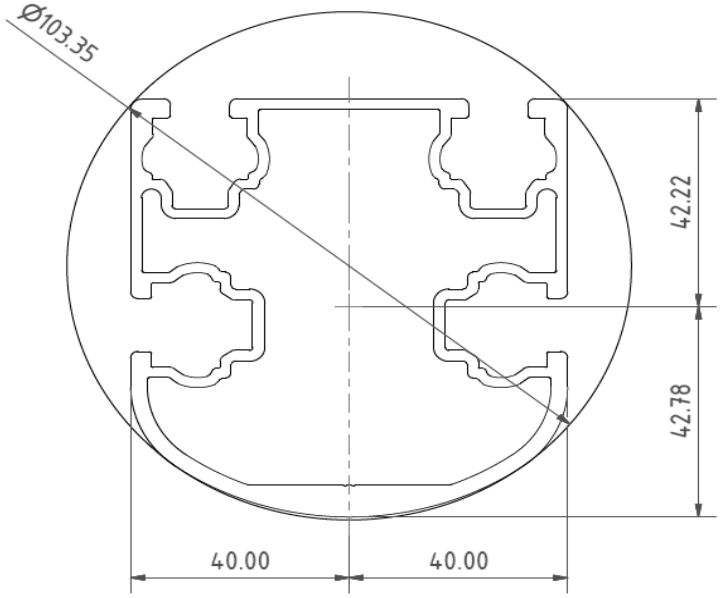

4.3 Front Strut Design

The front aluminum strut connects a portion of the girder to the foundation. Vertical girder forces are then transferred down through the strut into the foundation. The strut is attached with single M12 bolts at each end. See Appendix A.3 for detailed member calculations. Section units are in (mm).

Strut Type =	**55x55**	
Aluminum Type =	6105-T5	
F_{ty} =	35	ksi
L_b =	24.80	in
$\Phi F_{ty\ AXIAL}$ =	28.03	ksi
$\Phi F_{ty\ BENDING}$ =	28.22	ksi
S_y =	0.60	in^3
S_x =	0.60	in^3
E =	10100	ksi
I_y =	0.67	in^4
I_x =	0.67	in^4
A =	0.98	in^2
g =	1.18	lbs/ft
M_y =	0.000	k-ft
M_z =	-0.528	k-ft
P_n =	0.685	k
$M_{y\ allowable}$ =	1.408	k-ft
$M_{z\ allowable}$ =	1.408	k-ft
$P_{n\ allowable}$ =	27.532	k
Utilization =	40%	

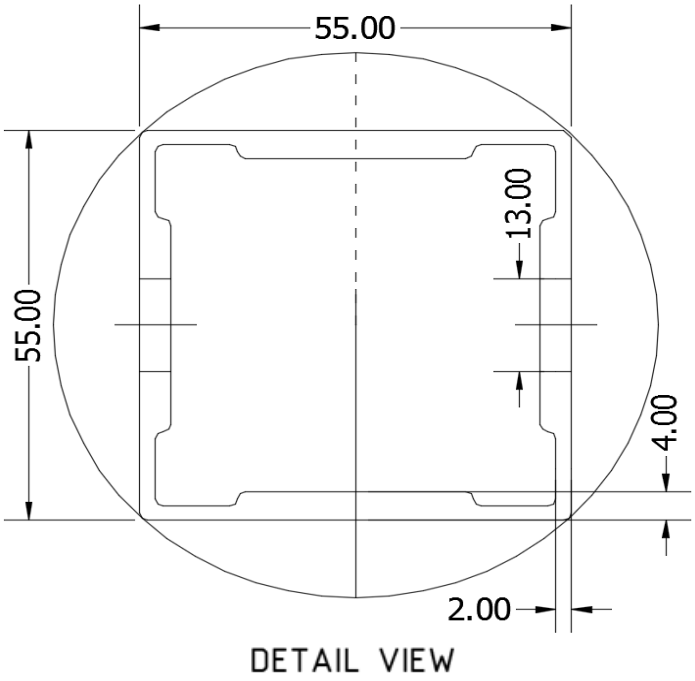

4.4 Diagonal Strut Design

A diagonal aluminum strut braces the support structure. It connects at a front portion of the girder and transfers horizontal forces to the rear foundation connection. The strut is attached with single M12 bolts at each end. See Appendix A.4 for detailed member calculations. Section units are in (mm).

Strut Type =	**55x55**	
Aluminum Type =	6105-T5	
F_{ty} =	35	ksi
L_b =	86.60	in
$\Phi F_{ty\ AXIAL}$ =	7.50	ksi
$\Phi F_{ty\ BENDING}$ =	28.22	ksi
S_y =	0.60	in^3
S_x =	0.60	in^3
E =	10100	ksi
I_y =	0.67	in^4
I_x =	0.67	in^4
A =	0.98	in^2
g =	1.18	lbs/ft
M_y =	0.010	k-ft
M_z =	0.000	k-ft
P_n =	1.366	k
$M_{y\ allowable}$ =	1.408	k-ft
$M_{z\ allowable}$ =	1.408	k-ft
$P_{n\ allowable}$ =	7.371	k
Utilization =	19%	

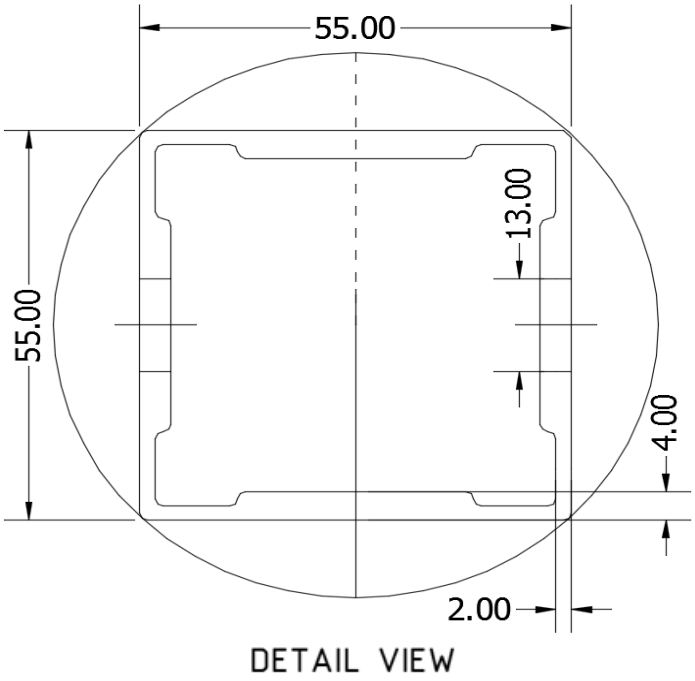

4.5 Rear Strut Design

An aluminum strut connects the rear portion of the girder to the rear foundation connection. Both vertical and horizontal forces are transferred from the girder. The strut is attached with single M12 bolts at each end. See Appendix A.5 for detailed member calculations. Section units are in (mm).

Strut Type =	**55x55**	
Aluminum Type =	6105-T5	
F_{ty} =	35	ksi
L_b =	55.91	in
$\Phi F_{ty\ AXIAL}$ =	15.92	ksi
$\Phi F_{ty\ BENDING}$ =	28.22	ksi
S_y =	0.60	in^3
S_x =	0.60	in^3
E =	10100	ksi
I_y =	0.67	in^4
I_x =	0.67	in^4
A =	0.98	in^2
g =	1.18	lbs/ft
M_y =	-0.008	k-ft
M_z =	-0.307	k-ft
P_n =	0.686	k
$M_{y\ allowable}$ =	1.408	k-ft
$M_{z\ allowable}$ =	1.408	k-ft
$P_{n\ allowable}$ =	15.642	k
Utilization =	27%	

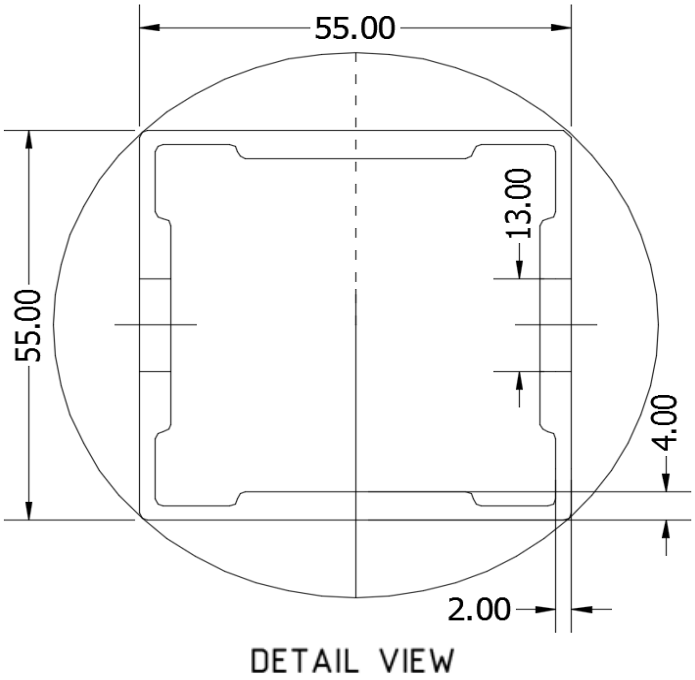

5. FOUNDATION DESIGN CALCULATIONS

5.1 Helical Pile Foundations

The following LRFD loads include a safety factor of 1.3, and are to be used in conjunction with a Schletter, Inc. Geotechnical Investigation Report. The forces below should fall within the guidelines provided in the Geotechnical Investigation Report. If a Geotechnical Investigation Report is not present, please proceed to Section 5.2 for a concrete foundation design.

Maximum	Front	Rear	
Tensile Load =	855.42	4493.19	k
Compressive Load =	4357.77	4700.90	k
Lateral Load =	350.77	2065.63	k
Moment (Weak Axis) =	0.71	0.39	k

5.2 Design of Ballast Foundations

Ballast foundations are used to secure the racking structure in place. The foundations are checked for potential overturning and sliding. Bearing pressures applied by the racking and ballast foundations are checked against the allowable bearing pressures provided by the IBC table 1806.2 (2012, 2015).

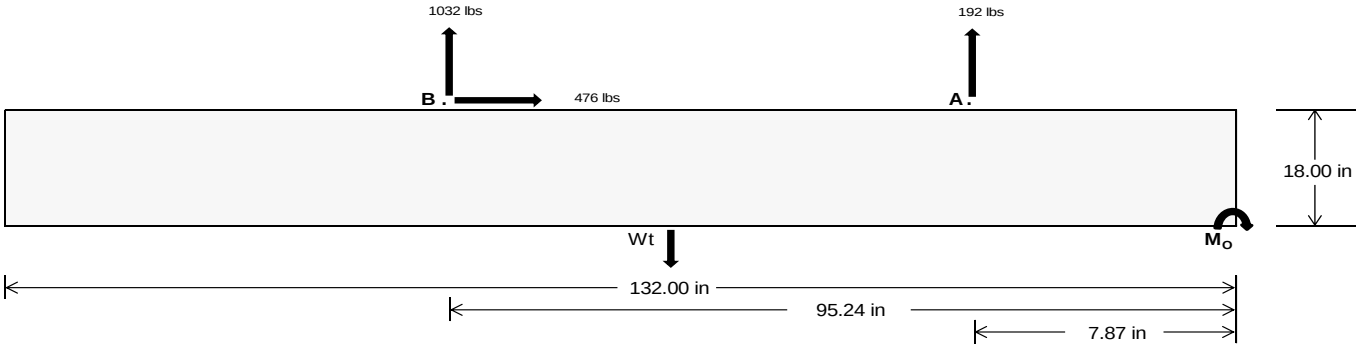

Concrete Properties

Weight of Concrete =	145 pcf
Compressive Strength =	2500 psi
Yield Strength =	60000 psi

Overturning Check

M_O =	108351.0 in-lbs
Resisting Force Required =	1641.68 lbs
S.F. =	1.67
Weight Required =	2736.14 lbs
Minimum Width =	24 in in
Weight Provided =	4785.00 lbs

Sliding

Force =	476.23 lbs
Friction =	0.4
Weight Required =	1190.57 lbs
Resisting Weight =	4785.00 lbs
Additional Weight Required =	0 lbs

Cohesion

Sliding Force =	476.23 lbs
Cohesion =	130 psf
Area =	22.00 ft^2
Resisting =	2392.50 lbs
Additional Weight Required =	0 lbs

Shear Key

Additional Force =	0 lbs
Lateral Bearing Pressure =	200 psf/ft
Required Depth =	0.00 ft
f'_c =	2500 psi
Length =	8 in

Footing Reinforcement

Use fiber reinforcing with (2) #5 rebar.

A minimum 132in long x 24in wide x 18in tall ballast foundation is required to resist overturning.

Use a 132in long x 24in wide x 18in tall ballast foundation to resist sliding. Friction is OK.

Use a 132in long x 24in wide x 18in tall ballast foundation. Cohesion is OK.

Shear key is not required.

Bearing Pressure

	Ballast Width			
	24 in	25 in	26 in	27 in
P_{ftg} = (145 pcf)(11 ft)(1.5 ft)(2 ft) =	4785 lbs	4984 lbs	5184 lbs	5383 lbs

ASD LC	1.0D + 1.0S				1.0D + 0.6W				1.0D + 0.75L + 0.45W + 0.75S				0.6D + 0.6W			
Width	24 in	25 in	26 in	27 in	24 in	25 in	26 in	27 in	24 in	25 in	26 in	27 in	24 in	25 in	26 in	27 in
F_A	1630 lbs	1630 lbs	1630 lbs	1630 lbs	1292 lbs	1292 lbs	1292 lbs	1292 lbs	2057 lbs	2057 lbs	2057 lbs	2057 lbs	-385 lbs	-385 lbs	-385 lbs	-385 lbs
F_B	1665 lbs	1665 lbs	1665 lbs	1665 lbs	1544 lbs	1544 lbs	1544 lbs	1544 lbs	2271 lbs	2271 lbs	2271 lbs	2271 lbs	-2064 lbs	-2064 lbs	-2064 lbs	-2064 lbs
F_V	187 lbs	187 lbs	187 lbs	187 lbs	862 lbs	862 lbs	862 lbs	862 lbs	773 lbs	773 lbs	773 lbs	773 lbs	-952 lbs	-952 lbs	-952 lbs	-952 lbs
P_{total}	8081 lbs	8280 lbs	8479 lbs	8679 lbs	7621 lbs	7820 lbs	8020 lbs	8219 lbs	9113 lbs	9312 lbs	9512 lbs	9711 lbs	423 lbs	542 lbs	662 lbs	782 lbs
M	4121 lbs-ft	4121 lbs-ft	4121 lbs-ft	4121 lbs-ft	3788 lbs-ft	3788 lbs-ft	3788 lbs-ft	3788 lbs-ft	5593 lbs-ft	5593 lbs-ft	5593 lbs-ft	5593 lbs-ft	1736 lbs-ft	1736 lbs-ft	1736 lbs-ft	1736 lbs-ft
e	0.51 ft	0.50 ft	0.49 ft	0.47 ft	0.50 ft	0.48 ft	0.47 ft	0.46 ft	0.61 ft	0.60 ft	0.59 ft	0.58 ft	4.11 ft	3.20 ft	2.62 ft	2.22 ft
L/6	1.83 ft	1.83 ft	1.83 ft	1.83 ft	1.83 ft	1.83 ft	1.83 ft	1.83 ft	1.83 ft	1.83 ft	1.83 ft	1.83 ft	1.83 ft	1.83 ft	1.83 ft	1.83 ft
f_{min}	265.1 psf	263.2 psf	261.5 psf	259.8 psf	252.5 psf	251.1 psf	249.8 psf	248.6 psf	275.6 psf	273.2 psf	271.1 psf	269.1 psf	0.0 psf	0.0 psf	0.0 psf	0.0 psf
f_{max}	469.5 psf	459.4 psf	450.1 psf	441.5 psf	440.3 psf	431.4 psf	423.2 psf	415.6 psf	552.9 psf	539.5 psf	527.1 psf	515.6 psf	101.1 psf	75.5 psf	70.8 psf	70.6 psf

Maximum Bearing Pressure = 553 psf
Allowable Bearing Pressure = 1500 psf

Use a 132in long x 24in wide x 18in tall ballast foundation for an acceptable bearing pressure.

Seismic Design

Overturning Check

M_O =	2039.5 ft-lbs
Resisting Force Required =	2039.47 lbs
S.F. =	1.67
Weight Required =	3399.12 lbs
Minimum Width =	24 in in
Weight Provided =	4785.00 lbs

A minimum 132in long x 24in wide x 18in tall ballast foundation is required to resist overturning.

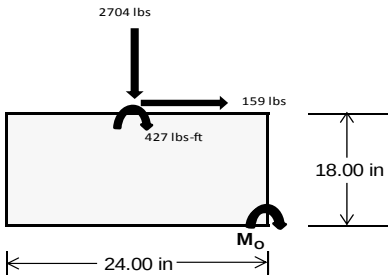

Bearing Pressure

ASD LC	1.238D + 0.875E			1.1785D + 0.65625E + 0.75S			0.362D + 0.875E		
Width	24 in			24 in			24 in		
Support	Outer	Inner	Outer	Outer	Inner	Outer	Outer	Inner	Outer
F_Y	274 lbs	671 lbs	226 lbs	926 lbs	2704 lbs	889 lbs	97 lbs	196 lbs	50 lbs
F_V	221 lbs	217 lbs	224 lbs	164 lbs	159 lbs	174 lbs	222 lbs	219 lbs	222 lbs
P_{total}	6198 lbs	6595 lbs	6150 lbs	6565 lbs	8344 lbs	6528 lbs	1829 lbs	1928 lbs	1782 lbs
M	886 lbs-ft	878 lbs-ft	894 lbs-ft	668 lbs-ft	665 lbs-ft	701 lbs-ft	883 lbs-ft	875 lbs-ft	887 lbs-ft
e	0.14 ft	0.13 ft	0.15 ft	0.10 ft	0.08 ft	0.11 ft	0.48 ft	0.45 ft	0.50 ft
L/6	0.33 ft	0.33 ft	0.33 ft	0.33 ft	0.33 ft	0.33 ft	0.33 ft	0.33 ft	0.33 ft
f_{min}	160.9 psf	180.0 psf	157.7 psf	207.4 psf	288.6 psf	201.1 psf	0.0 psf	0.0 psf	0.0 psf
f_{max}	402.5 psf	419.5 psf	401.5 psf	389.5 psf	469.9 psf	392.4 psf	214.4 psf	213.9 psf	215.0 psf

Maximum Bearing Pressure = 470 psf
Allowable Bearing Pressure = 1500 psf

Use a 132in long x 24in wide x 18in tall ballast foundation for an acceptable bearing pressure.

Foundation Requirements: 132in long x 24in wide x 18in tall ballast foundation and fiber reinforcing with (2) #5 rebar.

5.3 Foundation Anchors

Threaded rods are anchored to the the ballast foundations using the Simpson AT-XP epoxy solution. LRFD load results are compared to the allowable strengths of the epoxy solution. Please see the supplementary calculations provided by the Simpson Anchor Designer software.

6. DESIGN OF JOINTS AND CONNECTIONS

6.1 Anchorage of Modules to Purlins and Connection of Purlins to Girders

Modules are secured to the purlins with Schletter, Inc. Rapid2+ mounting clamps. Purlins are secured to the girders with the use of 80mm mounting clamps. The reliability of calculations is uncertain due to limited standards, therefore the strength of the clamp fasteners has been evaluated by load testing.

Fastening of Modules to Purlins

Maximum Uplifting Force	=	0.464 k
Allowable Uplift	=	1.214 k
Utilization	=	38%

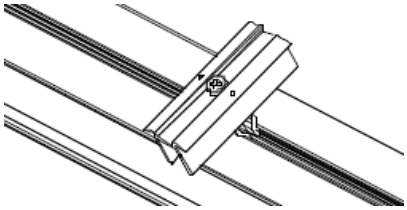

Fastening of Purlins to Girders

Maximum Uplifting Force	=	1.716 k
Allowable Uplift	=	4.357 k
Utilization	=	39%

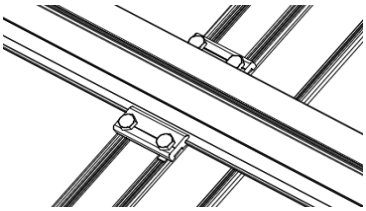

6.2 Strut Connections

The aluminum struts connect the aluminum girder ends to custom brackets with mounting holes. Single M12 bolts are used to attach each end of the strut to the girder and post. ASTM A193/A193M-86 equivalent stainless steel bolts are used.

Front Strut

Maximum Axial Load	=	3.352 k
M12 Bolt Capacity	=	12.808 k
Strut Bearing Capacity	=	7.421 k
Utilization	=	45%

Rear Strut

Maximum Axial Load	=	3.405 k
M12 Bolt Capacity	=	12.808 k
Strut Bearing Capacity	=	7.421 k
Utilization	=	46%

Diagonal Strut

Maximum Axial Load	=	1.433 k
M12 Bolt Shear Capacity	=	12.808 k
Strut Bearing Capacity	=	7.421 k
Utilization	=	19%

Bolt and bearing capacities are accounting for double shear. (ASCE 8-02, Eq. 5.3.4-1)

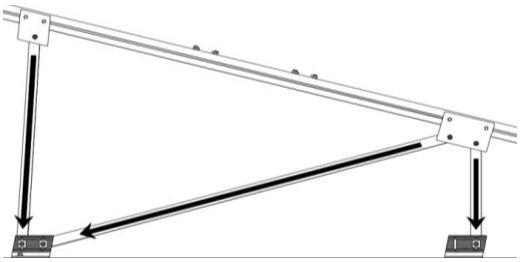

Struts under compression are shown to demonstrate the load transfer from the girder. Single M12 bolts are located at each end of the strut and are subjected to double shear.

7. SEISMIC DESIGN

7.1 Seismic Drift

The racking structure has been analyzed under seismic loading. The allowable story drift of the structure must fall within the limits provided by (ASCE 7, Table 12.12-1).

Mean Height, h_{sx}	=	40.12 in
Allowable Story Drift for All Other Structures, Δ	= {	$0.020h_{sx}$
		0.802 in
Max Drift, Δ_{MAX}	=	0.578 in

0.578 ≤ 0.802, OK.

The racking structure's reaction to seismic loads is shown to the right. The deflections have been magnified to provide a clear portrayal of potential story drift.

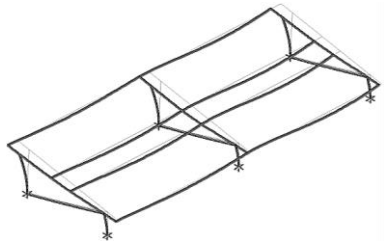

APPENDIX A

A.1 Design of Aluminum Purlins - Aluminum Design Manual, 2005 Edition

Purlin = **S1.5**

Strong Axis:		Weak Axis:	
3.4.14		**3.4.14**	
L_b =	126 in	L_b =	126
J =	0.432	J =	0.432
	348.575		221.673
$S1 = \left(\frac{Bc - \frac{\theta_y}{\theta_b} Fcy}{1.6Dc}\right)^2$		$S1 = \left(\frac{Bc - \frac{\theta_y}{\theta_b} Fcy}{1.6Dc}\right)^2$	
S1 =	0.51461	S1 =	0.51461
$S2 = \left(\frac{C_c}{1.6}\right)^2$		$S2 = \left(\frac{C_c}{1.6}\right)^2$	
S2 =	1701.56	S2 =	1701.56
φF_L=	φb[Bc-1.6Dc*√((LbSc)/(Cb*√(IyJ)/2))]	φF_L=	φb[Bc-1.6Dc*√((LbSc)/(Cb*√(IyJ)/2))]
φF_L=	27.2 ksi	φF_L=	28.5
3.4.16		**3.4.16**	
b/t =	32.195	b/t =	37.0588
$S1 = \frac{Bp - \frac{\theta_y}{\theta_b} Fcy}{1.6Dp}$		$S1 = \frac{Bp - \frac{\theta_y}{\theta_b} Fcy}{1.6Dp}$	
S1 =	12.2	S1 =	12.2
$S2 = \frac{k_1 Bp}{1.6Dp}$		$S2 = \frac{k_1 Bp}{1.6Dp}$	
S2 =	46.7	S2 =	46.7
φF_L=	φb[Bp-1.6Dp*b/t]	φF_L=	φb[Bp-1.6Dp*b/t]
φF_L=	25.1 ksi	φF_L=	23.1 ksi
3.4.16.1	Not Used	**3.4.16.1**	
Rb/t =		N/A for Weak Direction	
$S1 = \left(\frac{Bt - 1.17\frac{\theta_y}{\theta_b} Fcy}{1.6Dt}\right)^2$			
S1 =	1.1		
$S2 = C_t$			
S2 =	141.0		
φF_L=	1.17φyFcy		
φF_L=	38.9 ksi		
3.4.18		**3.4.18**	
h/t =	37.0588	h/t =	32.195
$S1 = \frac{Bbr - \frac{\theta_y}{\theta_b} 1.3Fcy}{mDbr}$		$S1 = \frac{Bbr - \frac{\theta_y}{\theta_b} 1.3Fcy}{mDbr}$	
S1 =	36.9	S1 =	36.9
m =	0.65	m =	0.65
C_0 =	40.985	C_0 =	45.5
Cc =	41.015	Cc =	45.5
$S2 = \frac{k_1 Bbr}{mDbr}$		$S2 = \frac{k_1 Bbr}{mDbr}$	
S2 =	77.2	S2 =	77.3
φF_L=	φb[Bbr-mDbr*h/t]	φF_L=	1.3φyFcy
φF_L=	43.2 ksi	φF_L=	43.2 ksi
φF_LSt=	25.1 ksi	φF_LWk=	23.1 ksi
Ix =	897074 mm^4	Iy =	446476 mm^4
	2.155 in^4		1.073 in^4
y =	41.015 mm	x =	45.5 mm
Sx =	1.335 in^3	Sy =	0.599 in^3
M_{max}St =	2.788 k-ft	M_{max}Wk =	1.152 k-ft

Compression

3.4.9

b/t = 32.195
S1 = 12.21 (See 3.4.16 above for formula)
S2 = 32.70 (See 3.4.16 above for formula)
φF_L = φc[Bp-1.6Dp*b/t]
φF_L = 25.1 ksi

b/t = 37.0588
S1 = 12.21
S2 = 32.70
φF_L = (φck2*√(BpE))/(1.6b/t)
φF_L = 21.9 ksi

3.4.10

Rb/t = 0.0

$$S1 = \left(\frac{Bt - \frac{\theta_y}{\theta_b} Fcy}{Dt}\right)^2$$

S1 = 6.87
S2 = 131.3
φF_L = φyFcy
φF_L = 33.25 ksi

φF_L = 21.94 ksi
A = 1215.13 mm^2
1.88 in^2
P_{max} = 41.32 kips

A.2 Design of Aluminum Girders - Aluminum Design Manual, 2005 Edition

Girder = **BF0**

Strong Axis:

3.4.14

L_b = 88.9 in
J = 1.08
152.913

$$S1 = \left(\frac{Bc - \frac{\theta_y}{\theta_b} Fcy}{1.6Dc}\right)^2$$

S1 = 0.51461

$$S2 = \left(\frac{C_c}{1.6}\right)^2$$

S2 = 1701.56
φF_L = φb[Bc-1.6Dc*√((LbSc)/(Cb*√(IyJ)/2))]
φF_L = 29.4 ksi

3.4.16

b/t = 16.2

$$S1 = \frac{Bp - \frac{\theta_y}{\theta_b} Fcy}{1.6Dp}$$

S1 = 12.2

$$S2 = \frac{k_1 Bp}{1.6Dp}$$

S2 = 46.7
φF_L = φb[Bp-1.6Dp*b/t]
φF_L = 31.6 ksi

Weak Axis:

3.4.14

L_b = 88.9
J = 1.08
161.829

$$S1 = \left(\frac{Bc - \frac{\theta_y}{\theta_b} Fcy}{1.6Dc}\right)^2$$

S1 = 0.51461

$$S2 = \left(\frac{C_c}{1.6}\right)^2$$

S2 = 1701.56
φF_L = φb[Bc-1.6Dc*√((LbSc)/(Cb*√(IyJ)/2))]
φF_L = 29.2

3.4.16

b/t = 7.4

$$S1 = \frac{Bp - \frac{\theta_y}{\theta_b} Fcy}{1.6Dp}$$

S1 = 12.2

$$S2 = \frac{k_1 Bp}{1.6Dp}$$

S2 = 46.7
φF_L = φyFcy
φF_L = 33.3 ksi

3.4.16.1 Used

Rb/t = 18.1

$$S1 = \left(\frac{Bt - 1.17\frac{\theta_y}{\theta_b}Fcy}{1.6Dt}\right)^2$$

S1 = 1.1

$$S2 = C_t$$

S2 = 141.0

φF_L= φb[Bt-Dt*√(Rb/t)]

φF_L= 31.1 ksi

3.4.16.1

N/A for Weak Direction

3.4.18

h/t = 7.4

$$S1 = \frac{Bbr - \frac{\theta_y}{\theta_b}1.3Fcy}{mDbr}$$

S1 = 35.2

m = 0.68

C_0 = 41.067

Cc = 43.717

$$S2 = \frac{k_1 Bbr}{mDbr}$$

S2 = 73.8

φF_L= 1.3φyFcy

φF_L= 43.2 ksi

$\varphi F_L St$= 29.4 ksi

Ix = 984962 mm^4

2.366 in^4

y = 43.717 mm

Sx = 1.375 in^3

$M_{max}St$ = 3.363 k-ft

3.4.18

h/t = 16.2

$$S1 = \frac{Bbr - \frac{\theta_y}{\theta_b}1.3Fcy}{mDbr}$$

S1 = 36.9

m = 0.65

C_0 = 40

Cc = 40

$$S2 = \frac{k_1 Bbr}{mDbr}$$

S2 = 77.3

φF_L= 1.3φyFcy

φF_L= 43.2 ksi

$\varphi F_L Wk$= 33.3 ksi

Iy = 923544 mm^4

2.219 in^4

x = 40 mm

Sy = 1.409 in^3

$M_{max}Wk$ = 3.904 k-ft

Compression

3.4.9

b/t = 16.2

S1 = 12.21 (See 3.4.16 above for formula)

S2 = 32.70 (See 3.4.16 above for formula)

φF_L= φc[Bp-1.6Dp*b/t]

φF_L= 31.6 ksi

b/t = 7.4

S1 = 12.21

S2 = 32.70

φF_L= φyFcy

φF_L= 33.3 ksi

3.4.10

Rb/t = 18.1

$$S1 = \left(\frac{Bt - \frac{\theta_y}{\theta_b}Fcy}{Dt}\right)^2$$

S1 = 6.87

S2 = 131.3

φF_L= φc[Bt-Dt*√(Rb/t)]

φF_L= 31.09 ksi

φF_L= 31.09 ksi

A = 1215.13 mm^2

1.88 in^2

P_{max} = 58.55 kips

A.3 Design of Aluminum Struts (Front) - Aluminum Design Manual, 2005 Edition

Strut = **55x55**

Strong Axis:

3.4.14

L_b = 24.8 in

J = 0.942

38.7028

$$S1 = \left(\frac{Bc - \frac{\theta_y}{\theta_b} Fcy}{1.6Dc}\right)^2$$

S1 = 0.51461

$$S2 = \left(\frac{C_c}{1.6}\right)^2$$

S2 = 1701.56

φF_L= φb[Bc-1.6Dc*√((LbSc)/(Cb*√(IyJ)/2))]

φF_L= 31.4 ksi

3.4.16

b/t = 24.5

$$S1 = \frac{Bp - \frac{\theta_y}{\theta_b} Fcy}{1.6Dp}$$

S1 = 12.2

$$S2 = \frac{k_1 Bp}{1.6Dp}$$

S2 = 46.7

φF_L= φb[Bp-1.6Dp*b/t]

φF_L= 28.2 ksi

3.4.16.1 Not Used

Rb/t = 0.0

$$S1 = \left(\frac{Bt - 1.17\frac{\theta_y}{\theta_b} Fcy}{1.6Dt}\right)^2$$

S1 = 1.1

$$S2 = C_t$$

S2 = 141.0

φF_L= 1.17φyFcy

φF_L= 38.9 ksi

3.4.18

h/t = 24.5

$$S1 = \frac{Bbr - \frac{\theta_y}{\theta_b} 1.3Fcy}{mDbr}$$

S1 = 36.9

m = 0.65

C_0 = 27.5

Cc = 27.5

$$S2 = \frac{k_1 Bbr}{mDbr}$$

S2 = 77.3

φF_L= 1.3φyFcy

φF_L= 43.2 ksi

φF_LSt= 28.2 ksi

Ix = 279836 mm^4

0.672 in^4

y = 27.5 mm

Sx = 0.621 in^3

M_{max}St = 1.460 k-ft

Weak Axis:

3.4.14

L_b = 24.8

J = 0.942

38.7028

$$S1 = \left(\frac{Bc - \frac{\theta_y}{\theta_b} Fcy}{1.6Dc}\right)^2$$

S1 = 0.51461

$$S2 = \left(\frac{C_c}{1.6}\right)^2$$

S2 = 1701.56

φF_L= φb[Bc-1.6Dc*√((LbSc)/(Cb*√(IyJ)/2))]

φF_L= 31.4

3.4.16

b/t = 24.5

$$S1 = \frac{Bp - \frac{\theta_y}{\theta_b} Fcy}{1.6Dp}$$

S1 = 12.2

$$S2 = \frac{k_1 Bp}{1.6Dp}$$

S2 = 46.7

φF_L= φb[Bp-1.6Dp*b/t]

φF_L= 28.2 ksi

3.4.16.1

N/A for Weak Direction

3.4.18

h/t = 24.5

$$S1 = \frac{Bbr - \frac{\theta_y}{\theta_b} 1.3Fcy}{mDbr}$$

S1 = 36.9

m = 0.65

C_0 = 27.5

Cc = 27.5

$$S2 = \frac{k_1 Bbr}{mDbr}$$

S2 = 77.3

φF_L= 1.3φyFcy

φF_L= 43.2 ksi

φF_LWk= 28.2 ksi

Iy = 279836 mm^4

0.672 in^4

x = 27.5 mm

Sy = 0.621 in^3

M_{max}Wk = 1.460 k-ft

Compression

3.4.7

λ = 0.57371

r = 0.81 in

$$S1^* = \frac{Bc - Fcy}{1.6Dc^*}$$

S1* = 0.33515

$$S2^* = \frac{Cc}{\pi}\sqrt{Fcy/E}$$

S2* = 1.23671

φcc = 0.87952

φF_L = φcc(Bc-Dc*λ)

φF_L = 28.0279 ksi

3.4.9

b/t = 24.5

S1 = 12.21 (See 3.4.16 above for formula)

S2 = 32.70 (See 3.4.16 above for formula)

φF_L = φc[Bp-1.6Dp*b/t]

φF_L = 28.2 ksi

b/t = 24.5

S1 = 12.21

S2 = 32.70

φF_L = φc[Bp-1.6Dp*b/t]

φF_L = 28.2 ksi

3.4.10

Rb/t = 0.0

$$S1 = \left(\frac{Bt - \frac{\theta_y}{\theta_b}Fcy}{Dt}\right)^2$$

S1 = 6.87

S2 = 131.3

φF_L = φyFcy

φF_L = 33.25 ksi

φF_L = 28.03 ksi

A = 663.99 mm^2

1.03 in^2

P_{max} = 28.85 kips

A.4 Design of Aluminum Struts (Diagonal) - Aluminum Design Manual, 2005 Edition

Strut = **55x55**

Strong Axis:

3.4.14

L_b = 86.60 in

J = 0.942

135.148

$$S1 = \left(\frac{Bc - \frac{\theta_y}{\theta_b}Fcy}{1.6Dc}\right)^2$$

S1 = 0.51461

$$S2 = \left(\frac{C_c}{1.6}\right)^2$$

S2 = 1701.56

φF_L = φb[Bc-1.6Dc*√((LbSc)/(Cb*√(IyJ)/2))]

φF_L = 29.6 ksi

Weak Axis:

3.4.14

L_b = 86.6

J = 0.942

135.148

$$S1 = \left(\frac{Bc - \frac{\theta_y}{\theta_b}Fcy}{1.6Dc}\right)^2$$

S1 = 0.51461

$$S2 = \left(\frac{C_c}{1.6}\right)^2$$

S2 = 1701.56

φF_L = φb[Bc-1.6Dc*√((LbSc)/(Cb*√(IyJ)/2))]

φF_L = 29.6

3.4.16

b/t = 24.5

$$S1 = \frac{Bp - \frac{\theta_y}{\theta_b} Fcy}{1.6Dp}$$

S1 = 12.2

$$S2 = \frac{k_1 Bp}{1.6Dp}$$

S2 = 46.7

φF_L= φb[Bp-1.6Dp*b/t]

φF_L= 28.2 ksi

3.4.16

b/t = 24.5

$$S1 = \frac{Bp - \frac{\theta_y}{\theta_b} Fcy}{1.6Dp}$$

S1 = 12.2

$$S2 = \frac{k_1 Bp}{1.6Dp}$$

S2 = 46.7

φF_L= φb[Bp-1.6Dp*b/t]

φF_L= 28.2 ksi

3.4.16.1 Not Used

Rb/t = 0.0

$$S1 = \left(\frac{Bt - 1.17 \frac{\theta_y}{\theta_b} Fcy}{1.6Dt} \right)^2$$

S1 = 1.1

$$S2 = C_t$$

S2 = 141.0

φF_L= 1.17φyFcy

φF_L= 38.9 ksi

3.4.16.1

N/A for Weak Direction

3.4.18

h/t = 24.5

$$S1 = \frac{Bbr - \frac{\theta_y}{\theta_b} 1.3Fcy}{mDbr}$$

S1 = 36.9

m = 0.65

C_0 = 27.5

Cc = 27.5

$$S2 = \frac{k_1 Bbr}{mDbr}$$

S2 = 77.3

φF_L= 1.3φyFcy

φF_L= 43.2 ksi

3.4.18

h/t = 24.5

$$S1 = \frac{Bbr - \frac{\theta_y}{\theta_b} 1.3Fcy}{mDbr}$$

S1 = 36.9

m = 0.65

C_0 = 27.5

Cc = 27.5

$$S2 = \frac{k_1 Bbr}{mDbr}$$

S2 = 77.3

φF_L= 1.3φyFcy

φF_L= 43.2 ksi

$\varphi F_L St$= 28.2 ksi

Ix = 279836 mm^4

0.672 in^4

y = 27.5 mm

Sx = 0.621 in^3

$M_{max}St$ = 1.460 k-ft

$\varphi F_L Wk$= 28.2 ksi

Iy = 279836 mm^4

0.672 in^4

x = 27.5 mm

Sy = 0.621 in^3

$M_{max}Wk$ = 1.460 k-ft

Compression

3.4.7

λ = 2.00335

r = 0.81 in

$$S1^* = \frac{Bc - Fcy}{1.6Dc^*}$$

$S1^*$ = 0.33515

$$S2^* = \frac{Cc}{\pi} \sqrt{Fcy/E}$$

$S2^*$ = 1.23671

φcc = 0.86047

φF_L= (φccFcy)/(λ²)

φF_L= 7.50396 ksi

3.4.9

b/t = 24.5
S1 = 12.21 (See 3.4.16 above for formula)
S2 = 32.70 (See 3.4.16 above for formula)
φF_L = φc[Bp-1.6Dp*b/t]
φF_L = 28.2 ksi

b/t = 24.5
S1 = 12.21
S2 = 32.70
φF_L = φc[Bp-1.6Dp*b/t]
φF_L = 28.2 ksi

3.4.10

Rb/t = 0.0

$$S1 = \left(\frac{Bt - \frac{\theta_y}{\theta_b} Fcy}{Dt}\right)^2$$

S1 = 6.87
S2 = 131.3
φF_L = φyFcy
φF_L = 33.25 ksi

φF_L = 7.50 ksi
A = 663.99 mm^2
1.03 in^2
P_{max} = 7.72 kips

A.5 Design of Aluminum Struts (Rear) - Aluminum Design Manual, 2005 Edition

Strut = **55x55**

Strong Axis:

3.4.14

L_b = 55.91 in
J = 0.942
87.2529

$$S1 = \left(\frac{Bc - \frac{\theta_y}{\theta_b} Fcy}{1.6Dc}\right)^2$$

S1 = 0.51461

$$S2 = \left(\frac{C_c}{1.6}\right)^2$$

S2 = 1701.56
φF_L = φb[Bc-1.6Dc*√((LbSc)/(Cb*√(IyJ)/2))]
φF_L = 30.4 ksi

3.4.16

b/t = 24.5

$$S1 = \frac{Bp - \frac{\theta_y}{\theta_b} Fcy}{1.6Dp}$$

S1 = 12.2

$$S2 = \frac{k_1 Bp}{1.6Dp}$$

S2 = 46.7
φF_L = φb[Bp-1.6Dp*b/t]
φF_L = 28.2 ksi

Weak Axis:

3.4.14

L_b = 55.91
J = 0.942
87.2529

$$S1 = \left(\frac{Bc - \frac{\theta_y}{\theta_b} Fcy}{1.6Dc}\right)^2$$

S1 = 0.51461

$$S2 = \left(\frac{C_c}{1.6}\right)^2$$

S2 = 1701.56
φF_L = φb[Bc-1.6Dc*√((LbSc)/(Cb*√(IyJ)/2))]
φF_L = 30.4

3.4.16

b/t = 24.5

$$S1 = \frac{Bp - \frac{\theta_y}{\theta_b} Fcy}{1.6Dp}$$

S1 = 12.2

$$S2 = \frac{k_1 Bp}{1.6Dp}$$

S2 = 46.7
φF_L = φb[Bp-1.6Dp*b/t]
φF_L = 28.2 ksi

3.4.16.1 Not Used

Rb/t = 0.0

$$S1 = \left(\frac{Bt - 1.17\frac{\theta_y}{\theta_b}Fcy}{1.6Dt}\right)^2$$

S1 = 1.1

$$S2 = C_t$$

S2 = 141.0

φF_L= 1.17φyFcy

φF_L= 38.9 ksi

3.4.16.1

N/A for Weak Direction

3.4.18

h/t = 24.5

$$S1 = \frac{Bbr - \frac{\theta_y}{\theta_b}1.3Fcy}{mDbr}$$

S1 = 36.9

m = 0.65

C_0 = 27.5

Cc = 27.5

$$S2 = \frac{k_1 Bbr}{mDbr}$$

S2 = 77.3

φF_L= 1.3φyFcy

φF_L= 43.2 ksi

$\varphi F_L St$= 28.2 ksi

Ix = 279836 mm^4

0.672 in^4

y = 27.5 mm

Sx = 0.621 in^3

$M_{max}St$ = 1.460 k-ft

3.4.18

h/t = 24.5

$$S1 = \frac{Bbr - \frac{\theta_y}{\theta_b}1.3Fcy}{mDbr}$$

S1 = 36.9

m = 0.65

C_0 = 27.5

Cc = 27.5

$$S2 = \frac{k_1 Bbr}{mDbr}$$

S2 = 77.3

φF_L= 1.3φyFcy

φF_L= 43.2 ksi

$\varphi F_L Wk$= 28.2 ksi

Iy = 279836 mm^4

0.672 in^4

x = 27.5 mm

Sy = 0.621 in^3

$M_{max}Wk$ = 1.460 k-ft

Compression

3.4.7

λ = 1.29339

r = 0.81 in

$$S1^* = \frac{Bc - Fcy}{1.6Dc^*}$$

$S1^*$ = 0.33515

$$S2^* = \frac{Cc}{\pi}\sqrt{Fcy/E}$$

$S2^*$ = 1.23671

φcc = 0.76107

φF_L= (φccFcy)/(λ²)

φF_L= 15.9235 ksi

3.4.9

b/t = 24.5

S1 = 12.21 (See 3.4.16 above for formula)

S2 = 32.70 (See 3.4.16 above for formula)

φF_L= φc[Bp-1.6Dp*b/t]

φF_L= 28.2 ksi

b/t = 24.5

S1 = 12.21

S2 = 32.70

φF_L= φc[Bp-1.6Dp*b/t]

φF_L= 28.2 ksi

3.4.10

Rb/t = 0.0

$$S1 = \left(\frac{Bt - \frac{\theta_y}{\theta_b} Fcy}{Dt}\right)^2$$

S1 = 6.87

S2 = 131.3

$\varphi F_L = \varphi y Fcy$

φF_L = 33.25 ksi

φF_L = 15.92 ksi

A = 663.99 mm^2

1.03 in^2

P_{max} = 16.39 kips

APPENDIX B

B.1

The following pages will contain the results from RISA. Please refer back to Section 2 for load information and Section 4-5 for member and foundation design.

Basic Load Cases

	BLC Description	Category	X Gravity	Y Gravity	Z Gravity	Joint	Point	Distribut...	Area(Me...	Surface(...
1	Dead Load, Max	DL		-1				4		
2	Dead Load, Min	DL		-1				4		
3	Snow Load	SL						4		
4	Wind Load - Pressure	WL						4		
5	Wind Load - Suction	WL						4		
6	Seismic - Lateral	EL			.8			8		

Member Distributed Loads (BLC 1 : Dead Load, Max)

	Member Label	Direction	Start Magnitude[lb/ft,F]	End Magnitude[lb/ft,F]	Start Location[ft,%]	End Location[ft,%]
1	M13	Y	-8.366	-8.366	0	0
2	M14	Y	-8.366	-8.366	0	0
3	M15	Y	-8.366	-8.366	0	0
4	M16	Y	-8.366	-8.366	0	0

Member Distributed Loads (BLC 2 : Dead Load, Min)

	Member Label	Direction	Start Magnitude[lb/ft,F]	End Magnitude[lb/ft,F]	Start Location[ft,%]	End Location[ft,%]
1	M13	Y	-4.45	-4.45	0	0
2	M14	Y	-4.45	-4.45	0	0
3	M15	Y	-4.45	-4.45	0	0
4	M16	Y	-4.45	-4.45	0	0

Member Distributed Loads (BLC 3 : Snow Load)

	Member Label	Direction	Start Magnitude[lb/ft,F]	End Magnitude[lb/ft,F]	Start Location[ft,%]	End Location[ft,%]
1	M13	Y	-54.031	-54.031	0	0
2	M14	Y	-54.031	-54.031	0	0
3	M15	Y	-54.031	-54.031	0	0
4	M16	Y	-54.031	-54.031	0	0

Member Distributed Loads (BLC 4 : Wind Load - Pressure)

	Member Label	Direction	Start Magnitude[lb/ft,F]	End Magnitude[lb/ft,F]	Start Location[ft,%]	End Location[ft,%]
1	M13	y	-60.802	-60.802	0	0
2	M14	y	-60.802	-60.802	0	0
3	M15	y	-95.545	-95.545	0	0
4	M16	y	-95.545	-95.545	0	0

Member Distributed Loads (BLC 5 : Wind Load - Suction)

	Member Label	Direction	Start Magnitude[lb/ft,F]	End Magnitude[lb/ft,F]	Start Location[ft,%]	End Location[ft,%]
1	M13	y	138.975	138.975	0	0
2	M14	y	106.548	106.548	0	0
3	M15	y	57.906	57.906	0	0
4	M16	y	57.906	57.906	0	0

Member Distributed Loads (BLC 6 : Seismic - Lateral)

	Member Label	Direction	Start Magnitude[lb/ft,F]	End Magnitude[lb/ft,F]	Start Location[ft,%]	End Location[ft,%]
1	M13	Z	6.693	6.693	0	0
2	M14	Z	6.693	6.693	0	0
3	M15	Z	6.693	6.693	0	0
4	M16	Z	6.693	6.693	0	0
5	M13	Z	0	0	0	0
6	M14	Z	0	0	0	0
7	M15	Z	0	0	0	0
8	M16	Z	0	0	0	0

Load Combinations

	Description	S...	P...	S...	B...	Fa...	B...	Fa...	B...	Fa...	B...	Fa...	B...	Fa...	B...	Fa...	B...	Fa...	B...	Fa...	B...	Fa...	B...	Fa...
1	LRFD 1.2D + 1.6S + 0.5W	Yes	Y		1	1.2	3	1.6	4	.5														
2	LRFD 1.2D + 1.0W + 0.5S	Yes	Y		1	1.2	3	.5	4	1														
3	LRFD 0.9D + 1.0W	Yes	Y		2	.9					5	1												
4	LATERAL - LRFD 1.54D + 1.3E ...	Yes	Y		1	1.54	3	.2			6	1.3												
5	LATERAL - LRFD 0.56D + 1.3E	Yes	Y		1	.56					6	1.3												
6	LATERAL - LRFD 1.54D + 1.25...	Yes	Y		1	1.54	3	.2			6	1.25												
7	LATERAL - LRFD 0.56D + 1.25E	Yes	Y		1	.56					6	1.25												
8																								
9	ASD 1.0D + 1.0S	Yes	Y		1	1	3	1																
10	ASD 1.0D + 0.6W	Yes	Y		1	1			4	.6														
11	ASD 1.0D + 0.75L + 0.45W + 0....	Yes	Y		1	1	3	.75	4	.45														
12	ASD 0.6D + 0.6W	Yes	Y		2	.6					5	.6												
13	LATERAL - ASD 1.238D + 0.875E	Yes	Y		1	1.2...					6	.875												
14	LATERAL - ASD 1.1785D + 0.65...	Yes	Y		1	1.1...	3	.75			6	.656												
15	LATERAL - ASD 0.362D + 0.875E	Yes	Y		1	.362					6	.875												

Envelope Joint Reactions

	Joint		X [lb]	LC	Y [lb]	LC	Z [lb]	LC	MX [k-ft]	LC	MY [k-ft]	LC	MZ [k-ft]	LC
1	N8	max	371.971	2	1062.298	1	.948	1	.005	1	0	1	0	1
2		min	-502.961	3	-1050.333	3	-65.952	5	-.297	4	0	1	0	1
3	N7	max	.04	1	1194.956	1	-.449	12	0	12	0	1	0	1
4		min	-.085	2	-179.869	3	-269.826	4	-.543	4	0	1	0	1
5	N15	max	.027	9	3352.132	1	0	9	0	9	0	1	0	1
6		min	-1.153	2	-658.015	3	-258.747	4	-.528	4	0	1	0	1
7	N16	max	1503.282	2	3616.077	1	0	2	0	2	0	1	0	1
8		min	-1588.946	3	-3456.301	3	-65.638	5	-.3	4	0	1	0	1
9	N23	max	.04	1	1194.956	1	10.385	1	.022	1	0	1	0	1
10		min	-.085	2	-179.869	3	-263.112	4	-.531	4	0	1	0	1
11	N24	max	371.971	2	1062.298	1	-.048	12	0	12	0	1	0	1
12		min	-502.961	3	-1050.333	3	-66.509	5	-.3	4	0	1	0	1
13	Totals:	max	2245.901	2	11482.716	1	0	11						
14		min	-2595.261	3	-6574.719	3	-984.268	4						

Envelope Member Section Forces

	Member	Sec		Axial[lb]	LC	y Shear[lb]	LC	z Shear[lb]	LC	Torque[k-ft]	LC	y-y Mome...	LC	z-z Mome...	LC
1	M13	1	max	110.403	1	478.768	1	-6.549	12	0	3	.263	1	0	4
2			min	4.788	12	-527.432	3	-169.914	1	-.013	1	.011	12	0	3
3		2	max	110.403	1	335.539	1	-5.123	12	0	3	.099	4	.524	3
4			min	4.788	12	-371.169	3	-130.692	1	-.013	1	.005	12	-.475	1
5		3	max	110.403	1	192.311	1	-3.698	12	0	3	.051	5	.866	3
6			min	4.788	12	-214.907	3	-91.471	1	-.013	1	-.042	1	-.783	1
7		4	max	110.403	1	49.083	1	-2.272	12	0	3	.026	5	1.026	3
8			min	4.788	12	-58.644	3	-52.249	1	-.013	1	-.125	1	-.924	1
9		5	max	110.403	1	97.619	3	-.847	12	0	3	.004	5	1.003	3
10			min	4.788	12	-94.145	1	-21.214	4	-.013	1	-.164	1	-.897	1
11		6	max	110.403	1	253.882	3	26.194	1	0	3	-.006	12	.798	3
12			min	4.192	15	-237.373	1	-15.853	5	-.013	1	-.156	1	-.704	1
13		7	max	110.403	1	410.144	3	65.415	1	0	3	-.004	12	.41	3
14			min	-5.468	5	-380.601	1	-13.648	5	-.013	1	-.102	1	-.344	1
15		8	max	110.403	1	566.407	3	104.637	1	0	3	0	10	.184	1
16			min	-17.444	5	-523.829	1	-11.442	5	-.013	1	-.049	4	-.159	3
17		9	max	110.403	1	722.67	3	143.858	1	0	3	.142	1	.879	1
18			min	-29.42	5	-667.057	1	-9.237	5	-.013	1	-.06	5	-.911	3

Envelope Member Section Forces (Continued)

	Member	Sec		Axial[lb]	LC	y Shear[lb]	LC	z Shear[lb]	LC	Torque[k-ft]	LC	y-y Mome...	LC	z-z Mome...	LC
19		10	max	110.403	1	878.932	3	183.08	1	.005	14	.332	1	1.74	1
20			min	4.788	12	-810.285	1	-106.219	14	-.013	1	.01	12	-1.845	3
21		11	max	110.403	1	667.057	1	-4.855	12	.013	1	.142	1	.879	1
22			min	4.788	12	-722.67	3	-143.858	1	0	3	.004	12	-.911	3
23		12	max	110.403	1	523.829	1	-3.43	12	.013	1	.047	4	.184	1
24			min	4.788	12	-566.407	3	-104.637	1	0	3	-.003	1	-.159	3
25		13	max	110.403	1	380.601	1	-2.004	12	.013	1	.021	5	.41	3
26			min	4.788	12	-410.144	3	-65.415	1	0	3	-.102	1	-.344	1
27		14	max	110.403	1	237.373	1	-.579	12	.013	1	-.001	15	.798	3
28			min	3.827	15	-253.882	3	-26.194	1	0	3	-.156	1	-.704	1
29		15	max	110.403	1	94.145	1	13.028	1	.013	1	-.006	12	1.003	3
30			min	-6.108	5	-97.619	3	-16.569	5	0	3	-.164	1	-.897	1
31		16	max	110.403	1	58.644	3	52.249	1	.013	1	-.004	12	1.026	3
32			min	-18.084	5	-49.083	1	-14.363	5	0	3	-.125	1	-.924	1
33		17	max	110.403	1	214.907	3	91.471	1	.013	1	0	12	.866	3
34			min	-30.061	5	-192.311	1	-12.158	5	0	3	-.066	4	-.783	1
35		18	max	110.403	1	371.169	3	130.692	1	.013	1	.088	1	.524	3
36			min	-42.037	5	-335.539	1	-9.952	5	0	3	-.069	5	-.475	1
37		19	max	110.403	1	527.432	3	169.914	1	.013	1	.263	1	0	1
38			min	-54.013	5	-478.768	1	-7.747	5	0	3	-.079	5	0	3
39	M14	1	max	63.806	4	503.282	1	-6.727	12	.006	3	.299	1	0	1
40			min	2.036	12	-409.883	3	-174.968	1	-.01	1	.013	12	0	3
41		2	max	51.83	4	360.054	1	-5.302	12	.006	3	.14	4	.409	3
42			min	2.036	12	-291.452	3	-135.746	1	-.01	1	.006	12	-.504	1
43		3	max	49.846	1	216.826	1	-3.876	12	.006	3	.075	5	.68	3
44			min	2.036	12	-173.02	3	-96.525	1	-.01	1	-.018	1	-.84	1
45		4	max	49.846	1	73.598	1	-2.451	12	.006	3	.04	5	.813	3
46			min	2.036	12	-54.589	3	-57.303	1	-.01	1	-.108	1	-1.01	1
47		5	max	49.846	1	63.842	3	-1.025	12	.006	3	.007	5	.807	3
48			min	2.036	12	-69.63	1	-31.218	4	-.01	1	-.152	1	-1.012	1
49		6	max	49.846	1	182.273	3	21.14	1	.006	3	-.006	12	.664	3
50			min	-6.586	5	-212.858	1	-24.596	5	-.01	1	-.15	1	-.847	1
51		7	max	49.846	1	300.704	3	60.361	1	.006	3	-.004	12	.382	3
52			min	-18.562	5	-356.087	1	-22.391	5	-.01	1	-.103	1	-.515	1
53		8	max	49.846	1	419.136	3	99.583	1	.006	3	0	10	0	15
54			min	-30.538	5	-499.315	1	-20.185	5	-.01	1	-.079	4	-.038	3
55		9	max	49.846	1	537.567	3	138.804	1	.006	3	.13	1	.65	1
56			min	-42.514	5	-642.543	1	-17.98	5	-.01	1	-.097	5	-.596	3
57		10	max	70.182	4	655.998	3	178.026	1	.006	3	.315	1	1.483	1
58			min	2.036	12	-785.771	1	-108.042	14	-.01	1	.009	12	-1.292	3
59		11	max	58.206	4	642.543	1	-4.677	12	.01	1	.141	4	.65	1
60			min	2.036	12	-537.567	3	-138.804	1	-.006	3	.003	12	-.596	3
61		12	max	49.846	1	499.315	1	-3.251	12	.01	1	.074	5	0	15
62			min	2.036	12	-419.136	3	-99.583	1	-.006	3	-.009	1	-.038	3
63		13	max	49.846	1	356.087	1	-1.826	12	.01	1	.038	5	.382	3
64			min	2.036	12	-300.704	3	-60.361	1	-.006	3	-.103	1	-.515	1
65		14	max	49.846	1	212.858	1	-.4	12	.01	1	.006	5	.664	3
66			min	2.036	12	-182.273	3	-31.909	4	-.006	3	-.15	1	-.847	1
67		15	max	49.846	1	69.63	1	18.082	1	.01	1	-.005	12	.807	3
68			min	-.082	15	-63.842	3	-24.744	5	-.006	3	-.152	1	-1.012	1
69		16	max	49.846	1	54.589	3	57.303	1	.01	1	-.003	12	.813	3
70			min	-12.043	5	-73.598	1	-22.538	5	-.006	3	-.108	1	-1.01	1
71		17	max	49.846	1	173.02	3	96.525	1	.01	1	0	3	.68	3
72			min	-24.02	5	-216.826	1	-20.333	5	-.006	3	-.083	4	-.84	1
73		18	max	49.846	1	291.452	3	135.746	1	.01	1	.117	1	.409	3
74			min	-35.996	5	-360.054	1	-18.127	5	-.006	3	-.1	5	-.504	1
75		19	max	49.846	1	409.883	3	174.968	1	.01	1	.299	1	0	1

Envelope Member Section Forces (Continued)

	Member	Sec		Axial[lb]	LC	y Shear[lb]	LC	z Shear[lb]	LC	Torque[k-ft]	LC	y-y Mome...	LC	z-z Mome...	LC
76			min	-47.972	5	-503.282	1	-15.922	5	-.006	3	-.119	5	0	3
77	M15	1	max	84.958	5	571.663	1	-6.699	12	.011	1	.298	1	0	2
78			min	-52.531	1	-218.514	3	-174.94	1	-.005	3	.013	12	0	12
79		2	max	72.982	5	408.168	1	-5.273	12	.011	1	.176	4	.219	3
80			min	-52.531	1	-156.832	3	-135.718	1	-.005	3	.006	12	-.572	1
81		3	max	61.006	5	244.674	1	-3.848	12	.011	1	.101	5	.366	3
82			min	-52.531	1	-95.15	3	-96.497	1	-.005	3	-.018	1	-.952	1
83		4	max	49.03	5	81.179	1	-2.422	12	.011	1	.056	5	.441	3
84			min	-52.531	1	-33.467	3	-57.275	1	-.005	3	-.108	1	-1.142	1
85		5	max	37.054	5	28.215	3	-.997	12	.011	1	.013	5	.444	3
86			min	-52.531	1	-82.316	1	-39.976	4	-.005	3	-.152	1	-1.142	1
87		6	max	25.078	5	89.897	3	21.168	1	.011	1	-.006	12	.375	3
88			min	-52.531	1	-245.811	1	-33.34	5	-.005	3	-.15	1	-.95	1
89		7	max	13.102	5	151.579	3	60.39	1	.011	1	-.004	12	.234	3
90			min	-52.531	1	-409.306	1	-31.135	5	-.005	3	-.103	1	-.568	1
91		8	max	1.126	5	213.261	3	99.611	1	.011	1	0	10	.021	3
92			min	-52.531	1	-572.801	1	-28.929	5	-.005	3	-.103	4	-.003	9
93		9	max	-2.325	12	274.944	3	138.833	1	.011	1	.13	1	.768	1
94			min	-52.531	1	-736.295	1	-26.724	5	-.005	3	-.132	5	-.263	3
95		10	max	-2.325	12	336.626	3	178.054	1	.011	1	.315	1	1.723	1
96			min	-52.531	1	-899.79	1	-112.502	14	-.005	3	.01	12	-.62	3
97		11	max	4.655	5	736.295	1	-4.705	12	.005	3	.176	4	.768	1
98			min	-52.531	1	-274.944	3	-138.833	1	-.011	1	.003	12	-.263	3
99		12	max	-2.325	12	572.801	1	-3.28	12	.005	3	.098	5	.021	3
100			min	-52.531	1	-213.261	3	-99.611	1	-.011	1	-.009	1	-.003	9
101		13	max	-2.325	12	409.306	1	-1.854	12	.005	3	.053	5	.234	3
102			min	-52.531	1	-151.579	3	-60.39	1	-.011	1	-.103	1	-.568	1
103		14	max	-2.325	12	245.811	1	-.429	12	.005	3	.01	5	.375	3
104			min	-52.531	1	-89.897	3	-40.687	4	-.011	1	-.15	1	-.95	1
105		15	max	-2.325	12	82.316	1	18.054	1	.005	3	-.005	12	.444	3
106			min	-54.878	4	-28.215	3	-33.49	5	-.011	1	-.152	1	-1.142	1
107		16	max	-2.325	12	33.467	3	57.275	1	.005	3	-.003	12	.441	3
108			min	-66.854	4	-81.179	1	-31.285	5	-.011	1	-.108	1	-1.142	1
109		17	max	-2.325	12	95.15	3	96.497	1	.005	3	0	3	.366	3
110			min	-78.83	4	-244.674	1	-29.079	5	-.011	1	-.109	4	-.952	1
111		18	max	-2.325	12	156.832	3	135.718	1	.005	3	.117	1	.219	3
112			min	-90.806	4	-408.168	1	-26.874	5	-.011	1	-.136	5	-.572	1
113		19	max	-2.325	12	218.514	3	174.94	1	.005	3	.298	1	0	2
114			min	-102.782	4	-571.663	1	-24.668	5	-.011	1	-.166	5	0	5
115	M16	1	max	83.875	5	547.349	1	-6.457	12	.011	1	.265	1	0	1
116			min	-117.155	1	-205.287	3	-170.116	1	-.008	3	.011	12	0	3
117		2	max	71.899	5	383.854	1	-5.032	12	.011	1	.133	4	.204	3
118			min	-117.155	1	-143.605	3	-130.895	1	-.008	3	.004	12	-.543	1
119		3	max	59.922	5	220.359	1	-3.606	12	.011	1	.075	5	.335	3
120			min	-117.155	1	-81.923	3	-91.673	1	-.008	3	-.041	1	-.896	1
121		4	max	47.946	5	56.864	1	-2.181	12	.011	1	.041	5	.395	3
122			min	-117.155	1	-20.24	3	-52.452	1	-.008	3	-.125	1	-1.057	1
123		5	max	35.97	5	41.442	3	-.755	12	.011	1	.01	5	.382	3
124			min	-117.155	1	-106.631	1	-29.123	4	-.008	3	-.163	1	-1.028	1
125		6	max	23.994	5	103.124	3	25.991	1	.011	1	-.006	12	.298	3
126			min	-117.155	1	-270.125	1	-23.668	5	-.008	3	-.156	1	-.809	1
127		7	max	12.018	5	164.806	3	65.213	1	.011	1	-.004	12	.142	3
128			min	-117.155	1	-433.62	1	-21.462	5	-.008	3	-.103	1	-.398	1
129		8	max	.135	15	226.488	3	104.434	1	.011	1	0	10	.203	1
130			min	-117.155	1	-597.115	1	-19.257	5	-.008	3	-.071	4	-.087	3
131		9	max	-4.901	12	288.17	3	143.656	1	.011	1	.141	1	.995	1
132			min	-117.155	1	-760.61	1	-17.051	5	-.008	3	-.09	5	-.387	3

Envelope Member Section Forces (Continued)

	Member	Sec		Axial[lb]	LC	y Shear[lb]	LC	z Shear[lb]	LC	Torque[k-ft]	LC	y-y Mome...	LC	z-z Mome...	LC
133		10	max	-4.901	12	349.853	3	182.877	1	.011	1	.332	1	1.978	1
134			min	-117.155	1	-924.105	1	-110.145	14	-.005	14	.011	12	-.759	3
135		11	max	-.604	15	760.61	1	-4.947	12	.008	3	.141	1	.995	1
136			min	-117.155	1	-288.17	3	-143.656	1	-.011	1	.004	12	-.387	3
137		12	max	-4.901	12	597.115	1	-3.521	12	.008	3	.069	4	.203	1
138			min	-117.155	1	-226.488	3	-104.434	1	-.011	1	-.004	1	-.087	3
139		13	max	-4.901	12	433.62	1	-2.096	12	.008	3	.034	5	.142	3
140			min	-117.155	1	-164.806	3	-65.213	1	-.011	1	-.103	1	-.398	1
141		14	max	-4.901	12	270.125	1	-.67	12	.008	3	.001	5	.298	3
142			min	-117.155	1	-103.124	3	-32.41	4	-.011	1	-.156	1	-.809	1
143		15	max	-4.901	12	106.631	1	13.23	1	.008	3	-.006	12	.382	3
144			min	-117.155	1	-41.442	3	-24.371	5	-.011	1	-.163	1	-1.028	1
145		16	max	-4.901	12	20.24	3	52.452	1	.008	3	-.004	12	.395	3
146			min	-117.155	1	-56.864	1	-22.165	5	-.011	1	-.125	1	-1.057	1
147		17	max	-4.901	12	81.923	3	91.673	1	.008	3	0	12	.335	3
148			min	-117.155	1	-220.359	1	-19.96	5	-.011	1	-.09	4	-.896	1
149		18	max	-4.901	12	143.605	3	130.895	1	.008	3	.089	1	.204	3
150			min	-117.155	1	-383.854	1	-17.754	5	-.011	1	-.102	5	-.543	1
151		19	max	-4.901	12	205.287	3	170.116	1	.008	3	.265	1	0	1
152			min	-122.506	4	-547.349	1	-15.548	5	-.011	1	-.121	5	0	5
153	M2	1	max	1052.51	1	2.07	4	1.029	1	0	3	0	3	0	1
154			min	-937.484	3	.507	15	-62.957	4	0	4	0	1	0	1
155		2	max	1052.89	1	2.037	4	1.029	1	0	3	0	1	0	15
156			min	-937.2	3	.499	15	-63.286	4	0	4	-.016	4	0	4
157		3	max	1053.269	1	2.003	4	1.029	1	0	3	0	1	0	15
158			min	-936.915	3	.491	15	-63.616	4	0	4	-.032	4	-.001	4
159		4	max	1053.648	1	1.97	4	1.029	1	0	3	0	1	0	15
160			min	-936.631	3	.483	15	-63.945	4	0	4	-.049	4	-.002	4
161		5	max	1054.027	1	1.937	4	1.029	1	0	3	.001	1	0	15
162			min	-936.346	3	.475	15	-64.275	4	0	4	-.065	4	-.002	4
163		6	max	1054.407	1	1.903	4	1.029	1	0	3	.001	1	0	15
164			min	-936.062	3	.467	15	-64.604	4	0	4	-.082	4	-.003	4
165		7	max	1054.786	1	1.87	4	1.029	1	0	3	.002	1	0	15
166			min	-935.777	3	.46	15	-64.934	4	0	4	-.098	4	-.003	4
167		8	max	1055.165	1	1.836	4	1.029	1	0	3	.002	1	0	15
168			min	-935.493	3	.452	15	-65.263	4	0	4	-.115	4	-.004	4
169		9	max	1055.544	1	1.803	4	1.029	1	0	3	.002	1	0	15
170			min	-935.208	3	.444	15	-65.593	4	0	4	-.132	4	-.004	4
171		10	max	1055.924	1	1.77	4	1.029	1	0	3	.002	1	-.001	15
172			min	-934.924	3	.436	15	-65.922	4	0	4	-.149	4	-.004	4
173		11	max	1056.303	1	1.736	4	1.029	1	0	3	.003	1	-.001	15
174			min	-934.64	3	.428	15	-66.251	4	0	4	-.166	4	-.005	4
175		12	max	1056.682	1	1.703	4	1.029	1	0	3	.003	1	-.001	15
176			min	-934.355	3	.42	15	-66.581	4	0	4	-.183	4	-.005	4
177		13	max	1057.061	1	1.669	4	1.029	1	0	3	.003	1	-.001	15
178			min	-934.071	3	.412	15	-66.91	4	0	4	-.2	4	-.006	4
179		14	max	1057.441	1	1.636	4	1.029	1	0	3	.003	1	-.002	15
180			min	-933.786	3	.405	15	-67.24	4	0	4	-.217	4	-.006	4
181		15	max	1057.82	1	1.603	4	1.029	1	0	3	.004	1	-.002	15
182			min	-933.502	3	.397	15	-67.569	4	0	4	-.234	4	-.007	4
183		16	max	1058.199	1	1.569	4	1.029	1	0	3	.004	1	-.002	15
184			min	-933.217	3	.389	15	-67.899	4	0	4	-.251	4	-.007	4
185		17	max	1058.578	1	1.536	4	1.029	1	0	3	.004	1	-.002	15
186			min	-932.933	3	.381	15	-68.228	4	0	4	-.269	4	-.007	4
187		18	max	1058.958	1	1.502	4	1.029	1	0	3	.004	1	-.002	15
188			min	-932.648	3	.373	15	-68.558	4	0	4	-.286	4	-.008	4
189		19	max	1059.337	1	1.469	4	1.029	1	0	3	.005	1	-.002	15

Envelope Member Section Forces (Continued)

	Member	Sec		Axial[lb]	LC	y Shear[lb]	LC	z Shear[lb]	LC	Torque[k-ft]	LC	y-y Mome...	LC	z-z Mome...	LC
190			min	-932.364	3	.365	15	-68.887	4	0	4	-.304	4	-.008	4
191	M3	1	max	325.624	2	8.008	4	1.335	4	0	3	0	1	.008	4
192			min	-455.684	3	1.895	15	.004	12	0	4	-.022	4	.002	15
193		2	max	325.454	2	7.239	4	1.876	4	0	3	0	1	.005	4
194			min	-455.811	3	1.714	15	.004	12	0	4	-.021	4	.001	12
195		3	max	325.283	2	6.469	4	2.416	4	0	3	0	1	.002	2
196			min	-455.939	3	1.533	15	.004	12	0	4	-.02	4	0	3
197		4	max	325.113	2	5.699	4	2.957	4	0	3	0	1	0	2
198			min	-456.067	3	1.352	15	.004	12	0	4	-.019	4	-.001	3
199		5	max	324.942	2	4.929	4	3.497	4	0	3	0	1	0	15
200			min	-456.195	3	1.171	15	.004	12	0	4	-.018	4	-.003	6
201		6	max	324.772	2	4.159	4	4.038	4	0	3	0	1	-.001	15
202			min	-456.322	3	.99	15	.004	12	0	4	-.016	4	-.005	6
203		7	max	324.602	2	3.389	4	4.579	4	0	3	0	1	-.001	15
204			min	-456.45	3	.809	15	.004	12	0	4	-.014	4	-.006	6
205		8	max	324.431	2	2.619	4	5.119	4	0	3	0	1	-.002	15
206			min	-456.578	3	.628	15	.004	12	0	4	-.012	4	-.007	6
207		9	max	324.261	2	1.849	4	5.66	4	0	3	0	1	-.002	15
208			min	-456.706	3	.447	15	.004	12	0	4	-.01	5	-.008	6
209		10	max	324.091	2	1.079	4	6.2	4	0	3	0	1	-.002	15
210			min	-456.833	3	.266	15	.004	12	0	4	-.007	5	-.009	6
211		11	max	323.92	2	.34	2	6.741	4	0	3	0	1	-.002	15
212			min	-456.961	3	-.002	3	.004	12	0	4	-.005	5	-.009	6
213		12	max	323.75	2	-.096	15	7.281	4	0	3	0	1	-.002	15
214			min	-457.089	3	-.463	6	.004	12	0	4	-.002	5	-.009	6
215		13	max	323.58	2	-.277	15	7.822	4	0	3	.001	4	-.002	15
216			min	-457.217	3	-1.233	6	.004	12	0	4	0	12	-.009	6
217		14	max	323.409	2	-.458	15	8.362	4	0	3	.005	4	-.002	15
218			min	-457.344	3	-2.003	6	.004	12	0	4	0	12	-.008	6
219		15	max	323.239	2	-.639	15	8.903	4	0	3	.008	4	-.002	15
220			min	-457.472	3	-2.772	6	.004	12	0	4	0	12	-.007	6
221		16	max	323.069	2	-.82	15	9.444	4	0	3	.012	4	-.001	15
222			min	-457.6	3	-3.542	6	.004	12	0	4	0	12	-.006	6
223		17	max	322.898	2	-1.001	15	9.984	4	0	3	.016	4	0	15
224			min	-457.728	3	-4.312	6	.004	12	0	4	0	12	-.004	6
225		18	max	322.728	2	-1.182	15	10.525	4	0	3	.021	4	0	15
226			min	-457.856	3	-5.082	6	.004	12	0	4	0	12	-.002	6
227		19	max	322.558	2	-1.363	15	11.065	4	0	3	.025	4	0	1
228			min	-457.983	3	-5.852	6	.004	12	0	4	0	12	0	1
229	M4	1	max	1191.889	1	0	1	-.448	12	0	1	.016	4	0	1
230			min	-182.169	3	0	1	-268.831	4	0	1	0	12	0	1
231		2	max	1192.06	1	0	1	-.448	12	0	1	0	12	0	1
232			min	-182.041	3	0	1	-268.979	4	0	1	-.015	4	0	1
233		3	max	1192.23	1	0	1	-.448	12	0	1	0	12	0	1
234			min	-181.913	3	0	1	-269.127	4	0	1	-.046	4	0	1
235		4	max	1192.4	1	0	1	-.448	12	0	1	0	12	0	1
236			min	-181.785	3	0	1	-269.274	4	0	1	-.077	4	0	1
237		5	max	1192.571	1	0	1	-.448	12	0	1	0	12	0	1
238			min	-181.658	3	0	1	-269.422	4	0	1	-.108	4	0	1
239		6	max	1192.741	1	0	1	-.448	12	0	1	0	12	0	1
240			min	-181.53	3	0	1	-269.57	4	0	1	-.139	4	0	1
241		7	max	1192.911	1	0	1	-.448	12	0	1	0	12	0	1
242			min	-181.402	3	0	1	-269.717	4	0	1	-.17	4	0	1
243		8	max	1193.082	1	0	1	-.448	12	0	1	0	12	0	1
244			min	-181.274	3	0	1	-269.865	4	0	1	-.201	4	0	1
245		9	max	1193.252	1	0	1	-.448	12	0	1	0	12	0	1
246			min	-181.147	3	0	1	-270.013	4	0	1	-.232	4	0	1

Envelope Member Section Forces (Continued)

	Member	Sec		Axial[lb]	LC	y Shear[lb]	LC	z Shear[lb]	LC	Torque[k-ft]	LC	y-y Mome...	LC	z-z Mome...	LC
247		10	max	1193.423	1	0	1	-.448	12	0	1	0	12	0	1
248			min	-181.019	3	0	1	-270.16	4	0	1	-.263	4	0	1
249		11	max	1193.593	1	0	1	-.448	12	0	1	0	12	0	1
250			min	-180.891	3	0	1	-270.308	4	0	1	-.294	4	0	1
251		12	max	1193.763	1	0	1	-.448	12	0	1	0	12	0	1
252			min	-180.763	3	0	1	-270.455	4	0	1	-.325	4	0	1
253		13	max	1193.934	1	0	1	-.448	12	0	1	0	12	0	1
254			min	-180.636	3	0	1	-270.603	4	0	1	-.356	4	0	1
255		14	max	1194.104	1	0	1	-.448	12	0	1	0	12	0	1
256			min	-180.508	3	0	1	-270.751	4	0	1	-.387	4	0	1
257		15	max	1194.274	1	0	1	-.448	12	0	1	0	12	0	1
258			min	-180.38	3	0	1	-270.898	4	0	1	-.418	4	0	1
259		16	max	1194.445	1	0	1	-.448	12	0	1	0	12	0	1
260			min	-180.252	3	0	1	-271.046	4	0	1	-.449	4	0	1
261		17	max	1194.615	1	0	1	-.448	12	0	1	0	12	0	1
262			min	-180.124	3	0	1	-271.194	4	0	1	-.48	4	0	1
263		18	max	1194.785	1	0	1	-.448	12	0	1	0	12	0	1
264			min	-179.997	3	0	1	-271.341	4	0	1	-.511	4	0	1
265		19	max	1194.956	1	0	1	-.448	12	0	1	0	12	0	1
266			min	-179.869	3	0	1	-271.489	4	0	1	-.543	4	0	1
267	M6	1	max	3397.957	1	2.339	2	0	1	0	1	0	4	0	1
268			min	-3082.058	3	.261	12	-63.573	4	0	4	0	1	0	1
269		2	max	3398.336	1	2.313	2	0	1	0	1	0	1	0	12
270			min	-3081.774	3	.248	12	-63.902	4	0	4	-.016	4	0	2
271		3	max	3398.715	1	2.287	2	0	1	0	1	0	1	0	12
272			min	-3081.489	3	.235	12	-64.232	4	0	4	-.033	4	-.001	2
273		4	max	3399.095	1	2.261	2	0	1	0	1	0	1	0	12
274			min	-3081.205	3	.222	12	-64.561	4	0	4	-.049	4	-.002	2
275		5	max	3399.474	1	2.235	2	0	1	0	1	0	1	0	12
276			min	-3080.921	3	.209	12	-64.891	4	0	4	-.066	4	-.002	2
277		6	max	3399.853	1	2.209	2	0	1	0	1	0	1	0	12
278			min	-3080.636	3	.196	12	-65.22	4	0	4	-.082	4	-.003	2
279		7	max	3400.232	1	2.183	2	0	1	0	1	0	1	0	12
280			min	-3080.352	3	.183	12	-65.55	4	0	4	-.099	4	-.003	2
281		8	max	3400.612	1	2.157	2	0	1	0	1	0	1	0	12
282			min	-3080.067	3	.165	3	-65.879	4	0	4	-.116	4	-.004	2
283		9	max	3400.991	1	2.131	2	0	1	0	1	0	1	0	12
284			min	-3079.783	3	.146	3	-66.209	4	0	4	-.133	4	-.005	2
285		10	max	3401.37	1	2.105	2	0	1	0	1	0	1	0	12
286			min	-3079.498	3	.126	3	-66.538	4	0	4	-.15	4	-.005	2
287		11	max	3401.749	1	2.079	2	0	1	0	1	0	1	0	12
288			min	-3079.214	3	.107	3	-66.868	4	0	4	-.167	4	-.006	2
289		12	max	3402.129	1	2.053	2	0	1	0	1	0	1	0	12
290			min	-3078.929	3	.087	3	-67.197	4	0	4	-.184	4	-.006	2
291		13	max	3402.508	1	2.027	2	0	1	0	1	0	1	0	12
292			min	-3078.645	3	.068	3	-67.526	4	0	4	-.202	4	-.007	2
293		14	max	3402.887	1	2.001	2	0	1	0	1	0	1	0	3
294			min	-3078.361	3	.048	3	-67.856	4	0	4	-.219	4	-.007	2
295		15	max	3403.266	1	1.975	2	0	1	0	1	0	1	0	3
296			min	-3078.076	3	.029	3	-68.185	4	0	4	-.236	4	-.008	2
297		16	max	3403.646	1	1.949	2	0	1	0	1	0	1	0	3
298			min	-3077.792	3	.009	3	-68.515	4	0	4	-.254	4	-.008	2
299		17	max	3404.025	1	1.923	2	0	1	0	1	0	1	0	3
300			min	-3077.507	3	-.01	3	-68.844	4	0	4	-.271	4	-.009	2
301		18	max	3404.404	1	1.897	2	0	1	0	1	0	1	0	3
302			min	-3077.223	3	-.03	3	-69.174	4	0	4	-.289	4	-.009	2
303		19	max	3404.783	1	1.871	2	0	1	0	1	0	1	0	3

Envelope Member Section Forces (Continued)

	Member	Sec		Axial[lb]	LC	y Shear[lb]	LC	z Shear[lb]	LC	Torque[k-ft]	LC	y-y Mome...	LC	z-z Mome...	LC
304			min	-3076.938	3	-.049	3	-69.503	4	0	4	-.307	4	-.01	2
305	M7	1	max	1366.332	2	8.022	6	1.196	4	0	1	0	1	.01	2
306			min	-1430.375	3	1.882	15	0	1	0	4	-.022	4	0	3
307		2	max	1366.162	2	7.252	6	1.737	4	0	1	0	1	.007	2
308			min	-1430.503	3	1.701	15	0	1	0	4	-.021	4	-.001	3
309		3	max	1365.992	2	6.482	6	2.277	4	0	1	0	1	.005	2
310			min	-1430.631	3	1.52	15	0	1	0	4	-.02	4	-.003	3
311		4	max	1365.821	2	5.712	6	2.818	4	0	1	0	1	.002	2
312			min	-1430.758	3	1.339	15	0	1	0	4	-.019	4	-.004	3
313		5	max	1365.651	2	4.942	6	3.358	4	0	1	0	1	0	2
314			min	-1430.886	3	1.158	15	0	1	0	4	-.018	4	-.005	3
315		6	max	1365.481	2	4.172	6	3.899	4	0	1	0	1	-.001	15
316			min	-1431.014	3	.977	15	0	1	0	4	-.016	4	-.006	3
317		7	max	1365.31	2	3.402	6	4.439	4	0	1	0	1	-.001	15
318			min	-1431.142	3	.796	15	0	1	0	4	-.015	4	-.006	3
319		8	max	1365.14	2	2.632	6	4.98	4	0	1	0	1	-.002	15
320			min	-1431.27	3	.615	15	0	1	0	4	-.013	4	-.007	4
321		9	max	1364.97	2	1.883	2	5.52	4	0	1	0	1	-.002	15
322			min	-1431.397	3	.388	12	0	1	0	4	-.011	4	-.008	4
323		10	max	1364.799	2	1.283	2	6.061	4	0	1	0	1	-.002	15
324			min	-1431.525	3	.077	3	0	1	0	4	-.008	4	-.009	4
325		11	max	1364.629	2	.683	2	6.602	4	0	1	0	1	-.002	15
326			min	-1431.653	3	-.373	3	0	1	0	4	-.005	4	-.009	4
327		12	max	1364.459	2	.083	2	7.142	4	0	1	0	1	-.002	15
328			min	-1431.781	3	-.823	3	0	1	0	4	-.003	4	-.009	4
329		13	max	1364.288	2	-.29	15	7.683	4	0	1	0	4	-.002	15
330			min	-1431.908	3	-1.273	3	0	1	0	4	0	1	-.009	4
331		14	max	1364.118	2	-.471	15	8.223	4	0	1	.004	4	-.002	15
332			min	-1432.036	3	-1.988	4	0	1	0	4	0	1	-.008	4
333		15	max	1363.948	2	-.652	15	8.764	4	0	1	.007	4	-.002	15
334			min	-1432.164	3	-2.758	4	0	1	0	4	0	1	-.007	4
335		16	max	1363.777	2	-.833	15	9.304	4	0	1	.011	4	-.001	15
336			min	-1432.292	3	-3.528	4	0	1	0	4	0	1	-.006	4
337		17	max	1363.607	2	-1.014	15	9.845	4	0	1	.015	4	-.001	15
338			min	-1432.419	3	-4.298	4	0	1	0	4	0	1	-.004	4
339		18	max	1363.437	2	-1.195	15	10.385	4	0	1	.02	4	0	15
340			min	-1432.547	3	-5.068	4	0	1	0	4	0	1	-.002	4
341		19	max	1363.266	2	-1.376	15	10.926	4	0	1	.024	4	0	1
342			min	-1432.675	3	-5.838	4	0	1	0	4	0	1	0	1
343	M8	1	max	3349.066	1	0	1	0	1	0	1	.015	4	0	1
344			min	-660.314	3	0	1	-261.502	4	0	1	0	1	0	1
345		2	max	3349.236	1	0	1	0	1	0	1	0	1	0	1
346			min	-660.187	3	0	1	-261.649	4	0	1	-.015	4	0	1
347		3	max	3349.407	1	0	1	0	1	0	1	0	1	0	1
348			min	-660.059	3	0	1	-261.797	4	0	1	-.045	4	0	1
349		4	max	3349.577	1	0	1	0	1	0	1	0	1	0	1
350			min	-659.931	3	0	1	-261.945	4	0	1	-.075	4	0	1
351		5	max	3349.747	1	0	1	0	1	0	1	0	1	0	1
352			min	-659.803	3	0	1	-262.092	4	0	1	-.105	4	0	1
353		6	max	3349.918	1	0	1	0	1	0	1	0	1	0	1
354			min	-659.675	3	0	1	-262.24	4	0	1	-.135	4	0	1
355		7	max	3350.088	1	0	1	0	1	0	1	0	1	0	1
356			min	-659.548	3	0	1	-262.388	4	0	1	-.165	4	0	1
357		8	max	3350.258	1	0	1	0	1	0	1	0	1	0	1
358			min	-659.42	3	0	1	-262.535	4	0	1	-.196	4	0	1
359		9	max	3350.429	1	0	1	0	1	0	1	0	1	0	1
360			min	-659.292	3	0	1	-262.683	4	0	1	-.226	4	0	1

Envelope Member Section Forces (Continued)

	Member	Sec		Axial[lb]	LC	y Shear[lb]	LC	z Shear[lb]	LC	Torque[k-ft]	LC	y-y Mome...	LC	z-z Mome...	LC
361		10	max	3350.599	1	0	1	0	1	0	1	0	1	0	1
362			min	-659.164	3	0	1	-262.831	4	0	1	-.256	4	0	1
363		11	max	3350.77	1	0	1	0	1	0	1	0	1	0	1
364			min	-659.037	3	0	1	-262.978	4	0	1	-.286	4	0	1
365		12	max	3350.94	1	0	1	0	1	0	1	0	1	0	1
366			min	-658.909	3	0	1	-263.126	4	0	1	-.316	4	0	1
367		13	max	3351.11	1	0	1	0	1	0	1	0	1	0	1
368			min	-658.781	3	0	1	-263.273	4	0	1	-.347	4	0	1
369		14	max	3351.281	1	0	1	0	1	0	1	0	1	0	1
370			min	-658.653	3	0	1	-263.421	4	0	1	-.377	4	0	1
371		15	max	3351.451	1	0	1	0	1	0	1	0	1	0	1
372			min	-658.526	3	0	1	-263.569	4	0	1	-.407	4	0	1
373		16	max	3351.621	1	0	1	0	1	0	1	0	1	0	1
374			min	-658.398	3	0	1	-263.716	4	0	1	-.437	4	0	1
375		17	max	3351.792	1	0	1	0	1	0	1	0	1	0	1
376			min	-658.27	3	0	1	-263.864	4	0	1	-.468	4	0	1
377		18	max	3351.962	1	0	1	0	1	0	1	0	1	0	1
378			min	-658.142	3	0	1	-264.012	4	0	1	-.498	4	0	1
379		19	max	3352.132	1	0	1	0	1	0	1	0	1	0	1
380			min	-658.015	3	0	1	-264.159	4	0	1	-.528	4	0	1
381	M10	1	max	1052.51	1	1.983	6	-.041	12	0	1	0	1	0	1
382			min	-937.484	3	.448	15	-63.503	4	0	5	0	3	0	1
383		2	max	1052.89	1	1.949	6	-.041	12	0	1	0	10	0	15
384			min	-937.2	3	.44	15	-63.832	4	0	5	-.016	4	0	6
385		3	max	1053.269	1	1.916	6	-.041	12	0	1	0	12	0	15
386			min	-936.915	3	.432	15	-64.162	4	0	5	-.033	4	0	6
387		4	max	1053.648	1	1.882	6	-.041	12	0	1	0	12	0	15
388			min	-936.631	3	.424	15	-64.491	4	0	5	-.049	4	-.001	6
389		5	max	1054.027	1	1.849	6	-.041	12	0	1	0	12	0	15
390			min	-936.346	3	.416	15	-64.82	4	0	5	-.066	4	-.002	6
391		6	max	1054.407	1	1.816	6	-.041	12	0	1	0	12	0	15
392			min	-936.062	3	.409	15	-65.15	4	0	5	-.082	4	-.002	6
393		7	max	1054.786	1	1.782	6	-.041	12	0	1	0	12	0	15
394			min	-935.777	3	.401	15	-65.479	4	0	5	-.099	4	-.003	6
395		8	max	1055.165	1	1.749	6	-.041	12	0	1	0	12	0	15
396			min	-935.493	3	.393	15	-65.809	4	0	5	-.116	4	-.003	6
397		9	max	1055.544	1	1.715	6	-.041	12	0	1	0	12	0	15
398			min	-935.208	3	.385	15	-66.138	4	0	5	-.133	4	-.004	6
399		10	max	1055.924	1	1.682	6	-.041	12	0	1	0	12	0	15
400			min	-934.924	3	.377	15	-66.468	4	0	5	-.15	4	-.004	6
401		11	max	1056.303	1	1.649	6	-.041	12	0	1	0	12	-.001	15
402			min	-934.64	3	.369	15	-66.797	4	0	5	-.167	4	-.005	6
403		12	max	1056.682	1	1.615	6	-.041	12	0	1	0	12	-.001	15
404			min	-934.355	3	.362	15	-67.127	4	0	5	-.184	4	-.005	6
405		13	max	1057.061	1	1.582	6	-.041	12	0	1	0	12	-.001	15
406			min	-934.071	3	.354	15	-67.456	4	0	5	-.201	4	-.005	6
407		14	max	1057.441	1	1.548	6	-.041	12	0	1	0	12	-.001	15
408			min	-933.786	3	.346	15	-67.786	4	0	5	-.219	4	-.006	6
409		15	max	1057.82	1	1.515	6	-.041	12	0	1	0	12	-.001	15
410			min	-933.502	3	.338	15	-68.115	4	0	5	-.236	4	-.006	6
411		16	max	1058.199	1	1.482	6	-.041	12	0	1	0	12	-.001	15
412			min	-933.217	3	.33	15	-68.445	4	0	5	-.254	4	-.007	6
413		17	max	1058.578	1	1.448	6	-.041	12	0	1	0	12	-.002	15
414			min	-932.933	3	.322	15	-68.774	4	0	5	-.271	4	-.007	6
415		18	max	1058.958	1	1.415	6	-.041	12	0	1	0	12	-.002	15
416			min	-932.648	3	.314	15	-69.103	4	0	5	-.289	4	-.007	6
417		19	max	1059.337	1	1.381	6	-.041	12	0	1	0	12	-.002	15

Envelope Member Section Forces (Continued)

	Member	Sec		Axial[lb]	LC	y Shear[lb]	LC	z Shear[lb]	LC	Torque[k-ft]	LC	y-y Mome...	LC	z-z Mome...	LC
418			min	-932.364	3	.307	15	-69.433	4	0	5	-.307	4	-.008	6
419	M11	1	max	325.624	2	7.955	6	1.293	4	0	1	0	12	.008	6
420			min	-455.684	3	1.859	15	-.081	1	0	4	-.022	4	.002	15
421		2	max	325.454	2	7.185	6	1.833	4	0	1	0	12	.005	2
422			min	-455.811	3	1.678	15	-.081	1	0	4	-.021	4	0	15
423		3	max	325.283	2	6.415	6	2.374	4	0	1	0	12	.002	2
424			min	-455.939	3	1.497	15	-.081	1	0	4	-.02	4	0	3
425		4	max	325.113	2	5.645	6	2.914	4	0	1	0	12	0	2
426			min	-456.067	3	1.316	15	-.081	1	0	4	-.019	4	-.001	3
427		5	max	324.942	2	4.875	6	3.455	4	0	1	0	12	0	15
428			min	-456.195	3	1.135	15	-.081	1	0	4	-.018	4	-.003	4
429		6	max	324.772	2	4.105	6	3.995	4	0	1	0	12	-.001	15
430			min	-456.322	3	.954	15	-.081	1	0	4	-.016	4	-.005	4
431		7	max	324.602	2	3.335	6	4.536	4	0	1	0	12	-.002	15
432			min	-456.45	3	.773	15	-.081	1	0	4	-.014	4	-.006	4
433		8	max	324.431	2	2.565	6	5.076	4	0	1	0	12	-.002	15
434			min	-456.578	3	.592	15	-.081	1	0	4	-.012	4	-.008	4
435		9	max	324.261	2	1.795	6	5.617	4	0	1	0	12	-.002	15
436			min	-456.706	3	.411	15	-.081	1	0	4	-.01	4	-.009	4
437		10	max	324.091	2	1.025	6	6.157	4	0	1	0	12	-.002	15
438			min	-456.833	3	.23	15	-.081	1	0	4	-.008	4	-.009	4
439		11	max	323.92	2	.34	2	6.698	4	0	1	0	12	-.002	15
440			min	-456.961	3	-.002	3	-.081	1	0	4	-.005	4	-.01	4
441		12	max	323.75	2	-.132	15	7.239	4	0	1	0	12	-.002	15
442			min	-457.089	3	-.516	4	-.081	1	0	4	-.002	4	-.009	4
443		13	max	323.58	2	-.313	15	7.779	4	0	1	.001	5	-.002	15
444			min	-457.217	3	-1.286	4	-.081	1	0	4	0	1	-.009	4
445		14	max	323.409	2	-.494	15	8.32	4	0	1	.005	5	-.002	15
446			min	-457.344	3	-2.056	4	-.081	1	0	4	0	1	-.008	4
447		15	max	323.239	2	-.675	15	8.86	4	0	1	.008	5	-.002	15
448			min	-457.472	3	-2.826	4	-.081	1	0	4	0	1	-.007	4
449		16	max	323.069	2	-.856	15	9.401	4	0	1	.012	4	-.001	15
450			min	-457.6	3	-3.596	4	-.081	1	0	4	0	1	-.006	4
451		17	max	322.898	2	-1.037	15	9.941	4	0	1	.016	4	-.001	15
452			min	-457.728	3	-4.366	4	-.081	1	0	4	0	1	-.004	4
453		18	max	322.728	2	-1.218	15	10.482	4	0	1	.02	4	0	15
454			min	-457.856	3	-5.136	4	-.081	1	0	4	0	1	-.002	4
455		19	max	322.558	2	-1.399	15	11.022	4	0	1	.025	4	0	1
456			min	-457.983	3	-5.906	4	-.081	1	0	4	0	1	0	1
457	M12	1	max	1191.889	1	0	1	10.774	1	0	1	.015	4	0	1
458			min	-182.169	3	0	1	-263.097	4	0	1	0	1	0	1
459		2	max	1192.06	1	0	1	10.774	1	0	1	0	1	0	1
460			min	-182.041	3	0	1	-263.245	4	0	1	-.015	4	0	1
461		3	max	1192.23	1	0	1	10.774	1	0	1	.002	1	0	1
462			min	-181.913	3	0	1	-263.392	4	0	1	-.045	4	0	1
463		4	max	1192.4	1	0	1	10.774	1	0	1	.003	1	0	1
464			min	-181.785	3	0	1	-263.54	4	0	1	-.075	4	0	1
465		5	max	1192.571	1	0	1	10.774	1	0	1	.004	1	0	1
466			min	-181.658	3	0	1	-263.688	4	0	1	-.106	4	0	1
467		6	max	1192.741	1	0	1	10.774	1	0	1	.006	1	0	1
468			min	-181.53	3	0	1	-263.835	4	0	1	-.136	4	0	1
469		7	max	1192.911	1	0	1	10.774	1	0	1	.007	1	0	1
470			min	-181.402	3	0	1	-263.983	4	0	1	-.166	4	0	1
471		8	max	1193.082	1	0	1	10.774	1	0	1	.008	1	0	1
472			min	-181.274	3	0	1	-264.131	4	0	1	-.196	4	0	1
473		9	max	1193.252	1	0	1	10.774	1	0	1	.009	1	0	1
474			min	-181.147	3	0	1	-264.278	4	0	1	-.227	4	0	1

Envelope Member Section Forces (Continued)

	Member	Sec		Axial[lb]	LC	y Shear[lb]	LC	z Shear[lb]	LC	Torque[k-ft]	LC	y-y Mome...	LC	z-z Mome...	LC
475		10	max	1193.423	1	0	1	10.774	1	0	1	.011	1	0	1
476			min	-181.019	3	0	1	-264.426	4	0	1	-.257	4	0	1
477		11	max	1193.593	1	0	1	10.774	1	0	1	.012	1	0	1
478			min	-180.891	3	0	1	-264.574	4	0	1	-.287	4	0	1
479		12	max	1193.763	1	0	1	10.774	1	0	1	.013	1	0	1
480			min	-180.763	3	0	1	-264.721	4	0	1	-.318	4	0	1
481		13	max	1193.934	1	0	1	10.774	1	0	1	.014	1	0	1
482			min	-180.636	3	0	1	-264.869	4	0	1	-.348	4	0	1
483		14	max	1194.104	1	0	1	10.774	1	0	1	.016	1	0	1
484			min	-180.508	3	0	1	-265.016	4	0	1	-.379	4	0	1
485		15	max	1194.274	1	0	1	10.774	1	0	1	.017	1	0	1
486			min	-180.38	3	0	1	-265.164	4	0	1	-.409	4	0	1
487		16	max	1194.445	1	0	1	10.774	1	0	1	.018	1	0	1
488			min	-180.252	3	0	1	-265.312	4	0	1	-.44	4	0	1
489		17	max	1194.615	1	0	1	10.774	1	0	1	.019	1	0	1
490			min	-180.124	3	0	1	-265.459	4	0	1	-.47	4	0	1
491		18	max	1194.785	1	0	1	10.774	1	0	1	.02	1	0	1
492			min	-179.997	3	0	1	-265.607	4	0	1	-.501	4	0	1
493		19	max	1194.956	1	0	1	10.774	1	0	1	.022	1	0	1
494			min	-179.869	3	0	1	-265.755	4	0	1	-.531	4	0	1
495	M1	1	max	169.918	1	527.417	3	53.993	5	0	1	.263	1	0	3
496			min	-7.747	5	-477.413	1	-110.272	1	0	3	-.079	5	-.013	1
497		2	max	170.408	1	526.407	3	55.234	5	0	1	.205	1	.24	1
498			min	-7.518	5	-478.759	1	-110.272	1	0	3	-.05	5	-.278	3
499		3	max	270.972	3	529.086	1	-3.271	15	0	3	.147	1	.481	1
500			min	-168.14	2	-376.383	3	-109.505	1	0	1	-.022	5	-.544	3
501		4	max	271.34	3	527.74	1	-2.435	15	0	3	.089	1	.202	1
502			min	-167.65	2	-377.393	3	-109.505	1	0	1	-.024	5	-.345	3
503		5	max	271.707	3	526.394	1	-1.6	15	0	3	.031	1	-.003	15
504			min	-167.16	2	-378.402	3	-109.505	1	0	1	-.026	5	-.146	3
505		6	max	272.075	3	525.048	1	-.764	15	0	3	-.001	12	.054	3
506			min	-166.67	2	-379.412	3	-109.505	1	0	1	-.032	4	-.354	1
507		7	max	272.442	3	523.702	1	.072	15	0	3	-.004	12	.254	3
508			min	-166.18	2	-380.421	3	-109.505	1	0	1	-.084	1	-.631	1
509		8	max	272.81	3	522.356	1	1.208	5	0	3	-.006	12	.455	3
510			min	-165.69	2	-381.431	3	-109.505	1	0	1	-.142	1	-.907	1
511		9	max	283.327	3	34.91	2	50.345	5	0	9	.083	1	.533	3
512			min	-96.386	2	.406	15	-159.38	1	0	3	-.13	5	-1.033	1
513		10	max	283.694	3	33.564	2	51.587	5	0	9	0	12	.518	3
514			min	-95.896	2	0	5	-159.38	1	0	3	-.104	4	-1.043	1
515		11	max	284.062	3	32.218	2	52.828	5	0	9	-.004	12	.504	3
516			min	-95.406	2	-1.674	4	-159.38	1	0	3	-.093	4	-1.052	1
517		12	max	294.532	3	245.484	3	145.058	5	0	1	.14	1	.438	3
518			min	-58.601	5	-559.156	1	-106.911	1	0	3	-.194	5	-.928	1
519		13	max	294.9	3	244.474	3	146.299	5	0	1	.084	1	.309	3
520			min	-58.372	5	-560.502	1	-106.911	1	0	3	-.117	5	-.633	1
521		14	max	295.267	3	243.464	3	147.54	5	0	1	.027	1	.18	3
522			min	-58.143	5	-561.848	1	-106.911	1	0	3	-.04	5	-.337	1
523		15	max	295.635	3	242.455	3	148.782	5	0	1	.038	5	.052	3
524			min	-57.915	5	-563.194	1	-106.911	1	0	3	-.029	1	-.04	1
525		16	max	296.002	3	241.445	3	150.023	5	0	1	.117	5	.257	1
526			min	-57.686	5	-564.54	1	-106.911	1	0	3	-.085	1	-.076	3
527		17	max	296.37	3	240.436	3	151.265	5	0	1	.197	5	.556	1
528			min	-57.457	5	-565.886	1	-106.911	1	0	3	-.142	1	-.203	3
529		18	max	15.32	5	549.971	1	-4.901	12	0	5	.173	5	.279	1
530			min	-170.603	1	-204.316	3	-123.832	4	0	1	-.203	1	-.1	3
531		19	max	15.548	5	548.625	1	-4.901	12	0	5	.121	5	.008	3

Envelope Member Section Forces (Continued)

	Member	Sec		Axial[lb]	LC	y Shear[lb]	LC	z Shear[lb]	LC	Torque[k-ft]	LC	y-y Mome...	LC	z-z Mome...	LC
532			min	-170.113	1	-205.326	3	-122.591	4	0	1	-.265	1	-.011	1
533	M5	1	max	366.151	1	1757.808	3	95.218	5	0	1	0	1	.025	1
534			min	12.562	12	-1612.422	1	0	1	0	4	-.179	4	0	3
535		2	max	366.641	1	1756.798	3	96.459	5	0	1	0	1	.876	1
536			min	12.807	12	-1613.768	1	0	1	0	4	-.129	4	-.928	3
537		3	max	872.047	3	1627.177	1	39.76	4	0	4	0	1	1.689	1
538			min	-616.978	2	-1217.22	3	0	1	0	1	-.079	4	-1.819	3
539		4	max	872.415	3	1625.83	1	41.002	4	0	4	0	1	.831	1
540			min	-616.488	2	-1218.23	3	0	1	0	1	-.058	4	-1.176	3
541		5	max	872.782	3	1624.484	1	42.243	4	0	4	0	1	.009	9
542			min	-615.999	2	-1219.239	3	0	1	0	1	-.036	4	-.533	3
543		6	max	873.15	3	1623.138	1	43.485	4	0	4	0	1	.11	3
544			min	-615.509	2	-1220.249	3	0	1	0	1	-.013	5	-.883	1
545		7	max	873.517	3	1621.792	1	44.726	4	0	4	.01	4	.755	3
546			min	-615.019	2	-1221.259	3	0	1	0	1	0	1	-1.74	1
547		8	max	873.884	3	1620.446	1	45.967	4	0	4	.034	4	1.399	3
548			min	-614.529	2	-1222.268	3	0	1	0	1	0	1	-2.595	1
549		9	max	892.441	3	115.629	2	161.685	4	0	1	0	1	1.613	3
550			min	-472.562	2	.407	15	0	1	0	1	-.18	4	-2.935	1
551		10	max	892.808	3	114.283	2	162.926	4	0	1	0	1	1.56	3
552			min	-472.072	2	.001	15	0	1	0	1	-.094	5	-2.968	1
553		11	max	893.175	3	112.937	2	164.168	4	0	1	0	1	1.509	3
554			min	-471.582	2	-1.497	6	0	1	0	1	-.01	5	-3	1
555		12	max	911.825	3	782.703	3	204.184	4	0	1	0	1	1.323	3
556			min	-329.629	2	-1744.624	1	0	1	0	4	-.279	4	-2.673	1
557		13	max	912.193	3	781.693	3	205.425	4	0	1	0	1	.911	3
558			min	-329.139	2	-1745.97	1	0	1	0	4	-.17	4	-1.752	1
559		14	max	912.56	3	780.684	3	206.667	4	0	1	0	1	.498	3
560			min	-328.649	2	-1747.316	1	0	1	0	4	-.062	4	-.83	1
561		15	max	912.927	3	779.674	3	207.908	4	0	1	.048	4	.146	2
562			min	-328.159	2	-1748.662	1	0	1	0	4	0	1	-.004	13
563		16	max	913.295	3	778.665	3	209.15	4	0	1	.158	4	1.015	1
564			min	-327.669	2	-1750.008	1	0	1	0	4	0	1	-.324	3
565		17	max	913.662	3	777.655	3	210.391	4	0	1	.268	4	1.939	1
566			min	-327.179	2	-1751.354	1	0	1	0	4	0	1	-.735	3
567		18	max	-12.989	12	1857.169	1	0	1	0	4	.277	4	1.002	1
568			min	-366.251	1	-698.937	3	-35.971	5	0	1	0	1	-.384	3
569		19	max	-12.744	12	1855.823	1	0	1	0	4	.26	4	.023	1
570			min	-365.761	1	-699.947	3	-34.729	5	0	1	0	1	-.015	3
571	M9	1	max	169.918	1	527.417	3	110.272	1	0	3	-.011	12	0	3
572			min	6.549	12	-477.413	1	4.788	12	0	4	-.263	1	-.013	1
573		2	max	170.408	1	526.407	3	110.272	1	0	3	-.009	12	.24	1
574			min	6.794	12	-478.759	1	4.788	12	0	4	-.205	1	-.278	3
575		3	max	270.972	3	529.086	1	109.505	1	0	1	-.006	12	.481	1
576			min	-168.14	2	-376.383	3	4.721	15	0	3	-.147	1	-.544	3
577		4	max	271.34	3	527.74	1	109.505	1	0	1	-.004	12	.202	1
578			min	-167.65	2	-377.393	3	4.745	12	0	3	-.089	1	-.345	3
579		5	max	271.707	3	526.394	1	109.505	1	0	1	-.001	12	-.003	15
580			min	-167.16	2	-378.402	3	4.745	12	0	3	-.036	4	-.146	3
581		6	max	272.075	3	525.048	1	109.505	1	0	1	.026	1	.054	3
582			min	-166.67	2	-379.412	3	4.745	12	0	3	-.024	5	-.354	1
583		7	max	272.442	3	523.702	1	109.505	1	0	1	.084	1	.254	3
584			min	-166.18	2	-380.421	3	4.745	12	0	3	-.017	5	-.631	1
585		8	max	272.81	3	522.356	1	109.505	1	0	1	.142	1	.455	3
586			min	-165.69	2	-381.431	3	4.745	12	0	3	-.011	5	-.907	1
587		9	max	283.327	3	34.91	2	159.38	1	0	3	-.004	12	.533	3
588			min	-96.386	2	.412	15	6.779	12	0	9	-.158	4	-1.033	1

Envelope Member Section Forces (Continued)

	Member	Sec		Axial[lb]	LC	y Shear[lb]	LC	z Shear[lb]	LC	Torque[k-ft]	LC	y-y Mome...	LC	z-z Mome...	LC
589		10	max	283.694	3	33.564	2	159.38	1	0	3	.001	1	.518	3
590			min	-95.896	2	.006	15	6.779	12	0	9	-.103	4	-1.043	1
591		11	max	284.062	3	32.218	2	159.38	1	0	3	.085	1	.504	3
592			min	-95.406	2	-1.628	6	6.779	12	0	9	-.066	5	-1.052	1
593		12	max	294.532	3	245.484	3	181.718	4	0	3	-.006	12	.438	3
594			min	-56.866	10	-559.156	1	4.456	12	0	1	-.242	4	-.928	1
595		13	max	294.9	3	244.474	3	182.96	4	0	3	-.004	12	.309	3
596			min	-56.458	10	-560.502	1	4.456	12	0	1	-.146	4	-.633	1
597		14	max	295.267	3	243.464	3	184.201	4	0	3	-.001	12	.18	3
598			min	-56.049	10	-561.848	1	4.456	12	0	1	-.049	4	-.337	1
599		15	max	295.635	3	242.455	3	185.443	4	0	3	.049	4	.052	3
600			min	-55.641	10	-563.194	1	4.456	12	0	1	.001	12	-.04	1
601		16	max	296.002	3	241.445	3	186.684	4	0	3	.147	4	.257	1
602			min	-55.233	10	-564.54	1	4.456	12	0	1	.004	12	-.076	3
603		17	max	296.37	3	240.436	3	187.925	4	0	3	.246	4	.556	1
604			min	-54.824	10	-565.886	1	4.456	12	0	1	.006	12	-.203	3
605		18	max	-6.702	12	549.971	1	117.281	1	0	1	.241	4	.279	1
606			min	-170.603	1	-204.316	3	-85.252	5	0	3	.008	12	-.1	3
607		19	max	-6.457	12	548.625	1	117.281	1	0	1	.265	1	.008	3
608			min	-170.113	1	-205.326	3	-84.011	5	0	3	.011	12	-.011	1

Envelope Member Section Deflections

	Member	Sec		x [in]	LC	y [in]	LC	z [in]	LC	x Rotate [r...	LC	(n) L/y Ratio	LC	(n) L/z Ratio	LC
1	M13	1	max	.001	1	.104	1	.005	3	8.29e-3	1	NC	1	NC	1
2			min	-.601	4	-.012	3	-.002	2	-9.946e-4	3	NC	1	NC	1
3		2	max	0	1	.276	3	.045	1	9.583e-3	1	NC	5	NC	2
4			min	-.601	4	-.137	1	-.02	5	-1.027e-3	3	873.478	3	5820.473	1
5		3	max	0	1	.51	3	.109	1	1.088e-2	1	NC	5	NC	3
6			min	-.601	4	-.328	1	-.023	5	-1.06e-3	3	482.732	3	2366.068	1
7		4	max	0	1	.652	3	.164	1	1.217e-2	1	NC	5	NC	3
8			min	-.601	4	-.436	1	-.016	5	-1.092e-3	3	379.716	3	1560.321	1
9		5	max	0	1	.684	3	.192	1	1.346e-2	1	NC	5	NC	3
10			min	-.601	4	-.445	1	-.003	5	-1.125e-3	3	361.995	3	1325.627	1
11		6	max	0	1	.61	3	.186	1	1.475e-2	1	NC	5	NC	3
12			min	-.601	4	-.359	1	.008	15	-1.157e-3	3	405.178	3	1369.4	1
13		7	max	0	1	.451	3	.147	1	1.605e-2	1	NC	5	NC	3
14			min	-.601	4	-.199	1	.01	10	-1.189e-3	3	544.018	3	1738.62	1
15		8	max	0	1	.25	3	.087	1	1.734e-2	1	NC	4	NC	3
16			min	-.601	4	-.011	9	.003	10	-1.222e-3	3	962.584	3	2983.755	1
17		9	max	0	1	.172	1	.027	4	1.863e-2	1	NC	4	NC	1
18			min	-.601	4	.005	15	-.003	10	-1.254e-3	3	3181.716	3	9442.513	4
19		10	max	0	1	.25	1	.015	3	1.992e-2	1	NC	3	NC	1
20			min	-.601	4	-.015	3	-.01	2	-1.287e-3	3	1724.338	1	NC	1
21		11	max	0	12	.172	1	.026	1	1.863e-2	1	NC	4	NC	1
22			min	-.601	4	.005	15	-.016	5	-1.254e-3	3	3181.716	3	NC	1
23		12	max	0	12	.25	3	.087	1	1.734e-2	1	NC	4	NC	3
24			min	-.601	4	-.011	9	-.016	5	-1.222e-3	3	962.584	3	2983.755	1
25		13	max	0	12	.451	3	.147	1	1.605e-2	1	NC	5	NC	3
26			min	-.601	4	-.199	1	-.005	5	-1.189e-3	3	544.018	3	1738.62	1
27		14	max	0	12	.61	3	.186	1	1.475e-2	1	NC	5	NC	3
28			min	-.601	4	-.359	1	.006	15	-1.157e-3	3	405.178	3	1369.4	1
29		15	max	0	12	.684	3	.192	1	1.346e-2	1	NC	5	NC	3
30			min	-.601	4	-.445	1	.013	12	-1.125e-3	3	361.995	3	1325.627	1
31		16	max	0	12	.652	3	.164	1	1.217e-2	1	NC	5	NC	3
32			min	-.601	4	-.436	1	.011	12	-1.092e-3	3	379.716	3	1560.321	1

Envelope Member Section Deflections (Continued)

	Member	Sec		x [in]	LC	y [in]	LC	z [in]	LC	x Rotate [r...	LC	(n) L/y Ratio	LC	(n) L/z Ratio	LC
33		17	max	0	12	.51	3	.109	1	1.088e-2	1	NC	5	NC	3
34			min	-.601	4	-.328	1	.008	12	-1.06e-3	3	482.732	3	2366.068	1
35		18	max	0	12	.276	3	.045	1	9.583e-3	1	NC	5	NC	2
36			min	-.601	4	-.137	1	.003	10	-1.027e-3	3	873.478	3	5820.473	1
37		19	max	0	12	.104	1	.005	3	8.29e-3	1	NC	1	NC	1
38			min	-.601	4	-.012	3	-.002	2	-9.946e-4	3	NC	1	NC	1
39	M14	1	max	0	1	.157	3	.004	3	5.21e-3	1	NC	1	NC	1
40			min	-.461	4	-.338	1	-.002	2	-2.842e-3	3	NC	1	NC	1
41		2	max	0	1	.427	3	.032	1	6.276e-3	1	NC	5	NC	2
42			min	-.461	4	-.704	1	-.028	5	-3.475e-3	3	689.717	1	8462.901	1
43		3	max	0	1	.654	3	.088	1	7.342e-3	1	NC	15	NC	3
44			min	-.461	4	-1.016	1	-.034	5	-4.109e-3	3	371.767	1	2935.23	1
45		4	max	0	1	.809	3	.141	1	8.408e-3	1	NC	15	NC	3
46			min	-.461	4	-1.24	1	-.022	5	-4.742e-3	3	279.664	1	1815.246	1
47		5	max	0	1	.878	3	.171	1	9.475e-3	1	9260.991	15	NC	3
48			min	-.461	4	-1.355	1	-.003	5	-5.376e-3	3	247.84	1	1489.237	1
49		6	max	0	1	.86	3	.17	1	1.054e-2	1	9228.063	15	NC	3
50			min	-.461	4	-1.363	1	.012	12	-6.009e-3	3	245.926	1	1504.66	1
51		7	max	0	1	.773	3	.136	1	1.161e-2	1	NC	15	NC	3
52			min	-.461	4	-1.281	1	.009	10	-6.643e-3	3	267.338	1	1880.483	1
53		8	max	0	1	.645	3	.081	1	1.267e-2	1	NC	15	NC	3
54			min	-.461	4	-1.145	1	.003	10	-7.276e-3	3	312.495	1	3185.145	1
55		9	max	0	1	.522	3	.039	4	1.374e-2	1	NC	15	NC	1
56			min	-.461	4	-1.008	1	-.003	10	-7.91e-3	3	376.146	1	6528.983	4
57		10	max	0	1	.465	3	.014	3	1.481e-2	1	NC	5	NC	1
58			min	-.461	4	-.944	1	-.009	2	-8.543e-3	3	416.396	1	NC	1
59		11	max	0	12	.522	3	.025	1	1.374e-2	1	NC	15	NC	1
60			min	-.461	4	-1.008	1	-.028	5	-7.91e-3	3	376.146	1	9298.292	5
61		12	max	0	12	.645	3	.081	1	1.267e-2	1	NC	15	NC	3
62			min	-.461	4	-1.145	1	-.032	5	-7.276e-3	3	312.495	1	3185.145	1
63		13	max	0	12	.773	3	.136	1	1.161e-2	1	NC	15	NC	3
64			min	-.461	4	-1.281	1	-.02	5	-6.643e-3	3	267.338	1	1880.483	1
65		14	max	0	12	.86	3	.17	1	1.054e-2	1	9227.713	15	NC	3
66			min	-.461	4	-1.363	1	0	15	-6.009e-3	3	245.926	1	1504.66	1
67		15	max	0	12	.878	3	.171	1	9.475e-3	1	9260.55	15	NC	3
68			min	-.461	4	-1.355	1	.011	12	-5.376e-3	3	247.84	1	1489.237	1
69		16	max	0	12	.809	3	.141	1	8.408e-3	1	NC	15	NC	3
70			min	-.461	4	-1.24	1	.009	12	-4.742e-3	3	279.664	1	1815.246	1
71		17	max	0	12	.654	3	.088	1	7.342e-3	1	NC	15	NC	3
72			min	-.461	4	-1.016	1	.007	12	-4.109e-3	3	371.767	1	2935.23	1
73		18	max	0	12	.427	3	.04	4	6.276e-3	1	NC	5	NC	2
74			min	-.461	4	-.704	1	.001	10	-3.475e-3	3	689.717	1	6290.567	4
75		19	max	0	12	.157	3	.004	3	5.21e-3	1	NC	1	NC	1
76			min	-.461	4	-.338	1	-.002	2	-2.842e-3	3	NC	1	NC	1
77	M15	1	max	0	12	.16	3	.004	3	2.391e-3	3	NC	1	NC	1
78			min	-.381	4	-.338	1	-.001	2	-5.319e-3	1	NC	1	NC	1
79		2	max	0	12	.327	3	.032	1	2.927e-3	3	NC	5	NC	2
80			min	-.381	4	-.741	1	-.039	5	-6.413e-3	1	625.842	1	6217.04	5
81		3	max	0	12	.47	3	.088	1	3.464e-3	3	NC	15	NC	3
82			min	-.381	4	-1.083	1	-.048	5	-7.507e-3	1	338.12	1	2927.322	1
83		4	max	0	12	.575	3	.141	1	4.e-3	3	NC	15	NC	3
84			min	-.381	4	-1.325	1	-.034	5	-8.602e-3	1	255.374	1	1811.456	1
85		5	max	0	12	.632	3	.172	1	4.537e-3	3	9271.126	15	NC	3
86			min	-.381	4	-1.445	1	-.008	5	-9.696e-3	1	227.726	1	1486.423	1
87		6	max	0	12	.642	3	.17	1	5.073e-3	3	9240.17	15	NC	3
88			min	-.381	4	-1.443	1	.012	12	-1.079e-2	1	228.098	1	1501.713	1
89		7	max	0	12	.613	3	.137	1	5.61e-3	3	NC	15	NC	3

Envelope Member Section Deflections (Continued)

	Member	Sec		x [in]	LC	y [in]	LC	z [in]	LC	x Rotate [r...	LC	(n) L/y Ratio	LC	(n) L/z Ratio	LC
90			min	-.381	4	-1.34	1	.009	10	-1.188e-2	1	251.484	1	1875.966	1
91		8	max	0	12	.558	3	.082	1	6.146e-3	3	NC	15	NC	3
92			min	-.381	4	-1.178	1	.003	10	-1.298e-2	1	300.125	1	3172.736	1
93		9	max	0	12	.502	3	.048	4	6.683e-3	3	NC	15	NC	1
94			min	-.381	4	-1.017	1	-.003	10	-1.407e-2	1	370.876	1	5216.355	4
95		10	max	0	1	.475	3	.013	3	7.219e-3	3	NC	5	NC	1
96			min	-.381	4	-.942	1	-.008	2	-1.517e-2	1	417.223	1	NC	1
97		11	max	0	1	.502	3	.026	1	6.683e-3	3	NC	15	NC	1
98			min	-.381	4	-1.017	1	-.038	5	-1.407e-2	1	370.876	1	6656.508	5
99		12	max	0	1	.558	3	.082	1	6.146e-3	3	NC	15	NC	3
100			min	-.381	4	-1.178	1	-.044	5	-1.298e-2	1	300.125	1	3172.736	1
101		13	max	0	1	.613	3	.137	1	5.61e-3	3	NC	15	NC	3
102			min	-.381	4	-1.34	1	-.029	5	-1.188e-2	1	251.484	1	1875.966	1
103		14	max	0	1	.642	3	.17	1	5.073e-3	3	9239.911	15	NC	3
104			min	-.381	4	-1.443	1	-.002	5	-1.079e-2	1	228.098	1	1501.713	1
105		15	max	0	1	.632	3	.172	1	4.537e-3	3	9270.801	15	NC	3
106			min	-.381	4	-1.445	1	.011	12	-9.696e-3	1	227.726	1	1486.423	1
107		16	max	0	1	.575	3	.141	1	4.e-3	3	NC	15	NC	3
108			min	-.381	4	-1.325	1	.009	12	-8.602e-3	1	255.374	1	1811.456	1
109		17	max	0	1	.47	3	.088	1	3.464e-3	3	NC	15	NC	3
110			min	-.381	4	-1.083	1	.006	12	-7.507e-3	1	338.12	1	2927.322	1
111		18	max	0	1	.327	3	.051	4	2.927e-3	3	NC	5	NC	2
112			min	-.381	4	-.741	1	.001	10	-6.413e-3	1	625.842	1	4933.914	4
113		19	max	0	1	.16	3	.004	3	2.391e-3	3	NC	1	NC	1
114			min	-.381	4	-.338	1	-.001	2	-5.319e-3	1	NC	1	NC	1
115	M16	1	max	0	12	.101	1	.004	3	4.182e-3	3	NC	1	NC	1
116			min	-.15	4	-.053	3	-.001	2	-7.768e-3	1	NC	1	NC	1
117		2	max	0	12	.046	3	.045	1	4.961e-3	3	NC	5	NC	2
118			min	-.15	4	-.183	2	-.03	5	-8.932e-3	1	903.216	1	5858.432	1
119		3	max	0	12	.124	3	.108	1	5.739e-3	3	NC	5	NC	3
120			min	-.15	4	-.4	1	-.037	5	-1.01e-2	1	502.941	1	2373.555	1
121		4	max	0	12	.166	3	.163	1	6.517e-3	3	NC	5	NC	3
122			min	-.15	4	-.527	1	-.027	5	-1.126e-2	1	401.223	1	1562.425	1
123		5	max	0	12	.167	3	.192	1	7.296e-3	3	NC	5	NC	3
124			min	-.15	4	-.542	1	-.009	5	-1.243e-2	1	392.146	1	1325.463	1
125		6	max	0	12	.126	3	.186	1	8.074e-3	3	NC	5	NC	3
126			min	-.15	4	-.448	2	.008	15	-1.359e-2	1	460.021	1	1366.906	1
127		7	max	0	12	.054	3	.147	1	8.852e-3	3	NC	5	NC	3
128			min	-.15	4	-.28	2	.011	10	-1.475e-2	1	685.959	1	1730.643	1
129		8	max	0	12	.001	13	.087	1	9.631e-3	3	NC	3	NC	3
130			min	-.15	4	-.073	2	.004	10	-1.592e-2	1	1615.383	2	2949.907	1
131		9	max	0	12	.153	1	.035	4	1.041e-2	3	NC	4	NC	2
132			min	-.15	4	-.109	3	-.002	10	-1.708e-2	1	4478.613	3	7222.543	4
133		10	max	0	1	.242	1	.011	3	1.119e-2	3	NC	5	NC	1
134			min	-.15	4	-.143	3	-.008	2	-1.825e-2	1	1784.603	1	NC	1
135		11	max	0	1	.153	1	.027	1	1.041e-2	3	NC	4	NC	2
136			min	-.15	4	-.109	3	-.024	5	-1.708e-2	1	4478.613	3	9967.315	1
137		12	max	0	1	.001	13	.087	1	9.631e-3	3	NC	3	NC	3
138			min	-.15	4	-.073	2	-.025	5	-1.592e-2	1	1615.383	2	2949.907	1
139		13	max	0	1	.054	3	.147	1	8.852e-3	3	NC	5	NC	3
140			min	-.15	4	-.28	2	-.012	5	-1.475e-2	1	685.959	1	1730.643	1
141		14	max	0	1	.126	3	.186	1	8.074e-3	3	NC	5	NC	3
142			min	-.15	4	-.448	2	.006	15	-1.359e-2	1	460.021	1	1366.906	1
143		15	max	0	1	.167	3	.192	1	7.296e-3	3	NC	5	NC	3
144			min	-.15	4	-.542	1	.011	12	-1.243e-2	1	392.146	1	1325.463	1
145		16	max	0	1	.166	3	.163	1	6.517e-3	3	NC	5	NC	3
146			min	-.15	4	-.527	1	.009	12	-1.126e-2	1	401.223	1	1562.425	1

Envelope Member Section Deflections (Continued)

	Member	Sec		x [in]	LC	y [in]	LC	z [in]	LC	x Rotate [r...	LC	(n) L/y Ratio	LC	(n) L/z Ratio	LC
147		17	max	0	1	.124	3	.108	1	5.739e-3	3	NC	5	NC	3
148			min	-.149	4	-.4	1	.007	12	-1.01e-2	1	502.941	1	2373.555	1
149		18	max	.001	1	.046	3	.046	4	4.961e-3	3	NC	5	NC	2
150			min	-.149	4	-.183	2	.003	10	-8.932e-3	1	903.216	1	5519.972	4
151		19	max	.001	1	.101	1	.004	3	4.182e-3	3	NC	1	NC	1
152			min	-.149	4	-.053	3	-.001	2	-7.768e-3	1	NC	1	NC	1
153	M2	1	max	.006	1	.003	2	.008	1	1.381e-3	5	NC	1	NC	2
154			min	-.005	3	-.007	3	-.565	4	-2.289e-4	1	NC	1	97.93	4
155		2	max	.005	1	.003	2	.008	1	1.483e-3	5	NC	1	NC	2
156			min	-.005	3	-.006	3	-.519	4	-2.135e-4	1	NC	1	106.669	4
157		3	max	.005	1	.002	2	.007	1	1.585e-3	5	NC	1	NC	2
158			min	-.004	3	-.006	3	-.473	4	-1.981e-4	1	NC	1	117.053	4
159		4	max	.005	1	.002	2	.006	1	1.687e-3	5	NC	1	NC	2
160			min	-.004	3	-.006	3	-.427	4	-1.827e-4	1	NC	1	129.513	4
161		5	max	.004	1	.001	2	.006	1	1.788e-3	5	NC	1	NC	2
162			min	-.004	3	-.006	3	-.383	4	-1.674e-4	1	NC	1	144.631	4
163		6	max	.004	1	0	2	.005	1	1.89e-3	5	NC	1	NC	1
164			min	-.004	3	-.006	3	-.339	4	-1.52e-4	1	NC	1	163.217	4
165		7	max	.004	1	0	2	.004	1	1.992e-3	5	NC	1	NC	1
166			min	-.003	3	-.005	3	-.297	4	-1.366e-4	1	NC	1	186.42	4
167		8	max	.003	1	0	15	.004	1	2.094e-3	5	NC	1	NC	1
168			min	-.003	3	-.005	3	-.256	4	-1.212e-4	1	NC	1	215.917	4
169		9	max	.003	1	0	15	.003	1	2.2e-3	4	NC	1	NC	1
170			min	-.003	3	-.005	3	-.218	4	-1.058e-4	1	NC	1	254.23	4
171		10	max	.003	1	0	15	.003	1	2.307e-3	4	NC	1	NC	1
172			min	-.002	3	-.005	3	-.181	4	-9.046e-5	1	NC	1	305.306	4
173		11	max	.002	1	0	15	.002	1	2.414e-3	4	NC	1	NC	1
174			min	-.002	3	-.004	3	-.147	4	-7.508e-5	1	NC	1	375.604	4
175		12	max	.002	1	0	15	.002	1	2.522e-3	4	NC	1	NC	1
176			min	-.002	3	-.004	3	-.116	4	-5.97e-5	1	NC	1	476.302	4
177		13	max	.002	1	0	15	.001	1	2.629e-3	4	NC	1	NC	1
178			min	-.002	3	-.003	3	-.088	4	-4.432e-5	1	NC	1	628.163	4
179		14	max	.002	1	0	15	0	1	2.737e-3	4	NC	1	NC	1
180			min	-.001	3	-.003	3	-.063	4	-2.894e-5	1	NC	1	873.462	4
181		15	max	.001	1	0	15	0	1	2.844e-3	4	NC	1	NC	1
182			min	-.001	3	-.002	3	-.042	4	-1.356e-5	1	NC	1	1309.768	4
183		16	max	0	1	0	15	0	1	2.952e-3	4	NC	1	NC	1
184			min	0	3	-.002	3	-.025	4	-2.295e-7	3	NC	1	2207.274	4
185		17	max	0	1	0	15	0	1	3.059e-3	4	NC	1	NC	1
186			min	0	3	-.001	6	-.012	4	5.437e-7	12	NC	1	4570.601	4
187		18	max	0	1	0	15	0	1	3.167e-3	4	NC	1	NC	1
188			min	0	3	0	6	-.004	4	1.219e-6	12	NC	1	NC	1
189		19	max	0	1	0	1	0	1	3.274e-3	4	NC	1	NC	1
190			min	0	1	0	1	0	1	1.895e-6	12	NC	1	NC	1
191	M3	1	max	0	1	0	1	0	1	-6.018e-7	12	NC	1	NC	1
192			min	0	1	0	1	0	1	-7.707e-4	4	NC	1	NC	1
193		2	max	0	3	0	15	.016	4	1.079e-5	1	NC	1	NC	1
194			min	0	2	-.002	6	0	12	-8.724e-5	5	NC	1	NC	1
195		3	max	0	3	0	15	.03	4	5.999e-4	4	NC	1	NC	1
196			min	0	2	-.003	6	0	12	1.511e-6	12	NC	1	NC	1
197		4	max	0	3	-.001	15	.044	4	1.285e-3	4	NC	1	NC	1
198			min	0	2	-.005	6	0	12	2.568e-6	12	NC	1	8617.972	4
199		5	max	0	3	-.002	15	.057	4	1.97e-3	4	NC	1	NC	1
200			min	0	2	-.007	6	0	12	3.624e-6	12	NC	1	7390.55	5
201		6	max	.001	3	-.002	15	.069	4	2.656e-3	4	NC	1	NC	1
202			min	0	2	-.009	6	0	12	4.681e-6	12	NC	1	6848.374	5
203		7	max	.001	3	-.002	15	.081	4	3.341e-3	4	NC	1	NC	1

Envelope Member Section Deflections (Continued)

	Member	Sec		x [in]	LC	y [in]	LC	z [in]	LC	x Rotate [r...	LC	(n) L/y Ratio	LC	(n) L/z Ratio	LC
204			min	0	2	-.01	6	0	12	5.737e-6	12	9082.49	6	6718.377	5
205		8	max	.002	3	-.002	15	.092	4	4.026e-3	4	NC	1	NC	1
206			min	-.001	2	-.011	6	0	12	6.794e-6	12	8115.637	6	6912.69	5
207		9	max	.002	3	-.003	15	.102	4	4.712e-3	4	NC	2	NC	1
208			min	-.001	2	-.012	6	0	12	7.85e-6	12	7539.713	6	7437.247	5
209		10	max	.002	3	-.003	15	.112	4	5.397e-3	4	NC	2	NC	1
210			min	-.001	2	-.013	6	0	12	8.907e-6	12	7253.115	6	8379.469	5
211		11	max	.002	3	-.003	15	.121	4	6.082e-3	4	NC	3	NC	1
212			min	-.002	2	-.013	6	0	12	9.963e-6	12	7213.156	6	9948.217	5
213		12	max	.002	3	-.003	15	.13	4	6.767e-3	4	NC	2	NC	1
214			min	-.002	2	-.012	6	0	12	1.102e-5	12	7419.628	6	NC	1
215		13	max	.003	3	-.003	15	.14	4	7.453e-3	4	NC	1	NC	1
216			min	-.002	2	-.012	6	0	12	1.208e-5	12	7916.766	6	NC	1
217		14	max	.003	3	-.002	15	.149	4	8.138e-3	4	NC	1	NC	1
218			min	-.002	2	-.011	6	0	12	1.313e-5	12	8816.602	6	NC	1
219		15	max	.003	3	-.002	15	.158	4	8.823e-3	4	NC	1	NC	1
220			min	-.002	2	-.009	6	0	12	1.419e-5	12	NC	1	NC	1
221		16	max	.003	3	-.001	15	.168	4	9.508e-3	4	NC	1	NC	1
222			min	-.002	2	-.008	1	0	12	1.525e-5	12	NC	1	NC	1
223		17	max	.004	3	0	15	.179	4	1.019e-2	4	NC	1	NC	1
224			min	-.003	2	-.006	1	0	12	1.63e-5	12	NC	1	NC	1
225		18	max	.004	3	0	15	.19	4	1.088e-2	4	NC	1	NC	1
226			min	-.003	2	-.005	1	0	12	1.736e-5	12	NC	1	NC	1
227		19	max	.004	3	0	5	.202	4	1.156e-2	4	NC	1	NC	1
228			min	-.003	2	-.003	1	0	12	1.842e-5	12	NC	1	NC	1
229	M4	1	max	.003	1	.002	2	0	12	2.055e-5	1	NC	1	NC	3
230			min	0	3	-.004	3	-.202	4	-7.457e-4	4	NC	1	122.815	4
231		2	max	.003	1	.002	2	0	12	2.055e-5	1	NC	1	NC	3
232			min	0	3	-.004	3	-.186	4	-7.457e-4	4	NC	1	133.654	4
233		3	max	.003	1	.002	2	0	12	2.055e-5	1	NC	1	NC	3
234			min	0	3	-.004	3	-.169	4	-7.457e-4	4	NC	1	146.547	4
235		4	max	.002	1	.002	2	0	12	2.055e-5	1	NC	1	NC	2
236			min	0	3	-.003	3	-.153	4	-7.457e-4	4	NC	1	162.029	4
237		5	max	.002	1	.002	2	0	12	2.055e-5	1	NC	1	NC	2
238			min	0	3	-.003	3	-.137	4	-7.457e-4	4	NC	1	180.826	4
239		6	max	.002	1	.002	2	0	12	2.055e-5	1	NC	1	NC	2
240			min	0	3	-.003	3	-.122	4	-7.457e-4	4	NC	1	203.947	4
241		7	max	.002	1	.002	2	0	12	2.055e-5	1	NC	1	NC	2
242			min	0	3	-.003	3	-.107	4	-7.457e-4	4	NC	1	232.821	4
243		8	max	.002	1	.001	2	0	12	2.055e-5	1	NC	1	NC	2
244			min	0	3	-.002	3	-.092	4	-7.457e-4	4	NC	1	269.534	4
245		9	max	.002	1	.001	2	0	12	2.055e-5	1	NC	1	NC	2
246			min	0	3	-.002	3	-.078	4	-7.457e-4	4	NC	1	317.228	4
247		10	max	.001	1	.001	2	0	12	2.055e-5	1	NC	1	NC	2
248			min	0	3	-.002	3	-.065	4	-7.457e-4	4	NC	1	380.811	4
249		11	max	.001	1	.001	2	0	12	2.055e-5	1	NC	1	NC	1
250			min	0	3	-.002	3	-.053	4	-7.457e-4	4	NC	1	468.318	4
251		12	max	.001	1	0	2	0	12	2.055e-5	1	NC	1	NC	1
252			min	0	3	-.002	3	-.042	4	-7.457e-4	4	NC	1	593.643	4
253		13	max	0	1	0	2	0	12	2.055e-5	1	NC	1	NC	1
254			min	0	3	-.001	3	-.032	4	-7.457e-4	4	NC	1	782.581	4
255		14	max	0	1	0	2	0	12	2.055e-5	1	NC	1	NC	1
256			min	0	3	-.001	3	-.023	4	-7.457e-4	4	NC	1	1087.614	4
257		15	max	0	1	0	2	0	12	2.055e-5	1	NC	1	NC	1
258			min	0	3	0	3	-.015	4	-7.457e-4	4	NC	1	1629.735	4
259		16	max	0	1	0	2	0	12	2.055e-5	1	NC	1	NC	1
260			min	0	3	0	3	-.009	4	-7.457e-4	4	NC	1	2743.456	4

Envelope Member Section Deflections (Continued)

	Member	Sec		x [in]	LC	y [in]	LC	z [in]	LC	x Rotate [r...	LC	(n) L/y Ratio	LC	(n) L/z Ratio	LC
261		17	max	0	1	0	2	0	12	2.055e-5	1	NC	1	NC	1
262			min	0	3	0	3	-.004	4	-7.457e-4	4	NC	1	5669.297	4
263		18	max	0	1	0	2	0	12	2.055e-5	1	NC	1	NC	1
264			min	0	3	0	3	-.001	4	-7.457e-4	4	NC	1	NC	1
265		19	max	0	1	0	1	0	1	2.055e-5	1	NC	1	NC	1
266			min	0	1	0	1	0	1	-7.457e-4	4	NC	1	NC	1
267	M6	1	max	.018	1	.015	2	0	1	1.456e-3	4	NC	3	NC	1
268			min	-.016	3	-.021	3	-.57	4	0	1	3798.219	2	97.044	4
269		2	max	.017	1	.013	2	0	1	1.556e-3	4	NC	3	NC	1
270			min	-.015	3	-.02	3	-.524	4	0	1	4177.663	2	105.705	4
271		3	max	.016	1	.012	2	0	1	1.656e-3	4	NC	3	NC	1
272			min	-.015	3	-.019	3	-.477	4	0	1	4637.452	2	115.997	4
273		4	max	.015	1	.011	2	0	1	1.757e-3	4	NC	1	NC	1
274			min	-.014	3	-.017	3	-.431	4	0	1	5201.234	2	128.347	4
275		5	max	.014	1	.009	2	0	1	1.857e-3	4	NC	1	NC	1
276			min	-.013	3	-.016	3	-.386	4	0	1	5902.349	2	143.331	4
277		6	max	.013	1	.008	2	0	1	1.957e-3	4	NC	1	NC	1
278			min	-.012	3	-.015	3	-.342	4	0	1	6789.041	2	161.754	4
279		7	max	.012	1	.007	2	0	1	2.057e-3	4	NC	1	NC	1
280			min	-.011	3	-.014	3	-.3	4	0	1	7933.294	2	184.754	4
281		8	max	.011	1	.006	2	0	1	2.157e-3	4	NC	1	NC	1
282			min	-.01	3	-.013	3	-.259	4	0	1	9446.524	2	213.992	4
283		9	max	.01	1	.005	2	0	1	2.257e-3	4	NC	1	NC	1
284			min	-.009	3	-.012	3	-.22	4	0	1	NC	1	251.972	4
285		10	max	.009	1	.004	2	0	1	2.358e-3	4	NC	1	NC	1
286			min	-.008	3	-.011	3	-.183	4	0	1	NC	1	302.607	4
287		11	max	.008	1	.003	2	0	1	2.458e-3	4	NC	1	NC	1
288			min	-.007	3	-.01	3	-.149	4	0	1	NC	1	372.302	4
289		12	max	.007	1	.002	2	0	1	2.558e-3	4	NC	1	NC	1
290			min	-.006	3	-.008	3	-.117	4	0	1	NC	1	472.145	4
291		13	max	.006	1	.001	2	0	1	2.658e-3	4	NC	1	NC	1
292			min	-.005	3	-.007	3	-.089	4	0	1	NC	1	622.731	4
293		14	max	.005	1	0	2	0	1	2.758e-3	4	NC	1	NC	1
294			min	-.005	3	-.006	3	-.064	4	0	1	NC	1	866.002	4
295		15	max	.004	1	0	2	0	1	2.859e-3	4	NC	1	NC	1
296			min	-.004	3	-.005	3	-.043	4	0	1	NC	1	1298.785	4
297		16	max	.003	1	0	2	0	1	2.959e-3	4	NC	1	NC	1
298			min	-.003	3	-.004	3	-.025	4	0	1	NC	1	2189.298	4
299		17	max	.002	1	0	2	0	1	3.059e-3	4	NC	1	NC	1
300			min	-.002	3	-.002	3	-.012	4	0	1	NC	1	4535.364	4
301		18	max	.001	1	0	2	0	1	3.159e-3	4	NC	1	NC	1
302			min	0	3	-.001	3	-.004	4	0	1	NC	1	NC	1
303		19	max	0	1	0	1	0	1	3.259e-3	4	NC	1	NC	1
304			min	0	1	0	1	0	1	0	1	NC	1	NC	1
305	M7	1	max	0	1	0	1	0	1	0	1	NC	1	NC	1
306			min	0	1	0	1	0	1	-7.655e-4	4	NC	1	NC	1
307		2	max	0	3	0	15	.016	4	0	1	NC	1	NC	1
308			min	0	2	-.002	3	0	1	-9.605e-5	4	NC	1	NC	1
309		3	max	.001	3	0	15	.03	4	5.734e-4	4	NC	1	NC	1
310			min	-.001	2	-.004	3	0	1	0	1	NC	1	NC	1
311		4	max	.002	3	-.001	15	.044	4	1.243e-3	4	NC	1	NC	1
312			min	-.002	2	-.006	3	0	1	0	1	NC	1	8138.135	4
313		5	max	.003	3	-.002	15	.057	4	1.912e-3	4	NC	1	NC	1
314			min	-.003	2	-.008	3	0	1	0	1	NC	1	6944.786	4
315		6	max	.003	3	-.002	15	.069	4	2.582e-3	4	NC	1	NC	1
316			min	-.003	2	-.009	3	0	1	0	1	NC	1	6403.42	4
317		7	max	.004	3	-.002	15	.08	4	3.251e-3	4	NC	1	NC	1

Envelope Member Section Deflections (Continued)

	Member	Sec		x [in]	LC	y [in]	LC	z [in]	LC	x Rotate [r...	LC	(n) L/y Ratio	LC	(n) L/z Ratio	LC
318			min	-.004	2	-.01	4	0	1	0	1	9173.392	4	6243.857	4
319		8	max	.005	3	-.003	15	.091	4	3.92e-3	4	NC	1	NC	1
320			min	-.005	2	-.012	4	0	1	0	1	8190.612	4	6376.054	4
321		9	max	.006	3	-.003	15	.101	4	4.59e-3	4	NC	1	NC	1
322			min	-.005	2	-.013	4	0	1	0	1	7604.587	4	6793.991	4
323		10	max	.006	3	-.003	15	.11	4	5.259e-3	4	NC	1	NC	1
324			min	-.006	2	-.013	4	0	1	0	1	7311.699	4	7557.96	4
325		11	max	.007	3	-.003	15	.12	4	5.929e-3	4	NC	1	NC	1
326			min	-.007	2	-.013	4	0	1	0	1	7268.238	4	8817.35	4
327		12	max	.008	3	-.003	15	.129	4	6.598e-3	4	NC	1	NC	1
328			min	-.007	2	-.013	4	0	1	0	1	7473.546	4	NC	1
329		13	max	.008	3	-.003	15	.137	4	7.268e-3	4	NC	1	NC	1
330			min	-.008	2	-.012	4	0	1	0	1	7971.852	4	NC	1
331		14	max	.009	3	-.003	15	.146	4	7.937e-3	4	NC	1	NC	1
332			min	-.009	2	-.011	4	0	1	0	1	8875.695	4	NC	1
333		15	max	.01	3	-.002	15	.155	4	8.606e-3	4	NC	1	NC	1
334			min	-.009	2	-.011	1	0	1	0	1	NC	1	NC	1
335		16	max	.01	3	-.002	15	.165	4	9.276e-3	4	NC	1	NC	1
336			min	-.01	2	-.01	1	0	1	0	1	NC	1	NC	1
337		17	max	.011	3	-.001	15	.175	4	9.945e-3	4	NC	1	NC	1
338			min	-.011	2	-.009	1	0	1	0	1	NC	1	NC	1
339		18	max	.012	3	0	15	.185	4	1.061e-2	4	NC	1	NC	1
340			min	-.011	2	-.008	1	0	1	0	1	NC	1	NC	1
341		19	max	.013	3	0	15	.197	4	1.128e-2	4	NC	1	NC	1
342			min	-.012	2	-.006	1	0	1	0	1	NC	1	NC	1
343	M8	1	max	.008	1	.011	2	0	1	0	1	NC	1	NC	1
344			min	-.002	3	-.013	3	-.197	4	-7.953e-4	4	NC	1	126.119	4
345		2	max	.008	1	.01	2	0	1	0	1	NC	1	NC	1
346			min	-.001	3	-.012	3	-.181	4	-7.953e-4	4	NC	1	137.253	4
347		3	max	.007	1	.009	2	0	1	0	1	NC	1	NC	1
348			min	-.001	3	-.011	3	-.165	4	-7.953e-4	4	NC	1	150.497	4
349		4	max	.007	1	.009	2	0	1	0	1	NC	1	NC	1
350			min	-.001	3	-.01	3	-.149	4	-7.953e-4	4	NC	1	166.4	4
351		5	max	.006	1	.008	2	0	1	0	1	NC	1	NC	1
352			min	-.001	3	-.01	3	-.134	4	-7.953e-4	4	NC	1	185.709	4
353		6	max	.006	1	.008	2	0	1	0	1	NC	1	NC	1
354			min	-.001	3	-.009	3	-.118	4	-7.953e-4	4	NC	1	209.458	4
355		7	max	.005	1	.007	2	0	1	0	1	NC	1	NC	1
356			min	-.001	3	-.008	3	-.104	4	-7.953e-4	4	NC	1	239.117	4
357		8	max	.005	1	.006	2	0	1	0	1	NC	1	NC	1
358			min	0	3	-.008	3	-.09	4	-7.953e-4	4	NC	1	276.829	4
359		9	max	.004	1	.006	2	0	1	0	1	NC	1	NC	1
360			min	0	3	-.007	3	-.076	4	-7.953e-4	4	NC	1	325.819	4
361		10	max	.004	1	.005	2	0	1	0	1	NC	1	NC	1
362			min	0	3	-.006	3	-.063	4	-7.953e-4	4	NC	1	391.131	4
363		11	max	.004	1	.005	2	0	1	0	1	NC	1	NC	1
364			min	0	3	-.006	3	-.052	4	-7.953e-4	4	NC	1	481.017	4
365		12	max	.003	1	.004	2	0	1	0	1	NC	1	NC	1
366			min	0	3	-.005	3	-.041	4	-7.953e-4	4	NC	1	609.75	4
367		13	max	.003	1	.004	2	0	1	0	1	NC	1	NC	1
368			min	0	3	-.004	3	-.031	4	-7.953e-4	4	NC	1	803.827	4
369		14	max	.002	1	.003	2	0	1	0	1	NC	1	NC	1
370			min	0	3	-.003	3	-.022	4	-7.953e-4	4	NC	1	1117.158	4
371		15	max	.002	1	.002	2	0	1	0	1	NC	1	NC	1
372			min	0	3	-.003	3	-.015	4	-7.953e-4	4	NC	1	1674.03	4
373		16	max	.001	1	.002	2	0	1	0	1	NC	1	NC	1
374			min	0	3	-.002	3	-.009	4	-7.953e-4	4	NC	1	2818.067	4

Envelope Member Section Deflections (Continued)

	Member	Sec		x [in]	LC	y [in]	LC	z [in]	LC	x Rotate [r...	LC	(n) L/y Ratio	LC	(n) L/z Ratio	LC
375		17	max	0	1	.001	2	0	1	0	1	NC	1	NC	1
376			min	0	3	-.001	3	-.004	4	-7.953e-4	4	NC	1	5823.589	4
377		18	max	0	1	0	2	0	1	0	1	NC	1	NC	1
378			min	0	3	0	3	-.001	4	-7.953e-4	4	NC	1	NC	1
379		19	max	0	1	0	1	0	1	0	1	NC	1	NC	1
380			min	0	1	0	1	0	1	-7.953e-4	4	NC	1	NC	1
381	M10	1	max	.006	1	.003	2	0	12	1.461e-3	4	NC	1	NC	2
382			min	-.005	3	-.007	3	-.57	4	1.026e-5	12	NC	1	97.154	4
383		2	max	.005	1	.003	2	0	12	1.561e-3	4	NC	1	NC	2
384			min	-.005	3	-.006	3	-.523	4	9.588e-6	12	NC	1	105.825	4
385		3	max	.005	1	.002	2	0	12	1.66e-3	4	NC	1	NC	2
386			min	-.004	3	-.006	3	-.477	4	8.913e-6	12	NC	1	116.129	4
387		4	max	.005	1	.002	2	0	12	1.759e-3	4	NC	1	NC	2
388			min	-.004	3	-.006	3	-.431	4	8.237e-6	12	NC	1	128.493	4
389		5	max	.004	1	.001	2	0	12	1.859e-3	4	NC	1	NC	2
390			min	-.004	3	-.006	3	-.386	4	7.562e-6	12	NC	1	143.495	4
391		6	max	.004	1	0	2	0	12	1.958e-3	4	NC	1	NC	1
392			min	-.004	3	-.006	3	-.342	4	6.886e-6	12	NC	1	161.939	4
393		7	max	.004	1	0	2	0	12	2.057e-3	4	NC	1	NC	1
394			min	-.003	3	-.005	3	-.299	4	6.211e-6	12	NC	1	184.965	4
395		8	max	.003	1	0	2	0	12	2.156e-3	4	NC	1	NC	1
396			min	-.003	3	-.005	3	-.258	4	5.535e-6	12	NC	1	214.238	4
397		9	max	.003	1	0	2	0	12	2.256e-3	4	NC	1	NC	1
398			min	-.003	3	-.005	3	-.219	4	4.86e-6	12	NC	1	252.262	4
399		10	max	.003	1	0	10	0	12	2.355e-3	4	NC	1	NC	1
400			min	-.002	3	-.005	3	-.183	4	4.184e-6	12	NC	1	302.957	4
401		11	max	.002	1	-.001	15	0	12	2.454e-3	4	NC	1	NC	1
402			min	-.002	3	-.004	3	-.148	4	3.509e-6	12	NC	1	372.735	4
403		12	max	.002	1	-.001	15	0	12	2.553e-3	4	NC	1	NC	1
404			min	-.002	3	-.004	3	-.117	4	2.834e-6	12	NC	1	472.698	4
405		13	max	.002	1	0	15	0	12	2.653e-3	4	NC	1	NC	1
406			min	-.002	3	-.003	3	-.089	4	2.158e-6	12	NC	1	623.467	4
407		14	max	.002	1	0	15	0	12	2.752e-3	4	NC	1	NC	1
408			min	-.001	3	-.003	4	-.064	4	1.483e-6	12	NC	1	867.04	4
409		15	max	.001	1	0	15	0	12	2.851e-3	4	NC	1	NC	1
410			min	-.001	3	-.003	4	-.043	4	8.072e-7	12	NC	1	1300.372	4
411		16	max	0	1	0	15	0	12	2.951e-3	4	NC	1	NC	1
412			min	0	3	-.002	4	-.025	4	-1.823e-6	1	NC	1	2192.056	4
413		17	max	0	1	0	15	0	12	3.05e-3	4	NC	1	NC	1
414			min	0	3	-.002	4	-.012	4	-1.72e-5	1	NC	1	4541.398	4
415		18	max	0	1	0	15	0	12	3.149e-3	4	NC	1	NC	1
416			min	0	3	0	4	-.004	4	-3.258e-5	1	NC	1	NC	1
417		19	max	0	1	0	1	0	1	3.248e-3	4	NC	1	NC	1
418			min	0	1	0	1	0	1	-4.796e-5	1	NC	1	NC	1
419	M11	1	max	0	1	0	1	0	1	1.508e-5	1	NC	1	NC	1
420			min	0	1	0	1	0	1	-7.626e-4	4	NC	1	NC	1
421		2	max	0	3	0	15	.016	4	-4.548e-7	12	NC	1	NC	1
422			min	0	2	-.002	4	0	1	-9.11e-5	4	NC	1	NC	1
423		3	max	0	3	0	15	.03	4	5.804e-4	4	NC	1	NC	1
424			min	0	2	-.004	4	0	1	-3.666e-5	1	NC	1	NC	1
425		4	max	0	3	-.001	15	.044	4	1.252e-3	4	NC	1	NC	1
426			min	0	2	-.006	4	0	1	-6.253e-5	1	NC	1	8372.29	4
427		5	max	0	3	-.002	15	.057	4	1.923e-3	4	NC	1	NC	1
428			min	0	2	-.007	4	-.001	1	-8.84e-5	1	NC	1	7167.02	4
429		6	max	.001	3	-.002	15	.069	4	2.595e-3	4	NC	1	NC	1
430			min	0	2	-.009	4	-.001	1	-1.143e-4	1	NC	1	6632.812	4
431		7	max	.001	3	-.003	15	.08	4	3.266e-3	4	NC	1	NC	1

Envelope Member Section Deflections (Continued)

	Member	Sec		x [in]	LC	y [in]	LC	z [in]	LC	x Rotate [r...	LC	(n) L/y Ratio	LC	(n) L/z Ratio	LC
432			min	0	2	-.011	4	-.002	1	-1.401e-4	1	8763.091	4	6496.338	4
433		8	max	.002	3	-.003	15	.09	4	3.938e-3	4	NC	1	NC	1
434			min	-.001	2	-.012	4	-.002	1	-1.66e-4	1	7851.293	4	6670.169	4
435		9	max	.002	3	-.003	15	.101	4	4.609e-3	4	NC	2	NC	1
436			min	-.001	2	-.013	4	-.002	1	-1.919e-4	1	7310.332	4	7156.402	4
437		10	max	.002	3	-.003	15	.11	4	5.281e-3	4	NC	2	NC	1
438			min	-.001	2	-.013	4	-.003	1	-2.178e-4	1	7045.48	4	8032.673	4
439		11	max	.002	3	-.003	15	.119	4	5.952e-3	4	NC	3	NC	1
440			min	-.002	2	-.014	4	-.003	1	-2.436e-4	1	7017.546	4	9485.761	4
441		12	max	.002	3	-.003	15	.128	4	6.624e-3	4	NC	2	NC	1
442			min	-.002	2	-.013	4	-.004	1	-2.695e-4	1	7227.833	4	NC	1
443		13	max	.003	3	-.003	15	.137	4	7.295e-3	4	NC	1	NC	1
444			min	-.002	2	-.013	4	-.004	1	-2.954e-4	1	7720.54	4	NC	1
445		14	max	.003	3	-.003	15	.146	4	7.967e-3	4	NC	1	NC	1
446			min	-.002	2	-.011	4	-.005	1	-3.212e-4	1	8605.859	4	NC	1
447		15	max	.003	3	-.002	15	.155	4	8.638e-3	4	NC	1	NC	1
448			min	-.002	2	-.01	4	-.005	1	-3.471e-4	1	NC	1	NC	1
449		16	max	.003	3	-.002	15	.165	4	9.31e-3	4	NC	1	NC	1
450			min	-.002	2	-.008	4	-.006	1	-3.73e-4	1	NC	1	NC	1
451		17	max	.004	3	-.002	15	.175	4	9.981e-3	4	NC	1	NC	1
452			min	-.003	2	-.006	1	-.007	1	-3.989e-4	1	NC	1	NC	1
453		18	max	.004	3	0	15	.186	4	1.065e-2	4	NC	1	NC	1
454			min	-.003	2	-.005	1	-.007	1	-4.247e-4	1	NC	1	NC	1
455		19	max	.004	3	0	15	.198	4	1.132e-2	4	NC	1	NC	1
456			min	-.003	2	-.003	1	-.008	1	-4.506e-4	1	NC	1	NC	1
457	M12	1	max	.003	1	.002	2	.008	1	-9.827e-7	12	NC	1	NC	3
458			min	0	3	-.004	3	-.198	4	-7.564e-4	4	NC	1	125.492	4
459		2	max	.003	1	.002	2	.007	1	-9.827e-7	12	NC	1	NC	3
460			min	0	3	-.004	3	-.182	4	-7.564e-4	4	NC	1	136.566	4
461		3	max	.003	1	.002	2	.007	1	-9.827e-7	12	NC	1	NC	3
462			min	0	3	-.004	3	-.166	4	-7.564e-4	4	NC	1	149.74	4
463		4	max	.002	1	.002	2	.006	1	-9.827e-7	12	NC	1	NC	2
464			min	0	3	-.003	3	-.15	4	-7.564e-4	4	NC	1	165.559	4
465		5	max	.002	1	.002	2	.005	1	-9.827e-7	12	NC	1	NC	2
466			min	0	3	-.003	3	-.134	4	-7.564e-4	4	NC	1	184.765	4
467		6	max	.002	1	.002	2	.005	1	-9.827e-7	12	NC	1	NC	2
468			min	0	3	-.003	3	-.119	4	-7.564e-4	4	NC	1	208.389	4
469		7	max	.002	1	.002	2	.004	1	-9.827e-7	12	NC	1	NC	2
470			min	0	3	-.003	3	-.104	4	-7.564e-4	4	NC	1	237.891	4
471		8	max	.002	1	.001	2	.004	1	-9.827e-7	12	NC	1	NC	2
472			min	0	3	-.002	3	-.09	4	-7.564e-4	4	NC	1	275.403	4
473		9	max	.002	1	.001	2	.003	1	-9.827e-7	12	NC	1	NC	2
474			min	0	3	-.002	3	-.077	4	-7.564e-4	4	NC	1	324.134	4
475		10	max	.001	1	.001	2	.003	1	-9.827e-7	12	NC	1	NC	2
476			min	0	3	-.002	3	-.064	4	-7.564e-4	4	NC	1	389.1	4
477		11	max	.001	1	.001	2	.002	1	-9.827e-7	12	NC	1	NC	1
478			min	0	3	-.002	3	-.052	4	-7.564e-4	4	NC	1	478.51	4
479		12	max	.001	1	0	2	.002	1	-9.827e-7	12	NC	1	NC	1
480			min	0	3	-.002	3	-.041	4	-7.564e-4	4	NC	1	606.561	4
481		13	max	0	1	0	2	.001	1	-9.827e-7	12	NC	1	NC	1
482			min	0	3	-.001	3	-.031	4	-7.564e-4	4	NC	1	799.608	4
483		14	max	0	1	0	2	0	1	-9.827e-7	12	NC	1	NC	1
484			min	0	3	-.001	3	-.022	4	-7.564e-4	4	NC	1	1111.274	4
485		15	max	0	1	0	2	0	1	-9.827e-7	12	NC	1	NC	1
486			min	0	3	0	3	-.015	4	-7.564e-4	4	NC	1	1665.182	4
487		16	max	0	1	0	2	0	1	-9.827e-7	12	NC	1	NC	1
488			min	0	3	0	3	-.009	4	-7.564e-4	4	NC	1	2803.118	4

Envelope Member Section Deflections (Continued)

	Member	Sec		x [in]	LC	y [in]	LC	z [in]	LC	x Rotate [r...	LC	(n) L/y Ratio	LC	(n) L/z Ratio	LC
489		17	max	0	1	0	2	0	1	-9.827e-7	12	NC	1	NC	1
490			min	0	3	0	3	-.004	4	-7.564e-4	4	NC	1	5792.566	4
491		18	max	0	1	0	2	0	1	-9.827e-7	12	NC	1	NC	1
492			min	0	3	0	3	-.001	4	-7.564e-4	4	NC	1	NC	1
493		19	max	0	1	0	1	0	1	-9.827e-7	12	NC	1	NC	1
494			min	0	1	0	1	0	1	-7.564e-4	4	NC	1	NC	1
495	M1	1	max	.005	3	.104	1	.601	4	1.789e-2	1	NC	1	NC	1
496			min	-.002	2	-.012	3	0	12	-2.138e-2	3	NC	1	NC	1
497		2	max	.005	3	.051	1	.583	4	9.28e-3	4	NC	3	NC	1
498			min	-.002	2	-.005	3	-.006	1	-1.058e-2	3	2165.657	1	NC	1
499		3	max	.005	3	.007	3	.565	4	1.48e-2	4	NC	5	NC	1
500			min	-.002	2	-.007	1	-.009	1	-1.703e-4	1	1035.487	1	7295.677	5
501		4	max	.005	3	.03	3	.547	4	1.303e-2	4	NC	5	NC	1
502			min	-.002	2	-.073	1	-.008	1	-3.77e-3	3	646.418	1	5094.894	5
503		5	max	.005	3	.059	3	.528	4	1.126e-2	4	NC	15	NC	1
504			min	-.002	2	-.144	1	-.005	1	-7.436e-3	3	462.187	1	3984.534	5
505		6	max	.005	3	.091	3	.51	4	1.483e-2	1	NC	15	NC	1
506			min	-.002	2	-.212	1	-.002	1	-1.11e-2	3	361.418	1	3323.935	5
507		7	max	.005	3	.122	3	.49	4	1.983e-2	1	9683.113	15	NC	1
508			min	-.002	2	-.274	1	0	12	-1.477e-2	3	302.285	1	2882.437	4
509		8	max	.005	3	.149	3	.47	4	2.483e-2	1	8599.544	15	NC	1
510			min	-.002	2	-.324	1	0	12	-1.844e-2	3	267.459	1	2574.457	4
511		9	max	.004	3	.166	3	.448	4	2.735e-2	1	8034.912	15	NC	1
512			min	-.002	2	-.355	1	0	1	-1.845e-2	3	249.386	1	2395.488	4
513		10	max	.004	3	.172	3	.424	4	2.821e-2	1	7863.026	15	NC	1
514			min	-.002	2	-.365	1	0	12	-1.605e-2	3	243.973	1	2348.325	4
515		11	max	.004	3	.168	3	.397	4	2.907e-2	1	8034.713	15	NC	1
516			min	-.002	2	-.354	1	0	12	-1.365e-2	3	249.685	1	2411.651	4
517		12	max	.004	3	.154	3	.369	4	2.745e-2	1	8599.09	15	NC	1
518			min	-.001	2	-.323	1	-.001	1	-1.13e-2	3	268.396	1	2603.71	4
519		13	max	.004	3	.131	3	.337	4	2.207e-2	1	9682.242	15	NC	1
520			min	-.001	2	-.272	1	0	1	-9.045e-3	3	304.61	1	3072.219	4
521		14	max	.004	3	.101	3	.303	4	1.67e-2	1	NC	15	NC	1
522			min	-.001	2	-.209	1	0	12	-6.789e-3	3	366.436	1	4034.061	4
523		15	max	.004	3	.069	3	.268	4	1.132e-2	1	NC	15	NC	1
524			min	-.001	2	-.14	1	0	12	-4.534e-3	3	472.581	1	6103.546	4
525		16	max	.004	3	.035	3	.234	4	9.788e-3	4	NC	5	NC	1
526			min	-.001	2	-.069	1	0	12	-2.279e-3	3	668.425	1	NC	1
527		17	max	.004	3	.002	3	.203	4	1.082e-2	4	NC	5	NC	1
528			min	-.001	2	-.004	2	0	12	-2.319e-5	3	1085.519	1	NC	1
529		18	max	.004	3	.051	1	.175	4	1.047e-2	1	NC	4	NC	1
530			min	-.001	2	-.026	3	0	12	-3.632e-3	3	2293.134	1	NC	1
531		19	max	.004	3	.101	1	.149	4	2.073e-2	1	NC	1	NC	1
532			min	-.001	2	-.053	3	-.001	1	-7.378e-3	3	NC	1	NC	1
533	M5	1	max	.015	3	.25	1	.601	4	0	1	NC	1	NC	1
534			min	-.01	2	-.015	3	0	1	-3.194e-6	4	NC	1	NC	1
535		2	max	.015	3	.122	1	.587	4	7.587e-3	4	NC	5	NC	1
536			min	-.01	2	-.006	3	0	1	0	1	894.793	1	NC	1
537		3	max	.015	3	.023	3	.57	4	1.494e-2	4	NC	15	NC	1
538			min	-.01	2	-.023	1	0	1	0	1	418.512	1	5964.644	4
539		4	max	.015	3	.085	3	.551	4	1.217e-2	4	9121.389	15	NC	1
540			min	-.01	2	-.2	1	0	1	0	1	254.125	1	4464.517	4
541		5	max	.015	3	.171	3	.531	4	9.406e-3	4	6386.097	15	NC	1
542			min	-.01	2	-.393	1	0	1	0	1	177.731	1	3711.194	4
543		6	max	.015	3	.267	3	.511	4	6.638e-3	4	4918.289	15	NC	1
544			min	-.009	2	-.586	1	0	1	0	1	136.739	1	3244.597	4
545		7	max	.014	3	.361	3	.49	4	3.87e-3	4	4070.301	15	NC	1

Envelope Member Section Deflections (Continued)

	Member	Sec		x [in]	LC	y [in]	LC	z [in]	LC	x Rotate [r...	LC	(n) L/y Ratio	LC	(n) L/z Ratio	LC
546			min	-.009	2	-.761	1	0	1	0	1	113.057	1	2902.83	4
547		8	max	.014	3	.441	3	.469	4	1.103e-3	4	3577.093	15	NC	1
548			min	-.009	2	-.901	1	0	1	0	1	99.283	1	2613.008	4
549		9	max	.014	3	.492	3	.448	4	0	1	3324.108	15	NC	1
550			min	-.009	2	-.989	1	0	1	-2.008e-6	5	92.223	1	2393.332	4
551		10	max	.013	3	.51	3	.424	4	0	1	3247.878	15	NC	1
552			min	-.009	2	-1.019	1	0	1	-1.923e-6	5	90.12	1	2364.423	4
553		11	max	.013	3	.498	3	.397	4	0	1	3324.175	15	NC	1
554			min	-.008	2	-.989	1	0	1	-1.839e-6	5	92.343	1	2437.367	4
555		12	max	.013	3	.455	3	.37	4	7.742e-4	4	3577.254	15	NC	1
556			min	-.008	2	-.898	1	0	1	0	1	99.68	1	2560.733	4
557		13	max	.012	3	.385	3	.338	4	2.718e-3	4	4070.636	15	NC	1
558			min	-.008	2	-.754	1	0	1	0	1	114.087	1	3023.902	4
559		14	max	.012	3	.298	3	.302	4	4.662e-3	4	4918.955	15	NC	1
560			min	-.008	2	-.575	1	0	1	0	1	139.056	1	4187.971	4
561		15	max	.012	3	.2	3	.266	4	6.606e-3	4	6387.428	15	NC	1
562			min	-.008	2	-.38	1	0	1	0	1	182.75	1	7394.309	4
563		16	max	.012	3	.101	3	.23	4	8.55e-3	4	9124.194	15	NC	1
564			min	-.008	2	-.186	1	0	1	0	1	265.339	1	NC	1
565		17	max	.011	3	.008	3	.197	4	1.049e-2	4	NC	15	NC	1
566			min	-.008	2	-.013	1	0	1	0	1	445.705	1	NC	1
567		18	max	.011	3	.125	1	.171	4	5.329e-3	4	NC	5	NC	1
568			min	-.008	2	-.072	3	0	1	0	1	967.484	1	NC	1
569		19	max	.011	3	.242	1	.15	4	0	1	NC	1	NC	1
570			min	-.008	2	-.143	3	0	1	-1.591e-6	4	NC	1	NC	1
571	M9	1	max	.005	3	.104	1	.601	4	2.138e-2	3	NC	1	NC	1
572			min	-.002	2	-.012	3	-.001	1	-1.789e-2	1	NC	1	NC	1
573		2	max	.005	3	.051	1	.586	4	1.058e-2	3	NC	3	NC	1
574			min	-.002	2	-.005	3	0	12	-8.699e-3	1	2165.657	1	NC	1
575		3	max	.005	3	.007	3	.569	4	1.49e-2	4	NC	5	NC	1
576			min	-.002	2	-.007	1	0	12	-1.681e-5	10	1035.487	1	6065.74	4
577		4	max	.005	3	.03	3	.551	4	1.168e-2	5	NC	5	NC	1
578			min	-.002	2	-.073	1	0	12	-4.83e-3	1	646.418	1	4497.108	4
579		5	max	.005	3	.059	3	.531	4	8.77e-3	5	NC	15	NC	1
580			min	-.002	2	-.144	1	0	12	-9.831e-3	1	462.187	1	3707.015	4
581		6	max	.005	3	.091	3	.511	4	1.11e-2	3	NC	15	NC	1
582			min	-.002	2	-.212	1	0	12	-1.483e-2	1	361.418	1	3222.143	4
583		7	max	.005	3	.122	3	.49	4	1.477e-2	3	9666.594	15	NC	1
584			min	-.002	2	-.274	1	0	1	-1.983e-2	1	302.285	1	2877.185	4
585		8	max	.005	3	.149	3	.469	4	1.844e-2	3	8585.214	15	NC	1
586			min	-.002	2	-.324	1	0	1	-2.483e-2	1	267.459	1	2597.848	4
587		9	max	.004	3	.166	3	.448	4	1.845e-2	3	8021.697	15	NC	1
588			min	-.002	2	-.355	1	0	12	-2.735e-2	1	249.386	1	2388.947	4
589		10	max	.004	3	.172	3	.424	4	1.605e-2	3	7850.139	15	NC	1
590			min	-.002	2	-.365	1	0	1	-2.821e-2	1	243.973	1	2349.411	4
591		11	max	.004	3	.168	3	.397	4	1.365e-2	3	8021.509	15	NC	1
592			min	-.002	2	-.354	1	0	1	-2.907e-2	1	249.685	1	2420.049	4
593		12	max	.004	3	.154	3	.369	4	1.13e-2	3	8584.861	15	NC	1
594			min	-.001	2	-.323	1	0	12	-2.745e-2	1	268.396	1	2580.198	4
595		13	max	.004	3	.131	3	.337	4	9.045e-3	3	9666.043	15	NC	1
596			min	-.001	2	-.272	1	0	12	-2.207e-2	1	304.61	1	3073.776	4
597		14	max	.004	3	.101	3	.302	4	6.789e-3	3	NC	15	NC	1
598			min	-.001	2	-.209	1	-.002	1	-1.67e-2	1	366.436	1	4163.073	5
599		15	max	.004	3	.069	3	.266	4	6.177e-3	5	NC	15	NC	1
600			min	-.001	2	-.14	1	-.005	1	-1.132e-2	1	472.581	1	6758.695	5
601		16	max	.004	3	.035	3	.23	4	8.323e-3	5	NC	5	NC	1
602			min	-.001	2	-.069	1	-.008	1	-5.95e-3	1	668.425	1	NC	1

Envelope Member Section Deflections (Continued)

	Member	Sec		x [in]	LC	y [in]	LC	z [in]	LC	x Rotate [r...	LC	(n) L/y Ratio	LC	(n) L/z Ratio	LC
603		17	max	.004	3	.002	3	.198	4	1.053e-2	4	NC	5	NC	1
604			min	-.001	2	-.004	2	-.008	1	-5.752e-4	1	1085.519	1	NC	1
605		18	max	.004	3	.051	1	.172	4	4.944e-3	5	NC	4	NC	1
606			min	-.001	2	-.026	3	-.006	1	-1.047e-2	1	2293.134	1	NC	1
607		19	max	.004	3	.101	1	.15	4	7.378e-3	3	NC	1	NC	1
608			min	-.001	2	-.053	3	0	12	-2.073e-2	1	NC	1	NC	1

1.Project information

Customer company:
Customer contact name:
Customer e-mail:
Comment:

Project description:
Location:
Fastening description:

2. Input Data & Anchor Parameters

General
Design method:ACI 318-05
Units: Imperial units

Anchor Information:
Anchor type: Bonded anchor
Material: A193 Grade B8/B8M (304/316SS)
Diameter (inch): 0.500
Effective Embedment depth, h_{ef} (inch): 6.000
Code report: IAPMO UES ER-263
Anchor category: -
Anchor ductility: Yes
h_{min} (inch): 8.50
c_{ac} (inch): 9.67
C_{min} (inch): 1.75
S_{min} (inch): 3.00

Load and Geometry
Load factor source: ACI 318 Section 9.2
Load combination: not set
Seismic design: No
Anchors subjected to sustained tension: No
Apply entire shear load at front row: No
Anchors only resisting wind and/or seismic loads: No

Base Material
Concrete: Normal-weight
Concrete thickness, h (inch): 18.00
State: Cracked
Compressive strength, f'_c (psi): 2500
$\Psi_{c,V}$: 1.0
Reinforcement condition: B tension, B shear
Supplemental reinforcement: Not applicable
Reinforcement provided at corners: No
Do not evaluate concrete breakout in tension: No
Do not evaluate concrete breakout in shear: No
Hole condition: Dry concrete
Inspection: Periodic
Temperature range, Short/Long: 110/75°F
Ignore 6do requirement: Not applicable
Build-up grout pad: No

Base Plate
Length x Width x Thickness (inch): 4.00 x 4.00 x 0.28

<Figure 1>

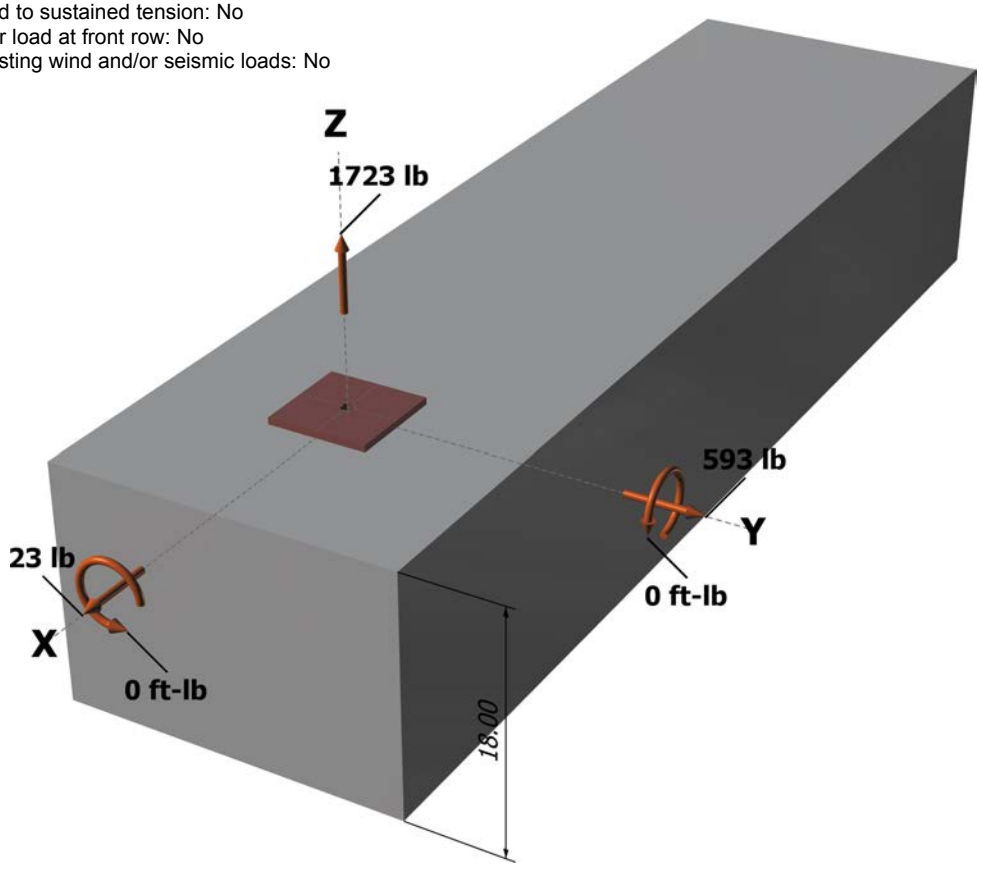

<Figure 2>

Recommended Anchor
Anchor Name: AT-XP® - AT-XP w/ 1/2"Ø A193 Gr. B8/B8M (304/316SS)
Code Report: IAPMO UES ER-263

3. Resulting Anchor Forces

Anchor	Tension load, N_{ua} (lb)	Shear load x, V_{uax} (lb)	Shear load y, V_{uay} (lb)	Shear load combined, $\sqrt{(V_{uax})^2+(V_{uay})^2}$ (lb)
1	1723.0	23.0	593.0	593.4
Sum	1723.0	23.0	593.0	593.4

Maximum concrete compression strain (‰): 0.00
Maximum concrete compression stress (psi): 0
Resultant tension force (lb): 1723
Resultant compression force (lb): 0
Eccentricity of resultant tension forces in x-axis, e'_{Nx} (inch): 0.00
Eccentricity of resultant tension forces in y-axis, e'_{Ny} (inch): 0.00
Eccentricity of resultant shear forces in x-axis, e'_{Vx} (inch): 0.00
Eccentricity of resultant shear forces in y-axis, e'_{Vy} (inch): 0.00

<Figure 3>

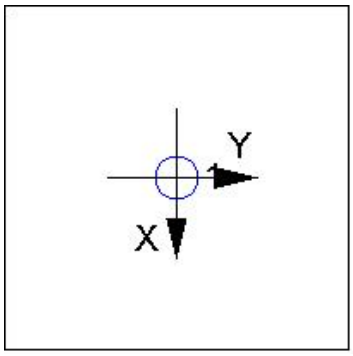

4. Steel Strength of Anchor in Tension(Sec. D.5.1)

N_{sa} (lb)	ϕ	ϕN_{sa} (lb)
8095	0.75	6071

5. Concrete Breakout Strength of Anchor in Tension (Sec. D.5.2)

$N_b = k_c \lambda \sqrt{f'_c} h_{ef}^{1.5}$ (Eq. D-7)

k_c	λ	f'_c (psi)	h_{ef} (in)	N_b (lb)
17.0	1.00	2500	5.247	10215

$\phi N_{cb} = \phi \, (A_{Nc} / A_{Nco}) \, \Psi_{ed,N} \, \Psi_{c,N} \, \Psi_{cp,N} N_b$ (Sec. D.4.1 & Eq. D-4)

A_{Nc} (in²)	A_{Nco} (in²)	$\Psi_{ed,N}$	$\Psi_{c,N}$	$\Psi_{cp,N}$	N_b (lb)	ϕ	ϕN_{cb} (lb)
220.36	247.75	0.967	1.00	1.000	10215	0.65	5710

6. Adhesive Strength of Anchor in Tension (AC308 Sec. 3.3)

$\tau_{k,cr} = \tau_{k,cr} f_{short\text{-}term} K_{sat}$

$\tau_{k,cr}$ (psi)	$f_{short\text{-}term}$	K_{sat}	$\tau_{k,cr}$ (psi)
1035	1.00	1.00	1035

$N_{a0} = \tau_{k,cr} \pi d_a h_{ef}$ (Eq. D-16f)

$\tau_{k,cr}$ (psi)	d_a (in)	h_{ef} (in)	N_{a0} (lb)
1035	0.50	6.000	9755

$\phi N_a = \phi \, (A_{Na} / A_{Na0}) \, \Psi_{ed,Na} \, \Psi_{p,Na} N_{a0}$ (Sec. D.4.1 & Eq. D-16a)

A_{Na} (in²)	A_{Na0} (in²)	$\Psi_{ed,Na}$	$\Psi_{p,Na}$	N_{a0} (lb)	ϕ	ϕN_a (lb)
109.66	109.66	1.000	1.000	9755	0.55	5365

8. Steel Strength of Anchor in Shear (Sec. D.6.1)

V_{sa} (lb)	ϕ_{grout}	ϕ	$\phi_{grout}\phi V_{sa}$ (lb)
4855	1.0	0.65	3156

9. Concrete Breakout Strength of Anchor in Shear (Sec. D.6.2)

Shear perpendicular to edge in y-direction:

$V_{by} = 7(l_e / d_a)^{0.2}\sqrt{d_a}\lambda\sqrt{f'_c}c_{a1}^{1.5}$ (Eq. D-24)

l_e (in)	d_a (in)	λ	f'_c (psi)	c_{a1} (in)	V_{by} (lb)
4.00	0.50	1.00	2500	7.00	6947

$\phi V_{cby} = \phi\,(A_{Vc} / A_{Vco})\,\Psi_{ed,V}\,\Psi_{c,V}\,\Psi_{h,V}V_{by}$ (Sec. D.4.1 & Eq. D-21)

A_{Vc} (in^2)	A_{Vco} (in^2)	$\Psi_{ed,V}$	$\Psi_{c,V}$	$\Psi_{h,V}$	V_{by} (lb)	ϕ	ϕV_{cby} (lb)
192.89	220.50	0.925	1.000	1.000	6947	0.70	3934

Shear perpendicular to edge in x-direction:

$V_{bx} = 7(l_e / d_a)^{0.2}\sqrt{d_a}\lambda\sqrt{f'_c}c_{a1}^{1.5}$ (Eq. D-24)

l_e (in)	d_a (in)	λ	f'_c (psi)	c_{a1} (in)	V_{bx} (lb)
4.00	0.50	1.00	2500	7.87	8282

$\phi V_{cbx} = \phi\,(A_{Vc} / A_{Vco})\,\Psi_{ed,V}\,\Psi_{c,V}\,\Psi_{h,V}V_{bx}$ (Sec. D.4.1 & Eq. D-21)

A_{Vc} (in^2)	A_{Vco} (in^2)	$\Psi_{ed,V}$	$\Psi_{c,V}$	$\Psi_{h,V}$	V_{bx} (lb)	ϕ	ϕV_{cbx} (lb)
165.27	278.72	0.878	1.000	1.000	8282	0.70	3018

Shear parallel to edge in x-direction:

$V_{by} = 7(l_e / d_a)^{0.2}\sqrt{d_a}\lambda\sqrt{f'_c}c_{a1}^{1.5}$ (Eq. D-24)

l_e (in)	d_a (in)	λ	f'_c (psi)	c_{a1} (in)	V_{by} (lb)
4.00	0.50	1.00	2500	7.00	6947

$\phi V_{cbx} = \phi\,(2)(A_{Vc} / A_{Vco})\,\Psi_{ed,V}\,\Psi_{c,V}\,\Psi_{h,V}V_{by}$ (Sec. D.4.1, D.6.2.1(c) & Eq. D-21)

A_{Vc} (in^2)	A_{Vco} (in^2)	$\Psi_{ed,V}$	$\Psi_{c,V}$	$\Psi_{h,V}$	V_{by} (lb)	ϕ	ϕV_{cbx} (lb)
192.89	220.50	1.000	1.000	1.000	6947	0.70	8508

Shear parallel to edge in y-direction:

$V_{bx} = 7(l_e / d_a)^{0.2}\sqrt{d_a}\lambda\sqrt{f'_c}c_{a1}^{1.5}$ (Eq. D-24)

l_e (in)	d_a (in)	λ	f'_c (psi)	c_{a1} (in)	V_{bx} (lb)
4.00	0.50	1.00	2500	7.87	8282

$\phi V_{cby} = \phi\,(2)(A_{Vc} / A_{Vco})\,\Psi_{ed,V}\,\Psi_{c,V}\,\Psi_{h,V}V_{bx}$ (Sec. D.4.1, D.6.2.1(c) & Eq. D-21)

A_{Vc} (in^2)	A_{Vco} (in^2)	$\Psi_{ed,V}$	$\Psi_{c,V}$	$\Psi_{h,V}$	V_{bx} (lb)	ϕ	ϕV_{cby} (lb)
165.27	278.72	1.000	1.000	1.000	8282	0.70	6875

10. Concrete Pryout Strength of Anchor in Shear (Sec. D.6.3)

$\phi V_{cp} = \phi \min|k_{cp}N_a\,;\,k_{cp}N_{cb}| = \phi \min|k_{cp}(A_{Na} / A_{Na0})\,\Psi_{ed,Na}\,\Psi_{p,Na}N_{a0}\,;\,k_{cp}(A_{Nc} / A_{Nco})\,\Psi_{ed,N}\,\Psi_{c,N}\,\Psi_{cp,N}N_b|$ (Eq. D-30a)

k_{cp}	A_{Na} (in^2)	A_{Na0} (in^2)	$\Psi_{ed,Na}$	$\Psi_{p,Na}$	N_{a0} (lb)	N_a (lb)
2.0	109.66	109.66	1.000	1.000	9755	9755

A_{Nc} (in^2)	A_{Nco} (in^2)	$\Psi_{ed,N}$	$\Psi_{c,N}$	$\Psi_{cp,N}$	N_b (lb)	N_{cb} (lb)	ϕ	ϕV_{cp} (lb)
220.36	247.75	0.967	1.000	1.000	10215	8785	0.70	12298

11. Results

Interaction of Tensile and Shear Forces (Sec. D.7)

Tension	Factored Load, N_{ua} (lb)	Design Strength, ϕN_n (lb)	Ratio	Status
Steel	1723	6071	0.28	Pass
Concrete breakout	1723	5710	0.30	Pass
Adhesive	**1723**	**5365**	**0.32**	**Pass (Governs)**

Shear	Factored Load, V_{ua} (lb)	Design Strength, ϕV_n (lb)	Ratio	Status
Steel	**593**	**3156**	**0.19**	**Pass (Governs)**
T Concrete breakout y+	593	3934	0.15	Pass
T Concrete breakout x+	23	3018	0.01	Pass
|| Concrete breakout y+	23	8508	0.00	Pass
|| Concrete breakout x+	593	6875	0.09	Pass
Concrete breakout, combined	-	-	0.15	Pass
Pryout	593	12298	0.05	Pass

Interaction check	$N_{ua}/\phi N_n$	$V_{ua}/\phi V_n$	Combined Ratio	Permissible	Status
Sec. D.7.1	0.32	0.00	32.1 %	1.0	Pass

AT-XP w/ 1/2"Ø A193 Gr. B8/B8M (304/316SS) with hef = 6.000 inch meets the selected design criteria.

12. Warnings

- This temperature range is currently outside the scope of ACI 318-11 and ACI 355.4, and is provided for historical purposes.

- Designer must exercise own judgement to determine if this design is suitable.

- Refer to manufacturer's product literature for hole cleaning and installation instructions.

1.Project information

Customer company:
Customer contact name:
Customer e-mail:
Comment:

Project description:
Location:
Fastening description:

2. Input Data & Anchor Parameters

General
Design method:ACI 318-05
Units: Imperial units

Anchor Information:
Anchor type: Bonded anchor
Material: A193 Grade B8/B8M (304/316SS)
Diameter (inch): 0.500
Effective Embedment depth, h_{ef} (inch): 6.000
Code report: IAPMO UES ER-263
Anchor category: -
Anchor ductility: Yes
h_{min} (inch): 8.50
c_{ac} (inch): 9.67
C_{min} (inch): 1.75
S_{min} (inch): 3.00

Load and Geometry
Load factor source: ACI 318 Section 9.2
Load combination: not set
Seismic design: No
Anchors subjected to sustained tension: No
Apply entire shear load at front row: No
Anchors only resisting wind and/or seismic loads: No

<Figure 1>

Base Material
Concrete: Normal-weight
Concrete thickness, h (inch): 18.00
State: Cracked
Compressive strength, f'_c (psi): 2500
$\Psi_{c,V}$: 1.0
Reinforcement condition: B tension, B shear
Supplemental reinforcement: Not applicable
Reinforcement provided at corners: No
Do not evaluate concrete breakout in tension: No
Do not evaluate concrete breakout in shear: No
Hole condition: Dry concrete
Inspection: Periodic
Temperature range, Short/Long: 110/75°F
Ignore 6do requirement: Not applicable
Build-up grout pad: No

Base Plate
Length x Width x Thickness (inch): 4.00 x 7.00 x 0.28

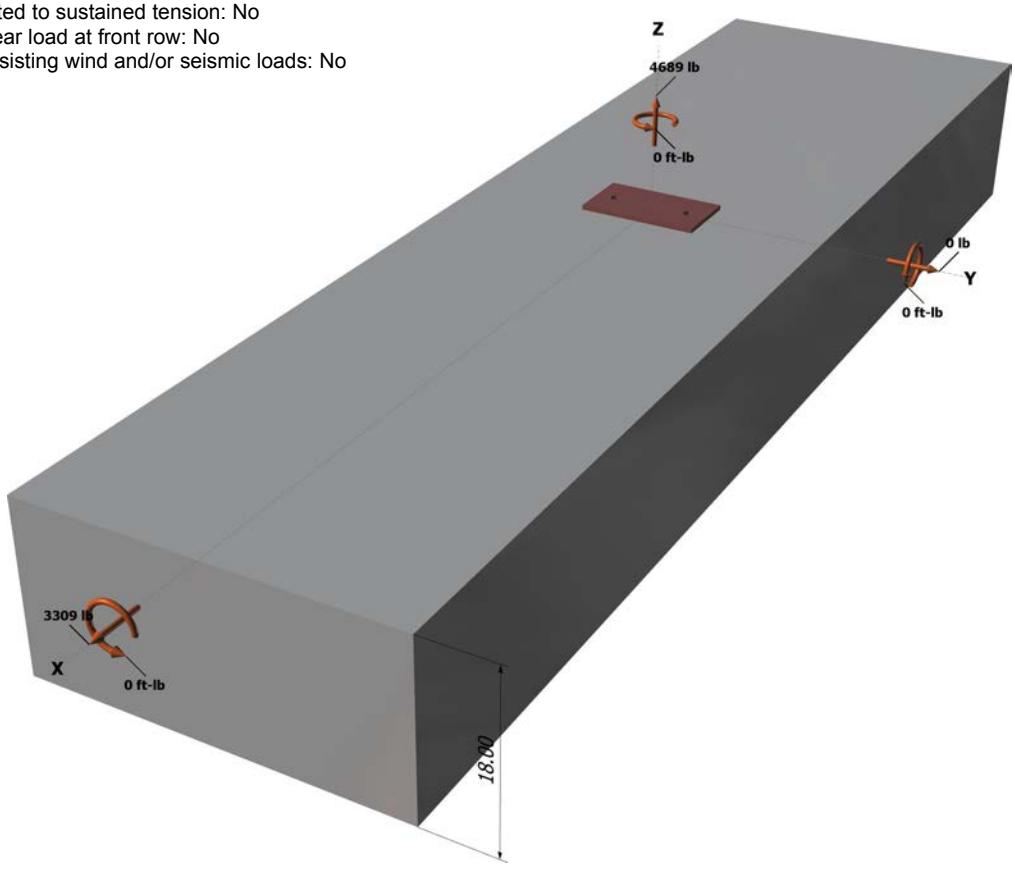

<Figure 2>

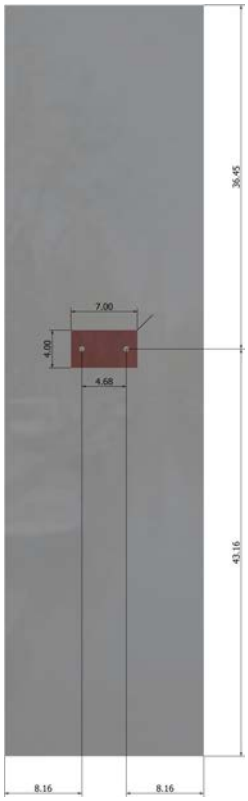

Recommended Anchor
Anchor Name: AT-XP® - AT-XP w/ 1/2"Ø A193 Gr. B8/B8M (304/316SS)
Code Report: IAPMO UES ER-263

3. Resulting Anchor Forces

Anchor	Tension load, N_{ua} (lb)	Shear load x, V_{uax} (lb)	Shear load y, V_{uay} (lb)	Shear load combined, $\sqrt{(V_{uax})^2+(V_{uay})^2}$ (lb)
1	2344.5	1654.5	0.0	1654.5
2	2344.5	1654.5	0.0	1654.5
Sum	4689.0	3309.0	0.0	3309.0

Maximum concrete compression strain (‰): 0.00
Maximum concrete compression stress (psi): 0
Resultant tension force (lb): 4689
Resultant compression force (lb): 0
Eccentricity of resultant tension forces in x-axis, e'_{Nx} (inch): 0.00
Eccentricity of resultant tension forces in y-axis, e'_{Ny} (inch): 0.00
Eccentricity of resultant shear forces in x-axis, e'_{Vx} (inch): 0.00
Eccentricity of resultant shear forces in y-axis, e'_{Vy} (inch): 0.00

<Figure 3>

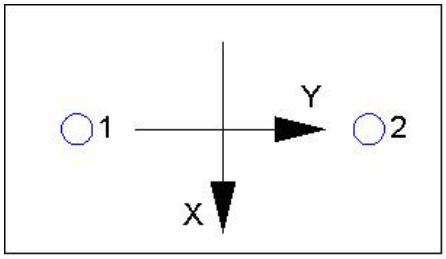

4. Steel Strength of Anchor in Tension(Sec. D.5.1)

N_{sa} (lb)	ϕ	ϕN_{sa} (lb)
8095	0.75	6071

5. Concrete Breakout Strength of Anchor in Tension (Sec. D.5.2)

$N_b = k_c \lambda \sqrt{f'_c} h_{ef}^{1.5}$ (Eq. D-7)

k_c	λ	f'_c (psi)	h_{ef} (in)	N_b (lb)
17.0	1.00	2500	6.000	12492

$\phi N_{cbg} = \phi (A_{Nc} / A_{Nco}) \Psi_{ec,N} \Psi_{ed,N} \Psi_{c,N} \Psi_{cp,N} N_b$ (Sec. D.4.1 & Eq. D-5)

A_{Nc} (in²)	A_{Nco} (in²)	$\Psi_{ec,N}$	$\Psi_{ed,N}$	$\Psi_{c,N}$	$\Psi_{cp,N}$	N_b (lb)	ϕ	ϕN_{cbg} (lb)
378.00	324.00	1.000	0.972	1.00	1.000	12492	0.65	9208

6. Adhesive Strength of Anchor in Tension (AC308 Sec. 3.3)

$\tau_{k,cr} = \tau_{k,cr} f_{short\text{-}term} K_{sat}$

$\tau_{k,cr}$ (psi)	$f_{short\text{-}term}$	K_{sat}	$\tau_{k,cr}$ (psi)
1035	1.00	1.00	1035

$N_{a0} = \tau_{k,cr} \pi d_a h_{ef}$ (Eq. D-16f)

$\tau_{k,cr}$ (psi)	d_a (in)	h_{ef} (in)	N_{a0} (lb)
1035	0.50	6.000	9755

$\phi N_{ag} = \phi (A_{Na} / A_{Na0}) \Psi_{ed,Na} \Psi_{g,Na} \Psi_{ec,Na} \Psi_{p,Na} N_{a0}$ (Sec. D.4.1 & Eq. D-16b)

A_{Na} (in²)	A_{Na0} (in²)	$\Psi_{ed,Na}$	$\Psi_{g,Na}$	$\Psi_{ec,Na}$	$\Psi_{p,Na}$	N_{a0}(lb)	ϕ	ϕN_{ag} (lb)
158.66	109.66	1.000	1.043	1.000	1.000	9755	0.55	8093

8. Steel Strength of Anchor in Shear (Sec. D.6.1)

V_{sa} (lb)	ϕ_{grout}	ϕ	$\phi_{grout}\phi V_{sa}$ (lb)
4855	1.0	0.65	3156

9. Concrete Breakout Strength of Anchor in Shear (Sec. D.6.2)

Shear perpendicular to edge in x-direction:

$V_{bx} = 7(l_e / d_a)^{0.2}\sqrt{d_a}\lambda\sqrt{f'_c}c_{a1}^{1.5}$ (Eq. D-24)

l_e (in)	d_a (in)	λ	f'_c (psi)	c_{a1} (in)	V_{bx} (lb)
4.00	0.50	1.00	2500	12.00	15593

$\phi V_{cbgx} = \phi\,(A_{Vc} / A_{Vco})\,\Psi_{ec,V}\,\Psi_{ed,V}\,\Psi_{c,V}\,\Psi_{h,V}V_{bx}$ (Sec. D.4.1 & Eq. D-22)

A_{Vc} (in^2)	A_{Vco} (in^2)	$\Psi_{ec,V}$	$\Psi_{ed,V}$	$\Psi_{c,V}$	$\Psi_{h,V}$	V_{bx} (lb)	ϕ	ϕV_{cbgx} (lb)
378.00	648.00	1.000	0.836	1.000	1.000	15593	0.70	5323

Shear parallel to edge in x-direction:

$V_{by} = 7(l_e / d_a)^{0.2}\sqrt{d_a}\lambda\sqrt{f'_c}c_{a1}^{1.5}$ (Eq. D-24)

l_e (in)	d_a (in)	λ	f'_c (psi)	c_{a1} (in)	V_{by} (lb)
4.00	0.50	1.00	2500	8.16	8744

$\phi V_{cbx} = \phi\,(2)(A_{Vc} / A_{Vco})\,\Psi_{ed,V}\,\Psi_{c,V}\,\Psi_{h,V}V_{by}$ (Sec. D.4.1, D.6.2.1(c) & Eq. D-21)

A_{Vc} (in^2)	A_{Vco} (in^2)	$\Psi_{ed,V}$	$\Psi_{c,V}$	$\Psi_{h,V}$	V_{by} (lb)	ϕ	ϕV_{cbx} (lb)
299.64	299.64	1.000	1.000	1.000	8744	0.70	12241

10. Concrete Pryout Strength of Anchor in Shear (Sec. D.6.3)

$\phi V_{cpg} = \phi \min|k_{cp}N_{ag}\,;\, k_{cp}N_{cbg}| = \phi \min|k_{cp}(A_{Na} / A_{Na0})\,\Psi_{ed,Na}\,\Psi_{g,Na}\,\Psi_{ec,Na}\,\Psi_{p,Na}N_{a0}\,;\, k_{cp}(A_{Nc} / A_{Nco})\,\Psi_{ec,N}\,\Psi_{ed,N}\,\Psi_{c,N}\,\Psi_{cp,N}N_b|$ (Eq. D-30b)

k_{cp}	A_{Na} (in^2)	A_{Na0} (in^2)	$\Psi_{ed,Na}$	$\Psi_{g,Na}$	$\Psi_{ec,Na}$	$\Psi_{p,Na}$	N_{a0} (lb)	N_a (lb)
2.0	158.66	109.66	1.000	1.043	1.000	1.000	9755	14715

A_{Nc} (in^2)	A_{Nco} (in^2)	$\Psi_{ec,N}$	$\Psi_{ed,N}$	$\Psi_{c,N}$	$\Psi_{cp,N}$	N_b (lb)	N_{cb} (lb)	ϕ
378.00	324.00	1.000	0.972	1.000	1.000	12492	14166	0.70

ϕV_{cpg} (lb)
19833

11. Results

Interaction of Tensile and Shear Forces (Sec. D.7)

Tension	Factored Load, N_{ua} (lb)	Design Strength, ϕN_n (lb)	Ratio	Status
Steel	2345	6071	0.39	Pass
Concrete breakout	4689	9208	0.51	Pass
Adhesive	**4689**	**8093**	**0.58**	**Pass (Governs)**

Shear	Factored Load, V_{ua} (lb)	Design Strength, ϕV_n (lb)	Ratio	Status
Steel	1655	3156	0.52	Pass
T Concrete breakout x+	**3309**	**5323**	**0.62**	**Pass (Governs)**
|| Concrete breakout y-	**1655**	**12241**	**0.14**	**Pass (Governs)**
Pryout	3309	19833	0.17	Pass

Interaction check	$N_{ua}/\phi N_n$	$V_{ua}/\phi V_n$	Combined Ratio	Permissible	Status

Sec. D.7.3	0.58	0.62	120.1 %	1.2	Pass

AT-XP w/ 1/2"Ø A193 Gr. B8/B8M (304/316SS) with hef = 6.000 inch meets the selected design criteria.

12. Warnings

- This temperature range is currently outside the scope of ACI 318-11 and ACI 355.4, and is provided for historical purposes.

- Designer must exercise own judgement to determine if this design is suitable.

- Refer to manufacturer's product literature for hole cleaning and installation instructions.