


Lead Contamination in Water Sources

Comparison with WHO drinking water guidelines | Higher values indicate greater contamination risk

Sampling Location

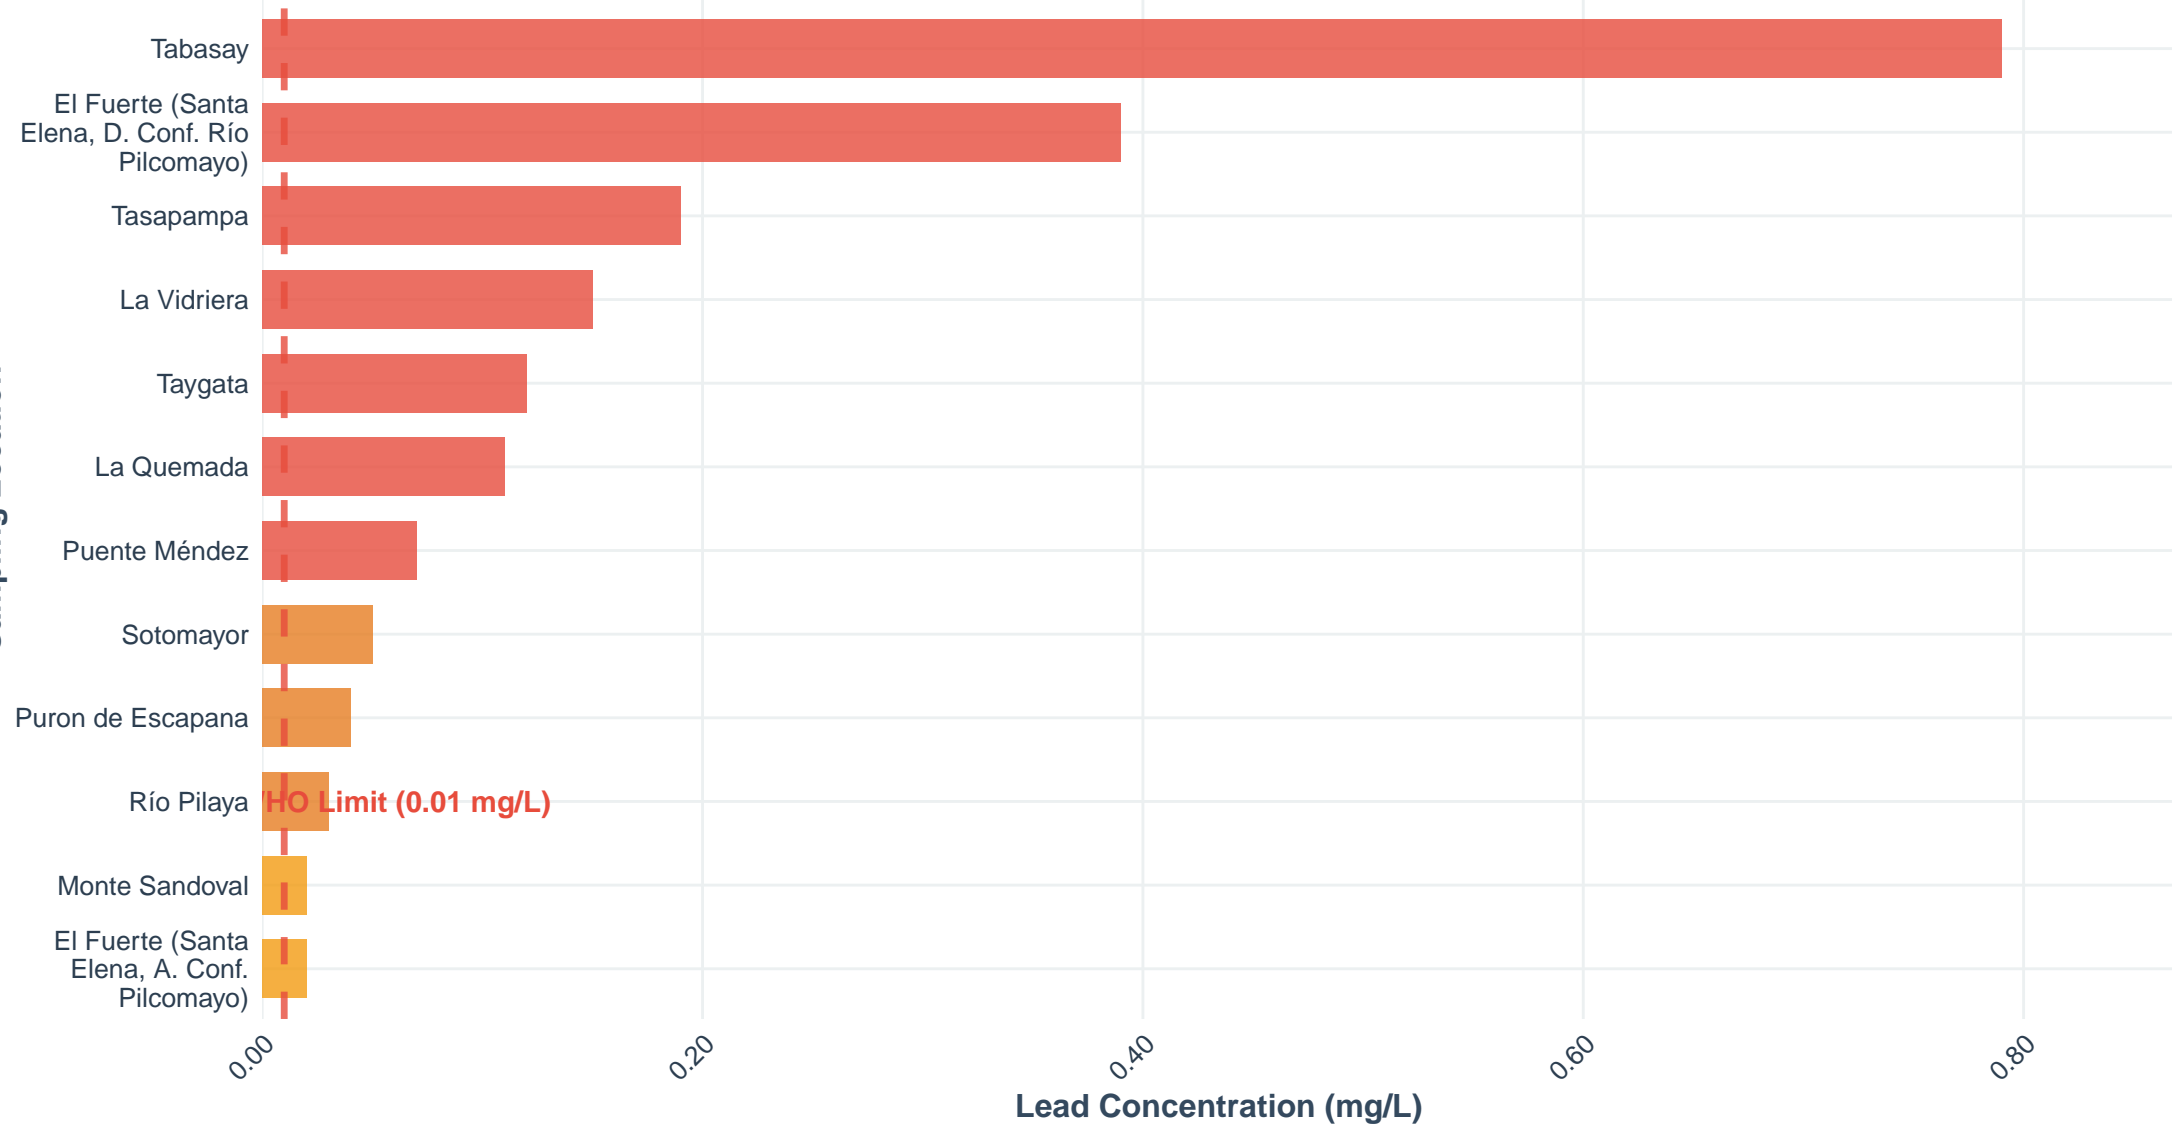

Risk Level Critical Risk High Risk Moderate Risk